

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH, N.C.

C203304

CONTRACT AND
CONTRACT BONDS
FOR CONTRACT NO. C203304

WBS 38748.3.FS1 NHS-17(32)

T.I.P NO. K-3800

COUNTY OF BEAUFORT
THIS IS THE REST AREA CONTRACT
ROUTE NUMBER US 17 LENGTH 0.374 MILES
LOCATION RELOCATION OF US-17 REST AREA.

CONTRACTOR BARNHILL CONTRACTING COMPANY
ADDRESS P.O. BOX 1529
TARBORO, NC 278861529

BIDS OPENED JANUARY 21, 2014
CONTRACT EXECUTION FEB 27 2014

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH, N.C.

PROPOSAL

DATE AND TIME OF BID OPENING: **JANUARY 21, 2014 AT 2:00 PM**

CONTRACT ID C203304
WBS 38748.3.FS1

FEDERAL-AID NO. NHS-17(32)
COUNTY BEAUFORT
T.I.P. NO. K-3800
MILES 0.374
ROUTE NO. US 17
LOCATION RELOCATION OF US-17 REST AREA.

TYPE OF WORK GRADING, DRAINAGE, PAVING, AND REST AREA.

NOTICE:

ALL BIDDERS SHALL COMPLY WITH ALL APPLICABLE LAWS REGULATING THE PRACTICE OF GENERAL CONTRACTING AS CONTAINED IN CHAPTER 87 OF THE GENERAL STATUTES OF NORTH CAROLINA WHICH REQUIRES THE BIDDER TO BE LICENSED BY THE N.C. LICENSING BOARD FOR CONTRACTORS WHEN BIDDING ON ANY NON-FEDERAL AID PROJECT WHERE THE BID IS \$30,000 OR MORE, EXCEPT FOR CERTAIN SPECIALTY WORK AS DETERMINED BY THE LICENSING BOARD. BIDDERS SHALL ALSO COMPLY WITH ALL OTHER APPLICABLE LAWS REGULATING THE PRACTICES OF ELECTRICAL, PLUMBING, HEATING AND AIR CONDITIONING AND REFRIGERATION CONTRACTING AS CONTAINED IN CHAPTER 87 OF THE GENERAL STATUTES OF NORTH CAROLINA. NOTWITHSTANDING THESE LIMITATIONS ON BIDDING, THE BIDDER WHO IS AWARDED ANY FEDERAL - AID FUNDED PROJECT SHALL COMPLY WITH CHAPTER 87 OF THE GENERAL STATUTES OF NORTH CAROLINA FOR LICENSING REQUIREMENTS WITHIN 60 CALENDAR DAYS OF BID OPENING.

BIDS WILL BE RECEIVED AS SHOWN BELOW:

THIS IS A REST AREA PROPOSAL

5% BID BOND OR BID DEPOSIT REQUIRED

**PROPOSAL FOR THE CONSTRUCTION OF
CONTRACT No. C203304 IN BEAUFORT COUNTY, NORTH CAROLINA**

Date _____ 20____

**DEPARTMENT OF TRANSPORTATION,
RALEIGH, NORTH CAROLINA**

The Bidder has carefully examined the location of the proposed work to be known as Contract No. **C203304**; has carefully examined the plans and specifications, which are acknowledged to be part of the proposal, the special provisions, the proposal, the form of contract, and the forms of contract payment bond and contract performance bond; and thoroughly understands the stipulations, requirements and provisions. The undersigned bidder agrees to bound upon his execution of the bid and subsequent award to him by the Board of Transportation in accordance with this proposal to provide the necessary contract payment bond and contract performance bond within fourteen days after the written notice of award is received by him. The undersigned Bidder further agrees to provide all necessary machinery, tools, labor, and other means of construction; and to do all the work and to furnish all materials, except as otherwise noted, necessary to perform and complete the said contract in accordance with *the 2012 Standard Specifications for Roads and Structures* by the dates(s) specified in the Project Special Provisions and in accordance with the requirements of the Engineer, and at the unit or lump sum prices, as the case may be, for the various items given on the sheets contained herein.

The Bidder shall provide and furnish all the materials, machinery, implements, appliances and tools, and perform the work and required labor to construct and complete State Highway Contract No. **C203304** in Beaufort County, for the unit or lump sum prices, as the case may be, bid by the Bidder in his bid and according to the proposal, plans, and specifications prepared by said Department, which proposal, plans, and specifications show the details covering this project, and hereby become a part of this contract.


The published volume entitled *North Carolina Department of Transportation, Raleigh, Standard Specifications for Roads and Structures, January 2012* with all amendments and supplements thereto, is by reference incorporated into and made a part of this contract; that, except as herein modified, all the construction and work included in this contract is to be done in accordance with the specifications contained in said volume, and amendments and supplements thereto, under the direction of the Engineer.

If the proposal is accepted and the award is made, the contract is valid only when signed either by the Contract Officer or such other person as may be designated by the Secretary to sign for the Department of Transportation. The conditions and provisions herein cannot be changed except over the signature of the said Contract Officer.

The quantities shown in the itemized proposal for the project are considered to be approximate only and are given as the basis for comparison of bids. The Department of Transportation may increase or decrease the quantity of any item or portion of the work as may be deemed necessary or expedient.

An increase or decrease in the quantity of an item will not be regarded as sufficient ground for an increase or decrease in the unit prices, nor in the time allowed for the completion of the work, except as provided for the contract.

Accompanying this bid is a bid bond secured by a corporate surety, or certified check payable to the order of the Department of Transportation, for five percent of the total bid price, which deposit is to be forfeited as liquidated damages in case this bid is accepted and the Bidder shall fail to provide the required payment and performance bonds with the Department of Transportation, under the condition of this proposal, within 14 calendar days after the written notice of award is received by him, as provided in the *Standard Specifications*; otherwise said deposit will be returned to the Bidder.

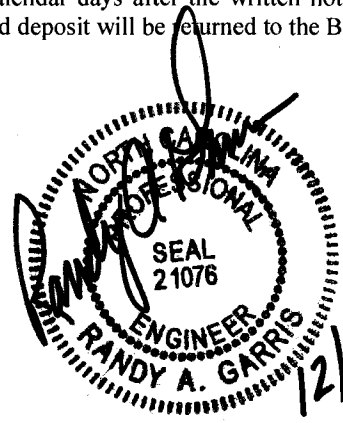 12/9/13

State Contract Officer

TABLE OF CONTENTS**COVER SHEET
PROPOSAL SHEET****PROJECT SPECIAL PROVISIONS**

CONTRACT TIME AND LIQUIDATED DAMAGES:	1
INTERMEDIATE CONTRACT TIME NUMBER 1 AND LIQUIDATED DAMAGES:	1
INTERMEDIATE CONTRACT TIME NUMBER 2 AND LIQUIDATED DAMAGES:	2
PERMANENT VEGETATION ESTABLISHMENT:	2
MAJOR CONTRACT ITEMS:	3
SPECIALTY ITEMS:	3
FUEL PRICE ADJUSTMENT:	3
SCHEDULE OF ESTIMATED COMPLETION PROGRESS:	4
DISADVANTAGED BUSINESS ENTERPRISE:	4
CERTIFICATION FOR FEDERAL-AID CONTRACTS:	18
CONTRACTOR'S LICENSE REQUIREMENTS:	18
U.S. DEPARTMENT OF TRANSPORTATION HOTLINE:	18
SUBSURFACE INFORMATION:	19
LOCATING EXISTING UNDERGROUND UTILITIES:	19
RESOURCE CONSERVATION:	19
DOMESTIC STEEL:	19
MAINTENANCE OF THE PROJECT:	20
TWELVE MONTH GUARANTEE:	20
GIFTS FROM VENDORS AND CONTRACTORS:	21
EROSION AND SEDIMENT CONTROL/STORMWATER CERTIFICATION:	22
PROCEDURE FOR MONITORING BORROW PIT DISCHARGE:	27
EMPLOYMENT:	29
STATE HIGHWAY ADMINISTRATOR TITLE CHANGE:	29
ROADWAY	30
LIGHTING	57
UTILITY CONSTRUCTION	69
UTILITIES BY OTHERS	72
EROSION CONTROL	73
REST AREA	96
<u>PERMITS</u>	R-1

STANDARD SPECIAL PROVISIONS

AVAILABILITY OF FUNDS – TERMINATION OF CONTRACTS	1
NCDOT GENERAL SEED SPECIFICATION FOR SEED QUALITY	2
ERRATA	5
PLANT AND PEST QUARANTINES	7
AWARD OF CONTRACT	8
MINORITY AND FEMALE EMPLOYMENT REQUIREMENTS	9

REQUIRED CONTRACT PROVISIONS FEDERAL - AID CONSTRUCTION

CONTRACTS.....	12
ON-THE-JOB TRAINING.....	21
MINIMUM WAGES	24

PROPOSAL ITEM SHEET AND SIGNATURE SHEET

ITEM SHEET(S) (TAN SHEETS)
SIGNATURE SHEET (BID ACCEPTANCE BY DEPARTMENT)

PROJECT SPECIAL PROVISIONS**GENERAL****CONTRACT TIME AND LIQUIDATED DAMAGES:**

(8-15-00) (Rev. 12-18-07)

108

SP1 G07 A

The date of availability for this contract is **March 3, 2014**, except that work in jurisdictional waters and wetlands shall not begin until a meeting between the DOT, Regulatory Agencies, and the Contractor is held as stipulated in the permits contained elsewhere in this proposal. This delay in availability has been considered in determining the contract time for this project.

The completion date for this contract is **October 12, 2015**.

Except where otherwise provided by the contract, observation periods required by the contract will not be a part of the work to be completed by the completion date and/or intermediate contract times stated in the contract. The acceptable completion of the observation periods that extend beyond the final completion date shall be a part of the work covered by the performance and payment bonds.

The liquidated damages for this contract are **Two Hundred Dollars (\$200.00)** per calendar day. These liquidated damages will not be cumulative with any liquidated damages which may become chargeable under Intermediate Contract Time Number 1.

INTERMEDIATE CONTRACT TIME NUMBER 1 AND LIQUIDATED DAMAGES:

(7-1-95) (Rev. 2-21-12)

108

SP1 G13 A

Except for that work required under the Project Special Provisions entitled *Planting, Reforestation* and/or *Permanent Vegetation Establishment*, included elsewhere in this proposal, the Contractor will be required to complete all work included in this contract and shall place and maintain traffic on same.

The date of availability for this intermediate contract time is **March 3, 2014**.

The completion date for this intermediate contract time is **April 15, 2015**.

The liquidated damages for this intermediate contract time are **One Thousand Dollars (\$1,000.00)** per calendar day.

Upon apparent completion of all the work required to be completed by this intermediate date, a final inspection will be held in accordance with Article 105-17 and upon acceptance, the Department will assume responsibility for the maintenance of all work except *Planting, Reforestation* and/or *Permanent Vegetation Establishment*. The Contractor will be responsible for and shall make corrections of all damages to the completed roadway caused by his planting operations, whether occurring prior to or after placing traffic through the project.

INTERMEDIATE CONTRACT TIME NUMBER 2 AND LIQUIDATED DAMAGES:

(2-20-07) (Rev. 6-18-13)

108

SP1 G14 H

The Contractor shall complete the work required of **Step 3** as shown on Sheets **TMP-4 through TMP-6** and shall place and maintain traffic on same.

The date of availability for this intermediate contract time is the date the Contractor elects to begin the work.

The completion date for this intermediate contract time is the date which is **sixty (60)** consecutive calendar days after and including the date the Contractor begins this work.

The liquidated damages are **Five Hundred Dollars (\$500.00)** per calendar day.

PERMANENT VEGETATION ESTABLISHMENT:

(2-16-12) (Rev. 10-15-13)

104

SP1 G16

Establish a permanent stand of the vegetation mixture shown in the contract. During the period between initial vegetation planting and final project acceptance, perform all work necessary to establish permanent vegetation on all erodible areas within the project limits, as well as, in borrow and waste pits. This work shall include erosion control device maintenance and installation, repair seeding and mulching, supplemental seeding and mulching, mowing, and fertilizer topdressing, as directed. All work shall be performed in accordance with the applicable section of the *2012 Standard Specifications*. All work required for initial vegetation planting shall be performed as a part of the work necessary for the completion and acceptance of the Intermediate Contract Time (ICT). Between the time of ICT and Final Project acceptance, or otherwise referred to as the vegetation establishment period, the Department will be responsible for preparing the required National Pollutant Discharge Elimination System (NPDES) inspection records.

Once the Engineer has determined that the permanent vegetation establishment requirement has been achieved at an 80% vegetation density (the amount of established vegetation per given area to stabilize the soil) and no erodible areas exist within the project limits, the Contractor will be notified to remove the remaining erosion control devices that are no longer needed. The Contractor will be responsible for, and shall correct any areas disturbed by operations performed in permanent vegetation establishment and the removal of temporary erosion control measures, whether occurring prior to or after placing traffic on the project.

Payment for *Response for Erosion Control, Seeding and Mulching, Repair Seeding, Supplemental Seeding, Mowing, Fertilizer Topdressing, Silt Excavation, and Stone for Erosion Control* will be made at contract unit prices for the affected items. Work required that is not represented by contract line items will be paid in accordance with Articles 104-7 or 104-3 of the *2012 Standard Specifications*. No additional compensation will be made for maintenance and removal of temporary erosion control items.

MAJOR CONTRACT ITEMS:

(2-19-02)

104

SP1 G28

The following listed items are the major contract items for this contract (see Article 104-5 of the 2012 *Standard Specifications*):

Line #	Description
23	Aggregate Base Course
28	Asphalt Concrete Intermediate Course, Type I19.0B
30	Asphalt Concrete Surface Course, Type S9.5B

SPECIALTY ITEMS:

(7-1-95)(Rev. 1-17-12)

108-6

SP1 G37

Items listed below will be the specialty items for this contract (see Article 108-6 of the 2012 *Standard Specifications*).

Line #	Description
52 thru 57	Fencing
62 thru 68	Signing
79 thru 83	Long-Life Pavement Markings
86	Permanent Pavement Markers
87 thru 105	Lighting
106 thru 120	Utility Construction
121 thru 151	Erosion Control
152 thru 174	Planting
176 thru 198	Rest Area

FUEL PRICE ADJUSTMENT:

(11-15-05) (Rev. 1-17-12)

109-8

SP1 G43

Revise the 2012 *Standard Specifications* as follows:

Page 1-83, Article 109-8, Fuel Price Adjustments, add the following:

The base index price for DIESEL #2 FUEL is \$ **3.1244** per gallon. Where any of the following are included as pay items in the contract, they will be eligible for fuel price adjustment.

The pay items and the fuel factor used in calculating adjustments to be made will be as follows:

Description	Units	Fuel Usage Factor Diesel
Unclassified Excavation	Gal/CY	0.29
Borrow Excavation	Gal/CY	0.29
Class IV Subgrade Stabilization	Gal/Ton	0.55
Aggregate Base Course	Gal/Ton	0.55
Asphalt Concrete Base Course, Type _____	Gal/Ton	2.90
Asphalt Concrete Intermediate Course, Type _____	Gal/Ton	2.90

Asphalt Concrete Intermediate Course, Type _____	Gal/Ton	2.90
Asphalt Concrete Surface Course, Type _____	Gal/Ton	2.90
Open-Graded Asphalt Friction Course	Gal/Ton	2.90
Sand Asphalt Surface Course, Type _____	Gal/Ton	2.90
Aggregate for Cement Treated Base Course	Gal/Ton	0.55
Portland Cement for Cement Treated Base Course	Gal/Ton	0.55
____ " Portland Cement Concrete Pavement	Gal/SY	0.245
Concrete Shoulders Adjacent to ____ " Pavement	Gal/SY	0.245

SCHEDULE OF ESTIMATED COMPLETION PROGRESS:

(7-15-08) (Rev. 5-21-13)

108-2

SP1 G58

The Contractor's attention is directed to the Standard Special Provision entitled *Availability of Funds Termination of Contracts* included elsewhere in this proposal. The Department of Transportation's schedule of estimated completion progress for this project as required by that Standard Special Provision is as follows:

	<u>Fiscal Year</u>	<u>Progress (% of Dollar Value)</u>
2014	(7/01/13 - 6/30/14)	42% of Total Amount Bid
2015	(7/01/14 - 6/30/15)	58% of Total Amount Bid

The Contractor shall also furnish his own progress schedule in accordance with Article 108-2 of the *2012 Standard Specifications*. Any acceleration of the progress as shown by the Contractor's progress schedule over the progress as shown above shall be subject to the approval of the Engineer.

DISADVANTAGED BUSINESS ENTERPRISE:

(10-16-07)(Rev. 12-17-13)

102-15(J)

SP1 G61

Description

The purpose of this Special Provision is to carry out the U.S. Department of Transportation's policy of ensuring nondiscrimination in the award and administration of contracts financed in whole or in part with Federal funds. This provision is guided by 49 CFR Part 26.

Definitions

Additional DBE Subcontractors - Any DBE submitted at the time of bid that will not be used to meet the DBE goal. No submittal of a Letter of Intent is required.

Committed DBE Subcontractor - Any DBE submitted at the time of bid that is being used to meet the DBE goal by submission of a Letter of Intent. Or any DBE used as a replacement for a previously committed DBE firm.

Contract Goal Requirement - The approved DBE participation at time of award, but not greater than the advertised contract goal.

DBE Goal - A portion of the total contract, expressed as a percentage, that is to be performed by committed DBE subcontractor(s).

Disadvantaged Business Enterprise (DBE) - A firm certified as a Disadvantaged Business Enterprise through the North Carolina Unified Certification Program.

Goal Confirmation Letter - Written documentation from the Department to the bidder confirming the Contractor's approved, committed DBE participation along with a listing of the committed DBE firms.

Manufacturer - A firm that operates or maintains a factory or establishment that produces on the premises, the materials or supplies obtained by the Contractor.

Regular Dealer - A firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials or supplies required for the performance of the contract are bought, kept in stock, and regularly sold to the public in the usual course of business. A regular dealer engages in, as its principal business and in its own name, the purchase and sale or lease of the products in question. A regular dealer in such bulk items as steel, cement, gravel, stone, and petroleum products need not keep such products in stock, if it owns and operates distribution equipment for the products. Brokers and packagers are not regarded as manufacturers or regular dealers within the meaning of this section.

North Carolina Unified Certification Program (NCUCP) - A program that provides comprehensive services and information to applicants for DBE certification, such that an applicant is required to apply only once for a DBE certification that will be honored by all recipients of USDOT funds in the state and not limited to the Department of Transportation only. The Certification Program is in accordance with 49 CFR Part 26.

United States Department of Transportation (USDOT) - Federal agency responsible for issuing regulations (49 CFR Part 26) and official guidance for the DBE program.

Forms and Websites Referenced in this Provision

DBE Payment Tracking System - On-line system in which the Contractor enters the payments made to DBE subcontractors who have performed work on the project.
<https://apps.dot.state.nc.us/Vendor/PaymentTracking/>

DBE-IS Subcontractor Payment Information - Form for reporting the payments made to all DBE firms working on the project. This form is for paper bid projects only.
<http://www.ncdot.org/doh/forms/files/DBE-IS.xls>

RF-1 DBE Replacement Request Form - Form for replacing a committed DBE.
<http://connect.ncdot.gov/projects/construction/Construction%20Forms/DBE%20MBE%20WBE%20Replacement%20Request%20Form.pdf>

SAF Subcontract Approval Form - Form required for approval to sublet the contract.
<http://connect.ncdot.gov/projects/construction/Construction%20Forms/Subcontract%20Approval%20Form%20Rev.%202012.zip>

JC-1 Joint Check Notification Form - Form and procedures for joint check notification. The form acts as a written joint check agreement among the parties providing full and prompt disclosure of the expected use of joint checks.
<http://connect.ncdot.gov/projects/construction/Construction%20Forms/Joint%20Check%20Notification%20Form.pdf>

Letter of Intent - Form signed by the Contractor and the DBE subcontractor, manufacturer or regular dealer that affirms that a portion of said contract is going to be performed by the signed DBE for the amount listed at the time of bid.
<http://connect.ncdot.gov/letting/LetCentral/Letter%20of%20Intent%20to%20Perform%20as%20a%20Subcontractor.pdf>

Listing of DBE Subcontractors Form - Form for entering DBE subcontractors on a project that will meet this DBE goal. This form is for paper bids only.
[http://connect.ncdot.gov/municipalities/Bid%20Proposals%20for%20LGA%20Content/08%20DBE%20Subcontractors%20\(Federal\).doc](http://connect.ncdot.gov/municipalities/Bid%20Proposals%20for%20LGA%20Content/08%20DBE%20Subcontractors%20(Federal).doc)

Subcontractor Quote Comparison Sheet - Spreadsheet for showing all subcontractor quotes in the work areas where DBEs quoted on the project. This sheet is submitted with good faith effort packages.
<http://connect.ncdot.gov/business/SmallBusiness/Documents/DBE%20Subcontractor%20Quote%20Comparison%20Example.xls>

DBE Goal

The following DBE goal for participation by Disadvantaged Business Enterprises is established for this contract:

Disadvantaged Business Enterprises **10.0 %**

- (A) *If the DBE goal is more than zero*, the Contractor shall exercise all necessary and reasonable steps to ensure that DBEs participate in at least the percent of the contract as set forth above as the DBE goal.
- (B) *If the DBE goal is zero*, the Contractor shall make an effort to recruit and use DBEs during the performance of the contract. Any DBE participation obtained shall be reported to the Department.

Directory of Transportation Firms (Directory)

Real-time information is available about firms doing business with the Department and firms that are certified through NCUCP in the Directory of Transportation Firms. Only firms identified

in the Directory as DBE certified shall be used to meet the DBE goal. The Directory can be found at the following link. <https://partner.ncdot.gov/VendorDirectory/default.html>

The listing of an individual firm in the directory shall not be construed as an endorsement of the firm's capability to perform certain work.

Listing of DBE Subcontractors

At the time of bid, bidders shall submit all DBE participation that they anticipate to use during the life of the contract. Only those identified to meet the DBE goal will be considered committed, even though the listing shall include both committed DBE subcontractors and additional DBE subcontractors. Additional DBE subcontractor participation submitted at the time of bid will be used toward the Department's overall race-neutral goal. Only those firms with current DBE certification at the time of bid opening will be acceptable for listing in the bidder's submittal of DBE participation. The Contractor shall indicate the following required information:

(A) Electronic Bids

Bidders shall submit a listing of DBE participation in the appropriate section of Expedite, the bidding software of Bid Express®.

- (1) Submit the names and addresses of DBE firms identified to participate in the contract. If the bidder uses the updated listing of DBE firms shown in Expedite, the bidder may use the dropdown menu to access the name and address of the DBE firm.
- (2) Submit the contract line numbers of work to be performed by each DBE firm. When no figures or firms are entered, the bidder will be considered to have no DBE participation.
- (3) The bidder shall be responsible for ensuring that the DBE is certified at the time of bid by checking the Directory of Transportation Firms. If the firm is not certified at the time of the bid-letting, that DBE's participation will not count towards achieving the DBE goal.

(B) Paper Bids

- (1) *If the DBE goal is more than zero,*
 - (a) Bidders, at the time the bid proposal is submitted, shall submit a listing of DBE participation, including the names and addresses on *Listing of DBE Subcontractors* contained elsewhere in the contract documents in order for the bid to be considered responsive. Bidders shall indicate the total dollar value of the DBE participation for the contract.

- (b) If bidders have no DBE participation, they shall indicate this on the *Listing of DBE Subcontractors* by entering the word “None” or the number “0.” This form shall be completed in its entirety. **Blank forms will not be deemed to represent zero participation.** Bids submitted that do not have DBE participation indicated on the appropriate form will not be read publicly during the opening of bids. The Department will not consider these bids for award and the proposal will be rejected.
 - (c) The bidder shall be responsible for ensuring that the DBE is certified at the time of bid by checking the Directory of Transportation Firms. If the firm is not certified at the time of the bid-letting, that DBE’s participation will not count towards achieving the corresponding goal.
- (2) *If the DBE goal is zero*, entries on the *Listing of DBE Subcontractors* are not required for the zero goal, however any DBE participation that is achieved during the project shall be reported in accordance with requirements contained elsewhere in the special provision.

DBE Prime Contractor

When a certified DBE firm bids on a contract that contains a DBE goal, the DBE firm is responsible for meeting the goal or making good faith efforts to meet the goal, just like any other bidder. In most cases, a DBE bidder on a contract will meet the DBE goal by virtue of the work it performs on the contract with its own forces. However, all the work that is performed by the DBE bidder and any other DBE subcontractors will count toward the DBE goal. The DBE bidder shall list itself along with any DBE subcontractors, if any, in order to receive credit toward the DBE goal.

For example, if the DBE goal is 45% and the DBE bidder will only perform 40% of the contract work, the prime will list itself at 40%, and the additional 5% shall be obtained through additional DBE participation with DBE subcontractors or documented through a good faith effort.

DBE prime contractors shall also follow Sections A and B listed under *Listing of DBE Subcontractor* just as a non-DBE bidder would.

Written Documentation – Letter of Intent

The bidder shall submit written documentation for each DBE that will be used to meet the DBE goal of the contract, indicating the bidder’s commitment to use the DBE in the contract. This documentation shall be submitted on the Department’s form titled *Letter of Intent*.

The documentation shall be received in the office of the State Contractor Utilization Engineer or at DBE@ncdot.gov no later than 12:00 noon of the sixth calendar day following opening of bids, unless the sixth day falls on an official state holiday. In that situation, it is due in the office of the State Contractor Utilization Engineer no later than 12:00 noon on the next official state business day.

If the bidder fails to submit the Letter of Intent from each committed DBE to be used toward the DBE goal, or if the form is incomplete (i.e. both signatures are not present), the DBE participation will not count toward meeting the DBE goal. If the lack of this participation drops the commitment below the DBE goal, the Contractor shall submit evidence of good faith efforts, completed in its entirety, to the State Contractor Utilization Engineer or DBE@ncdot.gov no later than 12:00 noon on the eighth calendar day following opening of bids, unless the eighth day falls on an official state holiday. In that situation, it is due in the office of the State Contractor Utilization Engineer no later than 12:00 noon on the next official state business day.

Submission of Good Faith Effort

If the bidder fails to meet or exceed the DBE goal, the apparent lowest responsive bidder shall submit to the Department documentation of adequate good faith efforts made to reach the DBE goal.

A hard copy and an electronic copy of this information shall be received in the office of the State Contractor Utilization Engineer or at DBE@ncdot.gov no later than 12:00 noon of the sixth calendar day following opening of bids unless the sixth day falls on an official state holiday. In that situation, it is due in the office of the State Contractor Utilization Engineer the next official state business day. If the contractor cannot send the information electronically, then one complete set and 9 copies of this information shall be received under the same time constraints above.

Note: Where the information submitted includes repetitious solicitation letters, it will be acceptable to submit a representative letter along with a distribution list of the firms that were solicited. Documentation of DBE quotations shall be a part of the good faith effort submittal. This documentation may include written subcontractor quotations, telephone log notations of verbal quotations, or other types of quotation documentation.

Consideration of Good Faith Effort for Projects with DBE Goals More Than Zero

Adequate good faith efforts mean that the bidder took all necessary and reasonable steps to achieve the goal which, by their scope, intensity, and appropriateness, could reasonably be expected to obtain sufficient DBE participation. Adequate good faith efforts also mean that the bidder actively and aggressively sought DBE participation. Mere *pro forma* efforts are not considered good faith efforts.

The Department will consider the quality, quantity, and intensity of the different kinds of efforts a bidder has made. Listed below are examples of the types of actions a bidder will take in making a good faith effort to meet the goal and are not intended to be exclusive or exhaustive, nor is it intended to be a mandatory checklist.

- (A) Soliciting through all reasonable and available means (e.g. attendance at pre-bid meetings, advertising, written notices, use of verifiable electronic means through the use of the NCDOT Directory of Transportation Firms) the interest of all certified DBEs who

have the capability to perform the work of the contract. The bidder must solicit this interest within at least 10 days prior to bid opening to allow the DBEs to respond to the solicitation. Solicitation shall provide the opportunity to DBEs within the Division and surrounding Divisions where the project is located. The bidder must determine with certainty if the DBEs are interested by taking appropriate steps to follow up initial solicitations.

- (B) Selecting portions of the work to be performed by DBEs in order to increase the likelihood that the DBE goals will be achieved.
 - (1) Where appropriate, break out contract work items into economically feasible units to facilitate DBE participation, even when the prime contractor might otherwise prefer to perform these work items with its own forces.
 - (2) Negotiate with subcontractors to assume part of the responsibility to meet the contract DBE goal when the work to be sublet includes potential for DBE participation (2nd and 3rd tier subcontractors).
- (C) Providing interested DBEs with adequate information about the plans, specifications, and requirements of the contract in a timely manner to assist them in responding to a solicitation.
- (D)
 - (1) Negotiating in good faith with interested DBEs. It is the bidder's responsibility to make a portion of the work available to DBE subcontractors and suppliers and to select those portions of the work or material needs consistent with the available DBE subcontractors and suppliers, so as to facilitate DBE participation. Evidence of such negotiation includes the names, addresses, and telephone numbers of DBEs that were considered; a description of the information provided regarding the plans and specifications for the work selected for subcontracting; and evidence as to why additional agreements could not be reached for DBEs to perform the work.
 - (2) A bidder using good business judgment would consider a number of factors in negotiating with subcontractors, including DBE subcontractors, and would take a firm's price and capabilities as well as contract goals into consideration. However, the fact that there may be some additional costs involved in finding and using DBEs is not in itself sufficient reason for a bidder's failure to meet the contract DBE goal, as long as such costs are reasonable. Also, the ability or desire of a prime contractor to perform the work of a contract with its own organization does not relieve the bidder of the responsibility to make good faith efforts. Bidding contractors are not, however, required to accept higher quotes from DBEs if the price difference is excessive or unreasonable.
- (E) Not rejecting DBEs as being unqualified without sound reasons based on a thorough investigation of their capabilities. The bidder's standing within its industry, membership in specific groups, organizations, or associates and political or social affiliations

(for example, union vs. non-union employee status) are not legitimate causes for the rejection or non-solicitation of bids in the bidder's efforts to meet the project goal.

- (F) Making efforts to assist interested DBEs in obtaining bonding, lines of credit, or insurance as required by the recipient or bidder.
- (G) Making efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services.
- (H) Effectively using the services of available minority/women community organizations; minority/women contractors' groups; Federal, State, and local minority/women business assistance offices; and other organizations as allowed on a case-by-case basis to provide assistance in the recruitment and placement of DBEs. Contact within 7 days from the bid opening the Business Development Manager in the Business Opportunity and Work Force Development Unit to give notification of the bidder's inability to get DBE quotes.
- (I) Any other evidence that the bidder submits which shows that the bidder has made reasonable good faith efforts to meet the DBE goal.

In addition, the Department may take into account the following:

- (1) Whether the bidder's documentation reflects a clear and realistic plan for achieving the DBE goal.
- (2) The bidders' past performance in meeting the DBE goals.
- (3) The performance of other bidders in meeting the DBE goal. For example, when the apparent successful bidder fails to meet the DBE goal, but others meet it, you may reasonably raise the question of whether, with additional reasonable efforts the apparent successful bidder could have met the goal. If the apparent successful bidder fails to meet the DBE goal, but meets or exceeds the average DBE participation obtained by other bidders, the Department may view this, in conjunction with other factors, as evidence of the apparent successful bidder having made a good faith effort.

If the Department does not award the contract to the apparent lowest responsive bidder, the Department reserves the right to award the contract to the next lowest responsive bidder that can satisfy to the Department that the DBE goal can be met or that an adequate good faith effort has been made to meet the DBE goal.

Non-Good Faith Appeal

The State Contractor Utilization Engineer will notify the contractor verbally and in writing of non-good faith. A contractor may appeal a determination of non-good faith made by the Goal Compliance Committee. If a contractor wishes to appeal the determination made by the Committee, they shall provide written notification to the State Contractual Services Engineer or

at DBE@ncdot.gov. The appeal shall be made within 2 business days of notification of the determination of non-good faith.

Counting DBE Participation Toward Meeting DBE Goal

(A) Participation

The total dollar value of the participation by a committed DBE will be counted toward the contract goal requirement. The total dollar value of participation by a committed DBE will be based upon the value of work actually performed by the DBE and the actual payments to DBE firms by the Contractor.

(B) Joint Checks

Prior notification of joint check use shall be required when counting DBE participation for services or purchases that involves the use of a joint check. Notification shall be through submission of Form JC-1 (*Joint Check Notification Form*) and the use of joint checks shall be in accordance with the Department's Joint Check Procedures.

(C) Subcontracts (Non-Trucking)

A DBE may enter into subcontracts. Work that a DBE subcontracts to another DBE firm may be counted toward the contract goal requirement. Work that a DBE subcontracts to a non-DBE firm does not count toward the contract goal requirement. If a DBE contractor or subcontractor subcontracts a significantly greater portion of the work of the contract than would be expected on the basis of standard industry practices, it shall be presumed that the DBE is not performing a commercially useful function. The DBE may present evidence to rebut this presumption to the Department. The Department's decision on the rebuttal of this presumption is subject to review by the Federal Highway Administration but is not administratively appealable to USDOT.

(D) Joint Venture

When a DBE performs as a participant in a joint venture, the Contractor may count toward its contract goal requirement a portion of the total value of participation with the DBE in the joint venture, that portion of the total dollar value being a distinct clearly defined portion of work that the DBE performs with its forces.

(E) Suppliers

A contractor may count toward its DBE requirement 60 percent of its expenditures for materials and supplies required to complete the contract and obtained from a DBE regular dealer and 100 percent of such expenditures from a DBE manufacturer.

(F) Manufacturers and Regular Dealers

A contractor may count toward its DBE requirement the following expenditures to DBE firms that are not manufacturers or regular dealers:

- (1) The fees or commissions charged by a DBE firm for providing a *bona fide* service, such as professional, technical, consultant, or managerial services, or for providing bonds or insurance specifically required for the performance of a DOT-assisted contract, provided the fees or commissions are determined to be reasonable and not excessive as compared with fees and commissions customarily allowed for similar services.
- (2) With respect to materials or supplies purchased from a DBE, which is neither a manufacturer nor a regular dealer, count the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site (but not the cost of the materials and supplies themselves), provided the fees are determined to be reasonable and not excessive as compared with fees customarily allowed for similar services.

Commercially Useful Function

(A) DBE Utilization

The Contractor may count toward its contract goal requirement only expenditures to DBEs that perform a commercially useful function in the work of a contract. A DBE performs a commercially useful function when it is responsible for execution of the work of the contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. To perform a commercially useful function, the DBE shall also be responsible with respect to materials and supplies used on the contract, for negotiating price, determining quality and quantity, ordering the material and installing (where applicable) and paying for the material itself. To determine whether a DBE is performing a commercially useful function, the Department will evaluate the amount of work subcontracted, industry practices, whether the amount the firm is to be paid under the contract is commensurate with the work it is actually performing and the DBE credit claimed for its performance of the work, and any other relevant factors.

(B) DBE Utilization in Trucking

The following factors will be used to determine if a DBE trucking firm is performing a commercially useful function:

- (1) The DBE shall be responsible for the management and supervision of the entire trucking operation for which it is responsible on a particular contract, and there shall not be a contrived arrangement for the purpose of meeting DBE goals.

- (2) The DBE shall itself own and operate at least one fully licensed, insured, and operational truck used on the contract.
- (3) The DBE receives credit for the total value of the transportation services it provides on the contract using trucks it owns, insures, and operates using drivers it employs.
- (4) The DBE may subcontract the work to another DBE firm, including an owner-operator who is certified as a DBE. The DBE who subcontracts work to another DBE receives credit for the total value of the transportation services the subcontracted DBE provides on the contract.
- (5) The DBE may also subcontract the work to a non-DBE firm, including from an owner-operator. The DBE who subcontracts the work to a non-DBE is entitled to credit for the total value of transportation services provided by the non-DBE subcontractor not to exceed the value of transportation services provided by DBE-owned trucks on the contract. Additional participation by non-DBE subcontractors receives credit only for the fee or commission it receives as a result of the subcontract arrangement. The value of services performed under subcontract agreements between the DBE and the Contractor will not count towards the DBE contract requirement.
- (6) A DBE may lease truck(s) from an established equipment leasing business open to the general public. The lease must indicate that the DBE has exclusive use of and control over the truck. This requirement does not preclude the leased truck from working for others during the term of the lease with the consent of the DBE, so long as the lease gives the DBE absolute priority for use of the leased truck. This type of lease may count toward the DBE's credit as long as the driver is under the DBE's payroll.
- (7) Subcontracted/leased trucks shall display clearly on the dashboard the name of the DBE that they are subcontracted/leased to and their own company name if it is not identified on the truck itself. Magnetic door signs are not permitted.

DBE Replacement

When a Contractor has relied on a commitment to a DBE firm (or an approved substitute DBE firm) to meet all or part of a contract goal requirement, the contractor shall not terminate the DBE for convenience. This includes, but is not limited to, instances in which the Contractor seeks to perform the work of the terminated subcontractor with another DBE subcontractor, a non-DBE subcontractor, or with the Contractor's own forces or those of an affiliate. A DBE may only be terminated after receiving the Engineer's written approval based upon a finding of good cause for the termination.

All requests for replacement of a committed DBE firm shall be submitted to the Engineer for approval on Form RF-1 (*DBE Replacement Request*). If the Contractor fails to follow this procedure, the Contractor may be disqualified from further bidding for a period of up to 6 months.

The Contractor shall comply with the following for replacement of a committed DBE:

(A) Performance Related Replacement

When a committed DBE is terminated for good cause as stated above, an additional DBE that was submitted at the time of bid may be used to fulfill the DBE commitment. A good faith effort will only be required for removing a committed DBE if there were no additional DBEs submitted at the time of bid to cover the same amount of work as the DBE that was terminated.

If a replacement DBE is not found that can perform at least the same amount of work as the terminated DBE, the Contractor shall submit a good faith effort documenting the steps taken. Such documentation shall include, but not be limited to, the following:

- (1) Copies of written notification to DBEs that their interest is solicited in contracting the work defaulted by the previous DBE or in subcontracting other items of work in the contract.
- (2) Efforts to negotiate with DBEs for specific subbids including, at a minimum:
 - (a) The names, addresses, and telephone numbers of DBEs who were contacted.
 - (b) A description of the information provided to DBEs regarding the plans and specifications for portions of the work to be performed.
- (3) A list of reasons why DBE quotes were not accepted.
- (4) Efforts made to assist the DBEs contacted, if needed, in obtaining bonding or insurance required by the Contractor.

(B) Decertification Replacement

- (1) When a committed DBE is decertified by the Department after the SAF (*Subcontract Approval Form*) has been received by the Department, the Department will not require the Contractor to solicit replacement DBE participation equal to the remaining work to be performed by the decertified firm. The participation equal to the remaining work performed by the decertified firm will count toward the contract goal requirement.

- (2) When a committed DBE is decertified prior to the Department receiving the SAF (*Subcontract Approval Form*) for the named DBE firm, the Contractor shall take all necessary and reasonable steps to replace the DBE subcontractor with another DBE subcontractor to perform at least the same amount of work to meet the DBE goal requirement. If a DBE firm is not found to do the same amount of work, a good faith effort must be submitted to NCDOT (see A herein for required documentation).

Changes in the Work

When the Engineer makes changes that result in the reduction or elimination of work to be performed by a committed DBE, the Contractor will not be required to seek additional participation. When the Engineer makes changes that result in additional work to be performed by a DBE based upon the Contractor's commitment, the DBE shall participate in additional work to the same extent as the DBE participated in the original contract work.

When the Engineer makes changes that result in extra work, which has more than a minimal impact on the contract amount, the Contractor shall seek additional participation by DBEs unless otherwise approved by the Engineer.

When the Engineer makes changes that result in an alteration of plans or details of construction, and a portion or all of the work had been expected to be performed by a committed DBE, the Contractor shall seek participation by DBEs unless otherwise approved by the Engineer.

When the Contractor requests changes in the work that result in the reduction or elimination of work that the Contractor committed to be performed by a DBE, the Contractor shall seek additional participation by DBEs equal to the reduced DBE participation caused by the changes.

Reports and Documentation

A SAF (*Subcontract Approval Form*) shall be submitted for all work which is to be performed by a DBE subcontractor. The Department reserves the right to require copies of actual subcontract agreements involving DBE subcontractors.

When using transportation services to meet the contract commitment, the Contractor shall submit a proposed trucking plan in addition to the SAF. The plan shall be submitted prior to beginning construction on the project. The plan shall include the names of all trucking firms proposed for use, their certification type(s), the number of trucks owned by the firm, as well as the individual truck identification numbers, and the line item(s) being performed.

Within 30 calendar days of entering into an agreement with a DBE for materials, supplies or services, not otherwise documented by the SAF as specified above, the Contractor shall furnish the Engineer a copy of the agreement. The documentation shall also indicate the percentage (60% or 100%) of expenditures claimed for DBE credit.

Reporting Disadvantaged Business Enterprise Participation

The Contractor shall provide the Engineer with an accounting of payments made to all DBE firms, including material suppliers and contractors at all levels (prime, subcontractor, or second tier subcontractor). This accounting shall be furnished to the Engineer for any given month by the end of the following month. Failure to submit this information accordingly may result in the following action:

- (A) Withholding of money due in the next partial pay estimate; or
- (B) Removal of an approved contractor from the prequalified bidders' list or the removal of other entities from the approved subcontractors list.

While each contractor (prime, subcontractor, 2nd tier subcontractor) is responsible for accurate accounting of payments to DBEs, it shall be the prime contractor's responsibility to report all monthly and final payment information in the correct reporting manner.

Failure on the part of the Contractor to submit the required information in the time frame specified may result in the disqualification of that contractor and any affiliate companies from further bidding until the required information is submitted.

Failure on the part of any subcontractor to submit the required information in the time frame specified may result in the disqualification of that contractor and any affiliate companies from being approved for work on future DOT projects until the required information is submitted.

Contractors reporting transportation services provided by non-DBE lessees shall evaluate the value of services provided during the month of the reporting period only.

At any time, the Engineer can request written verification of subcontractor payments.

- (A) Electronic Bids Reporting

The Contractor shall report the accounting of payments through the Department's DBE Payment Tracking System.

- (B) Paper Bids Reporting

The Contractor shall report the accounting of payments on the Department's DBE-IS (*Subcontractor Payment Information*) with each invoice. Invoices will not be processed for payment until the DBE-IS is received.

Failure to Meet Contract Requirements

Failure to meet contract requirements in accordance with Subarticle 102-15(J) of the *2012 Standard Specifications* may be cause to disqualify the Contractor.

CERTIFICATION FOR FEDERAL-AID CONTRACTS:

(3-21-90)

SP1 G85

The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:

- (A) No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
- (B) If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, *Disclosure Form to Report Lobbying*, in accordance with its instructions.

This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by *Section 1352, Title 31, U.S. Code*. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.

The prospective participant also agrees by submitting his or her bid or proposal that he or she shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such subrecipients shall certify and disclose accordingly.

CONTRACTOR'S LICENSE REQUIREMENTS:

(7-1-95)

102-14

SP1 G88

If the successful bidder does not hold the proper license to perform any plumbing, heating, air conditioning, or electrical work in this contract, he will be required to sublet such work to a contractor properly licensed in accordance with *Article 2 of Chapter 87 of the General Statutes* (licensing of heating, plumbing, and air conditioning contractors) and *Article 4 of Chapter 87 of the General Statutes* (licensing of electrical contractors).

U.S. DEPARTMENT OF TRANSPORTATION HOTLINE:

(11-22-94)

108-5

SP1 G100

To report bid rigging activities call: **1-800-424-9071**

The U.S. Department of Transportation (DOT) operates the above toll-free hotline Monday through Friday, 8:00 a.m. to 5:00 p.m. eastern time. Anyone with knowledge of possible bid

rigging, bidder collusion, or other fraudulent activities should use the hotline to report such activities.

The hotline is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

SUBSURFACE INFORMATION:

(7-1-95)

450

SP1 G112 B

Subsurface information is available on the roadway portion of this project only.

LOCATING EXISTING UNDERGROUND UTILITIES:

(3-20-12)

105

SP1 G115

Revise the *2012 Standard Specifications* as follows:

Page 1-43, Article 105-8, line 28, after the first sentence, add the following:

Identify excavation locations by means of pre-marking with white paint, flags, or stakes or provide a specific written description of the location in the locate request.

RESOURCE CONSERVATION:

(5-21-13)

104-13

SP1 G118

In accordance with North Carolina Executive Order 156, NCGS 130A-309.14(2), and NCGS 136-28.8, it is the policy of the Department to aid in the reduction of materials that become a part of our solid waste stream, to divert materials from landfills, and to find ways to recycle and reuse materials for the benefit of the Citizens of North Carolina.

Initiate, develop and use products and construction methods that incorporate the use of recycled or solid waste products in accordance with Article 104-13 of the *2012 Standard Specifications*. Report the quantities of reused or recycled materials either incorporated in the project or diverted from landfills on the Project Construction Reuse and Recycling Reporting Form.

A location-based tool for finding local recycling facilities and the Project Construction Reuse and Recycling Reporting Form are available at:

<http://connect.ncdot.gov/resources/Environmental/Pages/North-Carolina-Recycling-Locations.aspx>

DOMESTIC STEEL:

(4-16-13)

106

SP1 G120

Revise the *2012 Standard Specifications* as follows:

Page 1-49, Subarticle 106-1(B) Domestic Steel, lines 2-7, replace the first paragraph with the following:

All steel and iron products that are permanently incorporated into this project shall be produced in the United States except minimal amounts of foreign steel and iron products may be used

provided the combined material cost of the items involved does not exceed 0.1% of the total amount bid for the entire project or \$2,500, whichever is greater. If invoices showing the cost of the material are not provided, the amount of the bid item involving the foreign material will be used for calculations. This minimal amount of foreign produced steel and iron products permitted for use is not applicable to high strength fasteners. Domestically produced high strength fasteners are required.

MAINTENANCE OF THE PROJECT:

(11-20-07) (Rev. 1-17-12)

104-10

SP1 G125

Revise the *2012 Standard Specifications* as follows:

Page 1-35, Article 104-10 Maintenance of the Project, line 25, add the following after the first sentence of the first paragraph:

All guardrail/guiderail within the project limits shall be included in this maintenance.

Page 1-35, Article 104-10 Maintenance of the Project, line 30, add the following as the last sentence of the first paragraph:

The Contractor shall perform weekly inspections of guardrail and guiderail and shall report damages to the Engineer on the same day of the weekly inspection. *Where damaged guardrail or guiderail is repaired or replaced as a result of maintaining the project in accordance with this article, such repair or replacement shall be performed within 7 consecutive calendar days of such inspection report.*

Page 1-35, Article 104-10 Maintenance of the Project, lines 42-44, replace the last sentence of the last paragraph with the following:

The Contractor will not be directly compensated for any maintenance operations necessary, except for maintenance of guardrail/guiderail, as this work will be considered incidental to the work covered by the various contract items. The provisions of Article 104-7, Extra Work, and Article 104-8, Compensation and Record Keeping will apply to authorized maintenance of guardrail/guiderail. Performance of weekly inspections of guardrail/guiderail, and the damage reports required as described above, will be considered to be an incidental part of the work being paid for by the various contract items.

TWELVE MONTH GUARANTEE:

(7-15-03)

108

SP1 G145

- (A) The Contractor shall guarantee materials and workmanship against latent and patent defects arising from faulty materials, faulty workmanship or negligence for a period of twelve months following the date of final acceptance of the work for maintenance and shall replace such defective materials and workmanship without cost to the Department. The Contractor will not be responsible for damage due to faulty design, normal wear and tear, for negligence on the part of the Department, and/or for use in excess of the design.

- (B) Where items of equipment or material carry a manufacturer's guarantee for any period in excess of twelve months, then the manufacturer's guarantee shall apply for that particular piece of equipment or material. The Department's first remedy shall be through the manufacturer although the Contractor is responsible for invoking the warranted repair work with the manufacturer. The Contractor's responsibility shall be limited to the term of the manufacturer's guarantee. NCDOT would be afforded the same warranty as provided by the Manufacturer.

This guarantee provision shall be invoked only for major components of work in which the Contractor would be wholly responsible for under the terms of the contract. Examples would include pavement structures, bridge components, and sign structures. This provision will not be used as a mechanism to force the Contractor to return to the project to make repairs or perform additional work that the Department would normally compensate the Contractor for. In addition, routine maintenance activities (i.e. mowing grass, debris removal, ruts in earth shoulders,) are not parts of this guarantee.

Appropriate provisions of the payment and/or performance bonds shall cover this guarantee for the project.

To ensure uniform application statewide the Division Engineer will forward details regarding the circumstances surrounding any proposed guarantee repairs to the Chief Engineer for review and approval prior to the work being performed.

GIFTS FROM VENDORS AND CONTRACTORS:

(12-15-09)

107-1

SP1 G152

By Executive Order 24, issued by Governor Perdue, and *N.C.G.S. § 133-32*, it is unlawful for any vendor or contractor (i.e. architect, bidder, contractor, construction manager, design professional, engineer, landlord, offeror, seller, subcontractor, supplier, or vendor), to make gifts or to give favors to any State employee of the Governor's Cabinet Agencies (i.e. Administration, Commerce, Correction, Crime Control and Public Safety, Cultural Resources, Environment and Natural Resources, Health and Human Services, Juvenile Justice and Delinquency Prevention, Revenue, Transportation, and the Office of the Governor). This prohibition covers those vendors and contractors who:

- (A) Have a contract with a governmental agency; or
- (B) Have performed under such a contract within the past year; or
- (C) Anticipate bidding on such a contract in the future.

For additional information regarding the specific requirements and exemptions, vendors and contractors are encouraged to review Executive Order 24 and *N.C.G.S. § 133-32*.

Executive Order 24 also encouraged and invited other State Agencies to implement the requirements and prohibitions of the Executive Order to their agencies. Vendors and contractors should contact other State Agencies to determine if those agencies have adopted Executive Order 24.

EROSION AND SEDIMENT CONTROL/STORMWATER CERTIFICATION:

(1-16-07) (Rev 9-18-12)

105-16, 225-2, 16

SPI G180

General

Schedule and conduct construction activities in a manner that will minimize soil erosion and the resulting sedimentation and turbidity of surface waters. Comply with the requirements herein regardless of whether or not a National Pollution discharge Elimination System (NPDES) permit for the work is required.

Establish a chain of responsibility for operations and subcontractors' operations to ensure that the *Erosion and Sediment Control/Stormwater Pollution Prevention Plan* is implemented and maintained over the life of the contract.

- (A) *Certified Supervisor* - Provide a certified Erosion and Sediment Control/Stormwater Supervisor to manage the Contractor and subcontractor operations, insure compliance with Federal, State and Local ordinances and regulations, and manage the Quality Control Program.
- (B) *Certified Foreman* - Provide a certified, trained foreman for each construction operation that increases the potential for soil erosion or the possible sedimentation and turbidity of surface waters.
- (C) *Certified Installer* - Provide a certified installer to install or direct the installation for erosion or sediment/stormwater control practices.
- (D) *Certified Designer* - Provide a certified designer for the design of the erosion and sediment control/stormwater component of reclamation plans and, if applicable, for the design of the project erosion and sediment control/stormwater plan.

Roles and Responsibilities

- (A) *Certified Erosion and Sediment Control/Stormwater Supervisor* - The Certified Supervisor shall be Level II and responsible for ensuring the erosion and sediment control/stormwater plan is adequately implemented and maintained on the project and for conducting the quality control program. The Certified Supervisor shall be on the project within 24 hours notice from initial exposure of an erodible surface to the project's final acceptance. Perform the following duties:
 - (1) *Manage Operations* - Coordinate and schedule the work of subcontractors so that erosion and sediment control/stormwater measures are fully executed for each operation and in a timely manner over the duration of the contract.
 - (a) Oversee the work of subcontractors so that appropriate erosion and sediment control/stormwater preventive measures are conformed to at each stage of the work.
 - (b) Prepare the required National Pollutant Discharge Elimination System (NPDES) Inspection Record and submit to the Engineer.

- (c) Attend all weekly or monthly construction meetings to discuss the findings of the NPDES inspection and other related issues.
 - (d) Implement the erosion and sediment control/stormwater site plans requested.
 - (e) Provide any needed erosion and sediment control/stormwater practices for the Contractor's temporary work not shown on the plans, such as, but not limited to work platforms, temporary construction, pumping operations, plant and storage yards, and cofferdams.
 - (f) Acquire applicable permits and comply with requirements for borrow pits, dewatering, and any temporary work conducted by the Contractor in jurisdictional areas.
 - (g) Conduct all erosion and sediment control/stormwater work in a timely and workmanlike manner.
 - (h) Fully perform and install erosion and sediment control/stormwater work prior to any suspension of the work.
 - (i) Coordinate with Department, Federal, State and Local Regulatory agencies on resolution of erosion and sediment control/stormwater issues due to the Contractor's operations.
 - (j) Ensure that proper cleanup occurs from vehicle tracking on paved surfaces or any location where sediment leaves the Right-of-Way.
 - (k) Have available a set of erosion and sediment control/stormwater plans that are initialed and include the installation date of Best Management Practices. These practices shall include temporary and permanent groundcover and be properly updated to reflect necessary plan and field changes for use and review by Department personnel as well as regulatory agencies.
- (2) Requirements set forth under the NPDES Permit - The Department's NPDES Stormwater permit (NCS000250) outlines certain objectives and management measures pertaining to construction activities. The permit references *NCG010000, General Permit to Discharge Stormwater* under the NPDES, and states that the Department shall incorporate the applicable requirements into its delegated Erosion and Sediment Control Program for construction activities disturbing one or more acres of land. The Department further incorporates these requirements on all contracted bridge and culvert work at jurisdictional waters, regardless of size. Some of the requirements are, but are not limited to:
- (a) Control project site waste to prevent contamination of surface or ground waters of the state, i.e. from equipment operation/maintenance, construction materials, concrete washout, chemicals, litter, fuels, lubricants, coolants, hydraulic fluids, any other petroleum products, and sanitary waste.
 - (b) Inspect erosion and sediment control/stormwater devices and stormwater discharge outfalls at least once every 7 calendar days, twice weekly for construction related *Federal Clean Water Act, Section 303(d)* impaired streams with turbidity violations, and within 24 hours after a significant rainfall event of 0.5 inch that occurs within a 24 hour period.

- (c) Maintain an onsite rain gauge or use the Department's Multi-Sensor Precipitation Estimate website to maintain a daily record of rainfall amounts and dates.
 - (d) Maintain erosion and sediment control/stormwater inspection records for review by Department and Regulatory personnel upon request.
 - (e) Implement approved reclamation plans on all borrow pits, waste sites and staging areas.
 - (f) Maintain a log of turbidity test results as outlined in the Department's Procedure for Monitoring Borrow Pit Discharge.
 - (g) Provide secondary containment for bulk storage of liquid materials.
 - (h) Provide training for employees concerning general erosion and sediment control/stormwater awareness, the Department's NPDES Stormwater Permit NCS000250 requirements, and the applicable requirements of the *General Permit, NCG010000*.
 - (i) Report violations of the NPDES permit to the Engineer immediately who will notify the Division of Water Quality Regional Office within 24 hours of becoming aware of the violation.
- (3) Quality Control Program - Maintain a quality control program to control erosion, prevent sedimentation and follow provisions/conditions of permits. The quality control program shall:
- (a) Follow permit requirements related to the Contractor and subcontractors' construction activities.
 - (b) Ensure that all operators and subcontractors on site have the proper erosion and sediment control/stormwater certification.
 - (c) Notify the Engineer when the required certified erosion and sediment control/stormwater personnel are not available on the job site when needed.
 - (d) Conduct the inspections required by the NPDES permit.
 - (e) Take corrective actions in the proper timeframe as required by the NPDES permit for problem areas identified during the NPDES inspections.
 - (f) Incorporate erosion control into the work in a timely manner and stabilize disturbed areas with mulch/seed or vegetative cover on a section-by-section basis.
 - (g) Use flocculants approved by state regulatory authorities where appropriate and where required for turbidity and sedimentation reduction.
 - (h) Ensure proper installation and maintenance of temporary erosion and sediment control devices.
 - (i) Remove temporary erosion or sediment control devices when they are no longer necessary as agreed upon by the Engineer.
 - (j) The Contractor's quality control and inspection procedures shall be subject to review by the Engineer. Maintain NPDES inspection records and make records available at all times for verification by the Engineer.

- (B) *Certified Foreman* - At least one Certified Foreman shall be onsite for each type of work listed herein during the respective construction activities to control erosion, prevent sedimentation and follow permit provisions:

- (1) Foreman in charge of grading activities
- (2) Foreman in charge of bridge or culvert construction over jurisdictional areas
- (3) Foreman in charge of utility activities

The Contractor may request to use the same person as the Level II Supervisor and Level II Foreman. This person shall be onsite whenever construction activities as described above are taking place. This request shall be approved by the Engineer prior to work beginning.

The Contractor may request to name a single Level II Foreman to oversee multiple construction activities on small bridge or culvert replacement projects. This request shall be approved by the Engineer prior to work beginning.

- (C) *Certified Installers* - Provide at least one onsite, Level I Certified Installer for each of the following erosion and sediment control/stormwater crew:

- (1) Seeding and Mulching
- (2) Temporary Seeding
- (3) Temporary Mulching
- (4) Sodding
- (5) Silt fence or other perimeter erosion/sediment control device installations
- (6) Erosion control blanket installation
- (7) Hydraulic tackifier installation
- (8) Turbidity curtain installation
- (9) Rock ditch check/sediment dam installation
- (10) Ditch liner/matting installation
- (11) Inlet protection
- (12) Riprap placement
- (13) Stormwater BMP installations (such as but not limited to level spreaders, retention/detention devices)
- (14) Pipe installations within jurisdictional areas

If a Level I *Certified Installer* is not onsite, the Contractor may substitute a Level II Foreman for a Level I Installer, provided the Level II Foreman is not tasked to another crew requiring Level II Foreman oversight.

- (D) *Certified Designer* - Include the certification number of the Level III-B Certified Designer on the erosion and sediment control/stormwater component of all reclamation plans and if applicable, the certification number of the Level III-A Certified Designer on the design of the project erosion and sediment control/stormwater plan.

Preconstruction Meeting

Furnish the names of the *Certified Erosion and Sediment Control/Stormwater Supervisor*, *Certified Foremen*, *Certified Installers* and *Certified Designer* and notify the Engineer of changes in certified personnel over the life of the contract within 2 days of change.

Ethical Responsibility

Any company performing work for the North Carolina Department of Transportation has the ethical responsibility to fully disclose any reprimand or dismissal of an employee resulting from improper testing or falsification of records.

Revocation or Suspension of Certification

Upon recommendation of the Chief Engineer to the certification entity, certification for *Supervisor*, *Certified Foremen*, *Certified Installers* and *Certified Designer* may be revoked or suspended with the issuance of an *Immediate Corrective Action (ICA)*, *Notice of Violation (NOV)*, or *Cease and Desist Order* for erosion and sediment control/stormwater related issues.

The Chief Engineer may recommend suspension or permanent revocation of certification due to the following:

- (A) Failure to adequately perform the duties as defined within this certification provision.
- (B) Issuance of an ICA, NOV, or Cease and Desist Order.
- (C) Failure to fully perform environmental commitments as detailed within the permit conditions and specifications.
- (D) Demonstration of erroneous documentation or reporting techniques.
- (E) Cheating or copying another candidate's work on an examination.
- (F) Intentional falsification of records.
- (G) Directing a subordinate under direct or indirect supervision to perform any of the above actions.
- (H) Dismissal from a company for any of the above reasons.
- (I) Suspension or revocation of one's certification by another entity.

Suspension or revocation of a certification will be sent by certified mail to the certificant and the Corporate Head of the company that employs the certificant.

A certificant has the right to appeal any adverse action which results in suspension or permanent revocation of certification by responding, in writing, to the Chief Engineer within 10 calendar days after receiving notice of the proposed adverse action.

Chief Engineer
1536 Mail Service Center
Raleigh, NC 27699-1536

Failure to appeal within 10 calendar days will result in the proposed adverse action becoming effective on the date specified on the certified notice. Failure to appeal within the time specified will result in a waiver of all future appeal rights regarding the adverse action taken. The certificant will not be allowed to perform duties associated with the certification during the appeal process.

The Chief Engineer will hear the appeal and make a decision within 7 days of hearing the appeal. Decision of the Chief Engineer will be final and will be made in writing to the certificant.

If a certification is temporarily suspended, the certificant shall pass any applicable written examination and any proficiency examination, at the conclusion of the specified suspension period, prior to having the certification reinstated.

Measurement and Payment

Certified Erosion and Sediment Control/Stormwater Supervisor, Certified Foremen, Certified Installers and Certified Designer will be incidental to the project for which no direct compensation will be made.

PROCEDURE FOR MONITORING BORROW PIT DISCHARGE:

(2-20-07) (Rev. 3-19-13)

105-16, 230, 801

SP1 G181

Water discharge from borrow pit sites shall not cause surface waters to exceed 50 NTUs (nephelometric turbidity unit) in streams not designated as trout waters and 10 NTUs in streams, lakes or reservoirs designated as trout waters. For lakes and reservoirs not designated as trout waters, the turbidity shall not exceed 25 NTUs. If the turbidity exceeds these levels due to natural background conditions, the existing turbidity level shall not be increased.

If during any operating day, the downstream water quality exceeds the standard, the Contractor shall do all of the following:

- (A) Either cease discharge or modify the discharge volume or turbidity levels to bring the downstream turbidity levels into compliance, or
- (B) Evaluate the upstream conditions to determine if the exceedance of the standard is due to natural background conditions. If the background turbidity measurements exceed the standard, operation of the pit and discharge can continue as long as the stream turbidity levels are not increased due to the discharge.
- (C) Measure and record the turbidity test results (time, date and sampler) at all defined sampling locations 30 minutes after startup and at a minimum, one additional sampling of all sampling locations during that 24-hour period in which the borrow pit is discharging.
- (D) Notify DWQ within 24 hours of any stream turbidity standard exceedances that are not brought into compliance.

During the Environmental Assessment required by Article 230-4 of the *2012 Standard Specifications*, the Contractor shall define the point at which the discharge enters into the State's surface waters and the appropriate sampling locations. Sampling locations shall include points upstream and downstream from the point at which the discharge enters these waters. Upstream sampling location shall be located so that it is not influenced by backwater conditions and represents natural background conditions. Downstream sampling location shall be located at the point where complete mixing of the discharge and receiving water has occurred.

The discharge shall be closely monitored when water from the dewatering activities is introduced into jurisdictional wetlands. Any time visible sedimentation (deposition of sediment) on the wetland surface is observed, the dewatering activity will be suspended until turbidity levels in the stilling basin can be reduced to a level where sediment deposition does not occur. Staining of wetland surfaces from suspended clay particles, occurring after evaporation or infiltration, does not constitute sedimentation. No activities shall occur in wetlands that adversely affect the functioning of a wetland. Visible sedimentation will be considered an indication of possible adverse impacts on wetland use.

The Engineer will perform independent turbidity tests on a random basis. These results will be maintained in a log within the project records. Records will include, at a minimum, turbidity test results, time, date and name of sampler. Should the Department's test results exceed those of the Contractor's test results, an immediate test shall be performed jointly with the results superseding the previous test results of both the Department and the Contractor.

The Contractor shall use the *NCDOT Turbidity Reduction Options for Borrow Pits Matrix*, available at http://www.ncdot.gov/doh/operations/dp_chief_eng/roadside/fieldops/downloads/Files/TurbidityReductionOptionSheet.pdf to plan, design, construct, and maintain BMPs to address water quality standards. Tier I Methods include stilling basins which are standard compensatory BMPs. Other Tier I methods are noncompensatory and shall be used when needed to meet the stream turbidity standards. Tier II Methods are also noncompensatory and are options that may be needed for protection of rare or unique resources or where special environmental conditions exist at the site which have led to additional requirements being placed in the DWQ's 401 Certifications and approval letters, Isolated Wetland Permits, Riparian Buffer Authorization or a DOT Reclamation Plan's Environmental Assessment for the specific site. Should the Contractor exhaust all Tier I Methods on a site exclusive of rare or unique resources or special environmental conditions, Tier II Methods may be required by regulators on a case by case basis per supplemental agreement.

The Contractor may use cation exchange capacity (CEC) values from proposed site borings to plan and develop the bid for the project. CEC values exceeding 15 milliequivalents per 100 grams of soil may indicate a high potential for turbidity and should be avoided when dewatering into surface water is proposed.

No additional compensation for monitoring borrow pit discharge will be paid.

EMPLOYMENT:

(11-15-11) (Rev. 1-17-12)

108, 102

SP1 G184

Revise the *2012 Standard Specifications* as follows:

Page 1-20, Subarticle 102-15(O), delete and replace with the following:

(O) Failure to restrict a former Department employee as prohibited by Article 108-5.

Page 1-65, Article 108-5 Character of Workmen, Methods, and Equipment, line 32, delete all of line 32, the first sentence of the second paragraph and the first word of the second sentence of the second paragraph.

STATE HIGHWAY ADMINISTRATOR TITLE CHANGE:

(9-18-12)

SP1 G185

Revise the *2012 Standard Specifications* as follows:

Replace all references to "State Highway Administrator" with "Chief Engineer".

PROJECT SPECIAL PROVISIONS**ROADWAY****CLEARING AND GRUBBING - METHOD III:**

(4-6-06) (Rev. 1-17-12)

200

SP2 R02B

Perform clearing on this project to the limits established by Method "III" shown on Standard Drawing No. 200.03 of the *2012 Roadway Standard Drawings*.

NOTE TO CONTRACTOR:

In those areas where underground utilities are to be located and undercut is to be performed, the Contractor shall perform undercut operations first.

SHOULDER AND FILL SLOPE MATERIAL:

(5-21-02)

235, 560

SP2 R45 A

Description

Perform the required shoulder and slope construction for this project in accordance with the applicable requirements of Section 560 and Section 235 of the *2012 Standard Specifications*.

Measurement and Payment

Where the material has been obtained from an authorized stockpile or from a borrow source and *Borrow Excavation* is not included in the contract, no direct payment will be made for this work, as the cost of this work will be part of the work being paid at the contract lump sum price for *Grading*. If *Borrow Excavation* is included in this contract and the material has been obtained from an authorized stockpile or from a borrow source, measurement and payment will be as provided in Section 230 of the *2012 Standard Specifications* for *Borrow Excavation*.

HAZARDOUS SPILL BASIN/BIORETENTION BASIN:**Description**

The Contractor shall construct hazardous spill basins/bioretenention basins at locations indicated in the plans, in accordance with the contract documents and as directed by the Engineer.

Construction

Construct hazardous spill basin with bioretention basin in accordance with the plan details and as directed by the Engineer.

Install pipe in accordance with the contract documents.

Perform earthwork in accordance with the contract documents.

Perform all items of work related to Hazardous Spill Basin/Bioretenention Basin construction in accordance with the contract documents.

Measurement and Payment

Payment for the work of constructing the Hazardous Spill Basin/Bioretention Basin will be made at the contract unit price per each for *Hazardous Spill Basin/Bioretention Basin*. Such price and payment will be full compensation for all items within the limits of basin construction including but not limited to earthwork, berms, Drainage Ditch Excavation within the limits of basin construction, pipes entirely within the limits of the basin, drainage structures within the limits of the basin, grates and frames on drainage structures within the limits of the basin, top soil and Bermuda sod within basin construction limits, sod on berm, Class B Rip Rap within the limits of the basin, wall level spreader, Sluice Gates, Underdrain (including wyes, elbows, cleanouts, etc.), #57 Stone, Clean Sand, Impervious Membrane Liner, surveying/DTM file for the basin, basin bypass, Scour Holes within the limits of the basin, Permanent Soil Reinforcement Mat within the limits of the basin, and all incidentals necessary to complete the work.

Drainage Ditch Excavation outside the limits of the basin will be measured and paid for in accordance with Section 240 of the *Standard Specifications*.

Pipe outside the limits of the basin will be measured and paid for in accordance with Section 305 or 310 of the *Standard Specifications*. For pipes which are partially within the limits of the basin construction the entire length of the pipe from the end inside the basin to the end outside the basin will be measured.

Masonry Drainage Structures outside the limits of the basin will be measured and paid for in accordance with Section 840 of the *Standard Specifications*.

Frames with grates on masonry drainage structures outside the limits of the basin will be measured and paid for in accordance with Section 840 of the *Standard Specifications*.

Earthwork performed outside the limits of the basin will be included in the lump sum payment for *Grading*.

Pay Item	Unit
Hazardous Spill Basin/Bioretention Basin	EA

PIPE INSTALLATION:

(11-20-12)

300

SP3 R01

Revise the 2012 *Standard Specifications* as follows:

Page 3-1, Article 300-2, Materials, line 23-24, replace sentence with:

Provide foundation conditioning geotextile in accordance with Section 1056 for Type 4 geotextile.

ASPHALT PAVEMENTS - SUPERPAVE:

(6-19-12) (Rev. 12-17-13)

605, 609, 610, 650

SP6 R01

Revise the *2012 Standard Specifications* as follows:

Page 6-3, Article 605-7 APPLICATION RATES AND TEMPERATURES, replace this article, including Table 601-1, with the following:

Apply tack coat uniformly across the existing surface at target application rates shown in Table 605-1.

TABLE 605-1 APPLICATION RATES FOR TACK COAT	
Existing Surface	Target Rate (gal/sy)
	Emulsified Asphalt
New Asphalt	0.04 ± 0.01
Oxidized or Milled Asphalt	0.06 ± 0.01
Concrete	0.08 ± 0.01

Apply tack coat at a temperature within the ranges shown in Table 605-2. Tack coat shall not be overheated during storage, transport or at application.

TABLE 605-2 APPLICATION TEMPERATURE FOR TACK COAT	
Asphalt Material	Temperature Range
Asphalt Binder, Grade PG 64-22	350 - 400°F
Emulsified Asphalt, Grade RS-1H	130 - 160°F
Emulsified Asphalt, Grade CRS-1	130 - 160°F
Emulsified Asphalt, Grade CRS-1H	130 - 160°F
Emulsified Asphalt, Grade HFMS-1	130 - 160°F
Emulsified Asphalt, Grade CRS-2	130 - 160°F

Page 6-7, Article 609-3 FIELD VERIFICATION OF MIXTURE AND JOB MIX FORMULA ADJUSTMENTS, lines 35-37, delete the second sentence of the second paragraph.

Page 6-18, Article 610-1 DESCRIPTION, lines 40-41, delete the last sentence of the last paragraph.

Page 6-19, Subarticle 610-3(A) Mix Design-General, line 5, add the following as the first paragraph:

Warm mix asphalt (WMA) is allowed for use at the Contractor's option in accordance with the NCDOT Approved Products List for WMA Technologies available at:

<https://connect.ncdot.gov/resources/Materials/MaterialsResources/Warm%20Mix%20Asphalt%20Approved%20List.pdf>

Page 6-21, Subarticle 610-3(C) Job Mix Formula (JMF), replace Table 610-1 with the following:

TABLE 610-1 DESIGN MIXING TEMPERATURE AT THE ASPHALT PLANT^A		
Binder Grade	HMA JMF Temperature	WMA JMF Temperature Range
PG 64-22	300°F	225 - 275°F
PG 70-22	315°F	240 - 290°F
PG 76-22	335°F	260 - 310°F

- A.** The mix temperature, when checked in the truck at the roadway, shall be within plus 15° and minus 25° of the temperature specified on the JMF.

Page 6-21, Subarticle 610-3(C) Job Mix Formula (JMF), lines 4-6, delete first sentence of the second paragraph. Line 7, in the second sentence of the second paragraph, replace “275°F” with “275°F or greater.”

Page 6-22, Article 610-4 WEATHER, TEMPERATURE AND SEASONAL LIMITATIONS FOR PRODUCING AND PLACING ASPHALT MIXTURES, lines 15-17, replace the second sentence of the first paragraph with the following:

Do not place asphalt material when the air or surface temperatures, measured at the location of the paving operation away from artificial heat, do not meet Table 610-5.

Page 6-23, Article 610-4 WEATHER, TEMPERATURE AND SEASONAL LIMITATIONS FOR PRODUCING AND PLACING ASPHALT MIXTURES, replace Table 610-5 with the following:

TABLE 610-5 PLACEMENT TEMPERATURES FOR ASPHALT	
Asphalt Concrete Mix Type	Minimum Surface and Air Temperature
B25.0B, C	35°F
I19.0B, C, D	35°F
SF9.5A, S9.5B	40°F
S9.5C, S12.5C	45°F
S9.5D, S12.5D	50°F

Page 6-26, Article 610-7 HAULING OF ASPHALT MIXTURE, lines 22-23, in the fourth sentence of the first paragraph replace “so as to overlap the top of the truck bed and” with “to”.

Page 6-41, Subarticle 650-3(B) Mix Design Criteria, replace Table 650-1 with the following:

TABLE 650-1 OGAFC GRADATION CRITERIA			
Grading Requirements	Total Percent Passing		
Sieve Size (mm)	Type FC-1	Type FC-1 Modified	Type FC-2 Modified
19.0	-	-	100
12.5	100	100	80 - 100
9.50	75 - 100	75 - 100	55 - 80
4.75	25 - 45	25 - 45	15 - 30
2.36	5 - 15	5 - 15	5 - 15
0.075	1.0 - 3.0	1.0 - 3.0	2.0 - 4.0

ASPHALT PAVER - FIXED STRING LINE:

(10-21-03) (Rev. 1-17-12)

610

SP6 R06A

A fixed string line is required on this project.

ASPHALT BINDER CONTENT OF ASPHALT PLANT MIXES:

(11-21-00) (Rev. 7-17-12)

609

SP6 R15

The approximate asphalt binder content of the asphalt concrete plant mixtures used on this project will be as follows:

Asphalt Concrete Base Course	Type B 25.0	4.4%
Asphalt Concrete Intermediate Course	Type I 19.0	4.8%
Asphalt Concrete Surface Course	Type S 4.75A	6.8%
Asphalt Concrete Surface Course	Type SA-1	6.8%
Asphalt Concrete Surface Course	Type SF 9.5A	6.7%
Asphalt Concrete Surface Course	Type S 9.5	6.0%
Asphalt Concrete Surface Course	Type S 12.5	5.6%

The actual asphalt binder content will be established during construction by the Engineer within the limits established in the *2012 Standard Specifications*.

ASPHALT PLANT MIXTURES:

(7-1-95)

609

SP6 R20

Place asphalt concrete base course material in trench sections with asphalt pavement spreaders made for the purpose or with other equipment approved by the Engineer.

PRICE ADJUSTMENT - ASPHALT BINDER FOR PLANT MIX:

(11-21-00)

620

SP6 R25

Price adjustments for asphalt binder for plant mix will be made in accordance with Section 620 of the *2012 Standard Specifications*.

The base price index for asphalt binder for plant mix is \$ **562.19** per ton.

This base price index represents an average of F.O.B. selling prices of asphalt binder at supplier's terminals on **December 1, 2013**.

FINAL SURFACE TESTING NOT REQUIRED:

(5-18-04) (Rev. 5-15-12)

610

SP6 R45

Final surface testing is not required on this project.

SLUICE GATE:

(7-1-95) (Rev. 3-17-09)

838

SP8 R20(Rev)

Description

This work consists of the construction of a sluice gate in accordance with the details in the plans, the applicable requirements of Section 838 of the *2012 Standard Specifications*, in accordance with the manufacturer's recommendations and as directed by the Engineer.

Materials

Sluice gates shall meet the manufacturer's recommendations for the corresponding pipe size. Due to variations in individual manufacturer's products, a slight variation from the size specified may be allowed. Submit the proposed catalog cut to the Engineer for approval prior to use.

Construction Methods

Provide a gate that forms a watertight seal when closed.

Measurement and Payment

Payment for sluice gates will be included in the price per each for Hazardous Spill Basin/Bioretention Basin. Such prices and payment will be full compensation for all materials, labor, tools, equipment and incidentals necessary to complete the work.

72" CHAIN LINK FENCE WITH SLATS:

SPI

Description

The work covered by this item shall consist of furnishing and installing 72" chain link fence with HDPE 1 3/32" slats/panels.

Materials

Refer to Article 866-2 of the *Standard Specifications*.

HDPE fence slats shall be extruded with integral brown pigment and have UV inhibitors specifically designed to retard the harmful effects of the sun. Density of material shall be between 0.914 and 0.960 for maximum strength and slats shall conform to all applicable manufacturers' standards for the product used.

Construction Methods

Install chain link fence in accordance with Section 866 of the *Standard Specifications*.

Install fence slats as indicated in the plans, manufacturer's instructions, and as directed by the Engineer.

Measurement and Payment

72" Chain Link Fence With Slats will be measure and paid in linear feet of fence measured in place from center of each post or gate post to center of end post or gate post exclusive of gate sections that has been completed and accepted.

Work includes, but is not limited to, clearing and grading, furnishing and installing fence fabric, HDPE slats, tie wires, stretcher bars, top rails, tension wire, posts and post braces, concrete, fittings and all other incidentals necessary to compete the work.

Payment will be made under:

Pay Item

72"Chain Link Fence With Slats

Pay Unit

Linear Foot

PREFORMED SCOUR HOLE WITH LEVEL SPREADER APRON:

(10-15-02) (Rev. 10-20-09)

410

SP8 R105

Description

Construct and maintain preformed scour holes with spreader aprons at the locations shown on the plans and in accordance with the details in the plans. Work includes excavation, shaping and maintaining the hole and apron, furnishing and placing filter fabric, rip rap (class as specified in the plans) and permanent soil reinforcement matting.

Materials**Item**

Plain Rip Rap
Filter Fabric

Section

1042
1056

The permanent soil reinforcement matting shall be permanent erosion control reinforcement mat and shall be constructed of synthetic or a combination of coconut and synthetic fibers evenly distributed throughout the mat between a bottom UV stabilized netting and a heavy duty UV stabilized top net. The matting shall be stitched together with UV stabilized polypropylene

thread to form a permanent three dimensional structure. The mat shall have the following minimum physical properties:

Property	Test Method	Value Unit
Light Penetration	ASTM D6567	9 %
Thickness	ASTM D6525	0.40 in
Mass Per Unit Area	ASTM D6566	0.55 lb/sy
Tensile Strength	ASTM D6818	385 lb/ft
Elongation (Maximum)	ASTM D6818	49 %
Resiliency	ASTM D1777	>70 %
UV Stability *	ASTM 4355	≥80 %
Porosity (Permanent Net)	ECTC Guidelines	≥85 %
Maximum Permissible Shear Stress (Vegetated)	Performance Bench Test	≥8.0 lb/ft ²
Maximum Allowable Velocity (Vegetated)	Performance Bench Test	≥16.0 ft/s

*ASTM D1682 Tensile Strength and % strength retention of material after 1,000 hours of exposure.

Submit a certification (Type 1, 2, or 3) from the manufacturer showing:

- (A) The chemical and physical properties of the mat used, and
- (B) Conformance of the mat with this specification.

Construction Methods

All areas to be protected with the mat shall be brought to final grade and seeded in accordance with Section 1660 of the *2012 Standard Specifications*. The surface of the soil shall be smooth, firm, stable and free of rocks, clods, roots or other obstructions that would prevent the mat from lying in direct contact with the soil surface. Areas where the mat is to be placed will not need to be mulched.

Measurement and Payment

Performed Scour Holes with Level Spreader Aprons will be measured and paid as the actual number incorporated into the completed and accepted work. Such price and payment will be full compensation for all work covered by this provision.

Payment will be made under:

Pay Item
Preformed Scour Hole with Level Spreader Aprons

Pay Unit
Each

DETECTABLE WARNINGS FOR PROPOSED CURB RAMPS:

(6-15-10) (Rev. 8-16-11)

848

SP8 R126

Description

Construct detectable warnings consisting of integrated raised truncated domes on proposed concrete curb ramps in accordance with the *2012 Standard Specifications*, plan details, the requirements of the *28 CFR Part 36 ADA Standards for Accessible Design* and this provision.

Materials

Detectable warning for proposed curb ramps shall consist of integrated raised truncated domes. The description, size and spacing shall conform to Section 848 of the *2012 Standard Specifications*.

Use material for detectable warning systems as shown herein. Material and coating specifications must be stated in the Manufacturers Type 3 Certification and all Detectable Warning systems must be on the NCDOT Approved Products List.

Install detectable warnings created from one of the following materials: precast concrete blocks or bricks, clay paving brick, gray or ductile iron castings, mild steel, stainless steel, and engineered plastics, rubber or composite tile. Only one material type for detectable warning will be permitted per project, unless otherwise approved by the Engineer.

- (A) Detectable Warnings shall consist of a base with integrated raised truncated domes, and when constructed of precast concrete they shall conform to the material requirements of Article 848-2 of the *2012 Standard Specifications*.
- (B) Detectable Warnings shall consist of a base with integrated raised truncated domes, and may be comprised of other materials including, but not limited, to clay paving brick, gray iron or ductile iron castings, mild steel, stainless steel, and engineered plastics, rubber or composite tile, which are cast into the concrete of the curb ramps. The material shall have an integral color throughout the thickness of the material. The detectable warning shall include fasteners or anchors for attachment in the concrete and shall be furnished as a system from the manufacturer.

Prior to installation, the Contractor shall submit to the Engineer assembling instructions from the manufacturer for each type of system used in accordance with Article 105-2 of the *2012 Standard Specifications*. The system shall be furnished as a kit containing all consumable materials and consumable tools, required for the application. They shall be capable of being affixed to or anchored in the concrete curb ramp, including green concrete (concrete that has set but not appreciably hardened). The system shall be solvent free and contain no volatile organic compounds (VOC). The static coefficient of friction shall be 0.8 or greater when measured on top of the truncated domes and when measured between the domes in accordance with ASTM C1028 (dry and wet). The system shall be resistant to deterioration due to exposure to sunlight, water, salt or adverse weather conditions and impervious to degradation by motor fuels, lubricants and antifreeze.

- (C) When steel or gray iron or ductile iron casting products are provided, only products that meet the requirements of Subarticle 106-1(B) of the *2012 Standard Specifications* may be used. Submit to the Engineer a Type 6 Certification, catalog cuts and installation procedures at least 30 days prior to installation for all.

Construction Methods

- (A) Prior to placing detectable warnings in proposed concrete curb ramps, adjust the existing subgrade to the proper grade and in accordance with Article 848-3 of the *2012 Standard Specifications*.
- (B) Install all detectable warning in proposed concrete curb ramps in accordance with the manufacturer's recommendations.

Measurement and Payment

Detectable Warnings installed for construction of proposed curb ramps will not be paid for separately. Such payment will be included in the price bid for *Concrete Curb Ramps*.

FOUNDATIONS AND ANCHOR ROD ASSEMBLIES FOR METAL POLES:

(1-17-12) (Rev. 5-21-13)

9, 14, 17

SP9 R05

Description

Foundations for metal poles include foundations for signals, cameras, overhead and dynamic message signs (DMS) and high mount and low level light standards supported by metal poles or upright trusses. Foundations consist of footings with pedestals and drilled piers with or without grade beams or wings. Anchor rod assemblies consist of anchor rods (also called anchor bolts) with nuts and washers on the exposed ends of rods and nuts and a plate or washers on the other ends of rods embedded in the foundation.

Construct concrete foundations with the required resistances and dimensions and install anchor rod assemblies in accordance with the contract and accepted submittals. Construct drilled piers consisting of cast-in-place reinforced concrete cylindrical sections in excavated holes. Provide temporary casings or polymer slurry as needed to stabilize drilled pier excavations. Use a prequalified Drilled Pier Contractor to construct drilled piers for metal poles. Define "excavation" and "hole" as a drilled pier excavation and "pier" as a drilled pier.

This provision does not apply to materials and anchor rod assemblies for standard foundations for low level light standards. See Section 1405 of the *2012 Standard Specifications* and Standard Drawing No. 1405.01 of the *2012 Roadway Standard Drawings* for materials and anchor rod assemblies for standard foundations. For construction of standard foundations for low level light standards, standard foundations are considered footings in this provision.

This provision does not apply to foundations for signal pedestals; see Section 1743 of the *2012 Standard Specifications* and Standard Drawing No. 1743.01 of the *2012 Roadway Standard Drawings*.

Materials

Refer to the *2012 Standard Specifications*.

Item	Section
Conduit	1091-3
Grout, Nonshrink	1003
Polymer Slurry	411-2(B)
Portland Cement Concrete	1000
Reinforcing Steel	1070
Rollers and Chairs	411-2(C)
Temporary Casings	411-2(A)

Provide Type 3 material certifications in accordance with Article 106-3 of the *2012 Standard Specifications* for conduit, rollers, chairs and anchor rod assemblies. Store steel materials on blocking at least 12" above the ground and protect it at all times from damage; and when placing in the work make sure it is free from dirt, dust, loose mill scale, loose rust, paint, oil or other foreign materials. Load, transport, unload and store foundation and anchor rod assembly materials so materials are kept clean and free of damage. Bent, damaged or defective materials will be rejected.

Use conduit type in accordance with the contract. Use Class A concrete for footings and pedestals, Class Drilled Pier concrete for drilled piers and Class AA concrete for grade beams and wings including portions of drilled piers above bottom of wings elevations. Corrugated temporary casings may be accepted at the discretion of the Engineer. A list of approved polymer slurry products is available from:

connect.ncdot.gov/resources/Geological/Pages/Products.aspx

Provide anchor rod assemblies in accordance with the contract consisting of the following:

- (A) Straight anchor rods,
- (B) Heavy hex top and leveling nuts and flat washers on exposed ends of rods, and
- (C) Nuts and either flat plates or washers on the other ends of anchor rods embedded in foundations.

Do not use lock washers. Use steel anchor rods, nuts and washers that meet ASTM F1554 for Grade 55 rods and Grade A nuts. Use steel plates and washers embedded in concrete with a thickness of at least 1/4". Galvanize anchor rods and exposed nuts and washers in accordance with Article 1076-4 of the *2012 Standard Specifications*. It is not necessary to galvanize nuts, plates and washers embedded in concrete.

Construction Methods

Install the required size and number of conduits in foundations in accordance with the plans and accepted submittals. Construct top of piers, footings, pedestals, grade beams and wings flat, level and within 1" of elevations shown in the plans or approved by the Engineer. Provide an Ordinary Surface finish in accordance with Subarticle 825-6(B) of the *2012 Standard Specifications* for portions of foundations exposed above finished grade. Do not remove anchor bolt templates or pedestal or grade beam forms or erect metal poles or upright trusses onto foundations until concrete attains a compressive strength of at least 3,000 psi.

(A) Drilled Piers

Before starting drilled pier construction, hold a predrill meeting to discuss the installation, monitoring and inspection of the drilled piers. Schedule this meeting after the Drilled Pier Contractor has mobilized to the site. The Resident or Division Traffic Engineer, Contractor and Drilled Pier Contractor Superintendent will attend this predrill meeting.

Do not excavate holes, install piles or allow equipment wheel loads or vibrations within 20 ft of completed piers until 16 hours after Drilled Pier concrete reaches initial set.

Check for correct drilled pier alignment and location before beginning drilling. Check plumbness of holes frequently during drilling.

Construct drilled piers with the minimum required diameters shown in the plans. Install piers with tip elevations no higher than shown in the plans or approved by the Engineer.

Excavate holes with equipment of the sizes required to construct drilled piers. Depending on the subsurface conditions encountered, drilling through rock and boulders may be required. Do not use blasting for drilled pier excavations.

Contain and dispose of drilling spoils and waste concrete as directed and in accordance with Section 802 of the *2012 Standard Specifications*. Drilling spoils consist of all materials and fluids removed from excavations.

If unstable, caving or sloughing materials are anticipated or encountered, stabilize holes with temporary casings and/or polymer slurry. Do not use telescoping temporary casings. If it becomes necessary to replace a temporary casing during drilling, backfill the excavation, insert a larger casing around the casing to be replaced or stabilize the excavation with polymer slurry before removing the temporary casing.

If temporary casings become stuck or the Contractor proposes leaving casings in place, temporary casings should be installed against undisturbed material. Unless otherwise approved, do not leave temporary casings in place for mast arm poles and cantilever signs. The Engineer will determine if casings may remain in place. If the Contractor proposes leaving temporary casings in place, do not begin drilling until a casing installation method is approved.

Use polymer slurry and additives to stabilize holes in accordance with the slurry manufacturer's recommendations. Provide mixing water and equipment suitable for polymer slurry. Maintain polymer slurry at all times so slurry meets Table 411-3 of the *2012 Standard Specifications* except for sand content.

Define a "sample set" as slurry samples collected from mid-height and within 2 ft of the bottom of holes. Take sample sets from excavations to test polymer slurry immediately after filling holes with slurry, at least every 4 hours thereafter and immediately before placing concrete. Do not place Drilled Pier concrete until both slurry samples from an excavation meet the required polymer slurry properties. If any slurry test results do not meet the requirements, the Engineer may suspend drilling until both samples from a sample set meet the required slurry properties.

Remove soft and loose material from bottom of holes using augers to the satisfaction of the Engineer. Assemble rebar cages and place cages and Drilled Pier concrete in accordance with Subarticle 411-4(E) of the *2012 Standard Specifications* except for the following:

- (1) Inspections for tip resistance and bottom cleanliness are not required,
- (2) Temporary casings may remain in place if approved, and
- (3) Concrete placement may be paused near the top of pier elevations for anchor rod assembly installation and conduit placement or
- (4) If applicable, concrete placement may be stopped at bottom of grade beam or wings elevations for grade beam or wing construction.

If wet placement of concrete is anticipated or encountered, do not place Drilled Pier concrete until a concrete placement procedure is approved. If applicable, temporary casings and fluids may be removed when concrete placement is paused or stopped in accordance with the exceptions above provided holes are stable. Remove contaminated concrete from exposed Drilled Pier concrete after removing casings and fluids. If holes are unstable, do not remove temporary casings until a procedure for placing anchor rod assemblies and conduit or constructing grade beams or wings is approved.

Use collars to extend drilled piers above finished grade. Remove collars after Drilled Pier concrete sets and round top edges of piers.

If drilled piers are questionable, pile integrity testing (PIT) and further investigation may be required in accordance with Article 411-5 of the *2012 Standard Specifications*. A drilled pier will be considered defective in accordance with Subarticle 411-5(D) of the *2012 Standard Specifications* and drilled pier acceptance is based in part on the criteria in Article 411-6 of the *2012 Standard Specifications* except for the top of pier tolerances in Subarticle 411-6(C) of the *2012 Standard Specifications*.

If a drilled pier is under further investigation, do not grout core holes, backfill around the pier or perform any work on the drilled pier until the Engineer accepts the pier. If the drilled pier is accepted, dewater and grout core holes and backfill around the pier with

approved material to finished grade. If the Engineer determines a pier is unacceptable, remediation is required in accordance with Article 411-6 of the *2012 Standard Specifications*. No extension of completion date or time will be allowed for remediation of unacceptable drilled piers or post repair testing.

Permanently embed a plate in or mark top of piers with the pier diameter and depth, size and number of vertical reinforcing bars and the minimum compressive strength of the concrete mix at 28 days.

(B) Footings, Pedestals, Grade Beams and Wings

Excavate as necessary for footings, grade beams and wings in accordance with the plans, accepted submittals and Section 410 of the *2012 Standard Specifications*. If unstable, caving or sloughing materials are anticipated or encountered, shore foundation excavations as needed with an approved method. Notify the Engineer when foundation excavation is complete. Do not place concrete or reinforcing steel until excavation dimensions and foundation material are approved.

Construct cast-in-place reinforced concrete footings, pedestals, grade beams and wings with the dimensions shown in the plans and in accordance with Section 825 of the *2012 Standard Specifications*. Use forms to construct portions of pedestals and grade beams protruding above finished grade. Provide a chamfer with a 3/4" horizontal width for pedestal and grade beam edges exposed above finished grade. Backfill and fill in accordance with Article 410-8 of the *2012 Standard Specifications*. Proper compaction around footings and wings is critical for foundations to resist uplift and torsion forces. Place concrete against undisturbed soil and do not use forms for standard foundations for low level light standards.

(C) Anchor Rod Assemblies

Size anchor rods for design and the required projection above top of foundations. Determine required anchor rod projections from nut, washer and base plate thicknesses, the protrusion of 3 to 5 anchor rod threads above top nuts after tightening and the distance of one nut thickness between top of foundations and bottom of leveling nuts.

Protect anchor rod threads from damage during storage and installation of anchor rod assemblies. Before placing anchor rods in foundations, turn nuts onto and off rods past leveling nut locations. Turn nuts with the effort of one workman using an ordinary wrench without a cheater bar. Report any thread damage to the Engineer that requires extra effort to turn nuts.

Arrange anchor rods symmetrically about center of base plate locations as shown in the plans. Set anchor rod elevations based on required projections above top of foundations. Securely brace and hold rods in the correct position, orientation and alignment with a steel template. Do not weld to reinforcing steel, temporary casings or anchor rods.

Install top and leveling (bottom) nuts, washers and the base plate for each anchor rod assembly in accordance with the following procedure:

- (1) Turn leveling nuts onto anchor rods to a distance of one nut thickness between the top of foundation and bottom of leveling nuts. Place washers over anchor rods on top of leveling nuts.
- (2) Determine if nuts are level using a flat rigid template on top of washers. If necessary, lower leveling nuts to level the template in all directions or if applicable, lower nuts to tilt the template so the metal pole or upright truss will lean as shown in the plans. If leveling nuts and washers are not in full contact with the template, replace washers with galvanized beveled washers.
- (3) Verify the distance between the foundation and leveling nuts is no more than one nut thickness.
- (4) Place base plate with metal pole or upright truss over anchor rods on top of washers. High mount luminaires may be attached before erecting metal poles but do not attach cables, mast arms or trusses to metal poles or upright trusses at this time.
- (5) Place washers over anchor rods on top of base plate. Lubricate top nut bearing surfaces and exposed anchor rod threads above washers with beeswax, paraffin or other approved lubricant.
- (6) Turn top nuts onto anchor rods. If nuts are not in full contact with washers or washers are not in full contact with the base plate, replace washers with galvanized beveled washers.
- (7) Tighten top nuts to snug-tight with the full effort of one workman using a 12" wrench. Do not tighten any nut all at once. Turn top nuts in increments. Follow a star pattern cycling through each nut at least twice.
- (8) Repeat (7) for leveling nuts.
- (9) Replace washers above and below the base plate with galvanized beveled washers if the slope of any base plate face exceeds 1:20 (5%), any washer is not in firm contact with the base plate or any nut is not in firm contact with a washer. If any washers are replaced, repeat (7) and (8).
- (10) With top and leveling nuts snug-tight, mark each top nut on a corner at the intersection of 2 flats and a corresponding reference mark on the base plate. Mark top nuts and base plate with ink or paint that is not water-soluble. Use the turn-of-nut method for pretensioning. Do not pretension any nut all at once. Turn top nuts in increments for a total turn that meets the following nut rotation requirements:

NUT ROTATION REQUIREMENTS (Turn-of-Nut Pretensioning Method)	
Anchor Rod Diameter, inch	Requirement
$\leq 1 \frac{1}{2}$	1/3 turn (2 flats)
$> 1 \frac{1}{2}$	1/6 turn (1 flat)

Follow a star pattern cycling through each top nut at least twice.

- (11) Ensure nuts, washers and base plate are in firm contact with each other for each anchor rod. Cables, mast arms and trusses may now be attached to metal poles and upright trusses.
- (12) Between 4 and 14 days after pretensioning top nuts, use a torque wrench calibrated within the last 12 months to check nuts in the presence of the Engineer. Completely erect mast arm poles and cantilever signs and attach any hardware before checking top nuts for these structures. Check that top nuts meet the following torque requirements:

TORQUE REQUIREMENTS	
Anchor Rod Diameter, inch	Requirement, ft-lb
7/8	180
1	270
1 1/8	380
1 1/4	420
$\geq 1 \frac{1}{2}$	600

If necessary, retighten top nuts in the presence of the Engineer with a calibrated torque wrench to within ± 10 ft-lb of the required torque. Do not overtighten top nuts.

- (13) Do not grout under base plate.

Measurement and Payment

Foundations and anchor rod assemblies for metal poles and upright trusses will be measured and paid for elsewhere in the contract.

No payment will be made for temporary casings that remain in drilled pier excavations. No payment will be made for PIT. No payment will be made for further investigation of defective piers. Further investigation of piers that are not defective will be paid as extra work in accordance with Article 104-7 of the *2012 Standard Specifications*. No payment will be made for remediation of unacceptable drilled piers or post repair testing.

MATERIALS:

(2-21-12) (Rev. 1-21-14)

1000, 1005, 1024, 1050, 1056, 1074, 1078, 1080, 1081, 1086, 1084, 1087, 1092

SP10 R01

Revise the *2012 Standard Specifications* as follows:

Page 10-1, Article 1000-1, DESCRIPTION, lines 9-10, replace the last sentence of the first paragraph with the following:

Type IL, IP, IS or IT blended cement may be used instead of Portland cement.

Page 10-1, Article 1000-1, DESCRIPTION, line 14, add the following:

Use materials which do not produce a mottled appearance through rusting or other staining of the finished concrete surface.

Page 10-1, Article 1000-2, MATERIALS, line 16, add the following to the table of item references:

Item

Type IL Blended Cement

Section

1024-1

Page 10-5, Table 1000-1, REQUIREMENTS FOR CONCRETE, replace with the following:

TABLE 1000-1 REQUIREMENTS FOR CONCRETE											
Class of Concrete	Min. Comp. Strength at 28 days	Maximum Water-Cement Ratio				Consistency Max. Slump		Cement Content			
		Air-Entrained Concrete		Non Air-Entrained Concrete		Vibrated	Non-Vibrated	Vibrated		Non- Vibrated	
		Rounded Aggregate	Angular Aggregate	Rounded Aggregate	Angular Aggregate			Min.	Max.	Min.	Max.
<i>Units</i>	<i>psi</i>					<i>inch</i>	<i>inch</i>	<i>lb/cy</i>	<i>lb/cy</i>	<i>lb/cy</i>	<i>lb/cy</i>
AA	4,500	0.381	0.426	-	-	3.5	-	639	715	-	-
AA Slip Form	4,500	0.381	0.426	-	-	1.5	-	639	715	-	-
Drilled Pier	4,500	-	-	0.450	0.450	-	5-7 dry 7-9 wet	-	-	640	800
A	3,000	0.488	0.532	0.550	0.594	3.5	4	564	-	602	-
B	2,500	0.488	0.567	0.559	0.630	2.5	4	508	-	545	-
B Slip Formed	2,500	0.488	0.567	-	-	1.5	-	508	-	-	-
Sand Light-weight	4,500	-	0.420	-	-	4	-	715	-	-	-
Latex Modified	3,000 7 day	0.400	0.400	-	-	6	-	658	-	-	-
Flowable Fill excavatable	150 max. at 56 days	as needed	as needed	as needed	as needed	-	Flowable	-	-	40	100
Flowable Fill non-excavatable	125	as needed	as needed	as needed	as needed	-	Flowable	-	-	100	as needed
Pavement	4,500 design, field 650 flexural, design only	0.559	0.559	-	-	1.5 slip form 3.0 hand place	-	526	-	-	-
Precast	See Table 1077-1	as needed	as needed	-	-	6	as needed	as needed	as needed	as needed	as needed
Prestress	per contract	See Table 1078-1	See Table 1078-1	-	-	8	-	564	as needed	-	-

Page 10-23, Table 1005-1, AGGREGATE GRADATION-COARSE AGGREGATE, replace with the following:

TABLE 1005-1 AGGREGATE GRADATION - COARSE AGGREGATE													
Percentage of Total by Weight Passing													
Std. Size #	2"	1 1/2"	1"	3/4"	1/2"	3/8"	#4	#8	#10	#16	#40	#200	Remarks
4	100	90-100	20-55	0-15	-	0-5	-	-	-	-	-	A	Asphalt Plant Mix
467M	100	95-100	-	35-70	-	0-30	0-5	-	-	-	-	A	Asphalt Plant Mix
5	-	100	90-100	20-55	0-10	0-5	-	-	-	-	-	A	AST, Sediment Control Stone
57	-	100	95-100	-	25-60	-	0-10	0-5	-	-	-	A	AST, Str. Concrete, Shoulder Drain, Sediment Control Stone
57M	-	100	95-100	-	25-45	-	0-10	0-5	-	-	-	A	AST, Concrete Pavement
6M	-	-	100	90-100	20-55	0-20	0-8	-	-	-	-	A	AST
67	-	-	100	90-100	-	20-55	0-10	0-5	-	-	-	A	AST, Str. Concrete, Asphalt Plant Mix
78M	-	-	-	100	98-100	75-100	20-45	0-15	-	-	-	A	Asphalt Plant Mix, AST, Str. Conc. Weep Hole Drains
14M	-	-	-	-	-	100	35-70	5-20	-	0-8	-	A	Asphalt Plant Mix, AST, Weep Hole Drains, Str. Concrete
9	-	-	-	-	-	100	85-100	10-40	-	0-10	-	A	AST
ABC	-	100	75-97	-	55-80	-	35-55	-	25-45	-	14-30	4-12 ^B	Aggregate Base Course, Aggregate Stabilization
ABC (M)	-	100	75-100	-	45-79	-	20-40	-	0-25	-	-	0-12 ^B	Maintenance Stabilization
Light-weight C	-	-	-	-	100	80-100	5-40	0-20	-	0-10	-	0-2.5	AST

- A. See Subarticle 1005-4(A).
 B. See Subarticle 1005-4(B).
 C. For Lightweight Aggregate used in Structural Concrete, see Subarticle 1014-2(E)(6).

Page 10-46, Article 1024-1, PORTLAND CEMENT, line 33, add the following as the ninth paragraph:

Use Type IL blended cement that meets AASHTO M 240, except that the limestone content is limited to between 5 and 12% by weight and the constituents shall be interground. Class F fly ash can replace a portion of Type IL blended cement and shall be replaced as outlined in Subarticle 1000-4(I) for Portland cement. For mixes that contain cement with alkali content between 0.6% and 1.0% and for mixes that contain a reactive aggregate documented by the Department, use a pozzolan in the amount shown in Table 1024-1.

Page 10-65, Article 1050-1, GENERAL, line 41, replace the first sentence with the following:

All fencing material and accessories shall meet Section 106.

Page 10-73, Article 1056-1 DESCRIPTION, lines 7-8, delete the first sentence of the second paragraph and replace with the following:

Use geotextile fabrics that are on the NCDOT Approved Products List.

Page 10-73, Article 1056-2 HANDLING AND STORING, line 17, replace “mechanically stabilized earth (MSE) wall faces” with “temporary wall faces”.

Page 10-74, TABLE 1056-1 GEOTEXTILE REQUIREMENTS, replace table with the following:

TABLE 1056-1 GEOTEXTILE REQUIREMENTS						
Property	Requirement (MARV^A)					Test Method
	Type 1	Type 2	Type 3^B	Type 4	Type 5^C	
<i>Typical Application</i>	<i>Shoulder Drains</i>	<i>Under Rip Rap</i>	<i>Temporary Silt Fence</i>	<i>Soil Stabilization</i>	<i>Temporary Walls</i>	
Elongation (MD & CD)	≥ 50%	≥ 50%	≤ 25%	< 50%	< 50%	ASTM D4632
Grab Strength (MD & CD)	Table 1 ^D , Class 3	Table 1 ^D , Class 1	100 lb	Table 1 ^D , Class 3	-	ASTM D4632
Tear Strength (MD & CD)			-		-	ASTM D4533
Puncture Strength			-		-	ASTM D6241
Ultimate Tensile Strength (MD & CD)	-	-	-	-	2,400 lb/ft (unless required otherwise in the contract)	ASTM D4595
Permittivity	Table 2 ^D , 15% to 50% in Situ Soil Passing No. 200 ^E		Table 7 ^D	Table 5 ^D	0.20 sec ⁻¹	ASTM D4491
Apparent Opening Size					No. 30 ^E	ASTM D4751
UV Stability (Retained Strength)					70%	ASTM D4355

- A. MARV does not apply to elongation
- B. Minimum roll width of 36" required
- C. Minimum roll width of 13 ft required
- D. AASHTO M 288
- E. US Sieve No. per AASHTO M 92

Page 10-115, Subarticle 1074-7(B), Gray Iron Castings, lines 10-11, replace with the first two sentences with the following:

Supply gray iron castings meeting all facets of AASHTO M 306 excluding proof load. Proof load testing will only be required for new casting designs during the design process, and conformance to M306 loading (40,000 lbs.) will be required only when noted on the design documents.

Page 10-126, Table 1078-1, REQUIREMENTS FOR CONCRETE, replace with the following:

TABLE 1078-1 REQUIREMENTS FOR CONCRETE		
Property	28 Day Design Compressive Strength 6,000 psi or less	28 Day Design Compressive Strength greater than 6,000 psi
Maximum Water/Cementitious Material Ratio	0.45	0.40
Maximum Slump without HRWR	3.5"	3.5"
Maximum Slump with HRWR	8"	8"
Air Content (upon discharge into forms)	5 + 2%	5 + 2%

Page 10-151, Article 1080-4 Inspection and Sampling, lines 18-22, replace (B), (C) and (D) with the following:

- (B) At least 3 panels prepared as specified in 5.5.10 of AASHTO M 300, Bullet Hole Immersion Test.
- (C) At least 3 panels of 4"x6"x1/4" for the Elcometer Adhesion Pull Off Test, ASTM D4541.
- (D) A certified test report from an approved independent testing laboratory for the Salt Fog Resistance Test, Cyclic Weathering Resistance Test, and Bullet Hole Immersion Test as specified in AASHTO M 300.
- (E) A certified test report from an approved independent testing laboratory that the product has been tested for slip coefficient and meets AASHTO M253, Class B.

Page 10-161, Subarticle 1081-1(A) Classifications, lines 29-33, delete first 3 sentences of the description for Type 2 and replace with the following:

Type 2 - A low-modulus, general-purpose adhesive used in epoxy mortar repairs. It may be used to patch spalled, cracked or broken concrete where vibration, shock or expansion and contraction are expected.

Page 10-162, Subarticle 1081-1(A) Classifications, lines 4-7, delete the second and third sentences of the description for Type 3A. **Lines 16-22**, delete Types 6A, 6B and 6C.

Page 10-162, Subarticle 1081-1(B) Requirements, lines 26-30, replace the second paragraph with the following:

For epoxy resin systems used for embedding dowel bars, threaded rods, rebar, anchor bolts and other fixtures in hardened concrete, the manufacturer shall submit test results showing that the bonding system will obtain 125% of the specified required yield strength of the fixture. Furnish certification that, for the particular bolt grade, diameter and embedment depth required, the

anchor system will not fail by adhesive failure and that there is no movement of the anchor bolt. For certification and anchorage, use 3,000 psi as the minimum Portland cement concrete compressive strength used in this test. Use adhesives that meet Section 1081.

List the properties of the adhesive on the container and include density, minimum and maximum temperature application, setting time, shelf life, pot life, shear strength and compressive strength.

Page 10-163, Table 1081-1 Properties of Mixed Epoxy Resin Systems, replace table with the following:

Table 1081-1 Properties of Mixed Epoxy Resin Systems						
Property	Type 1	Type 2	Type 3	Type 3A	Type 4A	Type 4B
Viscosity-Poises at 77°F ± 2°F	Gel	10-30	25-75	Gel	40-150	40-150
Spindle No.	-	3	4	--	4	4
Speed (RPM)	-	20	20	--	10	10
Pot Life (Minutes)	20-50	30-60	20-50	5-50	40-80	40-80
Minimum Tensile Strength at 7 days (psi)	1,500	2,000	4,000	4,000	1,500	1,500
Tensile Elongation at 7 days (%)	30 min.	30 min.	2-5	2-5	5-15	5-15
Min. Compressive Strength of 2" mortar cubes at 24 hours	3,000 (Neat)	4,000-	6,000-	6,000 (Neat)	3,000	3,000
Min. Compressive Strength of 2" mortar cubes at 7 days	5,000 (Neat)	-	-	-	-	5,000
Maximum Water Absorption (%)	1.5	1.0	1.0	1.5	1.0	1.0
Min. Bond Strength Slant Shear Test at 14 days (psi)	1,500	1,500	2,000	2,000	1,500	1,500

Page 10-164, Subarticle 1081-1(E) Prequalification, lines 31-33, replace the second sentence of the first paragraph with the following:

Manufacturers choosing to supply material for Department jobs must submit an application through the Value Management Unit with the following information for each type and brand name:

Page 10-164, Subarticle 1081-1(E)(3), line 37, replace this subarticle with the following:

(3) Type of the material in accordance with Articles 1081-1 and 1081-4,

Page 10-165, Subarticle 1081-1(E)(6), line 1, in the first sentence of the first paragraph replace “AASHTO M 237” with “the specifications”.

Page 10-165, Subarticle 1081-1(E) Prequalification, line 9-10, delete the second sentence of the last paragraph.

Page 10-165, Subarticle 1081-1(F) Acceptance, line 14, in the first sentence of the first paragraph replace “Type 1” with “Type 3”.

Page 10-169, Subarticle 1081-3(G) Anchor Bolt Adhesives, delete this subarticle.

Page 10-170, Article 1081-3 Hot Bitumen, line 9, add the following at the end of Section 1081:

1081-4 EPOXY RESIN ADHESIVE FOR BONDING TRAFFIC MARKINGS

(A) General

This section covers epoxy resin adhesive for bonding traffic markers to pavement surfaces.

(B) Classification

The types of epoxies and their uses are as shown below:

Type I – Rapid Setting, High Viscosity, Epoxy Adhesive. This type of adhesive provides rapid adherence to traffic markers to the surface of pavement.

Type II – Standard Setting, High Viscosity, Epoxy Adhesive. This type of adhesive is recommended for adherence of traffic markers to pavement surfaces when rapid set is not required.

Type III – Rapid Setting, Low Viscosity, Water Resistant, Epoxy Adhesive. This type of rapid setting adhesive, due to its low viscosity, is appropriate only for use with embedded traffic markers.

Type IV – Standard Set Epoxy for Blade Deflecting-Type Plowable Markers.

(C) Requirements

Epoxies shall conform to the requirements set forth in AASHTO M 237.

(D) Prequalification

Refer to Subarticle 1081-1(E).

(E) Acceptance

Refer to Subarticle 1081-1(F).

Page 10-173, Article 1084-2 STEEL SHEET PILES, lines 37-38, replace first paragraph with the following:

Steel sheet piles detailed for permanent applications shall be hot rolled and meet ASTM A572 or ASTM A690 unless otherwise required by the plans. Steel sheet piles shall be coated as required by the plans. Galvanized sheet piles shall be coated in accordance with Section 1076.

Metallized sheet piles shall be metallized in accordance to the Project Special Provision "Thermal Sprayed Coatings (Metallization)" with an 8 mil, 99.9% aluminum alloy coating and a 0.5 mil seal coating. Any portion of the metallized sheet piling encased in concrete shall receive a barrier coat. The barrier coat shall be an approved waterborne coating with a low-viscosity which readily absorbs into the pores of the aluminum thermal sprayed coating.

The waterborne coating shall be applied at a spreading rate that results in a theoretical 1.5 mil dry film thickness. The manufacturer shall issue a letter of certification that the resin chemistry of the waterborne coating is compatible with the 99.9% aluminum thermal sprayed alloy and suitable for tidal water applications.

Page 10-174, Subarticle 1086-1(B)(1) Epoxy, lines 18-24, replace this subarticle with the following:

The epoxy shall meet Article 1081-4.

The 2 types of epoxy adhesive which may be used are Type I, Rapid Setting, and Type II, Standard Setting. Use Type II when the pavement temperature is above 60°F or per the manufacturer's recommendations whichever is more stringent. Use Type I when the pavement temperature is between 50°F and 60°F or per the manufacturer's recommendations whichever is more stringent. Epoxy adhesive Type I, Cold Set, may be used to attach temporary pavement markers to the pavement surface when the pavement temperature is between 32°F and 50°F or per the manufacturer's recommendations whichever is more stringent.

Page 10-175, Subarticle 1086-2(E) Epoxy Adhesives, line 27, replace "Section 1081" with "Article 1081-4".

Page 10-177, Subarticle 1086-3(E) Epoxy Adhesives, line 22, replace "Section 1081" with "Article 1081-4".

Page 10-179, Subarticle 1087-4(A) Composition, lines 39-41, replace the third paragraph with the following:

All intermixed and drop-on glass beads shall not contain more than 75 ppm arsenic or 200 ppm lead.

Page 10-180, Subarticle 1087-4(B) Physical Characteristics, line 8, replace the second paragraph with the following:

All intermixed and drop-on glass beads shall comply with NCGS § 136-30.2 and 23 USC § 109(r).

Page 10-181, Subarticle 1087-7(A) Intermixed and Drop-on Glass Beads, line 24, add the following after the first paragraph:

Use X-ray Fluorescence for the normal sampling procedure for intermixed and drop-on beads, without crushing, to check for any levels of arsenic and lead. If any arsenic or lead is detected, the sample shall be crushed and repeat the test using X-ray Fluorescence. If the X-ray Fluorescence test shows more than a LOD of 5 ppm, test the beads using United States Environmental Protection Agency Method 6010B, 6010C or 3052 for no more than 75 ppm arsenic or 200 ppm lead.

Page 10-204, Subarticle 1092-2(A) Performance and Test Requirements, replace Table 1092-3 Minimum Coefficient of Retroreflection for NC Grade A with the following:

TABLE 1092-3 MINIMUM COEFFICIENT OF RETROREFLECTION FOR NC GRADE A (Candelas Per Lux Per Square Meter)								
Observation Angle, degrees	Entrance Angle, degrees	White	Yellow	Green	Red	Blue	Fluorescent Yellow Green	Fluorescent Yellow
0.2	-4.0	525	395	52	95	30	420	315
0.2	30.0	215	162	22	43	10	170	130
0.5	-4.0	310	230	31	56	18	245	185
0.5	30.0	135	100	14	27	6	110	81
1.0	-4.0	120	60	8	16	3.6	64	48
1.0	30.0	45	34	4.5	9	2	36	27

SELECT MATERIAL, CLASS III, TYPE 3:

(1-17-12)

1016, 1044

SP10 R05

Revise the *2012 Standard Specifications* as follows:

Page 10-39, Article 1016-3, CLASS III, add the following after line 14:

Type 3 Select Material

Type 3 select material is a natural or manufactured fine aggregate material meeting the following gradation requirements and as described in Sections 1005 and 1006:

Percentage of Total by Weight Passing							
3/8"	#4	#8	#16	#30	#50	#100	#200
100	95-100	65-100	35-95	15-75	5-35	0-25	0-8

Page 10-39, Article 1016-3, CLASS III, line 15, replace “either type” with “Type 1, Type 2 or Type 3”.

Page 10-62, Article 1044-1, line 36, delete the sentence and replace with the following:

Subdrain fine aggregate shall meet Class III select material, Type 1 or Type 3.

Page 10-63, Article 1044-2, line 2, delete the sentence and replace with the following:

Subdrain coarse aggregate shall meet Class V select material.

SHOULDER AND SLOPE BORROW:

(3-19-13)

1019

SP10 R10

Use soil in accordance with Section 1019 of the *2012 Standard Specifications*. Use soil consisting of loose, friable, sandy material with a PI greater than 6 and less than 25 and a pH ranging from 5.5 to 7.0.

Soil with a pH ranging from 4.0 to 5.5 will be accepted without further testing if additional limestone is provided in accordance with the application rates shown in Table 1019-1A. Soil type is identified during the soil analysis. Soils with a pH above 7.0 require acidic amendments to be added. Submit proposed acidic amendments to the Engineer for review and approval. Soils with a pH below 4.0 or that do not meet the PI requirements shall not be used.

TABLE 1019-1A ADDITIONAL LIMESTONE APPLICATION RATE TO RAISE pH			
pH TEST RESULT	Sandy Soils Additional Rate (lbs. / Acre)	Silt Loam Soils Additional Rate (lbs. / Acre)	Clay Loam Soils Additional Rate (lbs. / Acre)
4.0 - 4.4	1,000	4,000	6,000
4.5 - 4.9	500	3,000	5,000
5.0 - 5.4	NA	2,000	4,000

Note: Limestone application rates shown in this table are in addition to the standard rate of 4000 lbs. / acre required for seeding and mulching.

No direct payment will be made for providing additional lime or acidic amendments for Ph adjustment.

TRUCK MOUNTED CHANGEABLE MESSAGE SIGNS:

(8-21-12)

1101.02

SP11 R10

Revise the *2012 Roadway Standard Drawings* as follows:

Drawing No. 1101.02, Sheet 12, TEMPORARY LANE CLOSURES, replace General Note #11 with the following:

11- TRUCK MOUNTED CHANGEABLE MESSAGE SIGNS (TMCMS) USED ON SHADOW VEHICLES FOR "IN LANE" ACTIVITIES SHALL BE A MINIMUM OF 43" X 73". THE DISPLAY PANEL SHALL HAVE FULL MATRIX CAPABILITY WITH THE CAPABILITY TO PROVIDE 2 MESSAGE LINES WITH 7 CHARACTERS PER LINE WITH A MINIMUM CHARACTER HEIGHT OF 18". FOR ADDITIONAL MESSAGING, CONTACT THE WORK ZONE TRAFFIC CONTROL SECTION.

12- TMCMS USED FOR ADVANCED WARNING ON VEHICLES LOCATED ON THE SHOULDER MAY BE SMALLER THAN 43" X 73". THE DISPLAY PANEL SHALL HAVE THE CAPABILITY TO PROVIDE 2 MESSAGE LINES WITH 7 CHARACTERS PER LINE WITH A MINIMUM CHARACTER HEIGHT OF 18". FOR ADDITIONAL MESSAGING, CONTACT THE WORK ZONE TRAFFIC CONTROL SECTION.

Drawing No. 1101.02, Sheet 13, TEMPORARY LANE CLOSURES, replace General Note #12 with the following:

12- TRUCK MOUNTED CHANGEABLE MESSAGE SIGNS (TMCMS) USED ON SHADOW VEHICLES FOR "IN LANE" ACTIVITIES SHALL BE A MINIMUM OF 43" X 73". THE DISPLAY PANEL SHALL HAVE FULL MATRIX CAPABILITY WITH THE CAPABILITY TO PROVIDE 2 MESSAGE LINES WITH 7 CHARACTERS PER LINE WITH A MINIMUM CHARACTER HEIGHT OF 18". FOR ADDITIONAL MESSAGING, CONTACT THE WORK ZONE TRAFFIC CONTROL SECTION.

13- TMCMS USED FOR ADVANCED WARNING ON VEHICLES LOCATED ON THE SHOULDER MAY BE SMALLER THAN 43" X 73". THE DISPLAY PANEL SHALL HAVE THE CAPABILITY TO PROVIDE 2 MESSAGE LINES WITH 7 CHARACTERS PER LINE WITH A MINIMUM CHARACTER HEIGHT OF 18". FOR ADDITIONAL MESSAGING, CONTACT THE WORK ZONE TRAFFIC CONTROL SECTION.

CENTRAL COASTAL PLAIN CAPACITY USE AREA (CCPCUA) RULES:

(11-17-04) (Rev. 4-17-12)

SPI

The Water Use Act of 1967 (*General Statute* 143-215.11 - .22) allows for designation of capacity use areas for regulation of water use. Over pumping of important aquifers in the coastal plain has led to the creation of the Central Coastal Plain Capacity Use Area (CCPCUA) and associated rules. The CCPCUA rules became effective on August 1, 2002 and affect a 15 county region (Beaufort, Carteret, Craven, Duplin, Edgecombe, Greene, Jones, Lenoir, Martin, Onslow, Pamlico, Pitt, Washington, Wayne, and Wilson). The CCPCUA rules require registration and reporting of water use for those persons using more than 10,000 gallons of ground water and/or surface water per day. A permit is required for persons who withdraw more than 100,000 gallons per day of ground water.

NCDOT will apply for CCPCUA permits for all proposed TIP projects requiring sizeable earthwork quantities in the affected fifteen county area.

Each contractor that utilizes a pump to dewater a borrow pit or utilizes a pump to withdraw surface water in the counties mentioned above will be required to record the volume of water pumped from each site on a daily basis. These daily recorded quantities should then be submitted for each pit on a monthly basis to the Resident Engineer. **Withdrawal rates based on pump curve data can be used in lieu of metering devices.** Included with that monthly submittal should be a record of the static and pumped water surface elevations. These two readings should be taken once each month at least 12 hours apart. The appropriate forms for recording this information are available at the following webpage:

http://www.ncdot.org/doh/operations/dp_chief_eng/roadside/fieldops/downloads/

The pumped water volumes and surface water elevations shall be recorded on the electronic form and submitted to the Resident Engineer along with a hard copy signed by the contractor. Once the Resident Engineer ensures the information is complete and accurate, it will be forwarded to the Roadside Environmental Field Operations Engineer on a quarterly basis. The Roadside Environmental Field Operations Engineer will compile this data for all pits located in the affected counties within his/her area and forward a complete package to the Roadside Environmental Unit for final review and transmittal to the Division of Water Resources.

The contractor shall assume all liability for impacts to wells or surface water bodies resulting from dewatering operations.

The contractor shall submit one additional copy of the development, use and reclamation plan and environmental assessment to the Resident Engineer. Once approved, the Resident Engineer will furnish a copy of the approved plan to the Division of Water Resources. In addition to the current required information, the reclamation plan submittal shall include:


- The average daily pump discharge (in MGD),
- The estimated maximum number of days of pumping during the anticipated life of the pit,
- The number and location (latitudinal and longitudinal coordinates) of wells within 1,500 feet of the pit boundaries, and

A determination as to whether adjoining dwellings are served by a county/municipal water system.

The Resident Engineer will forward the approved package to the Capacity Use Administrator at the following address:

Capacity Use Administrator
DENR – DWR
1611 Mail Service Center
Raleigh, NC 27699-1611

PROJECT SPECIAL PROVISIONS
Rest Area Lighting

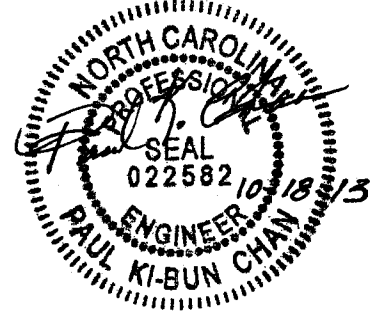

1.00 GENERAL

1.10 DESCRIPTION

Provide rest area lighting by installing post top standards with light emitting diode (LED) luminaires, aluminum bollard light standards with LED luminaires, roadway davit style light standard with LED luminaires, underground circuitry in conduit, junction boxes and a centralized control system.

Perform all work in accordance with these Special Provisions, the Plans, the National Electrical Code, and North Carolina Department of Transportation "Standard Specifications for Roads and Structures" (Standard Specifications).

Use Division 14 of the Standard Specifications for materials, construction methods and payment for all work, except as modified or added to by these Special Provisions. Specific sections of the Standard Specifications applicable to the work on this project are listed below:

Section 1405	Standard Foundation
Section 1409	Electrical Duct
Section 1410	Feeder Circuits
Section 1411	Electrical Junction Boxes

1.20 ELECTRICAL POWER

Electrical power will be provided through the building electrical service.

2.00 DAVIT STYLE LIGHT STANDARD

2.10 DESCRIPTION

The work covered by this section consists of furnishing and installing light standards complete with davit style arms 35 foot mounting height with breakaway bases.

2.20 MATERIALS

Provide a standard that meets the 100-mph design criteria of the AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals." Provide all poles from the same manufacturer.

Provide 35 foot mounting height, tapered shaft poles with 6-foot davit arms and breakaway base.

The standard shaft shall be one piece round tapered shaft from seamless tubing. The davit arm shall be one piece round tapered that slip fits onto a tapered pole top tenon where it is fastened

with stainless steel through bolts. Both shall be designed to support a luminaire with minimum weight, projected area and center of gravity as indicated in the section of these Special Provisions titles "LED Luminaire" for the light standard luminaire.

Provide a protective grommet at the arm-to-pole connection, to protect wiring during installation and maintenance.

Provide a cast aluminum transformer base that complies with AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals." Use anchor bolts, washers, nuts and shims which comply with the Specifications and details shown in the plans. Use connecting bolts as recommended by the light standard and transformer base manufacturer(s).

The shaft and the davit arm shall be 6063 aluminum alloy tubing. The finish shall be smooth and shall be free of scratches or dents and shall have suitable protection for handling during erection.

Pole hardware, nuts, bolts, and washers, etc. shall be made from 18-8 stainless steel, or steel conforming to ASTM A307 galvanized in accordance with ASTM A153.

Drawings submitted for approval shall show material specifications for each component and shall have a certification statement concerning conformance with AASHTO design criteria.

2.30 CONSTRUCTION METHODS

Lay out and identify light standards as shown on the plans. Adjust final location as per direction of the Engineer to avoid conflicts with other objects. Protect the shaft during storage and installation to ensure against scratches or dents. Use proper blocking and protection to prevent warping or discoloration when laid on the ground, and to prevent damage by other construction work.

Install standards vertically plumb, and use connecting bolts, washers and nuts compatible with the transformer base as recommended by the light standard manufacturer and which comply with the contract. Provide the required luminaire mounting height which is defined as vertical distance from luminaire to pavement surface.

2.40 MEASUREMENT AND PAYMENT

The quantity of light standards to be paid for will be the actual number of light standards with davit style arms and transformer bases that have been installed and accepted.

The quantity of light standards measured as provided above will be paid for at the contract unit price each for "Davit Style Light Standard, MH 35', SA 6'" of the appropriate type. Such price and payment will be full compensation for all work of furnishing and installing the standard with davit style arm and transformer base.

Payment will be made under:

Davit Style Light Standard, MH 35', SA 6' Each

3.00 POST TOP STANDARDS

3.10 DESCRIPTION

The work covered by this section consists of furnishing and installing post top light standards with contemporary style post top luminaires and breakaway base.

3.20 MATERIALS

Provide a 6063 aluminum alloy round tubing post top light standard that meets the 100-mph design criteria of the AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals."

The pole shall be sized to provide a nominal luminaire mounting height of 15 ft. when adding transformer base height. The pole shall have a 2" pipe size top mounted tenon (2 3/8" O.D. x 4 1/2" minimum length) for mounting the luminaire.

Use pole hardware, nuts, bolts, and washers, etc. made from 18-8 stainless steel, aluminum alloy 2024-T4, or steel conforming to ASTM A307 and galvanized in accordance with ASTM A 153.

Drawings submitted for approval shall show material specifications, dimensions and shall have a certification statement concerning conformance with AASHTO design criteria. Only reviewed and approved materials will be used.

Provide a cast aluminum transformer base for each post top light standard that complies with AASHTO "Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals." Use anchor bolts, washers, nuts and shims which comply with the Specifications and details shown in the plans. Use connecting bolts as recommended by the post top light standard and transformer base manufacturer(s).

3.30 CONSTRUCTION METHODS

Identify light standards as shown on the plans. Use scaled dimensions to locate light standards. Adjust final location as per direction of the engineer to avoid conflicts with other objects. Protect the shaft during storage and installation to ensure against scratches or dents. Use proper blocking and protection to prevent warping or discoloration when laid on the ground, and to prevent damage by other construction work.

Install all standards vertically plumb, and provide the required luminaire mounting height.

3.40 MEASUREMENT AND PAYMENT

The quantity of post top standards to be paid for will be the actual number that have been installed and accepted.

The quantity of post top standards measured as provided above will be paid for at the contract unit price each for "Post Top Light Standard" of the appropriate type. Such price and payment will be full compensation for all work of furnishing and installing the standard and the breakaway base.

Payment will be made under:

Post Top Light Standard Each

4.00 LIGHT CONTROL SYSTEM

4.10 DESCRIPTION

The work covered by this section includes the furnishing and installing of all materials necessary to provide a wall mounted lighting control system in a rest area service building as shown on the plans.

4.20 MATERIALS

Provide a 5/8" thick Exterior Grade AD plywood back panel slightly larger than the layout of the control system components.

Provide a 6" x 6" x 4' wire trough. The wire trough shall be long enough to accommodate all components and connections. The trough shall be constructed of formed and welded steel that is painted or galvanized, with one removable side plate that is secured in place with corrosion resistant screws, and has only the holes necessary for the conduits shown in the plans. Wire trough with knockouts is not acceptable.

Provide a lighting panel consisting of a surface mount load center, with copper bus, factory installed main breaker, 22,000 Amps short circuit current rating sized as shown in the plans, a minimum of 16 single-pole branch breaker spaces and an equipment ground bar. Use double-pole branch breakers with 10,000 Amps short circuit current rating sized as shown in the plans.

Provide electrically operated, mechanically held contactors with coil clearing contacts. Ensure latching without the use of hooks or semi-permanent magnets. Use contactors rated 240 VAC, 30 amps, with 120 VAC coils and 4 poles each.

Provide a control relay rated 600 VAC, with one normally open contact, one normally closed contact, and "continuous load" rating and "inductive make and break" rating greater than that required by the mechanically held contactors. Install control relay in a NEMA 1 enclosure.

Use a control selector switch rated standard duty, with three positions, and maintained contacts, in a surface mount NEMA 1 enclosure. Provide contacts with an inductive rating of 5 amps continuous, 3600 VA make, and 3600 VA break. Provide a legend plate that indicates "On-Off-Auto".

Use a "dual voltage" photocontrol with surge protection and single pole, single throw, contact with a minimum contact rating of 1000 watts. Provide a normally closed contact that is "daylight energized," with a turn on range of approximately 3 footcandles. Mount the photocontrol in a three-prong locking type receptacle, conforming to NEMA Standard C136.10.

Use number 8 AWG type THHN stranded copper conductors on the line side of the mechanically held contactors, and number 12 AWG stranded copper conductors for the control circuit, conforming to the requirements of Article 1400-2C of the Standard Specifications titled "Wire". Size all other conductors as shown in the plans.

Use rigid galvanized steel conduit in accordance with Article 1400-2B of the Standard Specifications titled "Conduit".

4.30 CONSTRUCTION METHODS

Use the plywood panel for mounting components on all walls other than masonry. Arrange the components as shown on the equipment layout detail in the plans.

Install conductors and conduit in accordance with Articles 1400-4F of the Standard Specifications titled "Wiring Methods" and 1400-4E "Conduit Installation". Clearly identify the phase, neutral, and contact conductors for the photocontrol in the wire trough.

Install flashing around the conduit extended through the roof to the photo control.

Securely fasten each component to the wall or panel with corrosion resistant bolts and inserts. Utilize all mounting holes in each component. Install a galvanized washer between the component and masonry walls to assure a minimum of 1/4" air space.

Paint the plywood panel the same color as the wall. After the control system components are installed, clean, prime, and paint all exposed surfaces of enclosures and conduit with a premium quality paint that best matches the color of the adjacent walls. Mask all legend plates, nameplates, etc. while painting.

4.40 MEASUREMENT AND PAYMENT

The quantity of light control systems to be paid for will be the actual number of light control systems that have been installed and accepted.

The quantity of light control systems, measured as provided above, will be paid for at the contract unit price each for "Light Control Equipment, Type RA 120/240V" of the appropriate type. Such price and payment will be full compensation for all work of furnishing and installing

an entire control system, including mounting panel, control circuit, photocontrol, contactors, breakers, and selector switch.

Payment will be made under:

Light Control Equipment, Type RA 120/240V Each

5.00 BOLLARD LIGHT STANDARD

5.10 DESCRIPTION

The work covered by this section consists of furnishing and installing bollard light standards with luminaires. These lights are used as landscape accent lights around the building entrances.

5.20 MATERIALS

Housing and Top Cap

Provide bollard standards made from extruded aluminum with an 8-inch diameter housing and black in color. Bollard shall be 42" high and have a peaked, spun aluminum top cap with the same finish as the standard. The finish shall be a durable, textured thermoset polyester powder coat paint, oven-baked to promote superior adhesion and hardness. A minimum two year guarantee on finish is required.

Optics

Bollard should have a durable, corrosion resistant cast aluminum louver system with a Type 5 distribution pattern. An internal clear acrylic lens shall surround the lamp.

Light Source

High lumen output LED shall be used. Total assembly shall have an L70 rating of 60,000 hours, minimum.

Driver

Provide a high performance LED driver designed to operate at the voltage shown on the plan and capable of operating down to -20°F. Electrical components shall be mounted to a removable ballast tray. Driver shall be equipped with factory installed quick disconnect plug.

5.30 CONSTRUCTION METHODS

Install bollard lights as shown on the plans. Use scaled dimensions to locate lights. Adjust final location as per direction of the Engineer to avoid conflicts with other objects. Protect the light during storage and installation to ensure against scratches or dents, and to prevent damage by other construction work.

Install conductors and conduit in accordance with Articles 1400-4F of the Standard Specifications titled "Wiring Methods" and 1400-4E "Conduit Installation", and manufacturer's recommendations. Due to limited internal space, no splice of conductors shall take place inside the bollard housing. Splicing will be done in junction boxes adjacent to the bollard light standard.

5.40 MEASUREMENT AND PAYMENT

The quantity of bollard light standards to be paid for will be the actual number of bollards that have been installed and accepted.

The quantity of bollards, measured as provided above, will be paid for at the contract unit price each for "Bollard Light Standard" of the appropriate type. Such price and payment will be full compensation for all work of furnishing and installing the standard.

Payment will be made under:

Bollard Light Standard	Each
------------------------------	------

6.00 STANDARD FOUNDATION TYPE B1

6.10 DESCRIPTION

Work covered by this section shall be in conformance with Section 1405 of the Standard Specifications except as modified below.

6.20 MATERIALS

Same as Standard Specifications Section 1405-2

6.30 CONSTRUCTION METHODS

Light standard foundation type B1 for bollard light standards shall be constructed as shown on the sheet E4 of the plans, and as modified per the manufacturers recommendation concerning anchor bolt diameter.

The type B1 foundation shall be 24" diameter by 36" deep.

Anchor bolts supplied by the bollard light manufacturer shall be cast into the concrete base and positioned per the manufacturer's template.

6.40 MEASUREMENT AND PAYMENT

Same as Standard Specifications Section 1405-4

7.00 STANDARD FOUNDATION TYPE R1S

7.10 DESCRIPTION

Work covered by this section shall be in conformance with Section 1405 of the Standard Specifications except as modified below.

7.20 MATERIALS

Same as Standard Specifications Section 1405-2

7.30 CONSTRUCTION METHODS

Light standard foundation type R1S for post top lights shall be equal to type R1 on standard drawing 1405.01 except as stated below.

The type R1S foundation shall be 24" diameter by 48" deep.

Anchor bolts supplied by the post top light manufacturer shall be cast into the concrete base and positioned per the manufacturer's template.

7.40 MEASUREMENT AND PAYMENT

Same as Standard Specifications Section 1405-4

8.00 LED LUMINAIRES

8.10 DESCRIPTION

The work covered by this section consists of furnishing and installing LED roadway and post top luminaires on new metal single arm and post top light standards described in previous sections if these Special Provisions. Mounting height for roadway standards is 35'. Mounting height for post top standards is 15'.

For LED roadway luminaires installed on the davit arm of single arm standards, Contractor shall include all LEDs/light bars, drivers, wiring inside the standard from the circuit conductors to the LED luminaire, in-line breakaway fuseholders with fuses and ground wiring at the pole on the light standards. Third party certified photometric files in IES format are required to be submitted with the catalog cuts for the proposed LED roadway luminaire. Photometric files must show that proposed luminaire will meet or exceed the design shown in the plans.

8.20 MATERIALS

The Contractor shall supply luminaires conforming to the standards below.

The LED post top luminaire shall have a contemporary look such as the Cree THE EDGE Area Round or the Visionaire California Aria LED. This is not meant as a specification for these luminaires. These manufacturers and models are provided for reference only.

8.21 LUMINAIRE REQUIREMENTS

Unless otherwise stated, the requirements below apply to both the Roadway LED luminaire and the Post Top LED luminaire.

A. General Requirements

- LM-79 photometric test reports shall be provided for LED luminaires. LM-79 luminaire photometric reports shall be produced by an independent test laboratory and include the following:
 - Name of test laboratory. The test laboratory must hold National Voluntary Laboratory Accreditation Program (NVLAP) accreditation for the IES LM-79 test procedure or must be qualified, verified, and recognized through the U.S. Department of Energy's CALiPER program.
 - Report number
 - Date
 - Complete luminaire catalog number. Catalog number tested must match the catalog number of the luminaire submitted, except for variations which do not affect performance.
 - Description of luminaire, LED light source(s), and LED driver(s)
 - Goniophotometry
 - Colorimetry
- LM-80 lumen maintenance test report shall be provided for LED light source.
- The luminaire shall be constructed of a single piece die cast aluminum housing and finished gray in color unless otherwise noted.
- Luminaire shall have a minimum L70 rating of 70,000 hours at 25°C. Provide a summary of reliability testing performed for LED driver.
- Roadway and post top luminaires shall have a maximum total power consumption of 150W and 70W, respectively, at 240VAC. Nominal luminaire input wattage shall account for nominal applied voltage and any reduction in driver efficiency due to sub-optimal driver loading.
- Roadway luminaire shall have an IESNA distribution Type III. Post top luminaire shall have an IESNA distribution Type V.
- Luminaires shall meet dust and moisture rating of IP-65, minimum.
- Roadway luminaire shall have an external label per ANSI C136.15
- Luminaires shall have an internal label per ANSI C136.22.
- Luminaires shall start and operate in -20°C to +40°C ambient.
- Electrically test fully assembled luminaires before shipment from factory.
- Effective Projected Area (EPA) and weight of the roadway luminaire shall not exceed 0.75 square feet and 30 lbs., respectively.
- Luminaires shall be designed for ease of electrical component replacement.

- Luminaires shall be rated for minimum 2G vibration per ANSI C136.31-2010
- LED light sources and drivers shall be RoHS compliant.
- Transmissive optical components shall be applied in accordance with OEM design guidelines to ensure suitability for the thermal/mechanical/chemical environment.
- The luminaire manufacturer shall have no less than five (5) years of experience in manufacturing LED-based lighting products and the manufacturing facility must be ISO 9001 certified. Proof of certification shall be provided at the request of the Department.
- Roadway luminaire shall have a 1.625" to 2.375" adjustable tenon mount for connection to luminaire arm assembly.
- Pole hardware, nuts, bolts, and washers, etc. shall be made from 18-8 stainless steel, or steel conforming to ASTM A307 galvanized in accordance with ASTM A153.

B. Driver

- Rated case temperature shall be suitable for operation in the luminaire operating in the ambient temperature range of -20°C to +40°C.
- Shall be configured to operate at 240 VAC at 50/60 Hz, and shall operate normally for input voltage fluctuations of $\pm 10\%$.
- Shall have a minimum Power Factor (PF) of 0.90 at full input power and across specified voltage range.
- Roadway luminaire shall have maximum 600mA driver operating current. Post top luminaire shall have a maximum 350mA driver operating current.

C. Surge Suppression

- Integral surge protection shall meet ANSI/IEEE C62.45 procedures based on ANSI/IEEE C62.41.2 definitions for standard and optional waveforms for location category C-High 10kV/10kA test, IEC 61000-4-2 (Electrostatic Discharge) 8kV Air/4kV Contact test and IEC 61000-4-4 (Fast Transients).

D. Electromagnetic interference

- Luminaire shall have a maximum Total Harmonic Distortion (THD) of 20% at full input power and across specified voltage range.
- Luminaire shall comply with FCC 47 CFR part 15 non-consumer RFI/EMI standards.

E. Electrical safety testing

- Luminaire shall be listed for wet locations.
- Luminaire shall be UL listed and labeled.

F. Finish

- Luminaire shall be painted with a corrosion resistant polyester powdered paint with a minimum 2.0 mil thickness.

- Shall exceed a rating of six per ASTM D1654 after 1000 hours of salt spray fog testing per ASTM B117.
- The coating shall exhibit no greater than 30% reduction of gloss per ASTM D523, after 500 hours of QUV testing at ASTM G154 Cycle 6.

G. Thermal management

- Mechanical design of protruding external surfaces (heat sink fins) shall facilitate hose-down cleaning and discourage debris accumulation.

H. Color Quality

- Minimum Color Rendering Index (CRI) of 60 with a Correlated Color Temperature (CCT) of 4000K to 5000K

I. The following shall be in accordance with corresponding sections of ANSI C136.37

- All internal components shall be assembled and pre-wired using modular electrical connections.
- Terminal blocks shall be used for incoming AC lines
- Latching and hinging

J. Manufacturer or local sales representative shall provide installation and troubleshooting support via telephone and/or email.

8.30 WARRANTY

Provide a minimum five-year "no questions asked" warranty covering maintained integrity and functionality of the luminaire housing, wiring, and connections, LED light source(s) and LED driver. Negligible light output from more than 10 percent of the LED packages constitutes luminaire failure.

Warranty period shall begin 90 days after project completion.

8.40 CONSTRUCTION METHODS

Mount luminaires securely to the tenon and connect to the feeder circuit via a pair of fuse holders, accessible in the breakaway transformer base of the standard, in conformance with the plans, other sections of these Special Provisions and the Standard Specifications.

Level luminaires using leveling pads on the luminaire enclosure. Adjust any luminaires, as directed by the Engineer, to give optimum illumination distribution.

8.40 MEASUREMENT AND PAYMENT

The quantity of roadway and post top luminaires to be paid for will be the actual number of roadway and post top LED luminaires which have been installed and accepted.

The quantity of Post Top LED luminaires, measured as provided above, will be paid for at the contract unit price each for "Post Top Luminaires, LED, Type V" of the appropriate type and style. Such price and payment will be full compensation for all work of furnishing and installing the luminaire, wiring inside the standard from circuit conductors to luminaire, in-line breakaway fuses and ground wiring at the pole.

The quantity of Roadway LED luminaires, measured as provided above, will be paid for at the contract unit price each for "Roadway Luminaires, LED, Type III" of the appropriate type and style. Such price and payment will be full compensation for all work of furnishing and installing the luminaire, wiring inside the standard from circuit conductors to luminaire, in-line breakaway fuses and ground wiring at the pole.

Payment will be made under:

Post Top Luminaires, LED, Type V	Each
Roadway Luminaires, LED, Type III	Each

9.00 ELECTRICAL JUNCTION BOXES

9.10 DESCRIPTION

Same as Section 1411-1.

9.20 MATERIALS

Same as Section 1411-2, except modify referenced Section 1091-5 as follows:

- Page 10-202, revise paragraph starting on line 9 to read "Provide polymer concrete (PC) boxes which have bolted covers and open bottoms. Provide vertical extensions of 6" to 12" as required by project special provisions."
- Page 10-202, revise sentence beginning on line 14 to read "Other thermoplastic materials may be used for components which are not normally exposed to sunlight."

9.30 CONSTRUCTION METHODS

Same as Section 1411-3.


9.40 MEASUREMENT AND PAYMENT

Same as Section 1411-4.

PROJECT SPECIAL PROVISIONS
Utility Construction

NCDOT Utilities Unit
1555 MSC
Raleigh, NC 27699-1555

919.707.6690

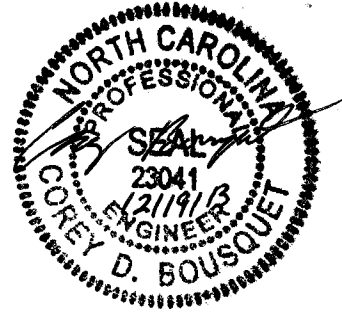

(Seal)

Revise the 2012 Standard Specifications as follows:

Page 10-58, Sub-article 1036-1 General

add the following sentence

All materials in contact with potable water shall be in conformance with Section 1417 of the Safe Drinking Water Act.

Page 15-1, Sub-article 1500-2 Cooperation with the Utility Owner, paragraph 2:

add the following sentences:

The utility owner is Beaufort County-Water. The contact person is Mr. Eric Jennings he can be reached by phone at 252-975-0720. Beaufort County shall be notified two weeks prior to beginning any work. Beaufort County will perform daily inspections of the water line installations. Beaufort County will also be present at all pressure and leakage test.

The utility owner is the Town of Chocowinity- Sewer. The contact person is Mr. Jeff Haddock and he can be reached by phone at 252-946-6568.

Page 15-2, Sub-article 1500-7 Submittals and Records

The As-Built Plans shall be certified by a North Carolina Licensed Professional Engineer in accordance to Beaufort County requirements:

- The Contractor shall provide GPS coordinates obtained with mapping grade survey equipment on horizontal datum NAD 83 (Latest Adjustment) and vertical datum NAVD 1988. Field survey should provide coordinates at maximum of 100' intervals, at all fittings, all change in material, valves, meters, backflow preventers and fire hydrants. The County has GIS Data Dictionary Tables that the Contractor will need to fill out along with preparing the As-Built Plans in Microstation or AutoCad.

PROJECT SPECIAL PROVISIONS
Utility Construction

Page 15-2, Sub-article 1500-9 Placing Pipelines into Service
add the following sentence:

Obtain approval from the NCDENR-Public Water Supply Section prior to placing a new water line into service. Use backflow prevention assemblies for temporary connections to isolate new water lines from existing water line.

Page 15-6, Sub-article 1510-3 (B), Testing and Sterilization
change the allowable leakage formula to:

$$W = LD\sqrt{P} \div 148,000$$

Page 15-6, Sub-article 1510-3 (B), Testing and Sterilization, sixth paragraph:
Replace the paragraph with the following:

Sterilize water lines in accordance with Section 1003 of The Rules Governing Public Water supply and AWWA C651 Section 4.4.3, the Continuous Feed Method. Provide a chlorine solution with between 50 parts per million and 100 parts per million in the initial feed. If the chlorine level drops below 10 parts per million during a 24 hour period, then flush, refill with fresh chlorine solution, and repeat for 24 hours. Provide certified bacteriological and contaminant test results from a state-approved or state-certified laboratory. Operate all valves and controls to assure thorough sterilization.

Page 15-6, Sub-article 1510-3 (B), Testing and Sterilization, seventh paragraph:
delete the words “may be performed concurrently or consecutively.”
and replace with “shall be performed consecutively.”

Page 15-7, sub-article 1515-2 Materials,
replace paragraph beginning “Double check valves...” with the following:

Double Check valves (DCV) and Reduced Pressure Zone principal (RPZ) backflow prevention assemblies shall be listed on the University of Southern California Foundation for Cross-Connection Control and Hydraulic Research list of approved backflow devices.

1. YARD HYDRANT:

Yard hydrants shall be installed in accordance with the applicable utility provisions herein, as shown on the utility plans, and/or as directed by the Engineer.

Yard hydrants shall be connected to a 1” water service line as shown on the plans or as specified by the Engineer.

PROJECT SPECIAL PROVISIONS

Utility Construction

Yard hydrants shall have a cast iron head and handle easily padlocked, removable 3/4" brass hose nozzle connection, 1" galvanized steel pipe, rod guide to eliminate side pull and reduces wear on packing, packing nut and stem, one piece variable flow plunger, large cushion type seal for longer life, automatic drain plunger opens to prevent freezing and closes at any flow to prevent wasting water, maximum working pressure of 125 psi.

Yard Hydrants, installed in accordance with the plans and provisions herein and accepted, will be measured and paid for at the contract unit price per each for "Yard Hydrant". Such prices and payments will be full compensation for all materials, equipment, excavation, labor, installation, backfilling, and incidentals necessary to complete the work as required.

PROJECT SPECIAL PROVISIONS
Utilities by Others

General:

The following utility companies have facilities that will be in conflict with the construction of this project:

A. Duke Energy Progress (Power)

The conflicting facilities of these concerns will be adjusted prior to the date of availability, unless otherwise noted and are therefore listed in these special provisions for the benefit of the Contractor. All utility work listed herein will be done by the utility owners. All utilities are shown on the plans from the best available information.

The Contractor's attention is directed to Article 105.8 of the Standard Specifications.

Utilities Requiring Adjustment:

A. Duke Energy Progress (Power)

1. See Utility Conflict Plans by Others. The contact person is
Sheila Talton at 919-481-6126
Sheila.Talton@duke-energy.com

**Project Special Provisions
Erosion Control**

STABILIZATION REQUIREMENTS:

Stabilization for this project shall comply with the time frame guidelines as specified by the NCG-010000 general construction permit effective August 3, 2011 issued by the North Carolina Department of Environment and Natural Resources Division of Water Quality. Temporary or permanent ground cover stabilization shall occur within 7 calendar days from the last land-disturbing activity, with the following exceptions in which temporary or permanent ground cover shall be provided in 14 calendar days from the last land-disturbing activity:

- Slopes between 2:1 and 3:1, with a slope length of 10 ft. or less
- Slopes 3:1 or flatter, with a slope of length of 50 ft. or less
- Slopes 4:1 or flatter

The stabilization timeframe for High Quality Water (HQW) Zones shall be 7 calendar days with no exceptions for slope grades or lengths. High Quality Water Zones (HQW) Zones are defined by North Carolina Administrative Code 15A NCAC 04A.0105 (25). Temporary and permanent ground cover stabilization shall be achieved in accordance with the provisions in this contract and as directed.

SEEDING AND MULCHING:

(East)

The kinds of seed and fertilizer, and the rates of application of seed, fertilizer, and limestone, shall be as stated below. During periods of overlapping dates, the kind of seed to be used shall be determined. All rates are in pounds per acre.

All Roadway Areas

March 1 - August 31		September 1 - February 28	
50#	Tall Fescue	50#	Tall Fescue
10#	Centipede	10#	Centipede
25#	Bermudagrass (hulled)	35#	Bermudagrass (unhulled)
500#	Fertilizer	500#	Fertilizer
4000#	Limestone	4000#	Limestone

Waste and Borrow Locations

March 1 - August 31		September 1 - February 28	
75#	Tall Fescue	75#	Tall Fescue
25#	Bermudagrass (hulled)	35#	Bermudagrass (unhulled)
500#	Fertilizer	500#	Fertilizer
4000#	Limestone	4000#	Limestone

Note: 50# of Bahiagrass may be substituted for either Centipede or Bermudagrass only upon Engineer's request.

Approved Tall Fescue Cultivars

2 nd Millennium	Duster	Magellan	Rendition
Avenger	Endeavor	Masterpiece	Scorpion
Barlexas	Escalade	Matador	Shelby
Barlexas II	Falcon II, III, IV & V	Matador GT	Signia
Barrera	Fidelity	Millennium	Silverstar
Barrington	Finesse II	Montauk	Southern Choice II
Biltmore	Firebird	Mustang 3	Stetson
Bingo	Focus	Olympic Gold	Tarheel
Bravo	Grande II	Padre	Titan Ltd
Cayenne	Greenkeeper	Paraiso	Titanium
Chapel Hill	Greystone	Picasso	Tomahawk
Chesapeake	Inferno	Piedmont	Tacer
Constitution	Justice	Pure Gold	Trooper
Chipper	Jaguar 3	Prospect	Turbo
Coronado	Kalahari	Quest	Ultimate
Coyote	Kentucky 31	Rebel Exeda	Watchdog
Davinci	Kitty Hawk	Rebel Sentry	Wolfpack
Dynasty	Kitty Hawk 2000	Regiment II	
Dominion	Lexington	Rembrandt	

On cut and fill slopes 2:1 or steeper Centipede shall be applied at the rate of 5 pounds per acre and add 20# of Sericea Lespedeza from January 1 - December 31.

Fertilizer shall be 10-20-20 analysis. A different analysis of fertilizer may be used provided the 1-2-2 ratio is maintained and the rate of application adjusted to provide the same amount of plant food as a 10-20-20 analysis and as directed.

Native Grass Seeding and Mulching

(East)

Native Grass Seeding and Mulching shall be performed on the disturbed areas of wetlands and riparian areas, and adjacent to Stream Relocation construction within a 50 foot zone on both sides of the stream or depression, measured from top of stream bank or center of depression. The stream bank of the stream relocation shall be seeded by a method that does not alter the typical cross section of the stream bank. Native Grass Seeding and Mulching shall also be performed in the permanent soil reinforcement mat section of preformed scour holes, and in other areas as directed.

The kinds of seed and fertilizer, and the rates of application of seed, fertilizer, and limestone, shall be as stated below. During periods of overlapping dates, the kind of seed to be used shall be determined. All rates are in pounds per acre.

March 1 - August 31

18# Creeping Red Fescue
 6# Indiangrass
 8# Little Bluestem
 4# Switchgrass
 25# Browntop Millet
 500# Fertilizer
 4000# Limestone

September 1 - February 28

18# Creeping Red Fescue
 6# Indiangrass
 8# Little Bluestem
 4# Switchgrass
 35# Rye Grain
 500# Fertilizer
 4000# Limestone

Approved Creeping Red Fescue Cultivars:

Aberdeen

Boreal

Epic

Cindy Lou

Fertilizer shall be 10-20-20 analysis. A different analysis of fertilizer may be used provided the 1-2-2 ratio is maintained and the rate of application adjusted to provide the same amount of plant food as a 10-20-20 analysis and as directed.

Native Grass Seeding and Mulching shall be performed in accordance with Section 1660 of the *Standard Specifications* and vegetative cover sufficient to restrain erosion shall be installed immediately following grade establishment.

Measurement and Payment

Native Grass *Seeding and Mulching* will be measured and paid for in accordance with Article 1660-8 of the *Standard Specifications*.

All areas seeded and mulched shall be tacked with asphalt. Crimping of straw in lieu of asphalt tack shall not be allowed on this project.

CRIMPING STRAW MULCH:

Crimping shall be required on this project adjacent to any section of roadway where traffic is to be maintained or allowed during construction. In areas within six feet of the edge of pavement, straw is to be applied and then crimped. After the crimping operation is complete, an additional application of straw shall be applied and immediately tacked with a sufficient amount of undiluted emulsified asphalt.

Straw mulch shall be of sufficient length and quality to withstand the crimping operation.

Crimping equipment including power source shall be subject to the approval of the Engineer providing that maximum spacing of crimper blades shall not exceed 8".

TEMPORARY SEEDING:

Fertilizer shall be the same analysis as specified for *Seeding and Mulching* and applied at the rate of 400 pounds and seeded at the rate of 50 pounds per acre. Sweet Sudan Grass, German Millet

or Browntop Millet shall be used in summer months and Rye Grain during the remainder of the year. The Engineer will determine the exact dates for using each kind of seed.

FERTILIZER TOPDRESSING:

Fertilizer used for topdressing on all roadway areas except slopes 2:1 and steeper shall be 10-20-20 grade and shall be applied at the rate of 500 pounds per acre. A different analysis of fertilizer may be used provided the 1-2-2 ratio is maintained and the rate of application adjusted to provide the same amount of plant food as 10-20-20 analysis and as directed.

Fertilizer used for topdressing on slopes 2:1 and steeper and waste and borrow areas shall be 16-8-8 grade and shall be applied at the rate of 500 pounds per acre. A different analysis of fertilizer may be used provided the 2-1-1 ratio is maintained and the rate of application adjusted to provide the same amount of plant food as 16-8-8 analysis and as directed.

SUPPLEMENTAL SEEDING:

The kinds of seed and proportions shall be the same as specified for *Seeding and Mulching*, with the exception that no centipede seed will be used in the seed mix for supplemental seeding. The rate of application for supplemental seeding may vary from 25# to 75# per acre. The actual rate per acre will be determined prior to the time of topdressing and the Contractor will be notified in writing of the rate per acre, total quantity needed, and areas on which to apply the supplemental seed. Minimum tillage equipment, consisting of a sod seeder shall be used for incorporating seed into the soil as to prevent disturbance of existing vegetation. A clodbuster (ball and chain) may be used where degree of slope prevents the use of a sod seeder.

MOWING:

The minimum mowing height on this project shall be 4 inches.

LAWN TYPE APPEARANCE:

All areas adjacent to lawns must be hand finished as directed to give a lawn type appearance. Remove all trash, debris, and stones ¾" and larger in diameter or other obstructions that could interfere with providing a smooth lawn type appearance. These areas shall be reseeded to match their original vegetative conditions, unless directed otherwise by the Field Operations Engineer.

RESPONSE FOR EROSION CONTROL:

Description

Furnish the labor, materials, tools and equipment necessary to move personnel, equipment, and supplies to the project necessary for the pursuit of any or all of the following work as shown herein, by an approved subcontractor.

Section	Erosion Control Item	Unit
1605	Temporary Silt Fence	LF
1606	Special Sediment Control Fence	LF/TON
1615	Temporary Mulching	ACR
1620	Seed - Temporary Seeding	LB
1620	Fertilizer - Temporary Seeding	TN
1631	Matting for Erosion Control	SY
SP	Coir Fiber Mat	SY
1640	Coir Fiber Baffles	LF
SP	Permanent Soil Reinforcement Mat	SY
1660	Seeding and Mulching	ACR
1661	Seed - Repair Seeding	LB
1661	Fertilizer - Repair Seeding	TON
1662	Seed - Supplemental Seeding	LB
1665	Fertilizer Topdressing	TON
SP	Safety/Highly Visible Fencing	LF
SP	Response for Erosion Control	EA

Construction Methods

Provide an approved subcontractor who performs an erosion control action as described in the NPDES Inspection Form SPPP30. Each erosion control action may include one or more of the above work items.

Measurement and Payment

Response for Erosion Control will be measured and paid for by counting the actual number of times the subcontractor moves onto the project, including borrow and waste sites, and satisfactorily completes an erosion control action described in Form 1675. The provisions of Article 104-5 of the *Standard Specifications* will not apply to this item of work.

Payment will be made under:

Pay Item

Response for Erosion Control

Pay Unit

Each

ENVIRONMENTALLY SENSITIVE AREAS:**Description**

This project is located in an *Environmentally Sensitive Area*. This designation requires special procedures to be used for clearing and grubbing, temporary stream crossings, and grading operations within the Environmentally Sensitive Areas identified on the plans and as designated by the Engineer. This also requires special procedures to be used for seeding and mulching and staged seeding within the project.

The Environmentally Sensitive Area shall be defined as a 50-foot buffer zone on both sides of the stream or depression measured from top of streambank or center of depression.

Construction Methods**(A) Clearing and Grubbing**

In areas identified as Environmentally Sensitive Areas, the Contractor may perform clearing operations, but not grubbing operations until immediately prior to beginning grading operations as described in Article 200-1 of the *Standard Specifications*. Only clearing operations (not grubbing) shall be allowed in this buffer zone until immediately prior to beginning grading operations. Erosion control devices shall be installed immediately following the clearing operation.

(B) Grading

Once grading operations begin in identified Environmentally Sensitive Areas, work shall progress in a continuous manner until complete. All construction within these areas shall progress in a continuous manner such that each phase is complete and areas are permanently stabilized prior to beginning of next phase. Failure on the part of the Contractor to complete any phase of construction in a continuous manner in Environmentally Sensitive Areas will be just cause for the Engineer to direct the suspension of work in accordance with Article 108-7 of the *Standard Specifications*.

(C) Temporary Stream Crossings

Any crossing of streams within the limits of this project shall be accomplished in accordance with the requirements of Subarticle 107-12 of the *Standard Specifications*.

(D) Seeding and Mulching

Seeding and mulching shall be performed in accordance with Section 1660 of the *Standard Specifications* and vegetative cover sufficient to restrain erosion shall be installed immediately following grade establishment.

Seeding and mulching shall be performed on the areas disturbed by construction immediately following final grade establishment. No appreciable time shall lapse into

the contract time without stabilization of slopes, ditches and other areas within the Environmentally Sensitive Areas.

(E) Stage Seeding

The work covered by this section shall consist of the establishment of a vegetative cover on cut and fill slopes as grading progresses. Seeding and mulching shall be done in stages on cut and fill slopes that are greater than 20 feet in height measured along the slope, or greater than 2 acres in area. Each stage shall not exceed the limits stated above. Additional payments will not be made for the requirements of this section, as the cost for this work shall be included in the contract unit prices for the work involved.

MINIMIZE REMOVAL OF VEGETATION:

The Contractor shall minimize removal of vegetation at stream banks and disturbed areas within the project limits as directed.

STOCKPILE AREAS:

The Contractor shall install and maintain erosion control devices sufficient to contain sediment around any erodible material stockpile areas as directed.

ACCESS AND HAUL ROADS:

At the end of each working day, the Contractor shall install or re-establish temporary diversions or earth berms across access/haul roads to direct runoff into sediment devices. Silt fence sections that are temporarily removed shall be reinstalled across access/haul roads at the end of each working day.

WASTE AND BORROW SOURCES:

Payment for temporary erosion control measures, except those made necessary by the Contractor's own negligence or for his own convenience, will be paid for at the appropriate contract unit price for the devices or measures utilized in borrow sources and waste areas.

No additional payment will be made for erosion control devices or permanent seeding and mulching in any commercial borrow or waste pit. All erosion and sediment control practices that may be required on a commercial borrow or waste site will be done at the Contractor's expense.

All offsite Staging Areas, Borrow and Waste sites shall be in accordance with "Borrow and Waste Site Reclamation Procedures for Contracted Projects" located at:

http://www.ncdot.gov/doh/operations/dp_chief_eng/roadside/fieldops/downloads/Files/ContractedReclamationProcedures.pdf

All forms and documents referenced in the "Borrow and Waste Site Reclamation Procedures for Contracted Projects" shall be included with the reclamation plans for offsite staging areas, and borrow and waste sites.

SAFETY FENCE AND JURISDICTIONAL FLAGGING:

Description

Safety Fence shall consist of furnishing materials, installing and maintaining polyethylene or polypropylene fence along the outside riparian buffer, wetland, or water boundary, or other boundaries located within the construction corridor to mark the areas that have been approved to infringe within the buffer, wetland, endangered vegetation, culturally sensitive areas or water. The fence shall be installed prior to any land disturbing activities.

Interior boundaries for jurisdictional areas noted above shall be delineated by stakes and highly visible flagging.

Jurisdictional boundaries at staging areas, waste sites, or borrow pits, whether considered outside or interior boundaries shall be delineated by stakes and highly visible flagging.

Materials

(A) Safety Fencing

Polyethylene or polypropylene fence shall be a highly visible preconstructed safety fence approved by the Engineer. The fence material shall have an ultraviolet coating.

Either wood posts or steel posts may be used. Wood posts shall be hardwood with a wedge or pencil tip at one end, and shall be at least 5 ft. in length with a minimum nominal 2" x 2" cross section. Steel posts shall be at least 5 ft. in length, and have a minimum weight of 0.85 lb/ft of length.

(B) Boundary Flagging

Wooden stakes shall be 4 feet in length with a minimum nominal 3/4" x 1-3/4" cross section. The flagging shall be at least 1" in width. The flagging material shall be vinyl and shall be orange in color and highly visible.

Construction Methods

No additional clearing and grubbing is anticipated for the installation of this fence. The fence shall be erected to conform to the general contour of the ground.

(A) Safety Fencing

Posts shall be set at a maximum spacing of 10 ft., maintained in a vertical position and hand set or set with a post driver. If hand set, all backfill material shall be thoroughly tamped. Wood posts may be sharpened to a dull point if power driven. Posts damaged by power driving shall be removed and replaced prior to final acceptance. The tops of all wood posts shall be cut at a 30-degree angle. The wood posts may, at the option of the Contractor, be cut at this angle either before or after the posts are erected.

The fence geotextile shall be attached to the wood posts with one 2" galvanized wire staple across each cable or to the steel posts with wire or other acceptable means.

Place construction stakes to establish the location of the safety fence in accordance with Article 105-9 or Article 801-1 of the *Standard Specifications*. No direct pay will be made for the staking of the safety fence. All stakeouts for safety fence shall be considered incidental to the work being paid for as "Construction Surveying", except that where there is no pay item for construction surveying, all safety fence stakeout will be performed by state forces.

The Contractor shall be required to maintain the safety fence in a satisfactory condition for the duration of the project as determined by the Engineer.

(B) Boundary Flagging

Boundary flagging delineation of interior boundaries shall consist of wooden stakes on 25 feet maximum intervals with highly visible orange flagging attached. Stakes shall be installed a minimum of 6" into the ground. Interior boundaries may be staked on a tangent that runs parallel to buffer but must not encroach on the buffer at any location. Interior boundaries of hand clearing shall be identified with a different colored flagging to distinguish it from mechanized clearing.

Boundary flagging delineation of interior boundaries will be placed in accordance with Article 105-9 or Article 801-1 of the *Standard Specifications*. No direct pay will be made for delineation of the interior boundaries. This delineation will be considered incidental to the work being paid for as *Construction Surveying*, except that where there is no pay item or construction surveying the cost of boundary flagging delineation shall be included in the unit prices bid for the various items in the contract. Installation for delineation of all jurisdictional boundaries at staging areas, waste sites, or borrow pits shall consist of wooden stakes on 25 feet maximum intervals with highly visible orange flagging attached. Stakes shall be installed a minimum of 6" into the ground. Additional flagging may be placed on overhanging vegetation to enhance visibility but does not substitute for installation of stakes.

Installation of boundary flagging for delineation of all jurisdictional boundaries at staging areas, waste sites, or borrow pits shall be performed in accordance with Subarticle 230-4(B)(3)(d) or Subarticle 802-2(F) of the *Standard Specifications*. No direct pay will be made for this delineation, as the cost of same shall be included in the unit prices bid for the various items in the contract.

The Contractor shall be required to maintain alternative stakes and highly visible flagging in a satisfactory condition for the duration of the project as determined by the Engineer.

Measurement and Payment

Safety Fence will be measured and paid as the actual number of linear feet of polyethylene or polypropylene fence installed in place and accepted. Such payment will be full compensation including but not limited to furnishing and installing fence geotextile with necessary posts and post bracing, staples, tie wires, tools, equipment and incidentals necessary to complete this work.

Payment will be made under:

Pay Item	Pay Unit
Safety Fence	Linear Foot

PERMANENT SOIL REINFORCEMENT MAT:

Description

This work consists of furnishing and placing *Permanent Soil Reinforcement Mat*, of the type specified, over previously prepared areas as directed.

Materials

The product shall be a permanent erosion control reinforcement mat and shall be constructed of synthetic or a combination of coconut and synthetic fibers evenly distributed throughout the mat between a bottom UV stabilized netting and a heavy duty UV stabilized top net. The matting shall be stitched together with UV stabilized polypropylene thread to form a permanent three-dimensional structure. The mat shall have the following minimum physical properties:

Property	Test Method	Value	Unit
Light Penetration	ASTM D6567	9	%
Thickness	ASTM D6525	0.40	in
Mass Per Unit Area	ASTM D6566	0.55	lb/sy
Tensile Strength	ASTM D6818	385	lb/ft
Elongation (Maximum)	ASTM D6818	49	%
Resiliency	ASTM D1777	>70	%
UV Stability *	ASTM D4355	≥80	%
Porosity (Permanent Net)	ECTC Guidelines	≥85	%
Maximum Permissible Shear	Performance Bench	≥8.0	lb/ft ²
Stress (Vegetated)	Test		
Maximum Allowable Velocity (Vegetated)	Performance Bench	≥16.0	ft/s
	Test		

*ASTM D1682 Tensile Strength and % strength retention of material after 1000 hours of exposure.

Submit a certification (Type 1, 2, or 3) from the manufacturer showing:

- (A) the chemical and physical properties of the mat used, and
- (B) conformance of the mat with this specification.

Construction Methods

Matting shall be installed in accordance with Subarticle 1631-3(B) of the *Standard Specifications*.

All areas to be protected with the mat shall be brought to final grade and seeded in accordance with Section 1660 of the *Standard Specifications*. The surface of the soil shall be smooth, firm, stable and free of rocks, clods, roots or other obstructions that would prevent the mat from lying in direct contact with the soil surface. Areas where the mat is to be placed will not need to be mulched.

Measurement and Payment

Permanent Soil Reinforcement Mat will be measured and paid for as the actual number of square yards measured along the surface of the ground over which Permanent Soil Reinforcement Mat is installed and accepted. Overlaps will not be included in the measurement, and will be considered as incidental to the work. Such payment shall be full compensation for furnishing and installing the mat, including overlaps, and for all required maintenance.

Payment will be made under:

Pay Item	Pay Unit
Permanent Soil Reinforcement Mat	Square Yard
<u>EARTHEN DAM WITH SKIMMER:</u>	
	(East)

Description

Provide an earthen dam with a skimmer attached to a barrel pipe at the outlet of a proposed roadway ditch to remove sediment from construction site runoff at locations shown in the erosion control plans. See the Earthen Dam with Skimmer Detail sheet provided in the erosion control plans. Work includes constructing earthen dam, installation of coir fiber baffles, furnishing, installation and cleanout of skimmer, providing and placing stone pad on bottom of ditch underneath skimmer device, providing and placing geotextile spillway liner, providing coir fiber mat stabilization for the skimmer outlet, removing earthen dam, coir fiber baffles, geotextile liner and skimmer device, and disposing of excess materials.

Materials

Item	Section
Stone for Erosion Control, Class B	1042
Staples	1060-8

Coir Fiber Mat
Coir Fiber Baffle

1060-14
1640

Provide appropriately sized and approved skimmer device.

Provide Schedule 40 PVC pipe with a length of 6 ft. to attach to the skimmer and the coupling connection to serve as the arm pipe. For skimmer sizes of 2.5 in. and smaller, the arm pipe diameter shall be 1.5 inches. For skimmer sizes of 3 in. and larger, refer to manufacturer recommendation.

Provide 4" diameter Schedule 40 PVC pipe to attach to coupling connection of skimmer to serve as the barrel pipe through the earthen dam.

The geotextile for the spillway liner shall meet the following minimum physical properties for low permeability, woven polypropylene geotextiles:

Property	Test Method	Value	Unit
Tensile Strength	ASTM D-4632	315	lb.
Tensile Elongation (Maximum)	ASTM D-4632	15	%
Trapezoidal Tear	ASTM D-4533	120	lbs.
CBR Puncture	ASTM D-6241	900	lbs.
UV Resistance (% retained at 500 hrs.)	ASTM D-4355	70	%
Apparent Opening Size (AOS)	ASTM D-4751	40	US Std. Sieve
Permittivity	ASTM D-4491	0.05	sec ⁻¹
Water Flow Rate	ASTM D-4491	4	gal/min/ft ²

Anchors: Staples, stakes, or reinforcement bars shall be used as anchors.

Wooden Stakes:

Provide hardwood stakes 12"- 24" long with a 2" x 2" nominal square cross section. One end of the stake must be sharpened or beveled to facilitate driving through the coir fiber mat and down into the underlying soil. The other end of the stake needs to have a 1"- 2" long head at the top with a 1"- 2" notch following to catch and secure the coir fiber mat.

Steel Reinforcement Bars:

Provide uncoated #10 steel reinforcement bars 24" nominal length. The bars shall have a 4" diameter bend at one end with a 4" straight section at the tip to catch and secure the coir fiber mat.

Staples:

Provide staples made of 0.125" diameter new steel wire formed into a *u* shape not less than 12" in length with a throat of 1" in width.

Construction Methods

Excavate proposed ditch according to the roadway plans and cross sections with ditch surface free of obstructions, debris, and pockets of low-density material. Construct earthen dam and install the primary spillway according to the Earthen Dam with Skimmer Detail sheet in the erosion control plans. Construct the coir fiber baffles according to *Roadway Standard Drawings* No. 1640.01 and Section 1640 of the *Standard Specifications*. Accumulated silt behind the earthen dam and baffles shall be removed regularly and as directed.

Install skimmer device according to manufacturer recommendations. Install 4" Schedule 40 PVC pipe into dam on the lower side of basin 1 ft. from the bottom of the basin and according to the detail, and extend the pipe so the basin will drain. Attach a 6 ft. arm pipe to the coupling connection and skimmer according to manufacturer recommendations. Attach the rope included with the skimmer to the tee between the vent socket and the tube inlet, and the other end to a wooden stake or metal post. Clean out skimmer device when it becomes clogged with sediment and/or debris and is unable to float at the top of water impounded in the ditch. Take appropriate measures to avoid ice accumulation in the skimmer device. Construct a stone pad of Class B stone directly underneath the skimmer device at bottom of ditch. The pad shall be a minimum of 12" in height, and shall have a minimum cross sectional area of 4 ft. by 4 ft.

Line primary spillway with low permeability polypropylene geotextile unrolled in the direction of flow and lay smoothly but loosely on soil surface without creases. Bury edges of geotextile in a trench at least 5" deep and tamp firmly. If geotextile for the primary spillway is not one continuous piece of material, make horizontal overlaps a minimum of 18" with upstream geotextile overlapping the downstream geotextile. Secure geotextile with eleven gauge wire staples shaped into a *u* shape with a length of not less than 12" and a throat not less than 1" in width. Place staples along outer edges and throughout the geotextile a maximum of 3 ft. horizontally and vertically. Geotextile shall be placed to the bottom and across the entire width of the ditch according to the Earthen Dam with Skimmer Detail. Place sealant inside basin around barrel pipe on top of geotextile with a minimum width of 6 in.

At the skimmer outlet, provide a smooth soil surface free from stones, clods, or debris that will prevent contact of the coir fiber matting with the soil. Unroll the matting and apply without stretching such that it will lie smoothly but loosely on the soil surface. Wooden stakes, reinforcement bars, or staples may be used as anchors in accordance with the details in the plans and as directed. Place anchors across the matting at the ends approximately 1 ft. apart. Place anchors along the outer edges and down the center of the matting 3 ft. apart.

Measurement and Payment

The construction of the earthen dam will be paid for as *Borrow Excavation* as provided in Section 230 of the *Standard Specifications* or included in the lump sum price for grading.

Silt Excavation will be measured and paid for in accordance with Article 1630-4 of the *Standard Specifications*, as calculated from the typical section throughout the length of the ditch as shown on the final approved plans.

Low Permeability Geotextile will be measured and paid for as the actual number of square yards measured along the surface of the spillway over which the geotextile is installed and accepted.

Coir Fiber Baffles will be measured and paid for in accordance with Article 1640-4 of the *Standard Specifications*.

___" *Skimmer* will be measured in units of each. ___" *Skimmer* will be measured and paid for as the maximum number of each size skimmer acceptably installed and in use at any one time during the life of the project. Barrel and arm pipe, cleanout, relocation and reinstallation of ___" *Skimmer* is considered incidental to the measurement of the quantity of ___" *Skimmer* and no separate payment will be made. No separate payment shall be made if ___" Skimmer, barrel and/or arm pipe(s) are damaged by ice accumulation.

Coir Fiber Mat will be measured and paid for as the actual number of square yards measured along the surface of the ground over which coir fiber mat is installed and accepted.

Stone for Erosion Control, Class ___ will be measured and paid for in accordance with Article 1610-4 of the *Standard Specifications*.

No measurement will be made for other items or for over excavation or stockpiling.

Payment will be made under:

Pay Item	Pay Unit
___" Skimmer	Each
Coir Fiber Mat	Square Yard
Low Permeability Geotextile	Square Yard

STORMWATER BASIN EROSION CONTROL:

Description

Provide a skimmer to remove sediment from construction site runoff in permanent stormwater basins at locations shown in the erosion control plans. Work includes constructing basin, installation of coir fiber baffles, furnishing, installation and cleanout of skimmer, providing and placing stone pad on bottom of basin underneath skimmer device, stabilizing side slopes of basin with matting and seed, disposing of excess materials, removing coir fiber baffles, and skimmer device.

Materials

Item	Section
Seeding and Mulching	1060-4
Matting for Erosion Control	1060-8
Staples	1060-8
Coir Fiber Baffle	1640

Provide appropriately sized and approved skimmer device.

Provide Schedule 40 PVC pipe with a length of 6 ft. to attach to the skimmer and the coupling connection to serve as the arm pipe. For skimmer sizes of 2.5 in. and smaller, the arm pipe diameter shall be 1.5 inches. For skimmer sizes of 3 in. and larger, refer to manufacturer recommendation.

Provide 4" diameter Schedule 40 PVC pipe to attach to coupling connection of skimmer to serve as the barrel pipe through the earthen dam.

Construction Methods

Construct permanent stormwater basin according to the plans with basin surface free of obstructions, debris, and pockets of low-density material. Construct the coir fiber baffles according to *Roadway Standard Drawings* No. 1640.01 and Section 1640 of the *Standard Specifications*.

Install skimmer device according to manufacturer recommendations. Install the coupling connection provided with the skimmer 1 ft. from the bottom of the basin and attach to permanent stormwater drainage structure. Attach the 6 ft. arm pipe to the coupling connection and skimmer according to manufacturer recommendations. Attach the rope included with the skimmer to the tee between the vent socket and the tube inlet, and the other end to a wooden stake or metal post. Clean out skimmer device when it becomes clogged with sediment and/or debris and is unable to float at the top of water in basin. Take appropriate measures to avoid ice accumulation in the skimmer device. Construct a stone pad of Class B stone directly underneath the skimmer device at bottom of basin. The pad shall be a minimum of 12" in height, and shall have a minimum cross sectional area of 4 ft. by 4 ft.

All bare side slope sections of the stormwater basin shall be seeded with a permanent seed mix as directed and in accordance with Articles 1660-4, 1660-5 and 1660-7 of the *Standard Specifications*. Straw or excelsior matting shall be installed on all bare side slope sections immediately upon the completion of seeding and in accordance with Article 1631-3 of the *Standard Specifications*.

Measurement and Payment

Silt Excavation will be measured and paid for in accordance with Article 1630-4 of the *Standard Specifications*, as calculated from the typical section throughout the length of the basin as shown on the final approved plans.

Coir Fiber Baffles will be measured and paid for in Accordance with Article 1640-4 of the *Standard Specifications*.

___ " *Skimmer* will be measured in units of each. ___ " *Skimmer* will be measured and paid for as the maximum number of each size skimmer acceptably installed and in use at any one time during the life of the project. Barrel and arm pipe, cleanout, relocation and reinstallation of ___ "

Skimmer is considered incidental to the measurement of the quantity of ___" *Skimmer* and no separate payment will be made. No separate payment shall be made if ___" *Skimmer*, barrel and/or arm pipe(s) are damaged by ice accumulation.

Stone for Erosion Control, Class ___ will be measured and paid for in accordance with Article 1610-4 of the *Standard Specifications*.

Seeding and Mulching will be measured and paid for in accordance with Article 1660-8 of the *Standard Specifications*.

Matting for Erosion Control will be measured and paid for in accordance with Article 1631-4 of the *Standard Specifications*.

No measurement will be made for other items or for over excavation or stockpiling.

Payment will be made under:

Pay Item

___" Skimmer

Pay Unit

Each

COIR FIBER WATTLES WITH POLYACRYLAMIDE (PAM):

Description

Coir Fiber Wattles are tubular products consisting of coir fibers (coconut fibers) encased in coir fiber netting. Coir Fiber Wattles are used on slopes or channels to intercept runoff and act as a velocity break. Coir Fiber Wattles are to be placed at locations shown on the plans or as directed. Installation shall follow the detail provided in the plans and as directed. Work includes furnishing materials, installation of coir fiber wattles, matting installation, PAM application, and removing wattles.

Materials

Coir Fiber Wattle shall meet the following specifications:

100% Coir (Coconut) Fibers	
Minimum Diameter	12 in.
Minimum Density	3.5 lb/ft ³ +/- 10%
Net Material	Coir Fiber
Net Openings	2 in. x 2 in.
Net Strength	90 lbs.
Minimum Weight	2.6 lbs./ft. +/- 10%

Anchors: Stakes shall be used as anchors.

Wooden Stakes:

Provide hardwood stakes a minimum of 2-ft. long with a 2 in. x 2 in. nominal square cross section. One end of the stake must be sharpened or beveled to facilitate driving down into the underlying soil.

Matting shall meet the requirements of Article 1060-8 of the *Standard Specifications*, or shall meet specifications provided elsewhere in this contract.

Provide staples made of 0.125" diameter new steel wire formed into a *u* shape not less than 12" in length with a throat of 1" in width.

Polyacrylamide (PAM) shall be applied in powder form and shall be anionic or neutrally charged. Soil samples shall be obtained in areas where the wattles will be placed, and from offsite material used to construct the roadway, and analyzed for the appropriate PAM flocculant to be utilized with each wattle. The PAM product used shall be listed on the North Carolina Department of Environment and Natural Resources (NCDENR) Division of Water Quality (DWQ) web site as an approved PAM product for use in North Carolina.

Construction Methods

Coir Fiber Wattles shall be secured to the soil by wire staples approximately every 1 linear foot and at the end of each section of wattle. A minimum of 4 stakes shall be installed on the downstream side of the wattle with a maximum spacing of 2 linear feet along the wattle, and according to the detail. Install a minimum of 2 stakes on the upstream side of the wattle according to the detail provided in the plans. Stakes shall be driven into the ground a minimum of 10 in. with no more than 2 in. projecting from the top of the wattle. Drive stakes at an angle according to the detail provided in the plans.

Only install coir fiber wattle(s) to a height in ditch so flow will not wash around wattle and scour ditch slopes and according to the detail provided in the plans and as directed. Overlap adjoining sections of wattles a minimum of 6 in.

Installation of matting shall be in accordance with the detail provided in the plans, and in accordance with Article 1631-3 of the *Standard Specifications*, or in accordance with specifications provided elsewhere in this contract.

Apply PAM over the lower center portion of the coir fiber wattle where the water is going to flow over at a rate of 2 ounces per wattle, and 1 ounce of PAM on matting on each side of the wattle. PAM applications shall be done during construction activities after every rainfall event that is equal to or exceeds 0.50 in.

The Contractor shall maintain the coir fiber wattles until the project is accepted or until the wattles are removed, and shall remove and dispose of silt accumulations at the wattles when so directed in accordance with the requirements of Section 1630 of the *Standard Specifications*.

Measurement and Payment

Coir Fiber Wattles will be measured and paid for by the actual number of linear feet of wattles which are installed and accepted. Such price and payment will be full compensation for all work covered by this section, including, but not limited to, furnishing all materials, labor, equipment and incidentals necessary to install the *Coir Fiber Wattles*.

Matting will be measured and paid for in accordance with Article 1631-4 of the *Standard Specifications*, or in accordance with specifications provided elsewhere in this contract.

Polyacrylamide(PAM) will be measured and paid for by the actual weight in pounds of PAM applied to the coir fiber wattles. Such price and payment will be full compensation for all work covered by this section, including, but not limited to, furnishing all materials, labor, equipment and incidentals necessary to apply the *Polyacrylamide(PAM)*.

Payment will be made under:

Pay Item

Polyacrylamide(PAM)
Coir Fiber Wattle

Pay Unit

Pound
Linear Foot

SILT FENCE COIR FIBER WATTLE BREAK:

(8-21-12)

1605,1630

Description

Silt fence coir fiber wattle breaks are tubular products consisting of coir fibers (coconut fibers) encased in coir fiber netting and used in conjunction with temporary silt fence at the toe of fills to intercept runoff. Silt fence coir fiber wattle breaks are to be placed at locations shown on the plans or as directed. Installation shall follow the detail provided in the plans and as directed. Work includes furnishing materials, installation, maintenance and removing Silt fence coir fiber wattle breaks.

Materials

Coir fiber wattle shall meet the following specifications:

100% Coir (Coconut) Fibers	
Minimum Diameter	12"
Minimum Length	10 ft
Minimum Density	3.5 lb/cf $\pm$ 10%
Net Material	Coir Fiber
Net Openings	2" x 2"
Net Strength	90 lb.
Minimum Weight	2.6 lb/ft $\pm$ 10%

Stakes shall be used as anchors. Provide hardwood stakes a minimum of 2-ft long with a 2" x 2" nominal square cross section. One end of the stake shall be sharpened or beveled to facilitate driving down into the underlying soil.

Provide staples made of 0.125" diameter new steel wire formed into a U-shape not less than 12" in length with a throat of 1" in width.

Construction Methods

Excavate a trench the entire length of each wattle with a depth of 1" to 2" for the wattle to be placed. Secure silt fence coir fiber wattle breaks to the soil by wire staples approximately every linear foot and at the end of each wattle. Install at least 4 stakes on the downslope side of the wattle with a maximum spacing of 2 linear feet and according to the detail. Install at least 2 stakes on the upslope side of the silt fence coir fiber wattle break according to the detail provided in the plans. Drive stakes into the ground at least 10" with no more than 2" projecting from the top of the wattle. Drive stakes at an angle according to the detail provided in the plans.

Install temporary silt fence in accordance with Section 1605 of the *2012 Standard Specifications* and overlap each downslope side of silt fence wattle break by 6".

Maintain the silt fence coir fiber wattle breaks until the project is accepted or until the silt fence coir fiber wattle breaks are removed, and remove and dispose of silt accumulations at the silt fence coir fiber wattle breaks when so directed in accordance with Section 1630 of the *2012 Standard Specifications*.

Measurement and Payment

Coir Fiber Wattle will be measured and paid as the actual number of linear feet of wattles installed and accepted. Such price and payment will be full compensation for all work covered by this provision, including, but not limited to, furnishing all materials, labor, equipment and incidentals necessary to install the silt fence coir fiber wattle break.

Payment will be made under:

Pay Item
Coir Fiber Wattle

Pay Unit
Linear Foot

TEMPORARY ROCK SILT CHECK TYPE A WITH EXCELSIOR MATTING AND POLYACRYLAMIDE (PAM):

Description

Temporary Rock Silt Checks Type A with Excelsior Matting and Polyacrylamide (PAM) are devices utilized in temporary and permanent ditches to reduce runoff velocity and incorporate PAM into the construction runoff to increase settling of sediment particles and reduce turbidity of runoff. Temporary Rock Silt Checks Type A with Excelsior Matting and PAM are to be

placed at locations shown on the plans or as directed. Installation shall follow the detail provided in the plans and as directed. Work includes furnishing materials, installation of Temporary Rock Silt Checks Type A, matting installation, PAM application, and removing Temporary Rock Silt Checks Type A with Excelsior Matting and PAM.

Materials

Structural stone shall be class B stone that meets the requirements of Section 1042 of the *Standard Specifications* for Stone for Erosion Control, Class B.

Sediment control stone shall be #5 or #57 stone, which meets the requirements of Section 1005 of the *Standard Specifications* for these stone sizes.

Matting shall meet the requirements of Excelsior Matting in Subarticle 1060-8(B) of the *Standard Specifications*, or shall meet specifications provided elsewhere in this contract.

Polyacrylamide (PAM) shall be applied in powder form and shall be anionic or neutrally charged. Soil samples shall be obtained in areas where the Temporary Rock Silt Checks Type A with Excelsior Matting and PAM will be placed, and from offsite material used to construct the roadway, and analyzed for the appropriate PAM flocculant to be utilized with each Temporary Rock Silt Check Type A. The PAM product used shall be listed on the North Carolina Department of Environment and Natural Resources (NCDENR) Division of Water Quality (DWQ) web site as an approved PAM product for use in North Carolina.

Construction Methods

Temporary Rock Silt Checks Type A shall be installed in accordance with Subarticle 1633-3(A) of the *Standard Specifications*, Roadway Standard Drawing No. 1633.01 and the detail provided in the plans.

Installation of matting shall be in accordance with the detail provided in the plans, and anchored by placing Class B stone on top of the matting at the upper and lower ends.

Apply PAM at a rate of 4 ounces over the center portion of the Temporary Rock Silt Checks Type A and matting where the water is going to flow over. PAM applications shall be done during construction activities and after every rainfall event that is equal to or exceeds 0.50 in.

The Contractor shall maintain the Temporary Rock Silt Checks Type A with Excelsior Matting and PAM until the project is accepted or until the Temporary Rock Silt Checks Type A with Excelsior Matting and PAM are removed, and shall remove and dispose of silt accumulations at the Temporary Rock Silt Checks Type A with Excelsior Matting and PAM when so directed in accordance with the requirements of Section 1630 of the *Standard Specifications*.

Measurement and Payment

Temporary Rock Silt Checks Type A will be measured and paid for in accordance with Article 1633-5 of the *Standard Specifications*, or in accordance with specifications provided elsewhere in this contract.

Matting will be measured and paid for in accordance with Article 1631-4 of the *Standard Specifications*, or in accordance with specifications provided elsewhere in this contract.

Polyacrylamide(PAM) will be measured and paid for by the actual weight in pounds of PAM applied to the Temporary Rock Silt Checks Type A. Such price and payment will be full compensation for all work covered by this section, including, but not limited to, furnishing all materials, labor, equipment and incidentals necessary to apply the *Polyacrylamide(PAM)*.

Payment will be made under:

Pay Item

Polyacrylamide(PAM)

Pay Unit

Pound

IMPERVIOUS DIKE:**Description**

This work consists of furnishing, installing, maintaining, and removing an *Impervious Dike* for the purpose of diverting normal stream flow around the construction site. The Contractor shall construct an impervious dike in such a manner approved by the Engineer. The impervious dike shall not permit seepage of water into the construction site or contribute to siltation of the stream. The impervious dike shall be constructed of an acceptable material in the locations noted on the plans or as directed.

Materials

Acceptable materials shall include but not be limited to sheet piles, sandbags, and/or the placement of an acceptable size stone lined with polypropylene or other impervious geotextile.

Earth material shall not be used to construct an impervious dike when it is in direct contact with the stream unless vegetation can be established before contact with the stream takes place.

Measurement and Payment

Impervious Dike will be measured and paid as the actual number of linear feet of impervious dike(s) constructed, measured in place from end to end of each separate installation that has been completed and accepted. Such price and payment will be full compensation for all work including but not limited to furnishing materials, construction, maintenance, and removal of the impervious dike.

Payment will be made under:

Pay Item

Impervious Dike

Pay Unit

Linear Foot

COIR FIBER MAT:**Description**

Furnish material, install and maintain coir fiber mat in locations shown on the plans or in locations as directed. Work includes providing all materials, excavating and backfilling, and placing and securing coir fiber mat with stakes, steel reinforcement bars or staples as directed.

Materials**Item**

Coir Fiber Mat

Section

1060-14

Anchors: Stakes, reinforcement bars, or staples shall be used as anchors.

Wooden Stakes:

Provide hardwood stakes 12"- 24" long with a 2" x 2" nominal square cross section. One end of the stake must be sharpened or beveled to facilitate driving through the coir fiber mat and down into the underlying soil. The other end of the stake needs to have a 1"- 2" long head at the top with a 1"- 2" notch following to catch and secure the coir fiber mat.

Steel Reinforcement Bars:

Provide uncoated #10 steel reinforcement bars 24" nominal length. The bars shall have a 4" diameter bend at one end with a 4" straight section at the tip to catch and secure the coir fiber mat.

Staples:

Provide staples made of 0.125" diameter new steel wire formed into a *u* shape not less than 12" in length with a throat of 1" in width.

Construction Methods

Place the coir fiber mat immediately upon final grading. Provide a smooth soil surface free from stones, clods, or debris that will prevent the contact of the mat with the soil. Unroll the mat and apply without stretching such that it will lie smoothly but loosely on the soil surface.

For stream relocation applications, take care to preserve the required line, grade, and cross section of the area covered. Bury the top slope end of each piece of mat in a narrow trench at

least 6 in. deep and tamp firmly. Where one roll of matting ends and a second roll begins, overlap the end of the upper roll over the buried end of the second roll so there is a 6 in. overlap. Construct check trenches at least 12 in. deep every 50 ft. longitudinally along the edges of the mat or as directed. Fold over and bury mat to the full depth of the trench, close and tamp firmly. Overlap mat at least 6 in. where 2 or more widths of mat are installed side by side. Place anchors across the mat at the ends approximately 1 ft. apart. Place anchors along the outer edges and down the center of the mat 3 ft. apart.

Adjustments in the trenching or anchoring requirements to fit individual site conditions may be required.

Measurement and Payment

Coir Fiber Mat will be measured and paid for as the actual number of square yards measured along the surface of the ground over which coir fiber mat is installed and accepted.

No measurement will be made for anchor items.

Payment will be made under:


Pay Item

Coir Fiber Mat

Pay Unit

Square Yard

TABLE OF CONTENTS REST AREA SITE WORK

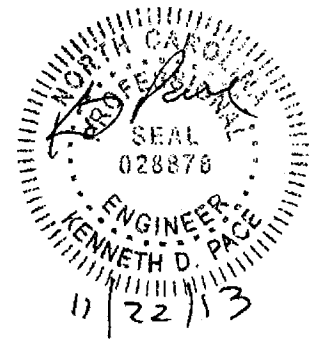

PLANTING

SEASONAL LIMITATIONS.....	2
MULCH FOR PLANTING.....	2
WATER FOR PLANTING.....	2
TOPSOIL.....	3
LANDSCAPE GRADING.....	3
ESTABLISHMENT PERIOD FOR PLANTING	5
STREAMBANK BUFFER REFORESTATION PLANTING	5

REST AREA SITE IMPROVEMENTS

PICNIC TABLES, TERRAZZO & STEEL.....	6
PICNIC SHELTER, ONE TABLE.....	8
WASTE CONTAINER.....	10
RECYCLING CONTAINER.....	11
4" CONCRETE SIDEWALK.....	11
COMPOSITE DECKING.....	12
PLACEMENT OF BOULDERS.....	12
LANDSCAPE METAL EDGING.....	13
6' WOOD FENCE.....	14
TAPERED ALUMINUM FLAGPOLE.....	15
RAINWATER COLLECTION SYSTEM.....	16
IRRIGATION SYSTEM.....	21
CENTPEDE TURF SEEDING.....	25
SODDING.....	25
RIVERSTONE.....	28
BICYCLE PARKING BOLLARD.....	28
WHEELSTOPS @ H/C PARKING.....	29
DEPRESSED CURB HANDICAP PARKING ACCESS, 28' x 6'.....	29
DEPRESSED CURB HANDICAP PARKING ACCESS, 60' x 8'.....	29
HDPE FENCE SLATS.....	30
3" PVC UTILITY SLEEVE.....	30

PLANTING

SEASONAL LIMITATIONS

The initial planting and replacement of plants shall be done from October 15 thru March 31.
See Standard Specifications Sections 1060 - Landscape Development Materials and 1670 - Planting.

MULCH FOR PLANTING

Mulch for Planting: Mulch will be pine bark mini-nuggets from a single source unless otherwise approved by the Engineer. **Submit sample for approval prior to placement.**
 Install mulch to a finished depth of 4 inches, rake and compact to create a uniform finish. All mulch and the work associated in placing the mulch during planting shall conform to article 1060-11 of the Standard Specifications.

Payment will be made under:

Mulch for plantingCY

WATER FOR PLANTING

Water for Planting: Water for Planting will be applied in accordance with the standard specifications. Water for Planting will be furnished as described herein. It is anticipated that installation of the landscape planting and sod, and therefore watering of plant materials and sod, will occur after the site water system has been installed, connected and is functional. Consequently the water for this project will be provided to the contractor through the on site water system. Should a problem occur with the on site water system the contractor will be required to furnish water from an alternative source with no additional compensation to the contractor. All applicable sections of Section 1060, 'Landscape Development Materials' and Section 1670, 'Planting' of the Standard Specifications will apply.

Payment will be made under:

Water for PlantingM/G

TOPSOIL

General: The work covered by this provision shall consist of furnishing and placing topsoil (approximately 4 inches) within the rest area sites for filling or raising areas within seeding and mulching areas and adjacent to sidewalk locations to provide proper surface drainage; backfilling

around buildings, sidewalks, picnicking facilities, etc., to bring to proposed finish grades as indicated on the plans and as directed by the Engineer.

Material: Topsoil shall consist of a sandy loam, silt loam or clay loam which contains a reasonable amount of humus material. Topsoil shall be of good texture, loose and friable and shall be representative of topsoil in the general vicinity. It shall be reasonably free from sod, hard lumps, subsoil, large roots, rocks and gravel, noxious weed seeds and/or toxic substitutes or other material which would be harmful to plant growth. All topsoil shall be approved by the Engineer when delivered to the job site, whether or not the source of topsoil has been previously approved.

Construction: The Contractor shall cut and satisfactorily dispose of weeds or other vegetative growth in areas to receive topsoil. The existing soil shall then be loosened by scarifying, harrowing, or discing to a depth of five inches; however, care shall be exercised by the Contractor to minimize disturbance of roots of trees and to prevent disturbance of existing water, sewer and electrical utilities which are to remain. Topsoil shall then be placed and spread evenly to the required depth which, after settlement, shall constitute finish grade. Topsoil shall not be placed when the ground is frozen, is excessively wet, nor is in a condition that the soil cannot be worked easily and dressed smoothly.

Compensation: The quantity of topsoil to be paid for will be the actual number of cubic yards of topsoil which has been placed as specified herein and accepted. The topsoil used on this project will be measured for payment by pit measurement as provided in Sub-article 230-5(A) or by truck measurement as provided by Sub-article 230-5(B), as directed by the Engineer. The quantity of topsoil, measured as provided for above, will be paid for at the contract unit price per cubic yard "Topsoil". Such price and REST AREA SITE WORK payment will be full compensation or furnishing, placing, all labor, equipment and all incidentals necessary to complete the work satisfactorily.

Payment will be made under:

Topsoil Cu. Yd.

LANDSCAPE GRADING

General: Landscape grading consist of fine grading within the rest area site to bring to proposed grades and provide proper drainage, backfilling around buildings, sidewalks, etc. and placement of topsoil within seeding and planting beds as indicated on the grading plans, site plan and as directed by the Engineer.

It is the intent of the Department to utilize the existing topsoil contained within the project limits, if approved, as the final soil layer distributed in the planting areas on this project. The contractor will strip, stockpile, transport, and distribute topsoil in accordance with the plans and specifications, and as directed by the Engineer.

Material: Topsoil will be as specified herein and will be utilized for all fill/backfill operations as directed by the Engineer.

If additional topsoil is needed beyond what can be obtained from the construction site, a sandy loam, silt loam or clay loam topsoil that contains a reasonable amount of humus material will be furnished. Topsoil will be of good texture, loose and friable and will be representative of topsoil in the general vicinity. It will be reasonably free from sod, hard lumps, subsoil, large roots, rocks and gravel, noxious weed seeds and/or toxic substances or other material, which would be harmful to plant growth. Remove all stones and other foreign material 3" or larger in diameter.

Topsoil when delivered to the job site will be approved by the Engineer prior to placement, whether or not the source of topsoil has been previously approved.

Fill material to bring building site to finished grade will be as specified in the building specifications under earthwork.

Installation: Place building fill and compact as described in the building specifications. Place topsoil and spread evenly to a depth of 4 inches or as directed by the Engineer, which after settlement, constitutes finish grade. Do not place topsoil when the ground is frozen, is excessively wet, or is in a condition that the soil cannot be worked easily and dressed smoothly. Fill material under sidewalks and concrete paving shall be compacted to a density equal to or greater than undisturbed soil in the area.

Compensation: 'Landscape Grading' will be paid for at the contract lump sum price for the work detailed in this section that has been successfully accomplished and accepted.

Building fill will be included as part of the building lump sum payment. 'Topsoil' will be paid for in the actual number of cubic yards of topsoil placed and accepted. Topsoil stripped, stockpiled and distributed from the rest area site will not qualify for compensation, only topsoil furnished from offsite sources will be compensated.

Such price and payment will be full compensation for furnishing, all labor, equipment and all incidentals necessary to complete the work satisfactorily.

Payment will be made under:

Landscape Grading LS

ESTABLISHMENT PERIOD FOR PLANTING

Establishment Period for Planting: An establishment period will begin after satisfactory installation and acceptance of all of the planting and *will apply only to the woody plant materials: trees, shrubs and ground covers*. All plants must be in an upright healthy condition, planted at the proper depth, mulched areas will be weed free and tidy and any staking or guying that is utilized must be in proper condition prior to beginning the establishment period. During the establishment period the contractor will be responsible for proper care of the plantings in accordance with Section 1670-14 Establishment.

All plants that do not continue to conform to the specifications and quality as approved when they were installed will be unacceptable. The contractor will remove all plants that are determined to be unacceptable from the site within five days of request by the Engineer. Replacements will be installed within the Seasonal Limitations.

Each month during the establishment period a meeting will be held between the Engineer and the Contractor to discuss establishment work required during that period. Additional meetings may be scheduled if deemed necessary by the Engineer. All the required work will be performed in a timely manner and with utmost regard to the safety and convenience of the rest area users. Failure on the part of the contractor to complete the required work in a satisfactory manner will result in the Department having the work performed by others and paid for by the Performance Bond.

All requirements of Section 1670-14 Establishment will also be applicable during the Establishment Period for Planting. The Establishment Period for Planting will last a minimum of twelve months and extend into the seasonal limitations for planting in order to allow replacement plantings to be installed. See contract times for exact time period and dates.

STREAMBANK BUFFER REFORESTATION PLANTING

General: Supply and install plantings of the species, quantity, size and spacing shown on the Streambank Buffer Reforestation Plan and Details sheets, and as directed by the Engineer.

Compensation: The work of supplying and installing streambank buffer reforestation, when completed and accepted, will be paid for at the contract unit price for Lump Sum. Such unit price to be considered full payment, including but not limited to, all labor, materials, and any other incidentals necessary or required to complete the work.

Payment will be made under:

Streambank Buffer Reforestation Planting Lump Sum

PICNIC TABLE, TERRAZZO & STEEL

General: Picnic tables shall consist of furnishing and installing tables on concrete slabs, in accordance with the sizes, dimensions and details shown on the plans and as described herein. A picnic table shall include table site preparation, grading, concrete footing and concrete floor slab, a welded tubular steel frame with a terrazzo table top and aluminum seats for benches, all hardware required for assembly and other incidentals as necessary for a complete installation in accordance with detail drawings.

The Engineer reserves the right to inspect the frames and tops at the place of manufacture in accordance with Article 106-6 of the Standard Specifications.

The locations of all tables are tentatively shown on the site plan; however, exact locations, elevation, orientation, etc., will be determined on the site by the Engineer.

Submittal: Submit color chart (four copies) on epoxy glaze coatings for color selection by the Engineer for steel frames.

Materials and Construction

Table Site Preparation: After table sites are located and staked by the Engineer, the Contractor shall perform necessary clearing and grubbing in accordance with Section 200 "Clearing and Grubbing" of the Standard Specifications.

Grading: Picnic table concrete slab sub grade shall be graded level with drainage swale cut on high side and filling on low side as shown on detail drawings. Additional embankment material, borrow excavation, if required for raising table elevation and backfilling, topsoil, around concrete slab are covered elsewhere in proposal.

Concrete and Steel: Class "B" concrete shall be used in all table footings and floor slabs. All concrete and all structural and reinforcing steel shall comply with applicable portions of Section 825 and 1000 "Incidental Concrete Construction - General"; Section 1070 "Reinforcing Steel"; and Section 1072 "Structural Steel"; of the Standard Specifications.

Benches: Aluminum seats for picnic tables shall be nominal size 2" x 10", aluminum.

Terrazzo Tops: Terrazzo tabletops shall conform to the following specifications:

1. Scope. Provide pre-cast terrazzo tops for picnic tables. Include inserts and bolts as indicated on drawings.

2. Materials.

- A. Portland Cement. Portland cement shall comply with all applicable requirements of Section 1024, "Materials for Portland Cement Concrete," of the Standard Specifications.
- B. Sand. Sand shall be clean and free from organic matter and shall meet the requirements of 4S mortar sand, from Table 1005-1, "Aggregate Gradation," of the Standard Specifications.
- C. Marble Chips. Of size, colors and kinds required by the color plate as specified herein; chips to have abrasive hardness not less than 13 as determined by method described in National Bureau of Standard BMS Report No. 98.
- D. Terrazzo Sealing Solution. Shall produce a waterproof film on surface; seal moisture in terrazzo and shall not be damaged by cleaning solution; shall not yellow terrazzo or leave tacky finish on surface after buffing.
- E. Terrazzo Cleaning Solution. Use only a neutral chemical cleaner that will not change the color of terrazzo or damage it in any way.

3. Terrazzo Composition and Colors.

- A. Terrazzo tops shall be of colors and composition as shown in Terrazzo Plant Catalog of the National Terrazzo and Mosaic Association, Inc. Mix terrazzo in accordance with formulas and specifications for Plate 129.

4. Production of Tops.

- A. Mix chips so that the finish surface has 80 percent aggregate showing.
- B. Perform initial and final grinding with abrasive grit stone of proper size to obtain the finish specified. After curing terrazzo topping, by keeping damp for 6 days (or less if it has set enough to grind without loosening of chips), grind surfaces with electric machine. After initial grinding or rubbing, grout surfaces with neat Portland Cement paste of creamy consistency, filling all voids; use Portland Cement and coloring corresponding to existing topping for grouting. Let grout remain on surfaces until final grinding, but not less than 2 days.
- C. Final grinding shall produce surface of same color and texture as Plate 129 as specified in Item 3 above. Surfaces shall be smooth and free from imperfections. In no case shall terrazzo show a wave exceeding 1/16" when tested with straight edge.

5. Cleaning and Sealing Terrazzo.

- A. After final grinding, apply cleaning solution to terrazzo in accordance with the manufacturer's directions. After surfaces are dry, wash and rinse terrazzo and apply a coat of sealing solution. Buff terrazzo with electric machine and leave in clean finished condition.

6. Installation of Table Tops.

- A. Bolt in place, without binding.
- B. Clean tops of grease, dirt, etc., and apply two (2) additional coats of sealing solution, buff with electric machine and leave in clean finished condition.
- C. Leave top in good condition. No chipped tops or edges and cracked slabs will be accepted.

7. Painting of Table, Steel Frame.

Exterior Steel:

One coat of factory priming, exterior rust resistant metal primer.

Two coats of epoxy glaze coating, gloss finish.

NOTE: Painter shall spot check a small area with a second coat to determine if primer "lifts off". If it does, obtain from the paint factory a second coater that will not lift from the priming coat actually used by the factory.

Compensation: The work of furnishing and installing picnic tables, when completed and accepted, will be paid for at the contract unit price for each "Picnic Table, Terrazzo and Steel", such unit price to be considered full payment for each table, including but not limited to, all labor, materials, and any other incidentals necessary or required to complete the work.

Payment will be made under:

Picnic Table, Terrazzo and Steel EA

PICNIC SHELTERS, ONE TABLE

General: The work covered by this section consists of furnishing and constructing as shown on the drawings and herein specified, picnic shelters complete with single picnic table including all labor, materials, services and incidentals required to complete the work.

Picnic tables shall be as described under "Picnic Tables, Terrazzo and Steel".

Concrete and Steel: Class "B" concrete shall be used in all footings and floor slabs. All concrete and all structural and reinforcing steel shall comply with applicable portions of Section 825 "Incidental Concrete Construction - General"; Section 1070 "Reinforcing Steel"; and Section 1072 "Structural Steel" of the Standard Specifications.

Include all fasteners, anchors, ties, gusset plates, etc., as required. Thru bolts shall be 1/2 inches in diameter, length as required, hot-dip galvanized steel. Install with steel galvanized washers under both bolt head and nut, except for gusset plates; galvanizing shall conform with applicable requirements of Section 1076 of the Standard Specifications.

Carpentry and Millwork: See drawings and details for location and quantity of both rough and finish carpentry.

Grading of all lumber, plywood and trim shall conform to the association under whose rules it is graded. Moisture content shall not exceed 18 percent for framing lumber and 12 percent for millwork and trim.

All lumber in contact with concrete or masonry, and/or soil shall be treated with water borne pentachlorophenol or CCA (Chromated Copper Arsenate) in accordance with standards of the American Wood Preserver's Association. Minimum retention shall be 0.25 pcf for material 2 inches and smaller and 0.40 pcf for materials greater than 2 inches.

All lumber and millwork shall be stored in a manner that will keep it dry and well ventilated, well off the ground, and adequately covered.

Carpentry and millwork materials shall be as follows:

All timbers, rafters and fascia shall be full size, rough-cut No. 1 southern yellow pine, thru-bolted where shown on drawings and securely spiked together at all other joints. Stain all timbers, rafters, fascia and underside of roof decking. The Engineer from samples furnished by the contractor will select color.

Treat portion of wood columns to be within concrete footing with asphalt paint, prior to placing concrete.

Roof decking shall be single tongue and groove, 2 inches by 6 inches with vee joints on face side, kiln-dried No. 1 southern yellow pine. Double spike each member at every rafter.

Installation: Framing rafters and fascia shall be cut square on bearings, closely fitted, accurately set to required lines and levels, and rigidly secured in place.

Moisture Protection:

1. Roofing and Related Items. See drawings and details for quantities, etc.

2. Roofing Felt; 15# asphalt-saturated felt conforming to ASTM D-226.
3. Metal Roofing shall be the same brand, color, and type as those approved for the rest area service building.

Lay one layer of 15# roofing felt to sheathing, lapping horizontally 6 inches, prior to placing metal roof (or as recommended by the engineer)

Furnish and install, where shown on drawings, all items of flashing and caulking as required to properly and completely weatherproof the building. Flashing, drips, etc., shall be galvanized steel, 26 ga., or aluminum, .019-inch sheeting, unless otherwise shown on drawings. Caulking shall be installed in accordance with manufacturer's specifications. Use Dap "Flex seal", Dow Corning "790", or Pecora GC-9 "Synthacalk", or approved equal.

Compensation: The work of furnishing and installing picnic shelters with tables, when completed and accepted, will be paid for at the contract unit price for each "Picnic Shelter, Single Picnic Table", such unit price to be considered full payment for each individual shelter with table, including but not limited to, all labor, materials, and any other incidentals necessary or required to complete the work.

Payment will be made under:

Picnic Shelter, Single Picnic Table EA

WASTE CONTAINER

General: Waste container shall be furnished and installed in tandem with Recycling Container on 4" concrete pad in accordance with detail plans and shall be located as shown on the plans or as directed by the Engineer.

Waste container unit shall be the product of a manufacturer regularly engaged in the design and manufacture of precast exposed aggregate waste containers. (See Waste/Recycle Container Detail Plan Sheet for size, design, material, etc.) Finish color shall be "Brown" hoods and "Sand" containers. Provide model TF1030 (A-3-color) by Wausau Tile or equal. Submit six (6) copies of shop drawings or submittal data to Engineer for approval.

Compensation: The quantity of waste container units to be paid for shall be the actual number of Waste Container units with foundation slabs, complete in place and accepted, at the contract unit price each for each "Waste Container". Such price and payment will be full compensation for the work of furnishing and installing the waste container, including but not limited to, all labor,

materials, tools, equipment and all incidentals necessary to complete the work.

Payment will be made under:

Waste Container EA

RECYCLING CONTAINER

General: Recycling container shall be furnished and installed in tandem with Waste Container on 4" concrete pad in accordance with detail plans and shall be located as shown on the plans or as directed by the Engineer.

Recycling container unit shall be the product of a manufacturer regularly engaged in the design and manufacture of precast exposed aggregate waste containers. (See Waste/Recycle Container Detail Plan Sheet for size, design, material, etc.) Recycling Container shall have blue international recycling logo cast into one side. Finish color shall be "Blue" hoods with single can sized hole and "Sand" containers. Provide model TF1030 (A-3-color) by Wausau Tile or equal. Submit six (6) copies of shop drawings or submittal data to Engineer for approval.

Compensation: The quantity of recycling container units to be paid for shall be the actual number of Recycling Container units with foundation slabs, complete in place and accepted, at the contract unit price each for each "Recycling Container". Such price and payment will be full compensation for the work of furnishing and installing the recycling container, including but not limited to, all labor, materials, tools, equipment and all incidentals necessary to complete the work.

Payment will be made under:

Recycling Container EA

4" CONCRETE SIDEWALKS

General: The sidewalks indicated on the plans shall be 4" concrete. The sidewalks shall be as specified in Section 848 and as shown on the plans.

Scoring patterns shall be as shown on plans or as directed by the Engineer in field, and as specified in Section 825-10. Control joints indicated on plans shall be as specified for Grooved Contraction Joints.

Compensation: The quantities of sidewalk to be paid for will be the actual number of square yards measured along the surface which have been completed and accepted. Sidewalks with turned down edges shall be measured to add the depth of the turned down height. The quantity of sidewalk measured as indicated above, will be paid for at the contract unit price per square yard for "4" Concrete Sidewalk". There will be no additional compensation for control and expansion joints.

Payment will be made under:

4" Concrete Sidewalk SY

COMPOSITE DECKING

General: The work covered by this section shall consist of furnishing and installing the Composite Decking in accordance with dimensions and finishes as shown on the plans, the details, and as described herein.

Materials and Construction: Decking shall be as manufactured by TmberTech, Fiberon, Moisture Seal, or other approved equal. Color: Gray/Earthtone. Decking shall be installed as noted on the plans and details. Decking shall be placed in line and plumb with proposed grades and sidewalks. Contractor shall supply samples to engineer for approval prior to construction.

Compensation: The work of furnishing and installing Composite Decking System as shown on the plans or as approved by the Engineer, when completed and accepted, will be paid for at the unit price per square feet for "Composite Decking". Such price and payment will be full compensation for all work covered by this special provision; including but not limited to furnishing transport, all labor, materials, equipment, excavation and grading, concrete slab, and any other incidentals necessary to complete the work.

Payment will be made under:

Composite DeckingSF

PLACEMENT OF BOULDERS

General: The work covered in this item shall include the contractor providing and installing boulders in landscaped areas shown on the plan.

Boulders shall be placed at locations shown on plans or as designated by the Engineer at appropriate stages of construction. Contractor shall supply to the Engineer a staging plan showing the time frame of installment of stones and how he will not damage any existing and proposed

hardscape (i.e. Roadway, sidewalks...)

The size of boulders shall be:

Medium Boulders – 10 CF-20 CF (8 boulders)

See the Landscape Plans (LP-002 & LD001)

Care shall be taken during transport, delivery and placement to prevent chipping, cracking or scarring of surfaces. Boulders shall be placed in such a way so that they will be immovable and will not roll.

Compensation: Placement of boulders as designated on plans and as directed by Engineer will be paid for at the contract price each for "Placement of Boulders". Such price and payment will be full compensation for all work covered by this Special Provision and details; including but not limited to furnishing all materials, labor and equipment necessary or required to complete the work.

Payment will be made under:

Placement of Boulders Each

LANDSCAPE METAL EDGING

General: The work covered by this item shall consist of furnishing and installing the metal landscape edging in accordance with the dimensions and finishes as shown on the plans, the details, and as described herein.

Landscape Metal edging construction shall conform to all applicable specifications for the product used.

Compensation: The work of installing landscape metal edging as shown on the plans or as approved by the Engineer, when completed and accepted, will be paid for at the unit price per linear foot for "Landscape Metal Edging". Such price and payment will be full compensation for all work covered by this special provision; including but not limited to furnishing all labor, materials, and equipment and any other incidentals necessary or required to complete the work.

Payment will be made under:

Landscape Metal Edging Linear Foot

6' WOOD FENCE

General: The work covered by this item shall consist of furnishing and installing the board on board wood fence, posts, and concrete piers as shown on the plans and described herein.

Carpentry and Millwork: See drawings and details for location and quantity of both rough and finish carpentry.

Materials: Grading of all lumber and trim shall conform to the association under whose rules it is graded. Moisture content shall not exceed 18 percent for framing lumber and 12 percent for millwork and trim. All lumber in contact with concrete or masonry, and/or soil shall be treated with water-born pentachlorophenol or CCA (Chromated Copper Arsenate) in accordance with standards of the American Wood Preserver's Association. Minimum retention shall be 0.25 pcf for material 2 inches and smaller and 0.40 pcf for materials greater than 2 inches. All lumber and millwork shall be stored in a manner that will keep it dry and well-ventilated, well off the ground, and adequately covered.

Carpentry and millwork materials shall be as follows: All lumber shall be full size, rough-cut No. 1 southern yellow pine, thru-bolted where shown on drawings and securely spiked together at all other joints. Stain/paint to match cedar wood siding on primary building as approved by the Engineer.

All bolts, screws, washers, and channel shall be galvanized and conform to all applicable requirements of Section 1076 of the Standard Specifications. Touch-up all breaks in galvanizing, such as holes, end cuts, etc. with zinc rich paint prior to assembling bench.

Concrete shall be Class "A" and meet the requirements of Section 1000 of the Standard Specifications.

Installation: Excavate and pour concrete piers as shown on the drawings. Place reinforcing steel anchors, in concrete piers, as described in Section 420-13 and Section 1070. Construction and framing shall be cut and assembled square on bearings, closely fitted, accurately set to required lines and levels, and rigidly secured in place.

Compensation: Six foot wood fence as described above and as shown on the plans shall be paid for at the contract unit price per linear feet of "6' Wood Fence", measured from the (vertical) center line of post to post along the wood fence, complete in place and accepted. Such price shall be full compensation for all labor, materials, tools, equipment, and all other incidentals necessary to complete the work.

Payment will be made under:

6' Wood Fence Linear Feet

TAPERED ALUMINUM FLAGPOLE

General: The work covered by this section consists of furnishing and installing 40' Tapered Aluminum Flagpole at locations as shown on the drawings.

Materials: The flagpoles shall be 30' exposed height (34' overall length) standard cone tapered aluminum flagpoles as manufactured by American Flagpole or equal. Provide a ball bearing revolving truck assembly with a 8" gold anodized ball finial. Provide an aluminum flash collar and all components recommended by the manufacturer for a ground-set installation.

Installation: Follow the manufacturer's recommendations concerning ground set mounting for a 80 M.P.H. design a wind load.

Compensation: The Tapered Aluminum Flagpoles will be paid for a the contract unit price for each. Such payment will be full compensation for all work covered by this section including, but not limited to, furnishing and installing the flagpole, flash collar, halyard, cleats, flag snaps, and all parts recommended by the manufacturer for a ground-set installation; and all labor, materials and equipment necessary to complete the work.

Payment will be made under:

Tapered Aluminum Flag Pole Each

RAINWATER COLLECTION SYSTEM**DESCRIPTION:**

A. Work required under this section consists of construction as noted on the drawings and as specified herein.

B. Scope of Work included in this section is for the furnishing of all materials, equipment and labor necessary for the completion of the described Rainwater Collection System. The system furnished must meet the criteria specified in the design schematics.

1. The furnishing and installation of materials shall include but not be limited to the following items:

- a. Rainwater collection and overflow piping, filters, tanks, and risers.
- b. Water supply piping for make-up and filter rinse.
- c. Rainwater collection system controller and monitoring equipment.

C. Coordination:

1. The installing Contractor(s) shall coordinate and schedule the contract work to integrate the system equipment into the other project specified work.

QUALITY ASSURANCE:

A. Approved Equipment Supplier:

- 1. The design schematic shown on the drawings and the specifications listed herein are based on the design data, services, and materials readily available through national suppliers of rainwater collection and storage equipment, and plumbing materials.
- 2. The contractor shall use only use reputable equipment suppliers approved by the Engineer.

B. Rainwater Collection System Supplier's design responsibility:

1. The Rainwater Collection System Supplier shall be responsible for providing a completely functional and integrated system.

C. Rainwater Collection System Supplier's field support:

1. Final start-up and adjustment meeting shall be provided for the proper adjustments to be made to the system to meet the performance levels established. It is also the time to familiarize the maintenance staff of the correct procedures to operate the collection system equipment. Before final inspection of the water feature the following items need to be complete:

- a. Electrical connections made and tested.

b. Hydraulic piping and fittings complete and tested for leaks, repaired if necessary, and flushed clean.

c. The water reservoir or cistern cleaned and filled to the correct operating depth.

2. Job site visits by NCDOT project engineers and designers can be made during certain construction phases of the project.

1. A pre-construction meeting shall be arranged with the general contractor for the coordination of the trades involved in the system construction and installation. This allows for a detailed explanation of the suggested installation techniques and the sequence of the installation.

INDUSTRY STANDARDS AND APPLICABLE CODES:

- A. The materials shall be installed in accordance with all applicable provisions of the most recent edition of the following:

ANSI

ASTM

ASSE

ASME

AWWA

CS

NEMA

NSF

UL

NEC

OSHA

NFPA

American National Standards Institute

American Society for Testing and Materials

American Society of Sanitary Engineering

American Society of Mechanical Engineers

American Water Works Association

Commercial Standards

National Electrical Manufacturers Association

National Sanitation Foundation

Underwriters Laboratory

National Electric Code

Occupational Safety and Health Act

National Fire Protection Agency

and, all other state or local code(s) which are applicable.

- B. The above referenced guidelines shall be considered minimum standards for the materials or

the installation practices applicable for the Rainwater Collection system.

SHOP DRAWINGS AND SUBMITTALS:

The Rainwater Collection system as shown on the plans shall be considered schematic in design. Final design specifications shall be defined and supplied by the contractor, in keeping with the contract work, noted minimum specifications, and in coordination with all other applicable site work.

A. The contractor shall submit drawings in accordance with the conditions of the Contract Specification section describing the size(s), location(s), and installation details of the piping, storage, filters, and water management equipment.

1. After the approval review and prior to construction a total of six (6) sets drawings will be provided to the Engineer for distribution to the respective engineers and installing Contractors.

B. The Engineer may add other drawings during the period of construction as required for clarification.

B. This specification shall be considered an integral part of the accompanying drawings. Anything omitted from one and embodied in the other is considered essential to the contract and must be furnished by the Contractor.

D. The drawings are essentially diagrammatic and are used only to define the scope of work to be done.

E. Three (3) complete sets of As-Built Drawings in the Operation and Maintenance Manuals shall be provided by the Engineer at the conclusion of the project.

F. All pertinent data on any substitute materials or equipment shall be provided to Engineer for review and evaluation.

SUBSTITUTIONS:

A. Submittals for equal items shall include the following information where applicable:

1. Operation Design Description.
2. Component materials and finishes.
3. Certification of conformance with specified codes and standards.

B. Proposed substitutions for equipment or material must be submitted within thirty (30) working days prior to final bid date for consideration as approved equals. Proposals for substitutions shall be made only by the prime bidders in writing to Engineer and sub-contractors shall not make any proposals to the Landscape Architect for substitution.

1. Contractors submitting bids including substitute equipment and / or materials must also submit a bid for the "as specified" equipment and materials at the same time.
2. All equipment supplied to the Contractor shall be supplied by a single supplier unless otherwise approved.

C. Submittals of equal systems or components may be rejected for the following reasons:

1. If the equipment or material should require any change to the electrical, mechanical, structural, or architectural design.
2. If the dimensions of the equal equipment or material vary from the specified equipment or material and impair accessibility or clearances.

D. Should a substitution be accepted and prove defective or otherwise unsatisfactory within the guarantee period the Contractor shall replace it at no cost to the owner.

SUBMITTALS:

A. Submittals shall include the following:

1. Shop drawings and product information for all equipment and materials furnished.
2. Complete Material list.

B. Submittals shall be rejected if they are difficult to read due to poor image, drafting quality, insufficient scale, or missing data.

GUARANTEE:

A. Rainwater Collection Supplier and installing Contractor(s) shall issue a joint guarantee that any equipment found defective within one (1) year of the final acceptance shall be replaced at no cost to the Owner.

B. The guarantee does not extend to damage incurred through operation and maintenance by the Owner. The Owner will assume full responsibility for the proper operation and maintenance of the system upon final acceptance.

GENERAL INSTALLATION:

- A. Protect all pipes, conduits, equipment and other parts of the work against injury by exposure to the weather while stored, during construction, or after installation.
- B. Install and connect all equipment in accordance with manufacturer's instruction and recommendations unless otherwise noted. If specified installation is contrary to the manufacturer's instruction, cease installation of affected components or systems and notify the Engineer.
- C. Accurately locate all in-slab items being cast in concrete and rigidly support them to resist loads during pour.

PIPE INSTALLATION:

- A. General installation:
 - 1. Make all pipe runs as direct as possible using a minimum number of fittings.
 - 2. Cut pipe and tubing ends square. Remove rough edges and burrs to create a smooth unobstructed flow.
 - 4. Protect all openings in piping during construction to prevent entrance of foreign matter.
 - 5. All connections between dissimilar metals shall be made with dielectric fittings.

Compensation: Basis of payment for this item of work will be the lump sum price for the installation of the "Rainwater Collection System". The above prices and payments will be full compensation for all work covered by this section.

Payment will be made under:

Rainwater Collection System.....Lump Sum

IRRIGATION SYSTEM

General: The Contractor shall provide all materials and labor to install an Irrigation System utilizing drip emitters. The Department has provided plan sheets that designate the planted areas that are to receive drip emitter irrigation. The contractor shall provide a Design Plan showing piping, emitter locations, pumps, controls, valves and components to operate the system by drawing water from a 3,000 gallon Cistern Tank (tank specified elsewhere) as well as shop drawings and specifications for the pipe, pumps, controls, irrigation components, system controller, and appropriate housing for all the components he proposes to furnish, for approval by the Engineer.

The Contractor shall provide all labor, equipment, and materials for the installation of the irrigation system including but not limited to layout, trenching, backfilling, providing and installing pipe, valves, filters, pressure regulators, pump, pressure tank, drip tubing, drains, controller, wiring, and boring sleeves.

The Contractor shall be familiar with all state and local regulations and ordinances concerning irrigation systems and obtain permits that are necessary for the installation of the irrigation system.

The Contractor shall lay out work as accurately as possible in accordance with the irrigation plans.

Design plan that is to be designed by the contractor and approved by the engineer.

The Contractor shall furnish a transferable certificate of warranty registration and a guarantee of work and materials for a one-year period from date of final acceptance of the system. Final payment for the system shall not be made unless this certification is presented to the Engineer.

The Contractor shall conduct his operations in such a manner to prevent injury to trees, shrubs, and turf or other types of vegetation that are to remain growing. When any such injuries to trees or shrubs occur, broken branches shall be removed and rough edges of scarred areas shaped and made smooth in accordance with generally accepted horticultural practice. All scarred areas and cut surfaces more than one (1) inch in diameter shall then be thoroughly covered with tree paint. Any plants that are damaged to such an extent as to destroy their value for landscape purposes shall be cut and disposed of and replaced in kind by the Contractor at no cost to the Department when so directed by the Engineer.

The Contractor shall be responsible for full and complete coverage of irrigated area and shall make any necessary minor adjustments or as directed by the Engineer at no additional costs.

The Contractor shall prepare an "as-built" drawing on a blue-line print which shall include locations of all parts of the irrigation system installed by the Contractor. This may include, but is not limited to all system controllers, valves (automatic and manual), pipe, bores, drip tube, wires, wire splices, and any deviation from the contract bid documents. Two (2) copies of the "as-built"

drawing shall be supplied to the Department of Transportation.

The Contractor shall be responsible for training personnel in the operation and maintenance of the irrigation system.

The Contractor shall balance and adjust the various components of the irrigation system as the overall operation of the system is most efficient. This includes synchronization of the controllers, adjustments to pressure valves, and individual station adjustments on the controllers.

Upon completion of the irrigation system installation, the Contractor shall schedule a final inspection with the Engineer. Final acceptance of the irrigation system shall take place upon approval of the Engineer that satisfactory installation is complete.

System Piping: The installation of the system piping shall be in accordance with the manufacturer's instructions and shall proceed from the point of connection of supply for the system. The supply for the system shall be the 3000 gallon underground rainwater collection tank located on site. The Irrigation System work includes a submersible pump with a screened floating suction intake and all connections. The pump shall be adequately sized for the operation of the system.

All irrigation pipes shall be installed in accordance with manufacturer's recommendations. Pipe and fittings shall be thoroughly cleaned of dirt, dust, and moisture before application of required solvent or lubricant. All connections between plastic pipe and metal valves or steel pipe shall be made using plastic male adapters. All threads shall be sealed with teflon thread sealing tape.

All automatic remote control valves with PVC ball valves; installed on the inlet side, shall be installed in 12 inch meter boxes to provide for accessibility for maintenance operations. Meter boxes shall be Ametek #170106 approved equal. Valve boxes shall be mounted with lids at the finish grade level. The Contractor shall install all valves in locations that will not conflict with plant locations in the plant beds.

If necessary, any PVC water pipe shall be installed in accordance with the applicable irrigation provisions herein, as shown on the irrigation plans, and/or as directed by the Engineer.

During the progress of the work and until the completion and final acceptance, the pipelines and their appurtenances shall be kept clean throughout. Any obstructions or deposits shall be removed. When work is not in progress, open ends of pipe, fittings, and valves shall be securely closed so that water, earth, or other foreign substances cannot enter.

If, at any time before completion of the contract, any broken pipe or any defects are found in the lines or in any of their fittings or appurtenances, they shall be replaced. All pipe, fittings, and appurtenances shall be carefully examined for defects before placing, and any found defective shall not be used.

The Contractor is herein forewarned as to the possibility of having to vary the depth of pipeline installation to achieve minimum cover specified (whether existing pipelines, conduits, cables,

mains, etc. are shown on the plans or not). Pipe and accessories shall be carefully lowered into the trench with suitable equipment. Under no circumstances shall any of the water main materials be dropped or dumped into the trench. All irrigation system main lines shall be installed at a minimum of 18 inches and a maximum of 24 inches below the soil grade. All irrigation system zone lines shall be installed at a minimum of 12 inches and a maximum of 18 inches below the soil grade.

All backfill material shall be free of rock, stones, lumps, or debris. Backfilled trenches shall be compacted to a degree comparable to the adjacent undisturbed material. Trenches shall be tamped mechanically. All disturbed areas shall be dressed off to finish grade. The Contractor shall be responsible for settling of the irrigation trenches for a period of one (1) year from date of final acceptance and refill trenches as needed.

PVC pipe shall be the size as noted on the irrigation plans.

All solvent weld fittings shall have a minimum Schedule 40 PVC rating.

All main line pipe and system zone line pipe shall be PR 200 PVC pipe.

Wiring: Automatic control wiring shall be installed in a common trench with the system piping where feasible. All wiring shall be installed at least 12 inches below finished grade and to the side and below the irrigation piping. The Contractor shall provide looped slack at the valve locations and snake wires in the trench to allow for linear contraction of the wires. Wiring shall be bundled and tied or taped at 10 ft. intervals. The following shall also apply:

All 26.5 VAC control wiring shall be #14 AG, single strand, copper wire with polyethylene UF installation rated for 300 VAC minimum unless otherwise noted. Common wires from controllers shall be white in color while hot wires shall be red in color.

Control wire splices shall be allowed only in runs of 500 feet or more. Splices shall be kept to a minimum and shall be made with approved materials. Concentrations of splices, where necessary, shall be installed in Ametek valve boxes or approved equal.

All 26.5 VAC control wire shall be installed within conduit whenever the wire is passing through sleeves.

Drip Irrigation Emitters: All drip irrigation emitters shall be of the size, type, and model numbers as indicated by the irrigation drawings and notes. Spacing of the emitters on this project shall not exceed the manufacturer's maximum recommended spacing. The location of all emitters shall be as shown on the irrigation plans.

½" & ¼" Tubing: All drip irrigation ½" and ¼" tubing shall be the size and type as indicated on the irrigation plans and shall be located as shown in the details. The ½" tubing shall be Rainbird

Xeri-Tube 700 or approved equal and the ¼" tubing shall be Rainbird ¼" Vinyl Distribution Tubing or an approved equal. All drip irrigation tubing shall meet the manufacturers recommended specifications.

Ball and Remote Control Valves, Filters, and Pressure Regulators: The ball and remote control valves, filters, and pressure regulators shall be a part of the Rainbird Control Zone Kit ¾" or approved equal. The kit contains a XBV-075 ball valve, a 75-DVX remote control valve, a RBY-075-200MX in-line filter, a PSI-M30X pressure regulator, and two ¾" schedule 80 nipples. The Control Zone Kit ¾" shall be installed to manufacturers specifications. The location of all valves, filters, and pressure regulators shall be as shown on the irrigation plans.

Dual Program Hybrid Controller: The irrigation system controller shall be a Dual Program Controller with a built in surge protector capable of fully automatic or manual operation of the system. It shall be housed in a weatherproof, key-lock cabinet for outdoor installation.

Check Valve: A check valve shall be installed on the irrigation system main line pipe within 10 (TEN) feet of the well head.

Testing: Upon completion of the irrigation system, the entire system shall be tested for proper operation. All air will be flushed from the system and the Contractor will check all components for proper operation.

The Contractor shall perform pressure and leakage testing of irrigation lines. The Contractor shall notify the Engineer two (2) days in advance of testing. Testing shall be performed in the presence of the Engineer or his representative. All main line piping shall be flushed of air and placed under the available static pressure or the design pressure, whichever is greater, for a period of six (6) hours. The system piping shall be isolated from the source of supply pressure for the duration of the test. The pressure in the system piping shall be noted every hour and if an excessive pressure drop is noted, the reason(s) shall be determined and repairs effected. Zone lateral lines shall be inspected while a particular irrigation zone is operating. Each emitter shall be inspected for leaks as will the route of the installed lateral piping.

Compensation: Basis of payment for this contract will be the lump sum price for the installation of the irrigation system. The above prices and payments will be full compensation for all work covered by this section.

Payment will be made under:

Irrigation SystemLump Sum

CENTIPEDE TURF SEEDING

General: The seeding shall be performed in accordance with all applicable requirements of Section 1660 of the Standard Specifications and the following provisions:

Materials:

Certified Centipede seed shall be applied at the rate of 1 lbs/1000 SF.

Balanced Lawn Fertilizer shall be incorporated into the planting soil at the rate of 15 lbs/1000SF.

Compensation: Basis of payment for this contract will be per acre price for the installation of the Centipede Turf Seeding, measured along the surface of the ground completed and accepted. No direct payment will be made for furnishing and applying limestone, fertilizer, mulch, or cover crops, as these will be considered incidental to seeding work.

Payment will be made under:

Centipede Turf Seeding Acre

SODDING**Sodding (Centipede)**

General: The sodding shall be prepared in accordance with all applicable requirements of Section 1664 of the Standard Specifications and the following provisions:

The Contractor shall obtain a certificate or limited permit issued by The N.C. Department of Agriculture (1-800-206-9333) or (919-733-6932) stating that the sod has been found to be free of injurious plant pests.

Materials: Only "approved sod" (trade designation) consisting of centipede grass shall be used. The sod, machine cut to the supplier's standard width and length, shall be 5/8 inch (16 mm) minimum thickness, excluding top growth and thatch, at the time of cutting. Before cutting, the sod shall be uniformly mowed at a height of 1 to 2 inches (25-52 mm). Standard sod sections shall be sufficiently strong to support their own weight and retain their size and shape when suspended vertically from a firm grasp on the upper 10% of the section.

Sod shall be delivered on site within 24 hours of being cut and be covered by acceptable means during delivery. A certificate from the sod producer stating the date and time of sod cutting shall accompany the sod when it arrives at the project site.

Soil Preparation: Remove litter and other debris. Mow and satisfactorily dispose of weeds or other unacceptable growth on the areas to be sodded.

Prior to beginning preparation of the soil to receive sod, all eroded, uneven and rough areas shall be contour graded and/or filled with soil as directed by the Engineer. The soil shall be scarified or otherwise loosened to a depth of not less than 5 inches (130 mm) with a maximum width of 48 inches (1145 mm). Clods shall be broken and the top 2 to 3 inches (52 to 78 mm) of soil shall be worked into an acceptable soil bed by the use of soil pulverizers, drags, or harrows.

The Contractor shall be responsible for taking sufficient soil samples (at least one sample per planting area for testing by The Department of Agriculture, Soil Testing Division, to determine the soil pH. Samples shall be taken in the presence of the Engineer. Results shall be received by the Engineer directly from the North Carolina Department of Agriculture and Consumer Services.

Limestone: Based on these results the Contractor shall add limestone, if required, to bring the soil pH to 5.5 to 6.5 (opt. 6.0). The amount of limestone to be applied will be approved by the Engineer prior to application. Application of limestone will be considered incidental to the work of "Sodding" and no direct payment will be made for such.

Sulfur: Based on these results the Contractor shall add sulfur if the pH is greater than 7.0, to bring the soil pH to 5.5 to 6.5 (opt. 6.0). The amount of sulfur to be applied will be approved by the Engineer prior to application. Application of sulfur will be considered incidental to the work of "Sodding" and no direct payment will be made for such.

After soil preparation, lime or sulfur (if necessary), shall be uniformly distributed by mechanical means using a drop type spreader and thoroughly mixed with the top five inches (130 mm) of the soil by discing, harrowing, or other approved methods.

The area shall then be harrowed, dragged, raked, or prepared by other approved methods which will give a lawn type finish. All trash, debris and stones larger than 1-1/2 inch (38 mm) in diameter or other obstructions that could interfere with the placing of the sod shall also be removed. The finished surface shall be moistened with water prior to placing the sod as directed by the Engineer.

Placement: Sod handling and placement shall be a continuous process of cutting, transporting and installing including repairing seams and voids. Sod shall always be installed within 48 hours after being cut. Sod shall be watered within 2 hours of installation.

Any sod or portions of sod rejected by the Engineer during the initial placement shall be removed from the project and replaced with acceptable sod immediately. The Contractor shall cease any and all other placement of sod on the project until rejected sod has been replaced.

After sod has been placed, and staked where necessary, according to Section 1664, it shall then be rolled or tamped carefully and firmly by means acceptable to the Engineer to ensure proper soil contact. If rolled, roller shall weigh 150#/ft (224kg/m) of roller width. Use of rubber tired equipment to roll shall not be allowed. Metal staples, 12 inches (305 mm) long unless otherwise approved, shall be made of 11 gauge (3.0 mm diameter) new steel wire so as not to bend when

pinned or driven through the sod. Extreme care shall be taken to prevent the installed sod from being torn or displaced. After rolling or tamping the sod, it shall be watered uniformly and thoroughly with a minimum of 1 inch of water (5.6 gallons per square yard (25 liters per square meter)) applied immediately after installation of sod. In no case shall the time interval between sod placement and initial watering exceed 2 hours. Water shall be placed to the required quantity through sequential passes to insure proper coverage and to prevent runoff. A minimum of ¼ inch (6.4 mm) should be placed on each pass.

Maintenance: The Contractor shall be responsible for all watering and other maintenance required to maintain the livability and health of the sod from installation until completion of the 60 day observation period. Additional water shall be applied as needed and as directed by the Engineer to maintain the livability of the sod. Each additional watering event shall be a minimum of 0.5 inch of water (2.8 gallons per square yard (13 liters per square meter)) uniformly applied over the sodded area and may be placed in a series of passes to prevent runoff, with a minimum of ¼ inch (6.4 mm) on each pass.

Any sod or portions of sod rejected by the Engineer after placement but prior to beginning the observation period, shall be removed from the project and replaced with acceptable sod. Satisfactory replacement of sod shall begin within 10 days of notification. Failure to replace and repair damaged or dead sod as directed by the Engineer may result in sanctions under Article 108-7 or Article 108-8.

Observation Period: The Contractor shall maintain responsibility for the sod for a 60 day observation period beginning upon the satisfactory completion and acceptance of all work required in the plans or as directed by the Engineer. The Contractor shall guarantee the sod under the payment and performance bond, per Article 109-10 in the standard specifications.

Upon satisfactory completion of work and acceptance by the Engineer, the 60 day observation period shall begin.

The Contractor shall be responsible for all watering and other maintenance required to maintain the livability of the sod from installation until final acceptance including monitoring the sod to ensure all watering and other maintenance is performed as required.

After the first 30 days of the 60 day observation period, the Contractor and Engineer shall meet to review the project and identify dead or damaged sod to be replaced. The Contractor, at no additional expense to the Department, shall satisfactorily replace any sod that is not in a living and healthy condition as determined by the Engineer. Replacement sod shall be furnished and installed in accordance with the same requirements as for initial sodding operation, except that the amounts of limestone, sulfur, and water may be readjusted as directed by the Engineer. Satisfactory replacement of sod shall begin within 10 days of notification. Failure to replace and repair damaged or dead sod as directed by the Engineer may result in sanctions under Article 108-7 or Article 108-8. Upon completion and acceptance of the sod repairs, the remaining 30 days of the observation period shall begin.

Acceptance: At the end of the 60 day observation period, the sod furnished and installed under this contract must be in a living and healthy condition, as determined by the Engineer.

Acceptance of sod will be at the end of the 60 day observation period.

Sodding shall be inspected by the Area Roadside Environmental Engineer to begin and end the 60 day observation period. The sod shall be weed free at time of final acceptance.

Compensation: Payment and measurement to be in accordance with Section 1664 of the Standard Specifications..

Payment will be made under:

Sodding Square Yards

RIVER STONE

General: The work covered by this section consists of furnishing and placing as shown on the drawings and herein specified, River Stone including all labor, materials, services and incidentals required to complete the work.

Materials: River stone shall be rounded washed stone from 2"- 5" in diameter place 6" deep.

Compensation: The quantities of River Stone to be paid for will be the actual number of tons which have been placed and accepted. The quantity of River Stone measured as indicated above, will be paid for at the contract unit price per ton for "River Stone"..

Payment will be made under:

River Stone TON

BICYCLE PARKING BOLLARD

General: The work covered by this section consists of furnishing and placing as shown on the drawings and herein specified, metal in ground mounted Bicycle Parking Bollards including all labor, materials, services and incidentals required to complete the work.

Materials: 4 ½" diameter, 1/8" wall thickness, powder coated steel, 2 bicycle capacity as manufactured or supplied by SiteScapes, Bike Parking, Victor Stanley, Pilot Rock, and others or equivalent.

Compensation: The quantities of Bicycle Parking Bollard to be paid for will be the actual number which have been placed and accepted. The quantity of Bicycle Parking Bollard measured as indicated above, will be paid for at the contract unit price per each for "Bicycle Parking Bollard"

Payment will be made under:

Bicycle Parking Bollard Each

WHEEL STOPS @ H/C PARKING

General: The work covered by this section consists of furnishing and placing as shown on the drawings and herein specified, pre-cast concrete wheel stops, including all labor, materials, services and incidentals required to complete the work.

Compensation: The quantities of Wheel Stops @ H/C Parking, to be paid for will be the actual number of units which have been completed and accepted. The quantity of wheel stops will be paid for at the contract unit price each for "Wheel Stops @ H/C Parking".

Payment will be made under:

Wheel Stops @ H/C Parking Each

DEPRESSED CURB HANDICAP ACCESS, 28' x 6'

General: The work covered by this section consists of constructing the depressed curb handicap access complete with detectable warning surfaces, as shown on the drawings, including all labor, materials, services and incidentals required to complete the work shown on the drawings.

Compensation: The quantities of Depressed Curb Handicap Access, 28' x 6' to be paid for will be the actual number of units which have been completed and accepted.

Payment will be made under:

Depressed Curb Handicap Access, 28' x 6' Each

DEPRESSED CURB HANDICAP ACCESS, 60' x 8'

General: The work covered by this section consists of constructing the depressed curb handicap access complete with detectable warning surfaces, as shown on the drawings, including all labor, materials, services and incidentals required to complete the work shown on the drawings.

Compensation: The quantities of Depressed Curb Handicap Access, 60' x 8' to be paid for will be the actual number of units which have been completed and accepted.

Payment will be made under:

Depressed Curb Handicap Access, 60' x 8' Each

3" PVC UTILITY SLEEVE

General: The work covered by the provision shall consist of furnishing and installing sleeve pipe as shown on the plans (or as directed by the Engineer) under sidewalks and patio pavement before they are poured (open cut). Place sleeve at a depth of 2' below finished grade to extend 18" beyond pavement on each side. **Mark the location of the sleeve by driving a pressure treated wooden stake in line at each end (1" exposed above finished grade).**

Material: The sleeve shall be rigid (Polyvinyl Chloride) heavy wall, UL approved for underground use without concrete encasement per UL 651 "Rigid Non-Metallic Conduit or Encasement".

Installation: Excavate, place encasement pipe and backfill so that encasement is in line with piping. Backfill shall be compacted to 95% where beneath walks, drives or other concrete pads.

Method of Measurement and Basis of Payment:

Measurement and payment for PVC Utility Sleeve shall be at the contract unit price per linear foot for "3" PVC Utility Sleeve" as installed, and will be full compensation for all work covered by this section.

Payment will be made under:

3" PVC Utility Sleeve.....LF

Installation: Excavate, place encasement pipe and backfill so that encasement is in line with piping. Backfill shall be compacted to 95% where beneath walks, drives or other concrete pads.

Method of Measurement and Basis of Payment:

Measurement and payment for PVC Utility Sleeve shall be at the contract unit price per linear foot for "3" PVC Utility Sleeve" as installed, and will be full compensation for all work covered by this section.

Payment will be made under:

3" PVC Utility Sleeve.....LF




PROJECT MANUAL

US-17 Rest Area


Beaufort County, North Carolina

NCDOT


Architecture: Clearscapes, PA
 Structure: Lysaght & Associates
 PME Building Systems: Burke Design Group, PA



11.7.13

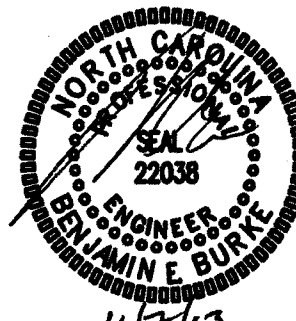

11/7/13

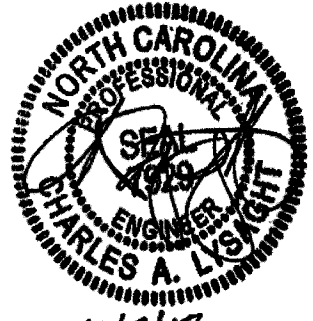

11/7/13

PROJ.CONTRACT #: C203304-RA
 TIP PROJECT#: K-3800
 WBS #: 38748.3.1
 F.A. PROJECT #: NHS-17(32)
 SCO PROJECT #: 13-10090-01

CONSTRUCTION DRAWINGS

US-17 REST AREA
BEAUFORT COUNTY, NORTH CAROLINA

September 2013

Architecture:	Clearscapes
Structure:	Lysaght & Associates
Site/Civil/Landscape:	NCDOT
PME Building Systems:	Burke Design Group, PA

Division.....	Section Title.....	Pages
TABLE OF CONTENTS		2
DIVISION 1 - GENERAL REQUIREMENTS		
01100.....	SUMMARY	3
01310.....	PROJECT MANAGEMENT AND COORDINATION	7
01320.....	CONSTRUCTION PROGRESS DOCUMENTATION	6
01330.....	SUBMITTAL PROCEDURES	8
01500.....	TEMPORARY FACILITIES AND CONTROLS	7
01524.....	CONSTRUCTION WASTE MANAGEMENT	5
01731.....	CUTTING AND PATCHING	4
01770.....	CLOSEOUT PROCEDURES	5
01781.....	PROJECT RECORD DOCUMENTS	3
01782.....	OPERATION AND MAINTENANCE DATA	5
DIVISION 2 – SITE CONSTRUCTION		
02300.....	EARTHWORK.....	8
02361.....	TERMITE CONTROL	3
02751.....	CEMENT CONCRETE PAVEMENT	5
DIVISION 3 – CONCRETE		
03300.....	CAST-IN-PLACE CONCRETE	8
DIVISION 4 - MASONRY		
04810.....	UNIT MASONRY ASSEMBLIES	10
DIVISION 5 - METALS		
05120.....	STRUCTURAL STEEL	5
05400.....	COLD-FORMED METAL FRAMING	6
05500.....	METAL FABRICATIONS	4
DIVISION 6 - WOOD AND PLASTICS		
06100.....	ROUGH CARPENTRY	5
06160.....	SHEATHING	5
06402.....	INTERIOR ARCHITECTURAL WOODWORK	5
DIVISION 7 - THERMAL AND MOISTURE PROTECTION		
07115.....	BITUMINOUS DAMPPROOFING	3
07210.....	BUILDING INSULATION.....	5
07610.....	SHEET METAL ROOFING	7
07620.....	SHEET METAL FLASHING AND TRIM	9
07920.....	JOINT SEALANTS.....	7
DIVISION 8 - DOORS AND WINDOWS		
08110.....	STEEL DOORS AND FRAMES	8
08211.....	FLUSH WOOD DOORS	4
08311.....	ACCESS DOORS AND FRAMES	3
08331.....	OVERHEAD COILING DOORS	5
08411.....	ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS	9
08710.....	DOOR HARDWARE.....	9
08800.....	GLAZING	9
08830.....	MIRRORS	3

DIVISION 9 - FINISHES

09111.....	NON-LOAD-BEARING STEEL FRAMING	5
09250.....	GYPSUM BOARD	5
09310.....	CERAMIC TILE	6
09653.....	RESILIENT WALL BASE AND ACCESSORIES	4
09911.....	EXTERIOR PAINTING	5
09912.....	INTERIOR PAINTING.....	6
09962.....	EPOXY TERRAZZO FLOORING.....	7

DIVISION 10 - SPECIALTIES

10155.....	TOILET COMPARTMENTS	3
10200.....	LOUVERS AND VENTS	3
10431.....	SIGNAGE.....	5
10520.....	FIRE-PROTECTION SPECIALTIES.....	4
10801.....	TOILET AND BATH ACCESSORIES.....	4

DIVISION 15A - PLUMBING

15010.....	BASIC PLUMBING REQUIREMENTS.....	7
15140.....	HANGERS AND SUPPORTS.....	4
15190.....	PLUMBING IDENTIFICATION	2
15250.....	PLUMBING PIPING INSULATION	4
15410.....	PLUMBING PIPING	3
15430.....	PLUMBING SPECIALTIES.....	2
15450.....	WATER HEATERS.....	2
15452.....	SOLAR WATER HEATING SYSTEM	3

DIVISION 15B - MECHANICAL

15500.....	BASIC MECHANICAL REQUIREMENTS.....	7
15501.....	HANGERS AND SUPPORTS.....	3
15504.....	PIPING INSULATION-REFRIGERANT/CONDENSATE	3
15507.....	DUCTWORK INSULATION.....	2
15510A.....	HYDRONIC PIPING	3
15510B.....	GROUND-LOOP HEAT-PUMP PIPING	2
15513.....	REFRIGERANT PIPING.....	2
15672.....	SPLIT SYSTEM HEAT PUMP	3
15674.....	DUCT FREE SPLIT SYSTEM AIR CONDITIONER.....	3
15745.....	WATER-SOURCE GEOTHERMAL HEAT PUMPS	6
15782.....	ENERGY RECOVERY VENTILATOR.....	3
15870.....	POWER VENTILATORS.....	3
15891.....	METAL DUCTWORK	3
15910.....	DUCT ACCESSORIES.....	2
15932.....	AIR OUTLETS & INLETS.....	3
15990.....	TESTING, ADJUSTING & BALANCING.....	6

DIVISION 16 - ELECTRICAL

16010.....	BASIC ELECTRICAL REQUIREMENTS	7
16050.....	BASIC ELECTRICAL MATERIALS AND METHODS.....	4
16100.....	RACEWAYS, BOXES AND CABINETS	5
16120.....	WIRES AND CABLES.....	3
16140.....	WIRING DEVICES	3
16190.....	SUPPORTING DEVICES.....	3
16195.....	ELECTRICAL IDENTIFICATION.....	3
16452.....	GROUNDING	4
16470.....	PANEL BOARDS	3
16476.....	DISCONNECTS.....	2
16515.....	INTERIOR LIGHTING	6

SECTION 01100 - SUMMARY

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Work covered by the Contract Documents.
 - 2. Work under other contracts.
 - 3. Use of premises.
 - 4. Specification formats and conventions.

1.2 WORK COVERED BY CONTRACT DOCUMENTS

- A. Project Identification: Highway 17 Rest Area
 - 1. Project Location: Beaufort County, North Carolina
- B. Owner: The State of North Carolina, through the Department of Transportation
- C. Architect: Clearscapes, PA, of Raleigh, North Carolina
- D. The Work consists of the following: The construction of a new approximately 2400 sf single story rest area.
- E. Project will be constructed under a single prime contract.

1.3 WORK UNDER OTHER CONTRACTS

- A. General: Cooperate fully with separate contractors so work on those contracts may be carried out smoothly, without interfering with or delaying work under this Contract. Coordinate the Work of this Contract with work performed under separate contracts.
- B. Future Work: Owner will award separate contract(s) for the following additional work to be performed at site after Substantial Completion. Completion of that work will depend on successful completion of preparatory work under this Contract.
 - 1. A separate contract will be awarded to provide the vending equipment.

1.4 USE OF PREMISES

- A. General: Contractor shall have partial use of premises for construction operations, including partial use of Project site, during construction period. Contractor's use of premises is limited only by Owner's right to perform work or to retain other contractors on portions of Project.

1.5 OWNER'S OCCUPANCY REQUIREMENTS

- A. Owner Occupancy of Completed Area of Construction: Owner reserves the right to occupy and to place and install equipment in completed areas of building, before Substantial Completion, provided such occupancy does not interfere with completion of the Work. Such placement of equipment and partial occupancy shall not constitute acceptance of the total Work.

1. Architect will prepare a Certificate of Substantial Completion for reach specific portion of the Work to be occupied before Owner occupancy.
2. Obtain a Certificate of Substantial Occupancy from authorities having jurisdiction before Owner occupancy.
3. Before partial Owner occupancy, mechanical and electrical system shall be fully operational, and required tests and inspection shall be successfully completed. On occupancy, Owner will operate and maintain mechanical and electrical systems serving occupied portions of building.
4. On occupancy, Owner will assume responsibility of maintenance and custodial service for occupied portions of building.

1.6 WORK RESTRICTIONS

1. Nonsmoking Building: Smoking is not permitted within the building or within 25 feet of entrances, operable window, or outdoor air intakes.

1.7 SPECIFICATION FORMATS AND CONVENTIONS

- A. Specification Format: The Specifications are organized into Divisions and Sections using the 16-division format and CSI/CSC's "Master Format" numbering system.
 1. Division 1: Sections in Division 1 govern the execution of the Work of all Sections in the Specifications.
- B. Specification Content: The Specifications use certain conventions for the style of language and the intended meaning of certain terms, words, and phrases when used in particular situations. These conventions are as follows:
 1. Abbreviated Language: Language used in the Specifications and other Contract Documents is abbreviated. Words and meanings shall be interpreted as appropriate. Words implied, but not stated, shall be inferred as the sense requires. Singular words shall be interpreted as plural, and plural words shall be interpreted as singular where applicable as the context of the Contract Documents indicates.
 2. Imperative mood and streamlined language are generally used in the Specifications. Requirements expressed in the imperative mood are to be performed by Contractor. Occasionally, the indicative or subjunctive mood may be used in the Section Text for clarity to describe responsibilities that must be fulfilled indirectly by Contractor or by others when so noted.
 - a. The words "shall," "shall be," or "shall comply with," depending on the context, are implied where a colon (:) is used within a sentence or phrase.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 01100

1. Abbreviated Language: Language used in the Specifications and other Contract Documents is abbreviated. Words and meanings shall be interpreted as appropriate. Words implied, but not stated, shall be inferred as the sense requires. Singular words shall be interpreted as plural, and plural words shall be interpreted as singular where applicable as the context of the Contract Documents indicates.
2. Imperative mood and streamlined language are generally used in the Specifications. Requirements expressed in the imperative mood are to be performed by Contractor. Occasionally, the indicative or subjunctive mood may be used in the Section Text for clarity to describe responsibilities that must be fulfilled indirectly by Contractor or by others when so noted.
 - a. The words "shall," "shall be," or "shall comply with," depending on the context, are implied where a colon (:) is used within a sentence or phrase.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 01100

SECTION 01310 - PROJECT MANAGEMENT AND COORDINATION

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative provisions for coordinating construction operations on Project including, but not limited to, the following:
 - 1. Coordination Drawings.
 - 2. Project meetings.
 - 3. Requests for Interpretation (RFIs).

1.2 DEFINITIONS

- A. RFI: Request from Contractor seeking interpretation or clarification of the Contract Documents.

1.3 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations, included in different Sections, that depend on each other for proper installation, connection, and operation.
 - 1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components with other contractors to ensure maximum accessibility for required maintenance, service, and repair.
 - 3. Make adequate provisions to accommodate items scheduled for later installation.
 - 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair of all components, including mechanical and electrical.
- B. Prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
 - 1. Prepare similar memoranda for Owner and separate contractors if coordination of their Work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:

1. Preparation of Contractor's Construction Schedule.
2. Preparation of the Schedule of Values.
3. Installation and removal of temporary facilities and controls.
4. Delivery and processing of submittals.
5. Progress meetings.
6. Preinstallation conferences.
7. Project closeout activities.
8. Startup and adjustment of systems.
9. Project closeout activities.

1.4 SUBMITTALS

- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.
1. Content: Project-specific information, drawn accurately to scale. Do not base Coordination Drawings on reproductions of the Contract Documents or standard printed data. Include the following information, as applicable:
 - a. Indicate functional and spatial relationships of components of architectural, structural, civil, mechanical, and electrical systems.
 - b. Indicate dimensions shown on the Contract Drawings and make specific note of dimensions that appear to be in conflict with submitted equipment and minimum clearance requirements. Provide alternate sketches to Architect for resolution of such conflicts. Minor dimension changes and difficult installations will not be considered changes to the Contract.
 2. Sheet Size: At least 8-1/2 by 11 inches but no larger than 30 by 40 inches.
 3. Number of Copies: Submit three opaque copies of each submittal. Architect will return one copy.
 4. Refer to individual Sections for Coordination Drawing requirements for Work in those Sections.

1.5 PROJECT MEETINGS

- A. General: Schedule and conduct meetings and conferences at Project site, unless otherwise indicated.
1. Attendees: Inform participants and others involved, and individuals whose presence is required, of date and time of each meeting. Notify Owner and Architect of scheduled meeting dates and times.
 2. Agenda: Prepare the meeting agenda. Distribute the agenda to all invited attendees.
 3. Minutes: Record significant discussions and agreements achieved. Distribute the meeting minutes to everyone concerned, including Owner and Architect, within three days of the meeting.
- B. Preconstruction Conference: Schedule a preconstruction conference before starting construction, at a time convenient to Owner and Architect, but no later than 15 days after

execution of the Agreement. Hold the conference at Project site or another convenient location. Conduct the meeting to review responsibilities and personnel assignments.

1. Attendees: Authorized representatives of Owner, Architect, and their consultants; Contractor and its superintendent; major subcontractors; suppliers; and other concerned parties shall attend the conference. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
 2. Agenda: Discuss items of significance that could affect progress, including the following:
 - a. Tentative construction schedule.
 - b. Phasing.
 - c. Critical work sequencing and long-lead items.
 - d. Designation of key personnel and their duties.
 - e. Procedures for processing field decisions and Change Orders.
 - f. Procedures for RFIs.
 - g. Procedures for testing and inspecting.
 - h. Procedures for processing Applications for Payment.
 - i. Distribution of the Contract Documents.
 - j. Submittal procedures.
 - k. LEED requirements.
 - l. Preparation of Record Documents.
 - m. Use of the premises.
 - n. Work restrictions.
 - o. Owner's occupancy requirements.
 - p. Responsibility for temporary facilities and controls.
 - q. Construction waste management and recycling.
 - r. Parking availability.
 - s. Office, work, and storage areas.
 - t. Equipment deliveries and priorities.
 - u. First aid.
 - v. Security.
 - w. Progress cleaning.
 - x. Working hours.
 3. Minutes: Architect will record and distribute meeting minutes.
- C. Preinstallation Conferences: Conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
1. Attendees: Installer and representatives of manufacturers and fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Architect of scheduled meeting dates.
 2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration, including requirements for the following:
 - a. The Contract Documents.
 - b. Options.
 - c. Related RFIs.
 - d. Related Change Orders.

- e. Purchases.
- f. Deliveries.
- g. Submittals.
- h. Review of mockups.
- i. Possible conflicts.
- j. Compatibility problems.
- k. Time schedules.
- l. Weather limitations.
- m. Manufacturer's written recommendations.
- n. Warranty requirements.
- o. Compatibility of materials.
- p. Acceptability of substrates.
- q. Temporary facilities and controls.
- r. Space and access limitations.
- s. Regulations of authorities having jurisdiction.
- t. Testing and inspecting requirements.
- u. Installation procedures.
- v. Coordination with other work.
- w. Required performance results.
- x. Protection of adjacent work.
- y. Protection of construction and personnel.

- 3. Record significant conference discussions, agreements, and disagreements, including required corrective measures and actions.
- 4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
- 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.

D. Progress Meetings: Conduct progress meetings at monthly intervals. Coordinate dates of meetings with preparation of payment requests.

- 1. Attendees: In addition to representatives of Owner and Architect, each contractor, subcontractor, supplier, and other entity concerned with current progress or involved in planning, coordination, or performance of future activities shall be represented at these meetings. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
- 2. Agenda: Review and correct or approve minutes of previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
 - a. Contractor's Construction Schedule: Review progress since the last meeting. Determine whether each activity is on time, ahead of schedule, or behind schedule, in relation to Contractor's Construction Schedule. Determine how construction behind schedule will be expedited; secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the Contract Time.

- 1) Review schedule for next period.

b. Review present and future needs of each entity present, including the following:

- 1) Interface requirements.
- 2) Sequence of operations.
- 3) Status of submittals.
- 4) Deliveries.
- 5) Off-site fabrication.
- 6) Access.
- 7) Site utilization.
- 8) Temporary facilities and controls.
- 9) Work hours.
- 10) Hazards and risks.
- 11) Progress cleaning.
- 12) Quality and work standards.
- 13) Status of correction of deficient items.
- 14) Field observations.
- 15) RFIs.
- 16) Status of proposal requests.
- 17) Pending changes.
- 18) Status of Change Orders.
- 19) Pending claims and disputes.
- 20) Documentation of information for payment requests.

3. Minutes: Architect will record and distribute to Contractor the meeting minutes.
4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.

- a. Schedule Updating: Revise Contractor's Construction Schedule after each progress meeting where revisions to the schedule have been made or recognized. Issue revised schedule concurrently with the report of each meeting.

1.6 REQUESTS FOR INTERPRETATION (RFIs)

- A. Procedure: Immediately on discovery of the need for interpretation of the Contract Documents, and if not possible to request interpretation at Project meeting, prepare and submit an RFI in the form specified.

1. RFIs shall originate with Contractor. RFIs submitted by entities other than Contractor will be returned with no response.
2. Coordinate and submit RFIs in a prompt manner so as to avoid delays in Contractor's work or work of subcontractors.

- B. Content of the RFI: Include a detailed, legible description of item needing interpretation and the following:

1. Project name.
2. Date.
3. Name of Contractor.
4. Name of Architect.
5. RFI number, numbered sequentially.

6. Specification Section number and title and related paragraphs, as appropriate.
 7. Drawing number and detail references, as appropriate.
 8. Field dimensions and conditions, as appropriate.
 9. Contractor's suggested solution(s). If Contractor's solution(s) impact the Contract Time or the Contract Sum, Contractor shall state impact in the RFI.
 10. Contractor's signature.
 11. Attachments: Include drawings, descriptions, measurements, photos, Product Data, Shop Drawings, and other information necessary to fully describe items needing interpretation.
- C. Hard-Copy RFIs:
1. Identify each page of attachments with the RFI number and sequential page number.
- D. Architect's Action: Architect will review each RFI, determine action required, and return it. Allow seven working days for Architect's response for each RFI. RFIs received after 1:00 p.m. will be considered as received the following working day.
1. The following RFIs will be returned without action:
 - a. Requests for approval of submittals.
 - b. Requests for approval of substitutions.
 - c. Requests for coordination information already indicated in the Contract Documents.
 - d. Requests for adjustments in the Contract Time or the Contract Sum.
 - e. Requests for interpretation of Architect's actions on submittals.
 - f. Incomplete RFIs or RFIs with numerous errors.
 2. Architect's action may include a request for additional information, in which case Architect's time for response will start again.
 3. Architect's action on RFIs that may result in a change to the Contract Time or the Contract Sum may be eligible for Contractor to submit Change Proposal according to Division 1 Section "Contract Modifications."
 - a. If Contractor believes the RFI response warrants change in the Contract Time or the Contract Sum, notify Architect in writing within 10 days of receipt of the RFI response.
- E. On receipt of Architect's action, update the RFI log and immediately distribute the RFI response to affected parties. Review response and notify Architect within seven days if Contractor disagrees with response.
- F. RFI Log: Prepare, maintain, and submit a tabular log of RFIs organized by the RFI number. Submit log monthly. Include the following:
1. Project name.
 2. Name and address of Contractor.
 3. Name and address of Architect.
 4. RFI number including RFIs that were dropped and not submitted.
 5. RFI description.
 6. Date the RFI was submitted.
 7. Date Architect's response was received.

8. Identification of related Minor Change in the Work, Construction Change Directive, and Proposal Request, as appropriate.
9. Identification of related Field Order, Work Change Directive, and Proposal Request, as appropriate.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF SECTION 01310

SECTION 01320 - CONSTRUCTION PROGRESS DOCUMENTATION

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for documenting the progress of construction during performance of the Work, including the following:
 - 1. Contractor's Construction Schedule.
 - 2. Submittals Schedule.

1.2 DEFINITIONS

- A. Activity: A discrete part of a project that can be identified for planning, scheduling, monitoring, and controlling the construction project. Activities included in a construction schedule consume time and resources.
 - 1. Critical activities are activities on the critical path. They must start and finish on the planned early start and finish times.
 - 2. Predecessor Activity: An activity that precedes another activity in the network.
 - 3. Successor Activity: An activity that follows another activity in the network.
- B. CPM: Critical path method, which is a method of planning and scheduling a construction project where activities are arranged based on activity relationships. Network calculations determine when activities can be performed and the critical path of Project.
- C. Critical Path: The longest connected chain of interdependent activities through the network schedule that establishes the minimum overall Project duration and contains no float.
- D. Float: The measure of leeway in starting and completing an activity.
 - 1. Float time belongs to the project..
- E. Fragnet: A partial or fragmentary network that breaks down activities into smaller activities for greater detail.
- F. Major Area: A story of construction, a separate building, or a similar significant construction element.

1.3 SUBMITTALS

- A. Submittals Schedule: Submit three copies of schedule. Arrange the following information in a tabular format:
 - 1. Scheduled date for first submittal.
 - 2. Specification Section number and title.

3. Submittal category (action or informational).
 4. Name of subcontractor.
 5. Description of the Work covered.
 6. Scheduled date for Architect's final release or approval.
- B. Contractor's Construction Schedule: Submit two opaque copies of initial schedule, large enough to show entire schedule for entire construction period.
1. Submit an electronic copy of schedule, using software indicated, on CD-R, and labeled to comply with requirements for submittals. Include type of schedule (Initial or Updated) and date on label.
- C. CPM Reports: Concurrent with CPM schedule, submit three copies of each of the following computer-generated reports. Format for each activity in reports shall contain activity number, activity description, cost and resource loading, original duration, remaining duration, early start date, early finish date, late start date, late finish date, and total float in calendar days.
1. Activity Report: List of all activities sorted by activity number and then early start date, or actual start date if known.
 2. Logic Report: List of preceding and succeeding activities for all activities, sorted in ascending order by activity number and then early start date, or actual start date if known.
 3. Total Float Report: List of all activities sorted in ascending order of total float.

1.4 COORDINATION

- A. Coordinate preparation and processing of schedules and reports with performance of construction activities and with scheduling and reporting of separate contractors.
- B. Coordinate Contractor's Construction Schedule with the Schedule of Values, list of subcontracts, Submittals Schedule, progress reports, payment requests, and other required schedules and reports.
1. Secure time commitments for performing critical elements of the Work from parties involved.
 2. Coordinate each construction activity in the network with other activities and schedule them in proper sequence.

PART 2 - PRODUCTS

2.1 SUBMITTALS SCHEDULE

- A. Preparation: Submit a schedule of submittals, arranged in chronological order by dates required by construction schedule. Include time required for review, resubmittal, ordering, manufacturing, fabrication, and delivery when establishing dates.
1. Coordinate Submittals Schedule with list of subcontracts, the Schedule of Values, and Contractor's Construction Schedule.

2. Submit concurrently with the first complete submittal of Contractor's Construction Schedule.

2.2 CONTRACTOR'S CONSTRUCTION SCHEDULE, GENERAL

- A. Time Frame: Extend schedule from date established for commencement of the Work to date of Final Completion.
 1. Contract completion date shall not be changed by submission of a schedule that shows an early completion date, unless specifically authorized by Change Order.
- B. Activities: Treat each story or separate area as a separate numbered activity for each principal element of the Work. Comply with the following:
 1. Activity Duration: Define activities so no activity is longer than [20] days, unless specifically allowed by Architect.
 2. Procurement Activities: Include procurement process activities for the following long lead items and major items, requiring a cycle of more than 60 days, as separate activities in schedule. Procurement cycle activities include, but are not limited to, submittals, approvals, purchasing, fabrication, and delivery.
 3. Submittal Review Time: Include review and resubmittal times indicated in Division 1 Section "Submittal Procedures" in schedule. Coordinate submittal review times in Contractor's Construction Schedule with Submittals Schedule.
 4. Startup and Testing Time: Include not less than 5 days for startup and testing.
 5. Substantial Completion: Indicate completion in advance of date established for Substantial Completion, and allow time for Architect's administrative procedures necessary for certification of Substantial Completion.
- C. Constraints: Include constraints and work restrictions indicated in the Contract Documents and as follows in schedule, and show how the sequence of the Work is affected.
 1. Phasing: Arrange list of activities on schedule by phase.
 2. Work under More Than One Contract: Include a separate activity for each contract.
 3. Work by Owner: Include a separate activity for each portion of the Work performed by Owner.
 4. Work Restrictions: Show the effect of the following items on the schedule:
 - a. Coordination with existing construction.
 - b. Limitations of continued occupancies.
 - c. Uninterruptible services.
 - d. Partial occupancy before Substantial Completion.
 - e. Use of premises restrictions.
 - f. Provisions for future construction.
 - g. Seasonal variations.
 - h. Environmental control.
 5. Work Stages: Indicate important stages of construction for each major portion of the Work.

6. Milestones: Include milestones indicated in the Contract Documents in schedule, including, but not limited to, the Notice to Proceed, Substantial Completion, and Final Completion.
- D. Contract Modifications: For each proposed contract modification and concurrent with its submission, prepare a time-impact analysis using fragnets to demonstrate the effect of the proposed change on the overall project schedule.

2.3 CONTRACTOR'S CONSTRUCTION SCHEDULE (CPM SCHEDULE)

- A. General: Prepare network diagrams using AON (activity-on-node) format.
- B. Preliminary Network Diagram: Submit diagram within 14 days of date established for the Notice to Proceed. Outline significant construction activities for the first 60 days of construction. Include skeleton diagram for the remainder of the Work and a cash requirement prediction based on indicated activities.
- C. CPM Schedule: Prepare Contractor's Construction Schedule using a computerized, cost- and resource-loaded, time-scaled CPM network analysis diagram for the Work.
 1. Develop network diagram in sufficient time to submit CPM schedule so it can be accepted for use no later than 30 days after date established the Notice to Proceed.
 - a. Failure to include any work item required for performance of this Contract shall not excuse Contractor from completing all work within applicable completion dates, regardless of Architect's approval of the schedule.
 2. Establish procedures for monitoring and updating CPM schedule and for reporting progress. Coordinate procedures with progress meeting and payment request dates.
 3. Use "one workday" as the unit of time. Include list of nonworking days and holidays incorporated into the schedule.
- D. CPM Schedule Preparation: Prepare a list of all activities required to complete the Work. Using the preliminary network diagram, prepare a skeleton network to identify probable critical paths.
 1. Activities: Indicate the estimated time duration, sequence requirements, and relationship of each activity in relation to other activities. Include estimated time frames for the following activities:
 - a. Preparation and processing of submittals.
 - b. Mobilization and demobilization.
 - c. Purchase of materials.
 - d. Delivery.
 - e. Fabrication.
 - f. Utility interruptions.
 - g. Installation.
 - h. Work by Owner that may affect or be affected by Contractor's activities.
 - i. Testing.

2. Critical Path Activities: Identify critical path activities, including those for interim completion dates. Scheduled start and completion dates shall be consistent with Contract milestone dates.
 3. Processing: Process data to produce output data on a computer-drawn, time-scaled network. Revise data, reorganize activity sequences, and reproduce as often as necessary to produce the CPM schedule within the limitations of the Contract Time.
 4. Format: Mark the critical path. Locate the critical path near center of network; locate paths with most float near the edges.
 - a. Subnetworks on separate sheets are permissible for activities clearly off the critical path.
- E. Initial Issue of Schedule: Prepare initial network diagram from a list of straight "early start-total float" sort. Identify critical activities. Prepare tabulated reports showing the following:
1. Contractor or subcontractor and the Work or activity.
 2. Description of activity.
 3. Principal events of activity.
 4. Immediate preceding and succeeding activities.
 5. Early and late start dates.
 6. Early and late finish dates.
 7. Activity duration in workdays.
 8. Total float or slack time.
 9. Average size of workforce.
- F. Schedule Updating: Concurrent with making revisions to schedule, prepare tabulated reports showing the following:
1. Identification of activities that have changed.
 2. Changes in early and late start dates.
 3. Changes in early and late finish dates.
 4. Changes in activity durations in workdays.
 5. Changes in the critical path.
 6. Changes in total float or slack time.
 7. Changes in the Contract Time.

PART 3 - EXECUTION

3.1 CONTRACTOR'S CONSTRUCTION SCHEDULE

- A. Contractor's Construction Schedule Updating: At monthly intervals, update schedule to reflect actual construction progress and activities. Issue schedule one week before each regularly scheduled progress meeting.
1. Revise schedule immediately after each meeting or other activity where revisions have been recognized or made. Issue updated schedule concurrently with the report of each such meeting.
 2. Include a report with updated schedule that indicates every change, including, but not limited to, changes in logic, durations, actual starts and finishes, and activity durations.

3. As the Work progresses, indicate Actual Completion percentage for each activity.
- B. Distribution: Distribute copies of approved schedule to Architect Owner, separate contractors, testing and inspecting agencies, and other parties identified by Contractor with a need-to-know schedule responsibility.
1. Post copies in Project meeting rooms and temporary field offices.
 2. When revisions are made, distribute updated schedules to the same parties and post in the same locations. Delete parties from distribution when they have completed their assigned portion of the Work and are no longer involved in performance of construction activities.

END OF SECTION 01320

SECTION 01330 - SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for submitting Shop Drawings, Product Data, Samples, and other submittals.
- B. See Division 1 Section "Construction Progress Documentation" for submitting schedules and reports, including Contractor's Construction Schedule.
- C. See Division 1 Section "Closeout Procedures" for submitting warranties.
- D. See Division 1 Section "Project Record Documents" for submitting Record Drawings, Record Specifications, and Record Product Data.
- E. See Division 1 Section "Operation and Maintenance Data" for submitting operation and maintenance manuals.

1.2 DEFINITIONS

- A. Action Submittals: Written and graphic information that requires Architect's responsive action.
- B. Informational Submittals: Written information that does not require Architect's responsive action. Submittals may be rejected for not complying with requirements.

1.3 SUBMITTAL PROCEDURES

- A. Coordination: Coordinate preparation and processing of submittals with performance of construction activities.
 - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
 - 2. Coordinate transmittal of different types of submittals for related parts of the Work so processing will not be delayed because of need to review submittals concurrently for coordination.
 - a. Architect reserves the right to withhold action on a submittal requiring coordination with other submittals until related submittals are received. All submittals which include color selection will be held until all color submittals are made.
- B. Submittals Schedule: Comply with requirements in Division 1 Section "Construction Progress Documentation" for list of submittals and time requirements for scheduled performance of related construction activities.

- C. **Processing Time:** Allow enough time for submittal review, including time for resubmittals, as follows. Time for review shall commence on Architect's receipt of submittal. No extension of the Contract Time will be authorized because of failure to transmit submittals enough in advance of the Work to permit processing, including resubmittals.
1. **Initial Review:** Allow 15 days for initial review of each submittal. Allow additional time if coordination with subsequent submittals is required. Architect will advise Contractor when a submittal being processed must be delayed for coordination.
 2. **Intermediate Review:** If intermediate submittal is necessary, process it in same manner as initial submittal.
 3. **Resubmittal Review:** Allow 15 days for review of each resubmittal.
- D. **Identification:** Place a permanent label or title block on each submittal for identification.
1. Indicate name of firm or entity that prepared each submittal on label or title block.
 2. Provide a space approximately 6 by 8 inches on label or beside title block to record Contractor's review and approval markings and action taken by Architect.
 3. Include the following information on label for processing and recording action taken:
 - a. Project name.
 - b. Date.
 - c. Name and address of Architect.
 - d. Name and address of Contractor.
 - e. Name and address of subcontractor.
 - f. Name and address of supplier.
 - g. Name of manufacturer.
 - h. Submittal number or other unique identifier, including revision identifier.
 - 1) Submittal number shall use Specification Section number followed by a decimal point and then a sequential number (e.g., 06100.01). Resubmittals shall include an alphabetic suffix after another decimal point (e.g., 06100.01.A).
 - i. Number and title of appropriate Specification Section.
 - j. Drawing number and detail references, as appropriate.
 - k. Location(s) where product is to be installed, as appropriate.
 - l. Other necessary identification.
- E. **Deviations:** Highlight, encircle, or otherwise specifically identify deviations from the Contract Documents on submittals.
- F. **Additional Copies:** Unless additional copies are required for final submittal, and unless Architect observes noncompliance with provisions in the Contract Documents, initial submittal may serve as final submittal.
1. Additional copies submitted for maintenance manuals will[**not**] be marked with action taken and will be returned.
- G. **Transmittal:** Package each submittal individually and appropriately for transmittal and handling. Transmit each submittal using transmittal form at end of this section. Architect will return submittals, without review, received from sources other than Contractor.

1. Transmittal Form: Use facsimile of sample form at end of Section.
- H. Resubmittals: Make resubmittals in same form and number of copies as initial submittal.
 1. Note date and content of previous submittal.
 2. Note date and content of revision in label or title block and clearly indicate extent of revision.
 3. Resubmit submittals until they are marked "No objections noted", or "Make corrections noted."
- I. Distribution: Furnish copies of final submittals to manufacturers, subcontractors, suppliers, fabricators, installers, authorities having jurisdiction, and others as necessary for performance of construction activities. Show distribution on transmittal forms.
- J. Use for Construction: Use only final submittals as noted above by Architect.

1.4 CONTRACTOR'S USE OF ARCHITECT'S CAD FILES

General: At Contractor's written request, copies of Architect's CAD files will be provided to Contractor for Contractor's use in connection with Project

PART 2 - PRODUCTS

2.1 ACTION SUBMITTALS

- A. General: Prepare and submit Action Submittals required by individual Specification Sections.
- B. Product Data: Collect information into a single submittal for each element of construction and type of product or equipment.
 1. If information must be specially prepared for submittal because standard printed data are not suitable for use, submit as Shop Drawings, not as Product Data.
 2. Mark each copy of each submittal to show which products and options are applicable.
 3. Include the following information, as applicable:
 - a. Manufacturer's written recommendations.
 - b. Manufacturer's product specifications.
 - c. Manufacturer's installation instructions.
 - d. Manufacturer's catalog cuts.
 - e. Wiring diagrams showing factory-installed wiring.
 - f. Printed performance curves.
 - g. Operational range diagrams.
 - h. Compliance with specified referenced standards.
 - i. Testing by recognized testing agency.
 4. Number of Copies: Submit three minimum copies of Product Data, unless otherwise indicated. Architect will return two copies. Mark up and retain one returned copy as a Project Record Document.

- C. Shop Drawings: Prepare Project-specific information, drawn accurately to scale. Do not base Shop Drawings on reproductions of the Contract Documents or standard printed data.
1. Preparation: Fully illustrate requirements in the Contract Documents. Include the following information, as applicable:
 - a. Dimensions.
 - b. Identification of products.
 - c. Fabrication and installation drawings.
 - d. Roughing-in and setting diagrams.
 - e. Wiring diagrams showing field-installed wiring, including power, signal, and control wiring.
 - f. Shopwork manufacturing instructions.
 - g. Templates and patterns.
 - h. Schedules.
 - i. Notation of coordination requirements.
 - j. Notation of dimensions established by field measurement.
 - k. Relationship to adjoining construction clearly indicated.
 - l. Seal and signature of professional engineer if specified.
 - m. Wiring Diagrams: Differentiate between manufacturer-installed and field-installed wiring.
 2. Sheet Size: Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 by 11 inches but no larger than 30 by 40 inches.
 3. Number of Copies: Submit two opaque (bond) copies of each submittal. Architect will return one copy.
- D. Samples: Submit Samples for review of kind, color, pattern, and texture for a check of these characteristics with other elements and for a comparison of these characteristics between submittal and actual component as delivered and installed.
1. Transmit Samples that contain multiple, related components such as accessories together in one submittal package.
 2. Identification: Attach label on unexposed side of Samples that includes the following:
 - a. Generic description of Sample.
 - b. Product name and name of manufacturer.
 - c. Sample source.
 - d. Number and title of appropriate Specification Section.
 3. Disposition: Maintain sets of approved Samples at Project site, available for quality-control comparisons throughout the course of construction activity. Sample sets may be used to determine final acceptance of construction associated with each set.
 4. Samples for Initial Selection: Submit manufacturer's color charts consisting of units or sections of units showing the full range of colors, textures, and patterns available.
 - a. Number of Samples: Submit one full set(s) of available choices where color, pattern, texture, or similar characteristics are required to be selected from manufacturer's product line. Architect will return submittal with options selected.

5. Samples for Verification: Submit full-size units or Samples of size indicated, prepared from same material to be used for the Work, cured and finished in manner specified, and physically identical with material or product proposed for use, and that show full range of color and texture variations expected. Samples include, but are not limited to, the following: partial sections of manufactured or fabricated components; small cuts or containers of materials; complete units of repetitively used materials; swatches showing color, texture, and pattern; color range sets; and components used for independent testing and inspection.
 - a. Number of Samples: Submit three sets of Samples. Architect will retain two Sample sets; remainder will be returned. Mark up and retain one returned Sample set as a Project Record Sample.
- E. Product Schedule or List: As required in individual Specification Sections, prepare a written summary indicating types of products required for the Work and their intended location.
 1. Number of Copies: Submit three copies of product schedule or list, unless otherwise indicated. Architect will return two copies.
- F. Submittals Schedule: Comply with requirements specified in Division 1 Section "Construction Progress Documentation."
- G. Application for Payment: Comply with requirements specified in Division 1 Section "Payment Procedures."
- H. Schedule of Values: Comply with requirements specified in Division 1 Section "Payment Procedures."
- I. Subcontract List: Prepare a written summary identifying individuals or firms proposed for each portion of the Work, including those who are to furnish products or equipment fabricated to a special design.
 1. Number of Copies: Submit three copies of subcontractor list, unless otherwise indicated. Architect will return two copies.

2.2 INFORMATIONAL SUBMITTALS

- A. General: Prepare and submit Informational Submittals required by other Specification Sections.
 1. Number of Copies: Submit two copies of each submittal, unless otherwise indicated. Architect will not return copies.
 2. Certificates and Certifications: Provide a notarized statement that includes signature of entity responsible for preparing certification. Certificates and certifications shall be signed by an officer or other individual authorized to sign documents on behalf of that entity.
 3. Test and Inspection Reports: Comply with requirements specified in Division 1 Section "Quality Requirements."
- B. Coordination Drawings: Comply with requirements specified in Division 1 Section "Project Management and Coordination."

- C. Contractor's Construction Schedule: Comply with requirements specified in Division 1 Section "Construction Progress Documentation."
- D. Qualification Data: Prepare written information that demonstrates capabilities and experience of firm or person. Include lists of completed projects with project names and addresses, names and addresses of architects and owners, and other information specified.
- E. Welding Certificates: Prepare written certification that welding procedures and personnel comply with requirements in the Contract Documents. Submit record of Welding Procedure Specification (WPS) and Procedure Qualification Record (PQR) on AWS forms. Include names of firms and personnel certified.
- F. Installer Certificates: Prepare written statements on manufacturer's letterhead certifying that Installer complies with requirements in the Contract Documents and, where required, is authorized by manufacturer for this specific Project.
- G. Manufacturer Certificates: Prepare written statements on manufacturer's letterhead certifying that manufacturer complies with requirements in the Contract Documents. Include evidence of manufacturing experience where required.
- H. Product Certificates: Prepare written statements on manufacturer's letterhead certifying that product complies with requirements in the Contract Documents.
- I. Material Certificates: Prepare written statements on manufacturer's letterhead certifying that material complies with requirements in the Contract Documents.
- J. Material Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting test results of material for compliance with requirements in the Contract Documents.
- K. Product Test Reports: Prepare written reports indicating current product produced by manufacturer complies with requirements in the Contract Documents. Base reports on evaluation of tests performed by manufacturer and witnessed by a qualified testing agency, or on comprehensive tests performed by a qualified testing agency.
- L. Research/Evaluation Reports: Prepare written evidence, from a model code organization acceptable to authorities having jurisdiction, that product complies with building code in effect for Project.
- M. Preconstruction Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of tests performed before installation of product, for compliance with performance requirements in the Contract Documents.
- N. Compatibility Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of compatibility tests performed before installation of product. Include written recommendations for primers and substrate preparation needed for adhesion.
- O. Field Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of field tests performed either during

installation of product or after product is installed in its final location, for compliance with requirements in the Contract Documents.

- P. Maintenance Data: Prepare written and graphic instructions and procedures for operation and normal maintenance of products and equipment. Comply with requirements specified in Division 1 Section "Operation and Maintenance Data."
- Q. Design Data: Prepare written and graphic information, including, but not limited to, performance and design criteria, list of applicable codes and regulations, and calculations. Include list of assumptions and other performance and design criteria and a summary of loads. Include load diagrams if applicable. Provide name and version of software, if any, used for calculations. Include page numbers.
- R. Manufacturer's Instructions: Prepare written or published information that documents manufacturer's recommendations, guidelines, and procedures for installing or operating a product or equipment. Include name of product and name, address, and telephone number of manufacturer.
- S. Manufacturer's Field Reports: Prepare written information documenting factory-authorized service representative's tests and inspections. Include the following, as applicable:
 - 1. Statement on condition of substrates and their acceptability for installation of product.
 - 2. Summary of installation procedures being followed, whether they comply with requirements and, if not, what corrective action was taken.
 - 3. Results of operational and other tests and a statement of whether observed performance complies with requirements.
- T. Insurance Certificates and Bonds: Prepare written information indicating current status of insurance or bonding coverage. Include name of entity covered by insurance or bond, limits of coverage, amounts of deductibles, if any, and term of the coverage.
- U. Material Safety Data Sheets (MSDSs): Submit information directly to Owner; do not submit to Architect.
 - 1. Architect will not review submittals that include MSDSs and will return them for resubmittal.

2.3 DELEGATED DESIGN

- A. Performance and Design Criteria: Where professional design services or certifications by a design professional are specifically required of Contractor by the Contract Documents, provide products and systems complying with specific performance and design criteria indicated.
 - 1. If criteria indicated are not sufficient to perform services or certification required, submit a written request for additional information to Architect.
- B. Delegated-Design Submittal: In addition to Shop Drawings, Product Data, and other required submittals, submit **[three]** copies of a statement, signed and sealed by the responsible design professional, for each product and system specifically assigned to Contractor to be designed or certified by a design professional.

SECTION 01500 - TEMPORARY FACILITIES AND CONTROLS

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes requirements for temporary utilities, support facilities, and security and protection facilities.
- B. Divisions 2 through 16 Sections for temporary heat, ventilation, and humidity requirements for products in those Sections.

1.2 DEFINITIONS

- A. Permanent Enclosure: As determined by Architect, permanent or temporary roofing is complete, insulated, and weathertight; exterior walls are insulated and weathertight; and all openings are closed with permanent construction or substantial temporary closures.

1.3 USE CHARGES

- A. General: Cost or use charges for temporary facilities shall be included in the Contract Sum. Allow other entities to use temporary services and facilities without cost, including, but not limited to Owner's construction forces, Architect, testing agencies, and authorities having jurisdiction.
- B. Electric Power Service: Electric power from Owner's existing system is available for use with payment of use charges. Provide connections and extensions of services as required for construction operations.

1.4 SUBMITTALS

- A. Site Plan: Show temporary facilities, utility hookups, staging areas, and parking areas for construction personnel.

1.5 QUALITY ASSURANCE

- A. Electric Service: Comply with NECA, NEMA, and UL standards and regulations for temporary electric service. Install service to comply with NFPA 70.
- B. Tests and Inspections: Arrange for authorities having jurisdiction to test and inspect each temporary utility before use. Obtain required certifications and permits.

1.6 PROJECT CONDITIONS

- A. Temporary Use of Permanent Facilities: Installer of each permanent service shall assume responsibility for operation, maintenance, and protection of each permanent service during its use as a construction facility before Owner's acceptance, regardless of previously assigned responsibilities.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Lumber and Plywood: Comply with requirements in Division 6 Section "Rough Carpentry".
- B. Gypsum Board: Minimum 1/2 inch thick by 48 inches wide by maximum available lengths; regular-type panels with tapered edges. Comply with ASTM C 36/C 36M.
- C. Insulation: Unfaced mineral-fiber blanket, manufactured from glass, slag wool, or rock wool; with maximum flame-spread and smoke-developed indexes of 25 and 50, respectively.

2.2 EQUIPMENT

- A. Fire Extinguishers: Portable, UL rated; with class and extinguishing agent as required by locations and classes of fire exposures.
- B. HVAC Equipment: Unless Owner authorizes use of permanent HVAC system, provide vented, self-contained, liquid-propane-gas or fuel-oil heaters with individual space thermostatic control.
 - 1. Use of gasoline-burning space heaters, open-flame heaters, or salamander-type heating units is prohibited.
 - 2. Heating Units: Listed and labeled for type of fuel being consumed, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
 - 3. Permanent HVAC System: If Owner authorizes use of permanent HVAC system for temporary use during construction, provide filter with MERV of [8] at each return air grille in system and remove at end of construction.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Locate facilities where they will serve Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required by progress of the Work.
 - 1. Locate facilities to limit site disturbance as specified in Division 1 Section "Summary."
- B. Provide each facility ready for use when needed to avoid delay. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.

3.2 TEMPORARY UTILITY INSTALLATION

- A. General: Install temporary service or connect to existing service.
 - 1. Arrange with utility company, Owner, and existing users for time when service can be interrupted, if necessary, to make connections for temporary services.
- B. Water Service: Use of Owner's new water service facilities will be permitted, as long as facilities are cleaned and maintained in a condition acceptable to Owner. Use charges will be the responsibility of the contractor. At Substantial Completion, restore these facilities to condition existing before initial use.
- C. Heating and Cooling: Provide temporary heating and cooling required by construction activities for curing or drying of completed installations or for protecting installed construction from adverse effects of low temperatures or high humidity. Select equipment that will not have a harmful effect on completed installations or elements being installed.
- D. Ventilation and Humidity Control: Provide temporary ventilation required by construction activities for curing or drying of completed installations or for protecting installed construction from adverse effects of high humidity. Select equipment that will not have a harmful effect on completed installations or elements being installed. Coordinate ventilation requirements to produce ambient condition required and minimize energy consumption.
- E. Electric Power Service: Use of Owner's new electric power service will be permitted, as long as equipment is maintained in a condition acceptable to Owner. Use charges will be the responsibility of the contractor.
- F. Electric Power Service: Provide electric power service and distribution system of sufficient size, capacity, and power characteristics required for construction operations.
 - 1. Install electric power service overhead unless otherwise indicated.
 - 2. Connect temporary service to Owner's existing power source, as directed by Owner.
- G. Lighting: Provide temporary lighting with local switching that provides adequate illumination for construction operations, observations, inspections, and traffic conditions.
 - 1. Install and operate temporary lighting that fulfills security and protection requirements without operating entire system.

3.3 SUPPORT FACILITIES INSTALLATION

- A. Waste Disposal Facilities: Provide waste-collection containers in sizes adequate to handle waste from construction operations. Comply with requirements of authorities having jurisdiction. Comply with Division 1 Section "Execution Requirements" for progress cleaning requirements.
- B. Lifts and Hoists: Provide facilities necessary for hoisting materials and personnel.
 - 1. Truck cranes and similar devices used for hoisting materials are considered "tools and equipment" and not temporary facilities.

3.4 SECURITY AND PROTECTION FACILITIES INSTALLATION

- A. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and that minimize possible air, waterway, and subsoil contamination or pollution or other undesirable effects.
 - 1. Comply with work restrictions specified in Division 1 Section "Summary."
- B. Temporary Erosion and Sedimentation Control: Provide measures to prevent soil erosion and discharge of soil-bearing water runoff and airborne dust to adjacent properties and walkways, according to requirements of authorities having jurisdiction.
- C. Pest Control: Engage pest-control service to recommend practices to minimize attraction and harboring of rodents, roaches, and other pests and to perform extermination and control procedures at regular intervals so Project will be free of pests and their residues at Substantial Completion. Obtain extended warranty for Owner. Perform control operations lawfully, using environmentally safe materials.
- D. Security Enclosure and Lockup: Install substantial temporary enclosure around partially completed areas of construction. Provide lockable entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.
- E. Barricades, Warning Signs, and Lights: Comply with requirements of authorities having jurisdiction for erecting structurally adequate barricades, including warning signs and lighting.
- F. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities. Provide temporary weathertight enclosure for building exterior.
 - 1. Where heating or cooling is needed and permanent enclosure is not complete, insulate temporary enclosures.
- G. Temporary Fire Protection: Install and maintain temporary fire-protection facilities of types needed to protect against reasonably predictable and controllable fire losses. Comply with NFPA 241.
 - 1. Prohibit smoking in construction areas.
 - 2. Supervise welding operations, combustion-type temporary heating units, and similar sources of fire ignition according to requirements of authorities having jurisdiction.
 - 3. Develop and supervise an overall fire-prevention and -protection program for personnel at Project site. Review needs with local fire department and establish procedures to be followed. Instruct personnel in methods and procedures. Post warnings and information.
 - 4. Provide temporary standpipes and hoses for fire protection. Hang hoses with a warning sign stating that hoses are for fire-protection purposes only and are not to be removed. Match hose size with outlet size and equip with suitable nozzles.

3.5 OPERATION, TERMINATION, AND REMOVAL

- A. Supervision: Enforce strict discipline in use of temporary facilities. To minimize waste and abuse, limit availability of temporary facilities to essential and intended uses.
- B. Maintenance: Maintain facilities in good operating condition until removal.
 - 1. Maintain operation of temporary enclosures, heating, cooling, humidity control, ventilation, and similar facilities on a 24-hour basis where required to achieve indicated results and to avoid possibility of damage.
- C. Temporary Facility Changeover: Do not change over from using temporary security and protection facilities to permanent facilities until Substantial Completion.
- D. Termination and Removal: Remove each temporary facility when need for its service has ended, when it has been replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.
 - 1. Materials and facilities that constitute temporary facilities are property of Contractor. Owner reserves right to take possession of Project identification signs.
 - 2. At Substantial Completion, clean and renovate permanent facilities used during construction period. Comply with final cleaning requirements specified in Division I Section "Closeout Procedures."

END OF SECTION 01500

SECTION 01524 - CONSTRUCTION WASTE MANAGEMENT

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for the following:
 - 1. Salvaging nonhazardous demolition and construction waste.
 - 2. Recycling nonhazardous demolition and construction waste.
 - 3. Disposing of nonhazardous demolition and construction waste.
- B. See Division 1 Section "Selective Demolition" for disposition of waste resulting from partial demolition of buildings, structures, and site improvements.
- C. See Division 4 Section "Unit Masonry Assemblies" for disposal requirements for masonry waste.

1.2 DEFINITIONS

- A. Construction Waste: Building and site improvement materials and other solid waste resulting from construction, remodeling, renovation, or repair operations. Construction waste includes packaging.
- B. Demolition Waste: Building and site improvement materials resulting from demolition or selective demolition operations.
- C. Disposal: Removal off-site of demolition and construction waste and subsequent sale, recycling, reuse, or deposit in landfill or incinerator acceptable to authorities having jurisdiction.
- D. Recycle: Recovery of demolition or construction waste for subsequent processing in preparation for reuse.
- E. Salvage: Recovery of demolition or construction waste and subsequent sale or reuse in another facility.
- F. Salvage and Reuse: Recovery of demolition or construction waste and subsequent incorporation into the Work.

1.3 PERFORMANCE GOALS

- A. General: Develop waste management plan that results in end-of-Project rates for salvage/recycling of 50 percent by weight of total waste generated by the Work.
- B. Salvage/Recycle Goals: Owner's goal is to salvage and recycle as much nonhazardous demolition and construction waste as possible.

1.4 SUBMITTALS

- A. **Waste Management Plan:** Submit 3 copies of plan within 30 days of date established for the Notice to Proceed.
- B. **Waste Reduction Progress Reports:** Concurrent with each Application for Payment, submit three copies of report. Include the following information:
 - 1. Material category.
 - 2. Generation point of waste.
 - 3. Total quantity of waste in tons.
 - 4. Quantity of waste salvaged, both estimated and actual in tons.
 - 5. Quantity of waste recycled, both estimated and actual in tons.
 - 6. Total quantity of waste recovered (salvaged plus recycled) in tons.
 - 7. Total quantity of waste recovered (salvaged plus recycled) as a percentage of total waste.
- C. **Waste Reduction Calculations:** Before request for Substantial Completion, submit three copies of calculated end-of-Project rates for salvage, recycling, and disposal as a percentage of total waste generated by the Work.
- D. **Records of Donations:** Indicate receipt and acceptance of salvageable waste donated to individuals and organizations. Indicate whether organization is tax exempt.
- E. **Records of Sales:** Indicate receipt and acceptance of salvageable waste sold to individuals and organizations. Indicate whether organization is tax exempt.
- F. **Recycling and Processing Facility Records:** Indicate receipt and acceptance of recyclable waste by recycling and processing facilities licensed to accept them. Include manifests, weight tickets, receipts, and invoices.
- G. **Landfill and Incinerator Disposal Records:** Indicate receipt and acceptance of waste by landfills and incinerator facilities licensed to accept them. Include manifests, weight tickets, receipts, and invoices.
- H. **Statement of Refrigerant Recovery:** Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.

1.5 WASTE MANAGEMENT PLAN

- A. **General:** Develop plan consisting of waste identification and waste reduction work plan. Include separate sections in plan for demolition and construction waste. Indicate quantities by weight or volume, but use same units of measure throughout waste management plan.
- B. **Waste Identification:** Indicate anticipated types and quantities of demolition and construction waste generated by the Work. Include estimated quantities and assumptions for estimates.
- C. **Waste Reduction Work Plan:** List each type of waste and whether it will be salvaged, recycled, or disposed of in landfill or incinerator. Include points of waste generation, total quantity of

each type of waste, quantity for each means of recovery, and handling and transportation procedures.

1. **Salvaged Materials for Reuse:** For materials that will be salvaged and reused in this Project, describe methods for preparing salvaged materials before incorporation into the Work.
2. **Salvaged Materials for Sale:** For materials that will be sold to individuals and organizations, include list of their names, addresses, and telephone numbers.
3. **Salvaged Materials for Donation:** For materials that will be donated to individuals and organizations, include list of their names, addresses, and telephone numbers.
4. **Recycled Materials:** Include list of local receivers and processors and type of recycled materials each will accept. Include names, addresses, and telephone numbers.
5. **Disposed Materials:** Indicate how and where materials will be disposed of. Include name, address, and telephone number of each landfill and incinerator facility.
6. **Handling and Transportation Procedures:** Include method that will be used for separating recyclable waste including sizes of containers, container labeling, and designated location on Project site where materials separation will be located.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 PLAN IMPLEMENTATION

- A. **General:** Implement waste management plan as approved by Architect. Provide handling, containers, storage, signage, transportation, and other items as required to implement waste management plan during the entire duration of the Contract.
- B. **Waste Management Coordinator:** Engage a waste management coordinator to be responsible for implementing, monitoring, and reporting status of waste management work plan. Coordinator shall be present at Project site full time for duration of Project.
- C. **Training:** Train workers, subcontractors, and suppliers on proper waste management procedures, as appropriate for the Work occurring at Project site.
 1. Distribute waste management plan to everyone concerned within three days of submittal return.
 2. Distribute waste management plan to entities when they first begin work on-site. Review plan procedures and locations established for salvage, recycling, and disposal.
- D. **Site Access and Temporary Controls:** Conduct waste management operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.
 1. Designate and label specific areas on Project site necessary for separating materials that are to be salvaged, recycled, reused, donated, and sold.
 2. Comply with Division 1 Section "Temporary Facilities and Controls" for controlling dust and dirt, environmental protection, and noise control.

3.2 SALVAGING DEMOLITION WASTE

- A. Salvaged Items for Donation: Not permitted on Project site.

3.3 RECYCLING CONSTRUCTION WASTE, GENERAL

- A. General: Recycle paper and beverage containers used by on-site workers.
- B. Recycling Incentives: Revenues, savings, rebates, tax credits, and other incentives received for recycling waste materials shall accrue to Contractor.
- C. Procedures: Separate recyclable waste from other waste materials, trash, and debris. Separate recyclable waste by type at Project site to the maximum extent practical.
 - 1. Provide appropriately marked containers or bins for controlling recyclable waste until they are removed from Project site. Include list of acceptable and unacceptable materials at each container and bin.
 - a. Inspect containers and bins for contamination and remove contaminated materials if found.
 - 2. Stockpile processed materials on-site without intermixing with other materials. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
 - 3. Stockpile materials away from construction area. Do not store within drip line of remaining trees.
 - 4. Store components off the ground and protect from the weather.
 - 5. Remove recyclable waste off Owner's property and transport to recycling receiver or processor.

3.4 RECYCLING CONSTRUCTION WASTE

- A. Packaging:
 - 1. Cardboard and Boxes: Break down packaging into flat sheets. Bundle and store in a dry location.
 - 2. Polystyrene Packaging: Separate and bag materials.
 - 3. Pallets: As much as possible, require deliveries using pallets to remove pallets from Project site. For pallets that remain on-site, break down pallets into component wood pieces and comply with requirements for recycling wood.
 - 4. Crates: Break down crates into component wood pieces and comply with requirements for recycling wood.
- B. Wood Materials:
 - 1. Clean Cut-Offs of Lumber: Grind or chip into small pieces.
 - 2. Clean Sawdust: Bag sawdust that does not contain painted or treated wood.
- C. Gypsum Board: Stack large clean pieces on wood pallets and store in a dry location.

1. Clean Gypsum Board: Grind scraps of clean gypsum board using small mobile chipper or hammer mill. Screen out paper after grinding.

3.5 DISPOSAL OF WASTE

- A. General: Except for items or materials to be salvaged, recycled, or otherwise reused, remove waste materials from Project site and legally dispose of them in a landfill or incinerator acceptable to authorities having jurisdiction.
 1. Except as otherwise specified, do not allow waste materials that are to be disposed of accumulate on-site.
 2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
- B. Burning: Do not burn waste materials.
- C. Disposal: Transport waste materials off Owner's property and legally dispose of them.

END OF SECTION 01524

SECTION 01731 - CUTTING AND PATCHING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes procedural requirements for cutting and patching.
- B. See Divisions 2 through 16 Sections for specific requirements and limitations applicable to cutting and patching individual parts of the Work.

1.2 SUBMITTALS

- A. Cutting and Patching Proposal: Submit a proposal describing procedures at least 10 days before the time cutting and patching will be performed, requesting approval to proceed. Include the following information:
 - 1. Extent: Describe cutting and patching, show how they will be performed, and indicate why they cannot be avoided.
 - 2. Changes to In-Place Construction: Describe anticipated results. Include changes to structural elements and operating components as well as changes in building's appearance and other significant visual elements.
 - 3. Products: List products to be used and firms or entities that will perform the Work.
 - 4. Dates: Indicate when cutting and patching will be performed.
 - 5. Utility Services and Mechanical/Electrical Systems: List services/systems that cutting and patching procedures will disturb or affect. List services/systems that will be relocated and those that will be temporarily out of service. Indicate how long services/systems will be disrupted.
 - 6. Structural Elements: Where cutting and patching involve adding reinforcement to structural elements, submit details and engineering calculations showing integration of reinforcement with original structure.
 - 7. Architect's Approval: Obtain approval of cutting and patching proposal before cutting and patching. Approval does not waive right to later require removal and replacement of unsatisfactory work.

1.3 QUALITY ASSURANCE

- A. Structural Elements: Do not cut and patch structural elements in a manner that could change their load-carrying capacity or load-deflection ratio.
 - 1. Operational Elements: Do not cut and patch operating elements and related components in a manner that results in reducing their capacity to perform as intended or that results in increased maintenance or decreased operational life or safety
- B. Miscellaneous Elements: Do not cut and patch miscellaneous elements or related components in a manner that could change their load-carrying capacity, that results in reducing their

capacity to perform as intended, or that results in increased maintenance or decreased operational life or safety.

- C. **Visual Requirements:** Do not cut and patch construction in a manner that results in visual evidence of cutting and patching. Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in Architect's opinion, reduce the building's aesthetic qualities. Remove and replace construction that has been cut and patched in a visually unsatisfactory manner.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. **General:** Comply with requirements specified in other Sections.
- B. **In-Place Materials:** Use materials identical to in-place materials. For exposed surfaces, use materials that visually match in-place adjacent surfaces to the fullest extent possible.
 - 1. If identical materials are unavailable or cannot be used, use materials that, when installed, will match the visual and functional performance of in-place materials.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. **Examine surfaces to be cut and patched and conditions under which cutting and patching are to be performed.**
 - 1. **Compatibility:** Before patching, verify compatibility with and suitability of substrates, including compatibility with in-place finishes or primers.
 - 2. **Proceed with installation only after unsafe or unsatisfactory conditions have been corrected.**

3.2 PREPARATION

- A. **Temporary Support:** Provide temporary support of Work to be cut.
- B. **Protection:** Protect in-place construction during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of Project that might be exposed during cutting and patching operations.
- C. **Adjoining Areas:** Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
- D. **Existing Utility Services and Mechanical/Electrical Systems:** Where existing services/systems are required to be removed, relocated, or abandoned, bypass such services/systems before cutting to minimize interruption to occupied areas.

3.3 PERFORMANCE

- A. General: Employ skilled workers to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time, and complete without delay.
 - 1. Cut in-place construction to provide for installation of other components or performance of other construction, and subsequently patch as required to restore surfaces to their original condition.
- B. Cutting: Cut in-place construction by sawing, drilling, breaking, chipping, grinding, and similar operations, including excavation, using methods least likely to damage elements retained or adjoining construction. If possible, review proposed procedures with original Installer; comply with original Installer's written recommendations.
 - 1. In general, use hand or small power tools designed for sawing and grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 - 2. Finished Surfaces: Cut or drill from the exposed or finished side into concealed surfaces.
 - 3. Concrete and Masonry: Cut using a cutting machine, such as an abrasive saw or a diamond-core drill.
 - 4. Excavating and Backfilling: Comply with requirements in applicable Division 2 Sections where required by cutting and patching operations.
 - 5. Mechanical and Electrical Services: Cut off pipe or conduit in walls or partitions to be removed. Cap, valve, or plug and seal remaining portion of pipe or conduit to prevent entrance of moisture or other foreign matter after cutting.
 - 6. Proceed with patching after construction operations requiring cutting are complete.
- C. Patching: Patch construction by filling, repairing, refinishing, closing up, and similar operations following performance of other Work. Patch with durable seams that are as invisible as possible. Provide materials and comply with installation requirements specified in other Sections.
 - 1. Inspection: Where feasible, test and inspect patched areas after completion to demonstrate integrity of installation.
 - 2. Exposed Finishes: Restore exposed finishes of patched areas and extend finish restoration into retained adjoining construction in a manner that will eliminate evidence of patching and refinishing.
 - 3. Floors and Walls: Where walls or partitions that are removed extend one finished area into another, patch and repair floor and wall surfaces in the new space. Provide an even surface of uniform finish, color, texture, and appearance. Remove in-place floor and wall coverings and replace with new materials, if necessary, to achieve uniform color and appearance.
 - 4. Ceilings: Patch, repair, or rehang in-place ceilings as necessary to provide an even-plane surface of uniform appearance.
 - 5. Exterior Building Enclosure: Patch components in a manner that restores enclosure to a weathertight condition.
- D. Cleaning: Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty, and similar materials.

END OF SECTION 01731

SECTION 01770 - CLOSEOUT PROCEDURES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for contract closeout, including, but not limited to, the following:
 - 1. Inspection procedures.
 - 2. Warranties.
 - 3. Final cleaning.
- B. See Division 1 Section "Project Record Documents" for submitting Record Drawings, Record Specifications, and Record Product Data.
- C. See Division 1 Section "Operation and Maintenance Data" for operation and maintenance manual requirements.
- D. See Division 1 Section "Demonstration and Training" for requirements for instructing Owner's personnel.
- E. See Divisions 2 through 16 Sections for specific closeout and special cleaning requirements for the Work in those Sections.

1.2 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for determining date of Substantial Completion, complete the following. List items below that are incomplete in request.
 - 1. Prepare a list of items to be completed and corrected (punch list), the value of items on the list, and reasons why the Work is not complete.
 - 2. Advise Owner of pending insurance changeover requirements.
 - 3. Submit specific warranties, workmanship bonds, maintenance service agreements, final certifications, and similar documents.
 - 4. Obtain and submit releases permitting Owner unrestricted use of the Work and access to services and utilities. Include occupancy permits, operating certificates, and similar releases.
 - 5. Prepare and submit Project Record Documents, operation and maintenance manuals, damage or settlement surveys, property surveys, and similar final record information.
 - 6. Deliver tools, spare parts, extra materials, and similar items to location designated by Owner. Label with manufacturer's name and model number where applicable.
 - 7. Make final changeover of permanent locks and deliver keys to Owner. Advise Owner's personnel of changeover in security provisions.
 - 8. Complete startup testing of systems.
 - 9. Submit test/adjust/balance records.

10. Terminate and remove temporary facilities from Project site, along with mockups, construction tools, and similar elements.
 11. Advise Owner of changeover in heat and other utilities.
 12. Submit changeover information related to Owner's occupancy, use, operation, and maintenance.
 13. Complete final cleaning requirements, including touchup painting.
 14. Touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.
- B. Inspection: Submit a written request for inspection for Substantial Completion: On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare the Certificate of Substantial Completion after inspection or will notify Contractor of items, either on Contractor's list or additional items identified by Architect, that must be completed or corrected before certificate will be issued.
1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.
 2. Results of completed inspection will form the basis of requirements for Final Completion.

1.3 FINAL COMPLETION

- A. Preliminary Procedures: Before requesting final inspection for determining date of Final Completion, complete the following:
1. Submit a final Application for Payment according to Division I Section "Payment Procedures."
 2. Submit certified copy of Architect's Substantial Completion inspection list of items to be completed or corrected (punch list), endorsed and dated by Architect. The certified copy of the list shall state that each item has been completed or otherwise resolved for acceptance.
 3. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
 4. Submit pest-control final inspection report and warranty.
 5. Instruct Owner's personnel in operation, adjustment, and maintenance of products, equipment, and systems.
- B. Inspection: Submit a written request for final inspection for acceptance. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare a final Certificate for Payment after inspection or will notify Contractor of construction that must be completed or corrected before certificate will be issued.
1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.

1.4 LIST OF INCOMPLETE ITEMS (PUNCH LIST)

- A. Preparation: Submit three copies of list. Include name and identification of each space and area affected by construction operations for incomplete items and items needing correction including, if necessary, areas disturbed by Contractor that are outside the limits of construction.
 - 1. Organize list of spaces in sequential order, starting with exterior areas first] [and] [proceeding from lowest floor to highest floor.
 - 2. Organize items applying to each space by major element, including categories for ceiling, individual walls, floors, equipment, and building systems.

1.5 WARRANTIES

- A. Submittal Time: Submit written warranties on request of Architect for designated portions of the Work where commencement of warranties other than date of Substantial Completion is indicated.
- B. Organize warranty documents into an orderly sequence based on the table of contents of the Project Manual.
 - 1. Bind warranties and bonds in heavy-duty, 3-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8-1/2-by-11-inch paper.
 - 2. Provide heavy paper dividers with plastic-covered tabs for each separate warranty. Mark tab to identify the product or installation. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
 - 3. Identify each binder on the front and spine with the typed or printed title "WARRANTIES," Project name, and name of Contractor.
- C. Provide additional copies of each warranty to include in operation and maintenance manuals.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by manufacturer or fabricator of the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

PART 3 - EXECUTION

3.1 FINAL CLEANING

- A. **General:** Provide final cleaning. Conduct cleaning and waste-removal operations to comply with local laws and ordinances and Federal and local environmental and antipollution regulations.
- B. **Cleaning:** Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to condition expected in an average commercial building cleaning and maintenance program. Comply with manufacturer's written instructions.
 - 1. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for entire Project or for a portion of Project:
 - a. Clean Project site, yard, and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and other foreign substances.
 - b. Sweep paved areas broom clean. Remove petrochemical spills, stains, and other foreign deposits.
 - c. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
 - d. Remove tools, construction equipment, machinery, and surplus material from Project site.
 - e. Remove snow and ice to provide safe access to building.
 - f. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
 - g. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
 - h. Sweep concrete floors broom clean in unoccupied spaces.
 - i. Vacuum carpet and similar soft surfaces, removing debris and excess nap; shampoo if visible soil or stains remain.
 - j. Clean transparent materials, including mirrors and glass in doors and windows. Remove glazing compounds and other noticeable, vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
 - k. Remove labels that are not permanent.
 - l. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
 - 1) Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
 - m. Wipe surfaces of mechanical and electrical equipment, elevator equipment, and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
 - n. Replace parts subject to unusual operating conditions.

- o. Clean plumbing fixtures to a sanitary condition, free of stains, including stains resulting from water exposure.
 - p. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
 - q. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs, and those noticeably dimmed by hours of use, and defective and noisy starters in fluorescent and mercury vapor fixtures to comply with requirements for new fixtures.
 - r. Leave Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid Project of rodents, insects, and other pests. Prepare a report.
- D. Comply with safety standards for cleaning. Do not burn waste materials. Do not bury debris or excess materials on Owner's property. Do not discharge volatile, harmful, or dangerous materials into drainage systems. Remove waste materials from Project site and dispose of lawfully.

END OF SECTION 01770

SECTION 01781 - PROJECT RECORD DOCUMENTS

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for Project Record Documents, including the following:
 - 1. Record Drawings.
 - 2. Record Specifications.
 - 3. Record Product Data.
- B. See Division 1 Section "Operation and Maintenance Data" for operation and maintenance manual requirements.
- C. See Divisions 2 through 16 Sections for specific requirements for Project Record Documents of the Work in those Sections.

1.2 SUBMITTALS

- A. Record Drawings: Comply with the following:
 - 1. Number of Copies: Submit one set(s) of marked-up Record Prints.
- B. Record Specifications: Submit one copy of Project's Specifications, including addenda and contract modifications.
- C. Record Product Data: Submit one copy of each Product Data submittal.

PART 2 - PRODUCTS

2.1 RECORD DRAWINGS

- A. Record Prints: Maintain one set of blue- or black-line white prints of the Contract Drawings and Shop Drawings.
 - 1. Preparation: Mark Record Prints to show the actual installation where installation varies from that shown originally. Require individual or entity who obtained record data, whether individual or entity is Installer, subcontractor, or similar entity, to prepare the marked-up Record Prints.
 - a. Give particular attention to information on concealed elements that would be difficult to identify or measure and record later.
 - b. Record data as soon as possible after obtaining it. Record and check the markup before enclosing concealed installations.

2. Mark the Contract Drawings or Shop Drawings, whichever is most capable of showing actual physical conditions, completely and accurately. If Shop Drawings are marked, show cross-reference on the Contract Drawings.
3. Mark record sets with erasable, red-colored pencil. Use other colors to distinguish between changes for different categories of the Work at same location.
4. Note Construction Change Directive numbers, alternate numbers, Change Order numbers, and similar identification, where applicable.

2.2 RECORD SPECIFICATIONS

- A. Preparation: Mark Specifications to indicate the actual product installation where installation varies from that indicated in Specifications, addenda, and contract modifications.
 1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
 2. Mark copy with the proprietary name and model number of products, materials, and equipment furnished, including substitutions and product options selected.
 3. Record the name of manufacturer, supplier, Installer, and other information necessary to provide a record of selections made.
 4. Note related Change Orders, Record Product Data, and Record Drawings where applicable.

2.3 RECORD PRODUCT DATA

- A. Preparation: Mark Product Data to indicate the actual product installation where installation varies substantially from that indicated in Product Data submittal.
 1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
 2. Include significant changes in the product delivered to Project site and changes in manufacturer's written instructions for installation.
 3. Note related Change Orders, Record Specifications, and Record Drawings where applicable.

2.4 MISCELLANEOUS RECORD SUBMITTALS

- A. Assemble miscellaneous records required by other Specification Sections for miscellaneous record keeping and submittal in connection with actual performance of the Work. Bind or file miscellaneous records and identify each, ready for continued use and reference.

PART 3 - EXECUTION

3.1 RECORDING AND MAINTENANCE

- A. Recording: Maintain one copy of each submittal during the construction period for Project Record Document purposes. Post changes and modifications to Project Record Documents as they occur; do not wait until the end of Project.
- B. Maintenance of Record Documents and Samples: Store Record Documents and Samples in the field office apart from the Contract Documents used for construction. Do not use Project Record Documents for construction purposes. Maintain Record Documents in good order and in a clean, dry, legible condition, protected from deterioration and loss. Provide access to Project Record Documents for Architect's reference during normal working hours.

END OF SECTION 01781

SECTION 01782 - OPERATION AND MAINTENANCE DATA

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for preparing operation and maintenance manuals, including the following:
 - 1. Emergency manuals.
 - 2. Operation manuals for systems, subsystems, and equipment.
 - 3. Maintenance manuals for the care and maintenance of products, materials, and finishes, systems and equipment.
- B. See Divisions 2 through 16 Sections for specific operation and maintenance manual requirements for the Work in those Sections.

1.2 SUBMITTALS

- A. Manual: Submit one copy of each manual in final form at 80% completion of the project. Architect will return copy with comments within 15 days after submission.
 - 1. Correct or modify each manual to comply with Architect's comments. Submit 3 copies of each corrected manual within 15 days of receipt of Architect's comments.

PART 2 - PRODUCTS

2.1 MANUALS, GENERAL

- A. Organization: Unless otherwise indicated, organize each manual into a separate section for each system and subsystem, and a separate section for each piece of equipment not part of a system. Each manual shall contain a title page, table of contents, and manual contents.
- B. Title Page: Enclose title page in transparent plastic sleeve. Include the following information:
 - 1. Subject matter included in manual.
 - 2. Name and address of Project.
 - 3. Name and address of Owner.
 - 4. Date of submittal.
 - 5. Name, address, and telephone number of Contractor.
 - 6. Name and address of Architect.
 - 7. Cross-reference to related systems in other operation and maintenance manuals.
- C. Table of Contents: List each product included in manual, identified by product name, indexed to the content of the volume, and cross-referenced to Specification Section number in Project Manual.

- D. Manual Contents: Organize into sets of manageable size. Arrange contents alphabetically by system, subsystem, and equipment. If possible, assemble instructions for subsystems, equipment, and components of one system into a single binder.
1. Binders: Heavy-duty, 3-ring, vinyl-covered, loose-leaf binders, in thickness necessary to accommodate contents, sized to hold 8-1/2-by-11-inch paper; with clear plastic sleeve on spine to hold label describing contents and with pockets inside covers to hold folded oversize sheets.
 - a. Identify each binder on front and spine, with printed title "OPERATION AND MAINTENANCE MANUAL," Project title or name, and subject matter of contents. Indicate volume number for multiple-volume sets.
 2. Dividers: Heavy-paper dividers with plastic-covered tabs for each section. Mark each tab to indicate contents. Include typed list of products and major components of equipment included in the section on each divider, cross-referenced to Specification Section number and title of Project Manual.
 3. Protective Plastic Sleeves: Transparent plastic sleeves designed to enclose diagnostic software diskettes for computerized electronic equipment.
 4. Drawings: Attach reinforced, punched binder tabs on drawings and bind with text.
 - a. If oversize drawings are necessary, fold drawings to same size as text pages and use as foldouts.
 - b. If drawings are too large to be used as foldouts, fold and place drawings in labeled envelopes and bind envelopes in rear of manual. At appropriate locations in manual, insert typewritten pages indicating drawing titles, descriptions of contents, and drawing locations.

2.2 EMERGENCY MANUALS

- A. Content: Organize manual into a separate section for type of emergency, emergency instructions, and emergency procedures.
- B. Type of Emergency: Where applicable for each type of emergency indicated below, include instructions and procedures for each system, subsystem, piece of equipment, and component for fire, gas leak, water leak, power failure, water outage, equipment failure, and, chemical release or spill.
- C. Emergency Instructions: Describe and explain warnings, trouble indications, error messages, and similar codes and signals. Include responsibilities of Owner's operating personnel for notification of Installer, supplier, and manufacturer to maintain warranties.
- D. Emergency Procedures: Include instructions on stopping, shutdown instructions for each type of emergency, operating instructions for conditions outside normal operating limits, and required sequences for electric or electronic systems.

2.3 OPERATION MANUALS

- A. **Content:** In addition to requirements in this Section, include operation data required in individual Specification Sections and equipment descriptions, operating standards, operating procedures, operating logs, wiring and control diagrams, and license requirements.
- B. **Descriptions:** Include the following:
 - 1. Product name and model number.
 - 2. Manufacturer's name.
 - 3. Equipment identification with serial number of each component.
 - 4. Equipment function.
 - 5. Operating characteristics.
 - 6. Limiting conditions.
 - 7. Performance curves.
 - 8. Engineering data and tests.
 - 9. Complete nomenclature and number of replacement parts.
- C. **Operating Procedures:** Include start-up, break-in, and control procedures; stopping and normal shutdown instructions; routine, normal, seasonal, and weekend operating instructions; and required sequences for electric or electronic systems.
- D. **Systems and Equipment Controls:** Describe the sequence of operation, and diagram controls as installed.
- E. **Piped Systems:** Diagram piping as installed, and identify color-coding where required for identification.

2.4 PRODUCT MAINTENANCE MANUAL

- A. **Content:** Organize manual into a separate section for each product, material, and finish. Include source information, product information, maintenance procedures, repair materials and sources, and warranties and bonds, as described below.
- B. **Source Information:** List each product included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.
- C. **Product Information:** Include the following, as applicable:
 - 1. Product name and model number.
 - 2. Manufacturer's name.
 - 3. Color, pattern, and texture.
 - 4. Material and chemical composition.
 - 5. Reordering information for specially manufactured products.
- D. **Maintenance Procedures:** Include manufacturer's written recommendations and inspection procedures, types of cleaning agents, methods of cleaning, schedule for cleaning and maintenance, and repair instructions.

- E. Repair Materials and Sources: Include lists of materials and local sources of materials and related services.
- F. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.

2.5 SYSTEMS AND EQUIPMENT MAINTENANCE MANUAL

- A. Content: For each system, subsystem, and piece of equipment not part of a system, include source information, manufacturers' maintenance documentation, maintenance procedures, maintenance and service schedules, spare parts list and source information, maintenance service contracts, and warranty and bond information, as described below.
- B. Source Information: List each system, subsystem, and piece of equipment included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.
- C. Manufacturers' Maintenance Documentation: Manufacturers' maintenance documentation including maintenance instructions, drawings and diagrams for maintenance, nomenclature of parts and components, and recommended spare parts for each component part or piece of equipment:
- D. Maintenance Procedures: Include test and inspection instructions, troubleshooting guide, disassembly instructions, and adjusting instructions that detail essential maintenance procedures:
- E. Maintenance and Service Schedules: Include service and lubrication requirements, list of required lubricants for equipment, and separate schedules for preventive and routine maintenance and service with standard time allotment.
- F. Spare Parts List and Source Information: Include lists of replacement and repair parts, with parts identified and cross-referenced to manufacturers' maintenance documentation and local sources of maintenance materials and related services.
- G. Maintenance Service Contracts: Include copies of maintenance agreements with name and telephone number of service agent.
- H. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.

PART 3 - EXECUTION

3.1 MANUAL PREPARATION

- A. Emergency Manual: Assemble a complete set of emergency information indicating procedures for use by emergency personnel and by Owner's operating personnel for types of emergencies indicated.

- B. Product Maintenance Manual: Assemble a complete set of maintenance data indicating care and maintenance of each product, material, and finish incorporated into the Work.
- C. Operation and Maintenance Manuals: Assemble a complete set of operation and maintenance data indicating operation and maintenance of each system, subsystem, and piece of equipment not part of a system.
- D. Manufacturers' Data: Where manuals contain manufacturers' standard printed data, include only sheets pertinent to product or component installed. Mark each sheet to identify each product or component incorporated into the Work. If data include more than one item in a tabular format, identify each item using appropriate references from the Contract Documents. Identify data applicable to the Work and delete references to information not applicable.
- E. Drawings: Prepare drawings supplementing manufacturers' printed data to illustrate the relationship of component parts of equipment and systems and to illustrate control sequence and flow diagrams. Coordinate these drawings with information contained in Record Drawings to ensure correct illustration of completed installation.
 - 1. Do not use original Project Record Documents as part of operation and maintenance manuals.
- F. Comply with Division 1 Section "Closeout Procedures" for schedule for submitting operation and maintenance documentation.

END OF SECTION 01782

SECTION 02300 - EARTHWORK

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Preparing subgrades for slabs-on-grade, walks, pavements, lawns and grasses, and exterior plants.
2. Excavating and backfilling for buildings and structures.
3. Drainage course for slabs-on-grade.
4. Subbase course for concrete walks and pavements.
5. Excavating and backfilling for utility trenches.

1.2 DEFINITIONS

A. Backfill: Soil material used to fill an excavation.

1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
2. Final Backfill: Backfill placed over initial backfill to fill a trench.

B. Base Course: Course placed between the subbase course and hot-mix asphalt paving.

C. Bedding Course: Course placed over the excavated subgrade in a trench before laying pipe.

D. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill.

E. Drainage Course: Course supporting the slab-on-grade that also minimizes upward capillary flow of pore water.

F. Excavation: Removal of material encountered above subgrade elevations and to lines and dimensions indicated.

1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Architect. Authorized additional excavation and replacement material will be paid for according to Contract provisions changes in the Work.
2. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Architect. Unauthorized excavation, as well as remedial work directed by Architect, shall be without additional compensation.

G. Fill: Soil materials used to raise existing grades.

H. Structures: Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.

- I. Subbase Course: Course placed between the subgrade and base course for hot-mix asphalt pavement, or course placed between the subgrade and a cement concrete pavement or a cement concrete or hot-mix asphalt walk.
- J. Subgrade: Surface or elevation remaining after completing excavation, or top surface of a fill or backfill immediately below subbase, drainage fill, or topsoil materials.
- K. Utilities: On-site underground pipes, conduits, ducts, and cables, as well as underground services within buildings.

PART 2 - PRODUCTS

2.1 SOIL MATERIALS

- A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from excavations.
- B. Satisfactory Soils: ASTM D 2487 Soil Classification Groups GW, GP, GM, SW, SP, and SM or a combination of these groups; free of rock or gravel larger than 3 inches in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter.
- C. Unsatisfactory Soils: Soil Classification Groups GC, SC, CL, ML, OL, CH, MH, OH, and PT according to ASTM D 2487 or a combination of these groups.
 - 1. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction.
- D. Subbase Material: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 90 percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.
- E. Base Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 95 percent passing a 1-1/2-inch sieve and not more than 8 percent passing a No. 200 sieve.
- F. Engineered Fill: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 90 percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.
- G. Bedding Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; except with 100 percent passing a 1-inch sieve and not more than 8 percent passing a No. 200 sieve.
- H. Drainage Course: Narrowly graded mixture of crushed stone, or crushed or uncrushed gravel; ASTM D 448; coarse-aggregate grading Size 57; with 100 percent passing a 1-1/2-inch sieve and 0 to 5 percent passing a No. 8 sieve.

2.2 ACCESSORIES

- A. Warning Tape: Acid- and alkali-resistant polyethylene film warning tape manufactured for marking and identifying underground utilities, 6 inches wide and 4 mils thick, continuously inscribed with a description of the utility.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by earthwork operations.
- B. Preparation of subgrade for earthwork operations including removal of vegetation, topsoil, debris, obstructions, and deleterious materials from ground surface is specified in Division 2 Section "Site Clearing."
- C. Protect and maintain erosion and sedimentation controls, which are specified in Division 2 Section "Site Clearing," during earthwork operations.

3.2 EXCAVATION

- A. Unclassified Excavation: Excavate to subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, and obstructions. No changes in the Contract Sum or the Contract Time will be authorized for rock excavation or removal of obstructions.
 - 1. If excavated materials intended for fill and backfill include unsatisfactory soil materials and rock, replace with satisfactory soil materials.

3.3 EXCAVATION FOR STRUCTURES

- A. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 1 inch. If applicable, extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, and for inspections.
 - 1. Excavations for Footings and Foundations: Do not disturb bottom of excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.

3.4 EXCAVATION FOR WALKS AND PAVEMENTS

- A. Excavate surfaces under walks and pavements to indicated lines, cross sections, elevations, and subgrades.

3.5 EXCAVATION FOR UTILITY TRENCHES

- A. Excavate trenches to indicated gradients, lines, depths, and elevations.
- B. Excavate trenches to uniform widths to provide the following clearance on each side of pipe or conduit. Excavate trench walls vertically from trench bottom to 12 inches higher than top of pipe or conduit, unless otherwise indicated.
 - 1. Clearance: 12 inches each side of pipe or conduit.
- C. Trench Bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduit. Shape subgrade to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits. Remove projecting stones and sharp objects along trench subgrade.
 - 1. Excavate trenches 6 inches deeper than elevation required in rock or other unyielding bearing material, 4 inches deeper elsewhere, to allow for bedding course.

3.6 SUBGRADE INSPECTION

- A. Proof-roll subgrade below the building with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades. For roadway proof-rolling refer to NCDOT Standard Specification Section 260.
- B. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Architect, without additional compensation.

3.7 UNAUTHORIZED EXCAVATION

- A. Fill unauthorized excavation under foundations or wall footings by extending bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill, with 28-day compressive strength of 2500 psi, may be used when approved by Architect.
 - 1. Fill unauthorized excavations under other construction or utility pipe as directed by Architect.

3.8 STORAGE OF SOIL MATERIALS

- A. Stockpile borrow soil materials and excavated satisfactory soil materials without intermixing. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
 - 1. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

3.9 UTILITY TRENCH BACKFILL

- A. Place backfill on subgrades free of mud, frost, snow, or ice.

- B. Place and compact bedding course on trench bottoms and where indicated. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits.
- C. Backfill trenches excavated under footings and within 18 inches of bottom of footings with satisfactory soil; fill with concrete to elevation of bottom of footings. Concrete is specified in Division 3 Section "Cast-in-Place Concrete."
- D. Provide 4-inch- thick, concrete-base slab support for piping or conduit less than 30 inches below surface of roadways. After installing and testing, completely encase piping or conduit in a minimum of 4 inches of concrete before backfilling or placing roadway subbase.
- E. Place and compact initial backfill of satisfactory soil, free of particles larger than 1 inch in any dimension, to a height of 12 inches over the utility pipe or conduit.
 - 1. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of utility piping or conduit to avoid damage or displacement of piping or conduit. Coordinate backfilling with utilities testing.
- F. Place and compact final backfill of satisfactory soil to final subgrade elevation.
- G. Install warning tape directly above utilities, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

3.10 SOIL FILL

- A. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so fill material will bond with existing material.
- B. Place and compact fill material in layers to required elevations as follows:
 - 1. Under grass and planted areas, use satisfactory soil material.
 - 2. Under walks and pavements, use satisfactory soil material.
 - 3. Under building slabs, use engineered fill.
 - 4. Under footings and foundations, use engineered fill.

3.11 SOIL MOISTURE CONTROL

- A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within 2 percent of optimum moisture content.
 - 1. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
 - 2. Remove and replace, or scarify and air dry otherwise satisfactory soil material that exceeds optimum moisture content by 2 percent and is too wet to compact to specified dry unit weight.

3.12 COMPACTION OF SOIL BACKFILLS AND FILLS

- A. Place backfill and fill soil materials in layers not more than 8 inches in loose depth for material compacted by heavy compaction equipment, and not more than 4 inches in loose depth for material compacted by hand-operated tampers.
- B. Place backfill and fill soil materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure.
- C. Compact soil materials to not less than the following percentages of maximum dry unit weight according to ASTM D 698:
 - 1. Under structures, building slabs, steps, and pavements, scarify and recompact top 12 inches of existing subgrade and each layer of backfill or fill soil material at 95 percent.
 - 2. Under walkways, scarify and recompact top 6 inches below subgrade and compact each layer of backfill or fill soil material at 92 percent.
 - 3. Under lawn or unpaved areas, scarify and recompact top 6 inches below subgrade and compact each layer of backfill or fill soil material at 85 percent.
 - 4. For utility trenches, compact each layer of initial and final backfill soil material at 85 percent.

3.13 GRADING

- A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.
- B. Site Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to required elevations within the following tolerances:
 - 1. Lawn or Unpaved Areas: Plus or minus 1 inch.
 - 2. Walks: Plus or minus 1 inch.
 - 3. Pavements: Plus or minus 1/2 inch.
- C. Grading inside Building Lines: Finish subgrade to a tolerance of 1/2 inch when tested with a 10-foot straightedge.

3.14 SUBBASE AND BASE COURSES

- A. Place subbase and base course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place subbase and base course under pavements and walks as follows:
 - 1. Shape subbase and base course to required crown elevations and cross-slope grades.
 - 2. Compact subbase and base course at optimum moisture content to required grades, lines, cross sections, and thickness to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

3.15 DRAINAGE COURSE

- A. Place drainage course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place and compact drainage course under cast-in-place concrete slabs-on-grade as follows:
 - 1. Place drainage course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
 - 2. Compact each layer of drainage course to required cross sections and thicknesses to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

3.16 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent geotechnical engineering testing agency to perform field quality-control testing.
- B. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earthwork only after test results for previously completed work comply with requirements.
- C. Footing Subgrade: At footing subgrades, at least one test of each soil stratum will be performed to verify design bearing capacities. Subsequent verification and approval of other footing subgrades may be based on a visual comparison of subgrade with tested subgrade when approved by Architect.
- D. Testing agency will test compaction of soils in place according to ASTM D 1556, ASTM D 2167, ASTM D 2922, and ASTM D 2937, as applicable.
- E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil to depth required; recompact and retest until specified compaction is obtained.

3.17 PROTECTION

- A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.
- B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.
- C. Where settling occurs before Project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.
 - 1. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

3.18 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Owner's property.

END OF SECTION 02300

SECTION 02361 - TERMITE CONTROL

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Soil treatment with termiticide.
- B. See Division 6 Section "Rough Carpentry" for wood preservative treatment by pressure process.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated. Include the EPA-Registered Label.
- B. Product certificates.
- C. Soil Treatment Application Report: Include the following:
 - 1. Date and time of application.
 - 2. Moisture content of soil before application.
 - 3. Brand name and manufacturer of termiticide.
 - 4. Quantity of undiluted termiticide used.
 - 5. Dilutions, methods, volumes, and rates of application used.
 - 6. Areas of application.
 - 7. Water source for application.

1.3 QUALITY ASSURANCE

- A. Installer Qualifications: A specialist who is licensed according to regulations of authorities having jurisdiction to apply termite control treatment and products in jurisdiction where Project is located.
- B. Regulatory Requirements: Formulate and apply termiticides according to the EPA-Registered Label.

1.4 WARRANTY

- A. Special Warranty: Manufacturer's standard form, signed by Applicator and Contractor certifying that termite control work, consisting of applied soil termiticide treatment, will prevent infestation of subterranean termites. If subterranean termite activity or damage is discovered during warranty period, re-treat soil and repair or replace damage caused by termite infestation.
 - 1. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 SOIL TREATMENT

- A. Termiticide: Provide an EPA-registered termiticide complying with requirements of authorities having jurisdiction, in an aqueous solution formulated to prevent termite infestation. Provide quantity required for application at the label volume and rate for the maximum termiticide concentration allowed for each specific use, according to product's EPA-Registered Label.

PART 3 - EXECUTION

3.1 PREPARATION

- A. General: Remove all extraneous sources of wood cellulose and other edible materials such as wood debris, tree stumps and roots, stakes, formwork, and construction waste wood from soil within and around foundations.
- B. Soil Treatment Preparation: Loosen, rake, and level soil to be treated except previously compacted areas under slabs and footings. Termiticides may be applied before placing compacted fill under slabs if recommended in writing by termiticide manufacturer.

3.2 APPLYING SOIL TREATMENT

- A. Application: Mix soil treatment termiticide solution to a uniform consistency. Provide quantity required for application at the label volume and rate for the maximum specified concentration of termiticide, according to manufacturer's EPA-Registered Label, to the following so that a continuous horizontal and vertical termiticidal barrier or treated zone is established around and under building construction. Distribute treatment evenly.
 - 1. Slabs-on-Grade and Basement Slabs: Under ground-supported slab construction, including footings, building slabs, and attached slabs as an overall treatment. Treat soil materials before concrete footings and slabs are placed.
 - 2. Foundations: Adjacent soil including soil along the entire inside perimeter of foundation walls, along both sides of interior partition walls, around plumbing pipes and electric conduit penetrating the slab, and around interior column footers, piers, and chimney bases; also along the entire outside perimeter, from grade to bottom of footing. Avoid soil washout around footings.
 - 3. Crawlspace: Soil under and adjacent to foundations as previously indicated. Treat adjacent areas including around entrance platform, porches, and equipment bases. Apply overall treatment only where attached concrete platform and porches are on fill or ground.
 - 4. Masonry: Treat voids.
 - 5. Penetrations: At expansion joints, control joints, and areas where slabs will be penetrated.
- B. Avoid disturbance of treated soil after application. Keep off treated areas until completely dry.

- C. Protect termiticide solution, dispersed in treated soils and fills, from being diluted until ground-supported slabs are installed. Use waterproof barrier according to EPA-Registered Label instructions.
- D. Post warning signs in areas of application.
- E. Reapply soil treatment solution to areas disturbed by subsequent excavation, grading, landscaping, or other construction activities following application.

END OF SECTION 02361

SECTION 02751 - CEMENT CONCRETE PAVEMENT

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes exterior cement concrete pavement for the following:
 - 1. Walkways.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete pavement mixture.

1.3 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Manufacturer of ready-mixed concrete products who complies with ASTM C 94/C 94M requirements for production facilities and equipment.
- B. ACI Publications: Comply with ACI 301, "Specification for Structural Concrete," unless modified by requirements in the Contract Documents.

PART 2 - PRODUCTS

2.1 STEEL REINFORCEMENT

- A. Plain-Steel Welded Wire Reinforcement: ASTM A 185, fabricated from as-drawn steel wire into flat sheets.
- B. Deformed-Steel Welded Wire Reinforcement: ASTM A 497, flat sheet.
- C. Reinforcing Bars: ASTM A 615/A 615M, Grade 60; deformed.
- D. Plain Steel Wire: ASTM A 82, as drawn.
- E. Deformed-Steel Wire: ASTM A 496.
- F. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded wire reinforcement, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice."

2.2 CONCRETE MATERIALS

- A. **Cementitious Material:** Use one of the following cementitious materials, of the same type, brand, and source throughout the Project:
 - 1. **Portland Cement:** ASTM C 150, Type I, gray. Supplement with the following:
 - a. **Fly Ash:** ASTM C 618, Class C.
- B. **Normal-Weight Aggregates:** ASTM C 33, Class 4S coarse aggregate, uniformly graded. Provide aggregates from a single source.
- C. **Water:** ASTM C 94/C 94M.
- D. **Air-Entraining Admixture:** ASTM C 260.
- E. **Chemical Admixtures:** ASTM C 494/C 494M, of type suitable for application, certified by manufacturer to be compatible with other admixtures and to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material.

2.3 CURING MATERIALS

- A. **Water:** Potable.
- B. **Clear Waterborne Membrane-Forming Curing Compound:** ASTM C 309, Type 1, Class B, dissipating.

2.4 RELATED MATERIALS

- A. **Expansion- and Isolation-Joint-Filler Strips:** ASTM D 1751, asphalt-saturated cellulosic fiber.

2.5 CONCRETE MIXTURES

- A. **Prepare design mixtures, proportioned according to ACI 301, with the following properties:**
 - 1. **Compressive Strength (28 Days):** 3500 psi .
 - 2. **Maximum Water-Cementitious Materials Ratio at Point of Placement:** 0.50.
 - 3. **Slump Limit:** 4 inches, plus or minus 1 inch.
 - 4. **Air Content:** 6 percent plus or minus 1.5 percent.

2.6 CONCRETE MIXING

- A. **Ready-Mixed Concrete:** Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M. Furnish batch certificates for each batch discharged and used in the Work.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Proof-roll prepared subbase surface below concrete pavements with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding.

3.2 EDGE FORMS AND SCREED CONSTRUCTION

- A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides for pavement to required lines, grades, and elevations. Install forms to allow continuous progress of work and so forms can remain in place at least 24 hours after concrete placement.
- B. Clean forms after each use and coat with form-release agent to ensure separation from concrete without damage.

3.3 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.

3.4 JOINTS

- A. General: Form construction, isolation, and contraction joints and tool edgings true to line with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to centerline, unless otherwise indicated.
- B. Construction Joints: Set construction joints at side and end terminations of pavement and at locations where pavement operations are stopped for more than one-half hour unless pavement terminates at isolation joints.
- C. Isolation Joints: Form isolation joints of preformed joint-filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, walks, other fixed objects, and where indicated.
- D. Contraction Joints: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of the concrete thickness to match jointing of existing adjacent concrete pavement.
- E. Edging: Tool edges of pavement, gutters, curbs, and joints in concrete after initial floating with an edging tool to a 1/4-inch radius. Repeat tooling of edges after applying surface finishes. Eliminate tool marks on concrete surfaces.

3.5 CONCRETE PLACEMENT

- A. Moisten subbase to provide a uniform dampened condition at time concrete is placed.
- B. Comply with ACI 301 requirements for measuring, mixing, transporting, and placing concrete.

- C. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.
- D. Screed pavement surfaces with a straightedge and strike off.
- E. Commence initial floating using bull floats or darbies to impart an open textured and uniform surface plane before excess moisture or bleed water appears on the surface. Do not further disturb concrete surfaces before beginning finishing operations or spreading surface treatments.

3.6 FLOAT FINISHING

- A. General: Do not add water to concrete surfaces during finishing operations.
- B. Float Finish: Begin the second floating operation when bleed-water sheen has disappeared and concrete surface has stiffened sufficiently to permit operations. Float surface with power-driven floats, or by hand floating if area is small or inaccessible to power units. Finish surfaces to true planes. Cut down high spots and fill low spots. Refloat surface immediately to uniform granular texture.
 - 1. Medium-to-Fine-Textured Broom Finish: Draw a soft bristle broom across float-finished concrete surface perpendicular to line of traffic to provide a uniform, fine-line texture.

3.7 CONCRETE PROTECTION AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.
- B. Comply with ACI 306.1 for cold-weather protection.
- C. Evaporation Retarder: Apply evaporation retarder to concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- D. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.
- E. Curing Methods: Cure concrete by curing compound.

3.8 PAVEMENT TOLERANCES

- A. Comply with tolerances of ACI 117 and as follows:
 - 1. Elevation: 1/4 inch.
 - 2. Thickness: Plus 3/8 inch, minus 1/4 inch.
 - 3. Surface: Gap below 10-foot- long, unlevelled straightedge not to exceed 1/4 inch.
 - 4. Joint Spacing: 3 inches.
 - 5. Contraction Joint Depth: Plus 1/4 inch, no minus.
 - 6. Joint Width: Plus 1/8 inch, no minus.

3.9 REPAIRS AND PROTECTION

- A. Remove and replace concrete pavement that is broken, damaged, or defective or that does not comply with requirements in this Section.
- B. Protect concrete from damage. Exclude traffic from pavement for at least 14 days after placement.
- C. Maintain concrete pavement free of stains, discoloration, dirt, and other foreign material. Sweep concrete pavement not more than two days before date scheduled for Substantial Completion inspections.

END OF SECTION 02751

SECTION 03300 - CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes.
- B. Related Sections:
 - 1. Division 2 Section "Earthwork" for drainage fill under slabs-on-grade.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete mixture. All concrete used on this project must be an approved NCDOT concrete mix. There are several pre-approved NCDOT mixes which can be used. Contractor to submit NCDOT approved mix that meets the requirements of this Section.
- C. Steel Reinforcement Shop Drawings: Placing drawings that detail fabrication, bending, and placement.
- D. Colored concrete samples: Manufacturer's full range of integral, stained, and dry shake concrete products.

1.3 QUALITY ASSURANCE

- A. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.
 - 1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- B. Testing: All concrete to be tested by North Carolina Department of Transportation (NCDOT) for testing indicated. Contractor to coordinate with NCDOT Resident Engineer for collection of concrete samples for testing.
- C. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
 - 1. ACI 301, "Specifications for Structural Concrete".
 - 2. ACI 117, "Specifications for Tolerances for Concrete Construction and Materials."
- D. Preinstallation Conference: Conduct conference at Project site.

- E. Mock-up: Build a mock-up of floor slab demonstrating integral color, stained concrete, and finish for selection and approval.

PART 2 - PRODUCTS

2.1 FORM-FACING MATERIALS

- A. Smooth-Formed Finished Concrete: Form-facing panels that will provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.
- B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.

2.2 STEEL REINFORCEMENT

- A. Reinforcing Bars: ASTM A 615/A 615M, Grade 60, deformed.
- B. Plain-Steel Welded Wire Reinforcement: ASTM A 185/A 185M, plain, fabricated from as-drawn steel wire into flat sheets.
- C. Deformed-Steel Welded Wire Reinforcement: ASTM A 497/A 497M, flat sheet.
- D. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded wire reinforcement in place. Manufacture bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice.
- E. All steel on this project must be made in the United States of America as per Federal Highway Administration (FHWA) regulations.

2.3 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of the same type, brand, and source, throughout Project:
 - 1. Portland Cement: ASTM C 150, Type I, white.
 - a. Fly Ash: ASTM C 618, Class F or C.
- B. Normal-Weight Aggregates: ASTM C 33, graded.
 - 1. Maximum Coarse-Aggregate Size: 1 inch nominal.
 - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Lightweight Aggregate: ASTM C 330, 1-inch nominal maximum aggregate size.
- D. Water: ASTM C 94/C 94M and potable.

2.4 ADMIXTURES

- A. Air-Entraining Admixture: ASTM C 260.
- B. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
 - 1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
 - 2. Retarding Admixture: ASTM C 494/C 494M, Type B.
 - 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
 - 4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
 - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.

2.5 WATERSTOPS

- A. Flexible Rubber Waterstops: CE CRD-C 513, for embedding in concrete to prevent passage of fluids through joints. Factory fabricate corners, intersections, and directional changes.

2.6 VAPOR RETARDERS

- A. Sheet Vapor Retarder: ASTM E 1745, Class A. Include manufacturer's recommended adhesive or pressure-sensitive tape. 15 mils, fiber reinforced, below terrazzo areas and 6 mils all other areas.

2.7 COLORED CONCRETE PRODUCTS

- A. Colored concrete admixture for integrally colored concrete : Chromix P Admixture, by L.M. Scofield Company, Admixture shall be a colored, water reducing admixture containing ni calcium chloride with coloring agents that are lime-ptooof and ultra violet resistant conforming with ASTM C404 and AASHTO M194. Curing compound for integrally colored concrete (to be applied after install of all processed: I.E. integral color, hardener, color hardener, etc: Curing compound shall comply qith ASTM C309 and be from same manufacturer as colored admixture, for use with integrally colored concrete.
- B. Curing and Sealing compound: Cureseal semi-gloss L.M. Scofield Company. Curing and sealing compound shall comply with ASTM C309 and be from same manufacturer as colored admixture for use with integrally colored concrete.
- C. Dry-shake colored hardener: Lithochrome Color Hardener: L.M. Scofield Company, factory proportioned, mixed, and packaged, ready to use surface hardener.

2.8 CURING MATERIALS

- A. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.

- B. Water: Potable.

2.9 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber.

2.10 CONCRETE MIXTURES

- A. All concrete used on this project must be an approved NCDOT concrete mix. There are several pre-approved NCDOT mixes which can be used. Contractor to submit NCDOT approved mix that meets the requirements of this Section. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
- B. Cementitious Materials: Use fly ash and pozzolan, as needed to reduce the total amount of portland cement, which would otherwise be used, by not more than 25 percent.
- C. Admixtures: Use admixtures according to manufacturer's written instructions.
1. Use water-reducing admixture in concrete, as required, for placement and workability.
 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
 3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a water-cementitious materials ratio below 0.50.
- D. Proportion normal-weight concrete mixture as follows:
1. Minimum Compressive Strength: 4000 psi at 28 days.
 2. Maximum Water-Cementitious Materials Ratio: 0.45
 3. Slump Limit: 4 inches for concrete with verified slump of 2 to 4 inches before adding high-range water-reducing admixture or plasticizing admixture], plus or minus 1 inch.
 4. Air Content: 6 percent, plus or minus 1.5 percent at point of delivery for 1-inch, 3/4-inch nominal maximum aggregate size.
 5. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent. No air entrainment for interior slabs, only exterior slabs.
- E. Proportion structural lightweight concrete mixture as follows:
1. Minimum Compressive Strength: See structural drawings
 2. Calculated Equilibrium Unit Weight: 115 lb/cu. ft., plus or minus 3 lb/cu. ft. as determined by ASTM C 567.
 3. Slump Limit: 4 inches, plus or minus 1 inch.
 4. Air Content: 6 percent, plus or minus 2 percent at point of delivery for nominal maximum aggregate size greater than 3/8 inch.
 5. Air Content: Do not allow air content of trowel-finished floors to exceed 3 percent.

2.11 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

2.12 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94/C 94M and furnish batch ticket information.
 - 1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.

PART 3 - EXECUTION

3.1 FORMWORK

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.
- C. Chamfer exterior corners and edges of permanently exposed concrete.

3.2 EMBEDDED ITEMS

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.

3.3 VAPOR RETARDERS

- A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder according to ASTM E 1643 and manufacturer's written instructions.
 - 1. Lap joints 6 inches and seal with manufacturer's recommended tape.

3.4 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for placing reinforcement.
 - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.

202**3.5 JOINTS**

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
 - 1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.
 - 2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
- E. Waterstops: Install in construction joints and at other joints indicated according to manufacturer's written instructions.

3.6 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections have been performed.
- B. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete will be placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
 - 1. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
- C. Cold-Weather Placement: Comply with ACI 306.1.
- D. Hot-Weather Placement: Comply with ACI 301.

3.7 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces not exposed to public view.

- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
 - 1. Apply to concrete surfaces exposed to public view.
- C. Rubbed Finish: Apply the following to smooth-formed finished as-cast concrete where indicated:
 - 1. Smooth-Rubbed Finish: Not later than one day after form removal, moisten concrete surfaces and rub with carborundum brick or another abrasive until producing a uniform color and texture. Do not apply cement grout other than that created by the rubbing process.

3.8 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, restraighening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Scratch Finish: While still plastic, texture concrete surface that has been screeded and bull-floated or darbied. Use stiff brushes, brooms, or rakes to produce a profile amplitude of 1/4 inch in one direction.
 - 1. Apply scratch finish to surfaces indicated.
- C. Float Finish: Consolidate surface with power-driven floats or by hand floating if area is small or inaccessible to power driven floats. Restraighten, cut down high spots, and fill low spots. Repeat float passes and restraighening until surface is left with a uniform, smooth, granular texture.
 - 1. Apply float finish to surfaces to receive trowel finish.
- D. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.
 - 1. Apply a trowel finish to surfaces exposed to view.
 - 2. Finish and measure surface so gap at any point between concrete surface and an unleveled, freestanding, 10-ft long straightedge resting on two high spots and placed anywhere on the surface does not exceed 3/16 inch.
- E. Trowel and Fine-Broom Finish: Apply a first trowel finish to surfaces where ceramic or quarry tile is to be installed by either thickset or thin-set method. While concrete is still plastic, slightly scarify surface with a fine broom.
 - 1. Comply with flatness and levelness tolerances for trowel-finished floor surfaces.

- F. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, ramps, and elsewhere as indicated.

3.9 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.
- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period using cover material and waterproof tape.

3.10 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.

3.11 FIELD QUALITY CONTROL

- A. Testing and Inspecting: Owner will engage a qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.

END OF SECTION 03300

SECTION 04810 - UNIT MASONRY ASSEMBLIES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes unit masonry assemblies consisting of the following:
 - 1. Concrete stone masonry units (CSMUs).
 - 2. Concrete brick.
- B. See Division 5 Section "Metal Fabrications" for furnishing steel lintels and shelf angles for unit masonry.
- C. See Division 7 Section "Sheet Metal Flashing and Trim" for furnishing manufactured reglets installed in masonry joints for metal flashing.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For reinforcing steel. Detail bending and placement of unit masonry reinforcing bars. Comply with ACI 315, "Details and Detailing of Concrete Reinforcement."
- C. Samples for each type and color of exposed masonry units and colored mortars.
- D. Material Certificates: For each type of product indicated. Include statements of material properties indicating compliance with requirements including compliance with standards and type designations within standards.
 - 1. For masonry units include material test reports substantiating compliance with requirements.
- E. Mix Designs: For each type of mortar and grout. Include description of type and proportions of ingredients.

1.3 QUALITY ASSURANCE

- A. Fire-Resistance Ratings: Where indicated, provide materials and construction identical to those of assemblies with fire-resistance ratings determined per ASTM E 119 by a testing and inspecting agency, by equivalent concrete masonry thickness, or by other means, as acceptable to authorities having jurisdiction.
- B. Sample Panels: Build sample panels to verify selections made under sample submittals and to demonstrate aesthetic effects.

1. Build sample panels for each type of exposed unit masonry construction in sizes approximately 48 inches long by 48 inches high.

1.4 PROJECT CONDITIONS

- A. Cold-Weather Requirements: Do not use frozen materials or materials mixed or coated with ice or frost. Do not build on frozen substrates. Remove and replace unit masonry damaged by frost or by freezing conditions. Comply with cold-weather construction requirements contained in ACI 530.1/ASCE 6/TMS 602.
- B. Hot-Weather Requirements: Comply with hot-weather construction requirements contained in ACI 530.1/ASCE 6/TMS 602.

PART 2 - PRODUCTS

2.1 CONCRETE STONE MASONRY UNITS (CSMUs)

- A. Shapes: Provide special shapes for lintels, corners, jambs, sashes, movement joints, headers, bonding, and other special conditions.
- B. Concrete Stone Masonry Units: ASTM C 55-11. Any proposed substitutions of the product listed below are to be submitted prior to bid and must be approved by owner prior to bid.
 1. Concrete Stone Masonry Veneer: Waterford Stone Masonry Units as manufactured by Oldcastle Companies.
 2. Color: Minimum of three variegated color blending as selected from manufacturer's standard selection.
 3. Size: 4" in width nominal with face dimensions selected from a minimum of 15 face sizes to match ashlar pattern indicated on drawings or established in the approved mock-up.
- C. Concrete Building Brick: ASTM C 55.
 1. Unit Compressive Strength: Provide units with minimum average net-area compressive strength of 3500 psi.
 2. Weight Classification: Lightweight.

D. MORTAR AND GROUT MATERIALS

- D. Portland Cement: ASTM C 150, Type I or II, except Type III may be used for cold-weather construction.
- E. Hydrated Lime: ASTM C 207, Type N.
- F. Masonry Cement: ASTM C 91.
- G. Colored Cement Product: Packaged blend made from portland cement and lime and mortar pigments, all complying with specified requirements, and containing no other ingredients.

- H. Aggregate for Mortar: ASTM C 144.
 - 1. For joints less than 1/4 inch thick, use aggregate graded with 100 percent passing the No. 16 sieve.
 - 2. Colored-Mortar Aggregates: Natural sand or crushed stone of color necessary to produce required mortar color.
- I. Aggregate for Grout: ASTM C 404.
- J. Epoxy Pointing Mortar: ASTM C 395, epoxy-resin-based material formulated for use as pointing mortar for structural-clay tile facing units.
- K. Cold-Weather Admixture: Nonchloride, noncorrosive, accelerating admixture complying with ASTM C 494/C 494M, Type C, and recommended by manufacturer for use in masonry mortar of composition indicated.
- L. Water-Repellent Admixture: Liquid water-repellent mortar admixture intended for use with concrete masonry units, containing integral water repellent by same manufacturer.
- M. Water: Potable.

2.2 REINFORCEMENT

- A. Uncoated Steel Reinforcing Bars: ASTM A 615/A 615M or ASTM A 996/A 996M, Grade 60.
- B. Masonry Joint Reinforcement: ASTM A 951; mill galvanized, carbon-steel wire for interior walls and hot-dip galvanized, carbon-steel wire for exterior walls.
 - 1. Wire Size for Side Rods: W2.8 or 0.188-inch diameter.
 - 2. Wire Size for Cross Rods: W2.8 or 0.188-inch diameter.
 - 3. Wire Size for Veneer Ties: W2.8 or 0.188-inch diameter.
 - 4. Spacing of Cross Rods, Tabs, and Cross Ties: Not more than 16 inches o.c.
 - 5. Single-Wythe Masonry: Either ladder or truss type with single pair of side rods.
 - 6. Veneers Anchored with Seismic Masonry-Veneer Anchors: Single 0.188-inch- diameter, hot-dip galvanized, carbon-steel continuous wire.

2.3 TIES AND ANCHORS

- A. Materials:
 - 1. Hot-Dip Galvanized, Carbon-Steel Wire: ASTM A 82; with ASTM A 153/A 153M, Class B-2 coating.
 - 2. Steel Sheet, Galvanized after Fabrication: ASTM A 1008/A 1008M, Commercial Steel, hot-dip galvanized after fabrication to comply with ASTM A 153/A 153M.
 - 3. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.

- B. **Wire Ties, General:** Unless otherwise indicated, size wire ties to extend at least halfway through veneer but with at least 5/8-inch cover on outside face. Outer ends of wires are bent 90 degrees and extend 2 inches parallel to face of veneer.
- C. **Individual Wire Ties:** Rectangular units with closed ends and not less than 4 inches wide.
 - 1. **Wire:** Fabricate from 1/4-inch diameter, hot-dip galvanized steel wire.
- D. **Adjustable Anchors for Connecting to Structure:** Provide anchors that allow vertical or horizontal adjustment but resist tension and compression forces perpendicular to plane of wall.
 - 1. **Anchor Section for Welding to Steel Frame:** Crimped 1/4-inch diameter, hot-dip galvanized steel wire.
 - 2. **Tie Section:** Triangular-shaped wire tie, sized to extend within 1 inch of masonry face, made from 0.25-inch diameter, hot-dip galvanized steel wire.
 - 3. **Connector Section for Concrete:** Dovetail tabs for inserting into dovetail slots in concrete and attached to tie section; formed from 0.097-inch thick, steel sheet, galvanized after fabrication.
- E. **Partition Top anchors:** 0.097-inch thick metal plate with 3/8-inch diameter metal rod 6 inches long welded to plate and with closed-end plastic tube fitted over rod that allows rod to move in and out of tube. Fabricate from steel, hot-dip galvanized after fabrication.
- F. **Rigid Anchors:** Fabricate from steel bars 1-1/2 inches wide by 1/4 inch thick by 24 inches long, with ends turned up 2 inches or with cross pins.
 - 1. **Corrosion Protection:** Hot-dip galvanized to comply with ASTM A 153/A 153M.
- G. **Adjustable Masonry-Veneer Anchors**
 - 1. **General:** Provide anchors that allow vertical adjustment but resist tension and compression forces perpendicular to plane of wall, for attachment over sheathing to wood or metal studs, and as follows:
 - a. **Structural Performance Characteristics:** Capable of withstanding a 100-lbf load in both tension and compression without deforming or developing play in excess of 0.05 inch
 - 2. **Screw-Attached, Masonry-Veneer Anchors:** Units consisting of a wire tie and a metal anchor section.
 - a. **Anchor Section:** Rib-stiffened, sheet metal plate with screw holes top and bottom, and slotted holes for inserting wire tie.
 - b. **Fabricate sheet metal anchor sections** from 0.097-inch thick, steel sheet, galvanized after fabrication.
 - c. **Wire Ties:** Triangular-, rectangular-, or T-shaped wire ties fabricated from 0.25-inch diameter, hot-dip galvanized steel wire.

2.4 EMBEDDED FLASHING MATERIALS

- A. Flexible Flashing: For flashing not exposed to the exterior, use the following, unless otherwise indicated:
 - 1. Rubberized-Asphalt Flashing: Composite flashing product consisting of a pliable, adhesive rubberized-asphalt compound, bonded to a high-density, cross-laminated polyethylene film to produce an overall thickness of not less than 0.040 inch.
- B. Adhesives, Primers, and Seam Tapes for Flashings: Flashing manufacturer's standard products or products recommended by flashing manufacturer.

2.5 MISCELLANEOUS MASONRY ACCESSORIES

- A. Compressible Filler: Premolded filler strips complying with ASTM D 1056, Grade 2A1; compressible up to 35 percent; formulated from neoprene, urethane or PVC.
- B. Preformed Control-Joint Gaskets: Made from styrene-butadiene-rubber compound, complying with ASTM D 2000, Designation M2AA-805 or PVC, complying with ASTM D 2287, Type PVC-65406 and designed to fit standard sash block and to maintain lateral stability in masonry wall.
- C. Bond-Breaker Strips: Asphalt-saturated, organic roofing felt complying with ASTM D 226, Type I (No. 15 asphalt felt).
- D. Cavity Drainage Material: Free-draining mesh, made from polymer strands that will not degrade within the wall cavity.
 - 1. Provide one of the following configurations:
 - a. Strips, not less than 1-1/2 inches thick and 10 inches wide, with dimpled surface designed to catch mortar droppings and prevent weep holes from being clogged with mortar.

2.6 INSULATION

- A. Extruded-Polystyrene Board Insulation: ASTM C 578, Type X, closed-cell product extruded with an integral skin.

2.7 MASONRY CLEANERS

- A. Proprietary Acidic Cleaner: Manufacturer's standard-strength cleaner designed for removing mortar/grout stains from new masonry without damaging masonry. Use product approved for intended use by cleaner manufacturer and manufacturer of masonry units being cleaned.

2.8 MORTAR AND GROUT MIXES

- A. General: Do not use admixtures, unless otherwise indicated.

1. Do not use calcium chloride in mortar or grout.
 2. Limit cementitious materials in mortar for exterior masonry to portland cement and lime.
 3. Add cold-weather admixture (if used) at same rate for all mortar that will be exposed to view, regardless of weather conditions, to ensure that mortar color is consistent.
- B. Mortar for Unit Masonry: Comply with ASTM C 270, Property Specification.
1. For masonry below grade or in contact with earth, use Type M.
 2. For reinforced masonry, use Type N.
 3. For mortar parge coats, use Type N.
 4. For exterior, above-grade, load-bearing and non-load-bearing walls and parapet walls; for interior load-bearing walls; for interior non-load-bearing partitions; and for other applications where another type is not indicated, use Type N.
 5. For interior non-load-bearing partitions, Type O may be used instead of Type N.
- C. Pigmented Mortar: Use colored cement product or select and proportion pigments with other ingredients to produce color required. Do not add pigments to colored cement products.
1. Pigments shall not exceed 10 percent of portland cement by weight.
 2. Pigments shall not exceed 5 percent of masonry cement by weight.
- D. Grout for Unit Masonry: Comply with ASTM C 476.
1. Use grout of type indicated or, if not otherwise indicated, of type (fine or coarse) that will comply with Table 1.15.1 in ACI 530.1/ASCE 6/TMS 602 for dimensions of grout spaces and pour height.
 2. Provide grout with a slump of 8 to 11 inches as measured according to ASTM C 143/C 143M.
- E. Epoxy Pointing Mortar: Mix epoxy pointing mortar to comply with mortar manufacturer's written instructions.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Use full-size units without cutting if possible. If cutting is required, cut units with motor-driven saws; provide clean, sharp, unchipped edges. Allow units to dry before laying unless wetting of units is specified. Install cut units with cut surfaces and, where possible, cut edges concealed.
- B. Select and arrange units for exposed unit masonry to produce a uniform blend of colors and textures.
- C. Comply with tolerances in ACI 530.1/ASCE 6/TMS 602 and with the following:
1. For conspicuous vertical lines, such as external corners, door jambs, reveals, and expansion and control joints, do not vary from plumb by more than 1/4 inch in 20 feet maximum.

2. For conspicuous horizontal lines, such as lintels, sills, parapets, and reveals, do not vary from level by more than 1/4 inch in 20 feet maximum.

3.2 LAYING MASONRY WALLS

- A. Lay out walls in advance for accurate spacing of surface bond patterns with uniform joint thicknesses and for accurate location of openings, movement-type joints, returns, and offsets. Avoid using less-than-half-size units, particularly at corners, jambs, and, where possible, at other locations.
- B. Bond Pattern for Exposed Masonry: As shown on construction documents
- C. Built-in Work: As construction progresses, build in items specified in this and other Sections. Fill in solidly with masonry around built-in items.
- D. Fill space between steel frames and masonry solidly with mortar, unless otherwise indicated.
- E. Fill cores in hollow concrete masonry units with grout 24 inches under bearing plates, beams, lintels, posts, and similar items, unless otherwise indicated.

3.3 MORTAR BEDDING AND JOINTING

- A. Lay hollow concrete masonry units as follows:
 1. With face shells fully bedded in mortar and with head joints of depth equal to bed joints.
 2. With webs fully bedded in mortar in all courses of piers, columns, and pilasters.
 3. With webs fully bedded in mortar in grouted masonry, including starting course on footings.
 4. With entire units, including areas under cells, fully bedded in mortar at starting course on footings where cells are not grouted.
- B. Lay solid masonry units with completely filled bed and head joints; butter ends with sufficient mortar to fill head joints and shove into place. Do not deeply furrow bed joints or slush head joints.
- C. Tool exposed joints slightly concave when thumbprint hard, using a jointer larger than joint thickness, unless otherwise indicated.
- D. Cut joints flush for masonry walls to receive plaster or other direct-applied finishes (other than paint), unless otherwise indicated.

3.4 MASONRY JOINT REINFORCEMENT

- A. General: Install in mortar with a minimum cover of 5/8 inch on exterior side of walls, 1/2 inch elsewhere. Lap reinforcement a minimum of 6 inches.
- B. Interrupt joint reinforcement at control and expansion joints, unless otherwise indicated.
- C. Provide continuity at wall intersections by using prefabricated T-shaped units.

- D. Provide continuity at corners by using prefabricated L-shaped units.

3.5 ANCHORING MASONRY TO STRUCTURAL MEMBERS

- A. Anchor masonry to structural members where masonry abuts or faces structural members to comply with the following:
1. Provide an open space not less than 1 inch in width between masonry and structural member, unless otherwise indicated.
 2. Anchor masonry to structural members with anchors embedded in masonry joints and attached to structure.
 3. Space anchors as indicated, but not more than 24 inches o.c. vertically and 36 inches o.c. horizontally.

3.6 ANCHORING MASONRY VENEERS

- A. Anchor masonry veneers to wall framing with masonry-veneer anchors to comply with the following requirements:
1. Fasten screw-attached anchors through sheathing to wall framing with metal fasteners of type indicated. Use two fasteners.
 2. Embed tie sections in masonry joints. Provide not less than 2 inches of air space between back of masonry veneer and face of sheathing.
 3. Locate anchor sections to allow maximum vertical differential movement of ties up and down.
 4. Space anchors as indicated, but not more than 16 inches o.c. vertically and 24 inches o.c. horizontally with not less than 1 anchor for each 2.67 sq. ft. of wall area. Install additional anchors within 12 inches of openings and at intervals, not exceeding 36 inches, around perimeter.

3.7 FLASHING, WEEP HOLES, CAVITY DRAINAGE, AND VENTS

- A. General: Install embedded flashing and weep holes in masonry at shelf angles, lintels, ledges, other obstructions to downward flow of water in wall, and where indicated. Install vents at shelf angles, ledges, and other obstructions to upward flow of air in cavities, and where indicated.
- B. Install flashing as follows, unless otherwise indicated:
1. Prepare masonry surfaces so they are smooth and free from projections that could puncture flashing. Where flashing is within mortar joint, place through-wall flashing on sloping bed of mortar and cover with mortar. Before covering with mortar, seal penetrations in flashing as recommended by flashing manufacturer.
 2. At lintels and shelf angles, extend flashing a minimum of 6 inches into masonry at each end. At heads and sills, extend flashing 6 inches at ends and turn up not less than 2 inches to form end dams.

3. Install metal drip edges beneath flexible flashing at exterior face of wall. Stop flexible flashing 1/2 inch back from outside face of wall and adhere flexible flashing to top of metal drip edge.
 4. Install metal flashing termination beneath flexible flashing at exterior face of wall. Stop flexible flashing 1/2 inch back from outside face of wall and adhere flexible flashing to top of metal flashing termination.
- C. Install weep holes in head joints in exterior wythes of first course of masonry immediately above embedded flashing and as follows:
1. Use open head joints to form weep holes.
 2. Space weep holes 24 inches o.c., unless otherwise indicated.
 3. Cover cavity side of weep holes with plastic insect screening at cavities insulated with loose-fill insulation.
- D. Place cavity drainage material in cavities to comply with configuration requirements for cavity drainage material in Part 2 "Miscellaneous Masonry Accessories" Article.
- E. Install vents in head joints in exterior wythes at spacing indicated. Use open head joints to form vents.
1. Close cavities off vertically and horizontally with blocking in manner indicated. Install through-wall flashing and weep holes above horizontal blocking.

3.8 FIELD QUALITY CONTROL

- A. Inspectors: Owner will engage qualified independent inspectors to perform inspections and prepare reports. Allow inspectors access to scaffolding and work areas, as needed to perform inspections.
1. Place grout only after inspectors have verified compliance of grout spaces and grades, sizes, and locations of reinforcement.
- B. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections indicated below and prepare test reports:
1. Payment for these services will be made by Owner.
- C. Testing Frequency: One set of tests for each 5000 sq. ft. of wall area or portion thereof.
- D. Clay Masonry Unit Test: For each type of unit provided, per ASTM C 67.
- E. Concrete Masonry Unit Test: For each type of unit provided, per ASTM C 140.
- F. Mortar Test (Property Specification): For each mix provided, per ASTM C 780. Test mortar for mortar air content and compressive strength.
- G. Grout Test (Compressive Strength): For each mix provided, per ASTM C 1019.

3.9 PARGING

- A. Parge exterior faces of below-grade masonry walls, where indicated, in 2 uniform coats to a total thickness of 3/4 inch with a steel-trowel finish. Form a wash at top of parging and a cove at bottom. Damp-cure parging for at least 24 hours and protect parging until cured.

3.10 CLEANING

- A. In-Progress Cleaning: Clean unit masonry as work progresses by dry brushing to remove mortar fins and smears before tooling joints.
- B. Final Cleaning: After mortar is thoroughly set and cured, clean exposed masonry as follows:
 - 1. Test cleaning methods on sample wall panel; leave one-half of panel uncleaned for comparison purposes.
 - 2. Protect adjacent surfaces from contact with cleaner.
 - 3. Wet wall surfaces with water before applying cleaners; remove cleaners promptly by rinsing surfaces thoroughly with clear water.
 - 4. Clean brick by bucket-and-brush hand-cleaning method described in BIA Technical Notes 20.
 - 5. Clean masonry with a proprietary acidic cleaner applied according to manufacturer's written instructions.
 - 6. Clean concrete masonry by cleaning method indicated in NCMA TEK 8-2A applicable to type of stain on exposed surfaces.

3.11 MASONRY WASTE DISPOSAL

- A. Waste Disposal as Fill Material: Dispose of clean masonry waste, including excess or soil-contaminated sand, waste mortar, and broken masonry units, by crushing and mixing with fill material as fill is placed.
 - 1. Do not dispose of masonry waste as fill within 18 inches of finished grade.
 - 2. Remove excess clean masonry waste that cannot be used as fill, as described above, and other masonry waste, and legally dispose of off Owner's property.

END OF SECTION 04810

SECTION 05120 - STRUCTURAL STEEL

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes structural steel and grout.

1.2 PERFORMANCE REQUIREMENTS

- A. Connections: Provide details of simple shear connections required by the Contract Documents to be selected or completed by structural-steel fabricator to withstand ASD-service loads indicated and comply with other information and restrictions indicated.
 - 1. Select and complete connections using schematic details indicated and AISC's "Manual of Steel Construction, Load and Resistance Factor Design," Volume 2, Part 9 and AISC's "Manual of Steel Construction, Allowable Stress Design," Part 4.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show fabrication of structural-steel components.
- C. Welding certificates.
- D. Mill test reports.
- E. Source quality-control test reports.

1.4 QUALITY ASSURANCE

- A. Fabricator Qualifications: A qualified fabricator who participates in the AISC Quality Certification Program and is designated an AISC-Certified Plant, Category Sbd.
- B. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code--Steel."
- C. Comply with applicable provisions of AISC's "Code of Standard Practice for Steel Buildings and Bridges."
- D. Preinstallation Conference: Conduct conference at Project site.

PART 2 - PRODUCTS

2.1 STRUCTURAL-STEEL MATERIALS

- A. W-Shapes: ASTM A 992/A 992M.
- B. Channels, Angles, M, S-Shapes: ASTM A 36/A 36M.
- C. Plate and Bar: ASTM A 36/A 36M.
- D. Cold-Formed Hollow Structural Sections: ASTM A 500, Grade B, structural tubing.
- E. Steel Pipe: ASTM A 53/A 53M, Type E or S, Grade B.
- F. Welding Electrodes: Comply with AWS requirements.

2.2 BOLTS, CONNECTORS, AND ANCHORS

- A. High-Strength Bolts, Nuts, and Washers: ASTM A 325, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers.
 - 1. Finish: Plain.
- B. Shear Connectors: ASTM A 108, Grades 1015 through 1020, headed-stud type, cold-finished carbon steel; AWS D1.1, Type B.
- C. Unheaded Anchor Rods: ASTM F 1554, Grade 36.
 - 1. Configuration: Hooked.
 - 2. Finish: Plain.
- D. Headed Anchor Rods: ASTM F 1554, Grade 36, straight.
 - 1. Finish: Plain.
- E. Threaded Rods: ASTM A 193/A 193M.
 - 1. Finish: Plain.

2.3 PRIMER

- A. Primer: Fabricator's standard lead- and chromate-free, nonasphaltic, rust-inhibiting primer.

2.4 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

2.5 FABRICATION

- A. Structural Steel: Fabricate and assemble in shop to greatest extent possible. Fabricate according to AISC's "Code of Standard Practice for Steel Buildings and Bridges" and AISC's "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design and Load and Resistance Factor Design Specification for Structural Steel Buildings."
- B. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1 and manufacturer's written instructions.

2.6 SHOP CONNECTIONS

- A. High-Strength Bolts: Shop install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: See structural drawings.].
- B. Weld Connections: Comply with AWS D1.1 for welding procedure specifications, tolerances, appearance, and quality of welds and for methods used in correcting welding work.

2.7 SHOP PRIMING

- A. Shop prime steel surfaces except the following:
 - 1. Surfaces embedded in concrete or mortar. Extend priming of partially embedded members to a depth of 2 inches.
 - 2. Surfaces to be field welded.
 - 3. Surfaces to be high-strength bolted with slip-critical connections.
 - 4. Surfaces to receive sprayed fire-resistive materials.
 - 5. Galvanized surfaces.
 - 6. Top flanges of beams to receive weld studs.
- B. Surface Preparation: Clean surfaces to be painted. Remove loose rust and mill scale and spatter, slag, or flux deposits. Prepare surfaces according to the following specifications and standards:
 - 1. SSPC-SP 2, "Hand Tool Cleaning."
- C. Priming: Immediately after surface preparation, apply primer according to manufacturer's written instructions and at rate recommended by SSPC to provide a dry film thickness of not

less than 1.5 mils. Use priming methods that result in full coverage of joints, corners, edges, and exposed surfaces.

2.8 SOURCE QUALITY CONTROL

- A. Owner will engage an independent testing and inspecting agency to perform shop tests and inspections and prepare test reports. Comply with testing and inspection requirements of Part 3, Article "Field Quality Control."
- B. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.
- C. In addition to visual inspection, shop-welded shear connectors will be tested and inspected according to requirements in AWS D1.1 for stud welding.

PART 3 - EXECUTION

3.1 ERECTION

- A. Examination: Verify elevations of concrete- and masonry-bearing surfaces and locations of anchor rods, bearing plates, and other embedments, with steel erector present, for compliance with requirements.
 - 1. Proceed with installation only after unsatisfactory conditions have been corrected.
- B. Set structural steel accurately in locations and to elevations indicated and according to AISC's "Code of Standard Practice for Steel Buildings and Bridges", "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design and Load and Resistance Factor Design Specification for Structural Steel Buildings."
- C. Base and Bearing Plates: Clean concrete- and masonry-bearing surfaces of bond-reducing materials, and roughen surfaces prior to setting base and bearing plates. Clean bottom surface of base and bearing plates.
 - 1. Set base and bearing plates for structural members on wedges, shims, or setting nuts as required.
 - 2. Weld plate washers to top of base plate.
 - 3. Snug-tighten anchor rods after supported members have been positioned and plumbed. Do not remove wedges or shims but, if protruding, cut off flush with edge of base or bearing plate before packing with grout.
 - 4. Promptly pack grout solidly between bearing surfaces and base or bearing plates so no voids remain. Neatly finish exposed surfaces; protect grout and allow to cure. Comply with manufacturer's written installation instructions for shrinkage-resistant grouts.
- D. Maintain erection tolerances of structural steel within AISC's "Code of Standard Practice for Steel Buildings and Bridges."

3.2 FIELD CONNECTIONS

- A. High-Strength Bolts: Install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: See structural drawings.
- B. Weld Connections: Comply with AWS D1.1 for welding procedure specifications, tolerances, appearance, and quality of welds and for methods used in correcting welding work.
 - 1. Comply with AISC's "Code of Standard Practice for Steel Buildings and Bridges" and "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design and Load and Resistance Factor Design Specification for Structural Steel Buildings" for bearing, adequacy of temporary connections, alignment, and removal of paint on surfaces adjacent to field welds.

3.3 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to inspect field welds and high-strength bolted connections.
- B. Bolted Connections: Shop-bolted connections will be inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- C. Welded Connections: Field welds will be visually inspected according to AWS D1.1.
 - 1. In addition to visual inspection, field welds will be tested according to AWS D1.1 and the following inspection procedures, at testing agency's option:
 - a. Liquid Penetrant Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- D. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.

END OF SECTION 05120

SECTION 05400 - COLD-FORMED METAL FRAMING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Exterior non-load-bearing wall framing.

1.2 PERFORMANCE REQUIREMENTS

- A. Structural Performance: Provide cold-formed metal framing capable of withstanding design loads within limits and under conditions indicated.
 - 1. Design Loads: As indicated on structural drawings.
 - 2. Deflection Limits: Design framing systems to withstand design loads without deflections greater than the following:
 - a. Exterior Load-Bearing Wall Framing: Horizontal deflection of 1/360 of the wall height.
 - b. Interior Load-Bearing Wall Framing: Horizontal deflection of 1/360 of the wall height under a horizontal load of 5 lbf/sq. ft.
 - c. Exterior Non-Load-Bearing Framing: Horizontal deflection of 1/360 of the wall height.
 - 3. Submit sealed calculations and drawings for review.

1.3 SUBMITTALS

- A. Product Data: For each type of product and accessory indicated.
- B. Shop Drawings: Show layout, spacings, sizes, thicknesses, and types of cold-formed metal framing; fabrication; and fastening and anchorage details, including mechanical fasteners.
 - 1. For cold-formed metal framing indicated to comply with design loads, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
- C. Welding certificates.
- D. Qualification data.
- E. Product test reports.
- F. Research/evaluation reports.

1.4 QUALITY ASSURANCE

- A. Product Tests: Mill certificates or data from a qualified independent testing agency indicating steel sheet complies with requirements.
- B. Welding: Qualify procedures and personnel according to AWS D1.3, "Structural Welding Code--Sheet Steel."
- C. Fire-Test-Response Characteristics: Where indicated, provide cold-formed metal framing identical to that of assemblies tested for fire resistance per ASTM E 119 by a testing and inspecting agency acceptable to authorities having jurisdiction.
- D. AISI Specifications and Standards: Comply with AISI's "North American Specification for the Design of Cold-Formed Steel Structural Members" and its "Standard for Cold-Formed Steel Framing - General Provisions."
 - 1. Comply with AISI's "Standard for Cold-Formed Steel Framing - Truss Design."
 - 2. Comply with AISI's "Standard for Cold-Formed Steel Framing - Header Design."
- E. Comply with AISI's "Standard for Cold-Formed Steel Framing - Prescriptive Method for One and Two Family Dwellings."

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Steel Sheet: ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of grade and coating weight as follows:
 - 1. Grade: As required by structural performance.
 - 2. Coating: G60.

2.2 EXTERIOR NON-LOAD-BEARING WALL FRAMING

- A. Steel Studs: Manufacturer's standard C-shaped steel studs, of web depths indicated, punched, with stiffened flanges, and as follows:
 - 1. Minimum Base-Metal Thickness: 0.0677 inch.
 - 2. Flange Width: 2 inches minimum..
 - 3. Section Properties: As required for design loads.
- B. Steel Track: Manufacturer's standard U-shaped steel track, of web depths indicated, unpunched, with unstiffened flanges, and same minimum base-metal thickness as steel studs.
- C. Vertical Deflection Clips: Manufacturer's standard head clips, capable of accommodating upward and downward vertical displacement of primary structure through positive mechanical attachment to stud web.

- D. Single Deflection Track: Manufacturer's single, deep-leg, U-shaped steel track; unpunched, with unstiffened flanges, of web depth to contain studs while allowing free vertical movement, with flanges designed to support horizontal and lateral loads.
- E. Double Deflection Tracks: Manufacturer's double, deep-leg, U-shaped steel tracks, consisting of nested inner and outer tracks; unpunched, with unstiffened flanges.

2.3 FRAMING ACCESSORIES

- A. Fabricate steel-framing accessories from steel sheet, ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of same grade and coating weight used for framing members, unless otherwise indicated.
- B. Steel Shapes and Clips: ASTM A 36/A 36M, zinc coated by hot-dip process according to ASTM A 123/A 123M.
- C. Anchor Bolts: ASTM F 1554, Grade 36, threaded carbon-steel hex-headed bolts and carbon-steel nuts; and flat, hardened-steel washers; zinc coated by hot-dip process according to ASTM A 153/A 153M, Class C.
- D. Expansion Anchors: Fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 488 conducted by a qualified independent testing agency.
- E. Power-Actuated Anchors: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 10 times design load, as determined by testing per ASTM E 1190 conducted by a qualified independent testing agency.
- F. Mechanical Fasteners: ASTM C 1513, corrosion-resistant-coated, self-drilling, self-tapping steel drill screws.
 - 1. Head Type: Low-profile head beneath sheathing, manufacturer's standard elsewhere.

2.4 MISCELLANEOUS MATERIALS

- A. Galvanizing Repair Paint: SSPC-Paint 20 or DOD-P-21035.
- B. Cement Grout: Portland cement, ASTM C 150, Type I; and clean, natural sand, ASTM C 404. Mix at ratio of 1 part cement to 2-1/2 parts sand, by volume, with minimum water required for placement and hydration.
- C. Shims: Load bearing, high-density multimonomer plastic, nonleaching.
- D. Sealer Gaskets: Closed-cell neoprene foam, 1/4 inch thick, selected from manufacturer's standard widths to match width of bottom track or rim track members.

PART 3 - EXECUTION**3.1 PREPARATION**

- A. Install load bearing shims or grout between the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations to ensure a uniform bearing surface on supporting concrete or masonry construction.
- B. Install sealer gaskets to isolate the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations.

3.2 INSTALLATION, GENERAL

- A. Install cold-formed metal framing according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions" and to manufacturer's written instructions unless more stringent requirements are indicated.
- B. Install cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened.
- C. Install framing members in one-piece lengths.
- D. Install temporary bracing and supports to secure framing and support loads comparable in intensity to those for which structure was designed. Maintain braces and supports in place, undisturbed, until entire integrated supporting structure has been completed and permanent connections to framing are secured.
- E. Do not bridge building expansion and control joints with cold-formed metal framing. Independently frame both sides of joints.
- F. Install insulation, specified in Division 7 Section "Building Insulation," in built-up exterior framing members, such as headers, sills, boxed joists, and multiple studs at openings, that are inaccessible on completion of framing work.
- G. Fasten hole reinforcing plate over web penetrations that exceed size of manufacturer's standard punched openings.
- H. Erection Tolerances: Install cold-formed metal framing level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet and as follows:
 - 1. Space individual framing members no more than plus or minus 1/8 inch from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.

3.3 EXTERIOR NON-LOAD-BEARING WALL INSTALLATION

- A. Install continuous tracks sized to match studs. Align tracks accurately and securely anchor to supporting structure as indicated.

- B. Fasten both flanges of studs to top and bottom track, unless otherwise indicated. Space studs as follows:
 - 1. Stud Spacing: As indicated on Shop Drawings.
- C. Set studs plumb, except as needed for diagonal bracing or required for nonplumb walls or warped surfaces and similar requirements.
- D. Isolate non-load-bearing steel framing from building structure to prevent transfer of vertical loads while providing lateral support.
 - 1. Install single deflection tracks and anchor to building structure.
 - 2. Install double deflection tracks and anchor outer track to building structure.
 - 3. Connect vertical deflection clips to infill studs and anchor to primary building structure.
- E. Install horizontal bridging in wall studs, spaced in rows indicated on Shop Drawings but not more than 48 inches apart. Fasten at each stud intersection.
 - 1. Top Bridging for Single Deflection Track: Install row of horizontal bridging within 12 inches of single deflection track. Install a combination of flat, taut, steel sheet straps of width and thickness indicated and stud or stud-track solid blocking of width and thickness matching studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 - a. Install solid blocking at centers indicated on Shop Drawings.
 - 2. Bridging: Cold-rolled steel channel, welded or mechanically fastened to webs of punched studs.
- F. Install miscellaneous framing and connections, including stud kickers, web stiffeners, clip angles, continuous angles, anchors, fasteners, and stud girts, to provide a complete and stable curtain-wall-framing system.

3.4 FIELD QUALITY CONTROL

- A. Testing: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Field and shop welds will be subject to testing and inspecting.
- C. Testing agency will report test results promptly and in writing to Contractor and Architect.
- D. Remove and replace work where test results indicate that it does not comply with specified requirements.
- E. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

3.5 REPAIRS AND PROTECTION

- A. Galvanizing Repairs: Prepare and repair damaged galvanized coatings on fabricated and installed cold-formed metal framing with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Provide final protection and maintain conditions, in a manner acceptable to manufacturer and Installer, that ensure that cold-formed metal framing is without damage or deterioration at time of Substantial Completion.

END OF SECTION 05400

SECTION 05500 - METAL FABRICATIONS**PART 1 - GENERAL****1.1 SUMMARY**

- A. This Section includes the following:
 - 1. Miscellaneous steel framing and supports.
 - 2. Shelf angles.
 - 3. Loose bearing and leveling plates.
 - 4. Steel weld plates and angles.
 - 5. Miscellaneous steel trim.
 - 6. Loose steel lintels.

1.2 SUBMITTALS

- A. Product Data: For the following:
 - 1. Grout.
- B. Shop Drawings: Include plans, elevations, sections, and details of metal fabrications and their connections. Show anchorage and accessory items.
- C. Templates: For anchors and bolts.
- D. Samples: For each type and finish of extruded nosing.

PART 2 - PRODUCTS**2.1 METALS**

- A. Metal Surfaces, General: Provide materials with smooth, flat surfaces without blemishes.
- B. Ferrous Metals:
 - 1. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
 - 2. Rolled-Steel Floor Plate: ASTM A 786/A 786M, rolled from plate complying with ASTM A 36/A 36M or ASTM A 283/A 283M, Grade C or D.
 - 3. Steel Tubing: ASTM A 500, cold-formed steel tubing.
 - 4. Steel Pipe: ASTM A 53/A 53M, standard weight (Schedule 40), unless another weight is indicated or required by structural loads.
- C. Nonferrous Metals:
 - 1. Aluminum Extrusions: ASTM B 221, alloy 6063-T6.
 - 2. Aluminum-Alloy Rolled Tread Plate: ASTM B 632/B 632M, alloy 6061-T6.

3. Aluminum Castings: ASTM B 26/B 26M, Alloy 443.0-F.

2.2 FASTENERS

- A. General: Type 304 stainless-steel fasteners for exterior use and zinc-plated fasteners with coating complying with ASTM B 633, Class Fe/Zn 5, at exterior walls. Provide stainless-steel fasteners for fastening aluminum. Select fasteners for type, grade, and class required.
- B. Cast-in-Place Anchors in Concrete: Threaded or wedge type; galvanized ferrous castings, either ASTM A 47/A 47M malleable iron or ASTM A 27/A 27M cast steel. Provide bolts, washers, and shims as needed, hot-dip galvanized per ASTM A 153/A 153M.

2.3 MISCELLANEOUS MATERIALS

- A. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI #79.
- B. Zinc-Rich Primer: Complying with SSPC-Paint 20 or SSPC-Paint 29 and compatible with topcoat.
- C. Galvanizing Repair Paint: SSPC-Paint 20, high-zinc-dust-content paint for regalvanizing welds in steel.
- D. Nonshrink, Nonmetallic Grout: Factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C 1107.
- E. Concrete Materials and Properties: Comply with requirements in Division 3 Section "Cast-in-Place Concrete" for normal-weight, air-entrained, ready-mix concrete with a minimum 28-day compressive strength of 3000 psi, unless otherwise indicated.

2.4 FABRICATION

- A. General: Preassemble items in the shop to greatest extent possible. Use connections that maintain structural value of joined pieces.
 1. Cut, drill, and punch metals cleanly and accurately. Remove burrs and ease edges. Remove sharp or rough areas on exposed surfaces.
 2. Weld corners and seams continuously. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals. Obtain fusion without undercut or overlap. Remove welding flux immediately. Finish exposed welds smooth and blended.
 3. Form exposed connections with hairline joints, flush and smooth, using concealed fasteners where possible. Locate joints where least conspicuous.
 4. Fabricate seams and other connections that will be exposed to weather in a manner to exclude water. Provide weep holes where water may accumulate.
 5. Where units are indicated to be cast into concrete or built into masonry, equip with integrally welded steel strap anchors, not less than 24 inches o.c.

- B. Miscellaneous Framing and Supports: Provide steel framing and supports not specified in other Sections as needed to complete the Work. Fabricate units from steel shapes, plates, and bars of welded construction. Cut, drill, and tap units to receive hardware, hangers, and similar items.
 - 1. Fabricate steel pipe columns for supporting wood frame construction with steel baseplates and top plates welded to pipe with fillet welds the same size as pipe wall thickness.
- C. Loose Steel Lintels: Fabricate loose steel lintels from steel angles and shapes of size indicated for openings and recesses in masonry walls and partitions at locations indicated.
 - 1. Lintels in Exterior Walls: Galvanize.
- D. Shelf Angles: Fabricate shelf angles of sizes indicated and for attachment to framing. Fabricate with horizontally slotted holes to receive 3/4-inch bolts, spaced not more than 6 inches from ends and 24 inches o.c.
 - 1. Shelf Angles in Exterior Walls: Galvanize.
 - 2. Furnish wedge-type concrete inserts, complete with fasteners, to attach shelf angles to cast-in-place concrete.
- E. Loose Bearing and Leveling Plates: Provide loose bearing and leveling plates for steel items bearing on masonry or concrete construction. Drill plates to receive anchor bolts.
- F. Miscellaneous Steel Trim: Fabricate units from steel shapes, plates, and bars of profiles shown with continuously welded joints and smooth exposed edges. Miter corners and use concealed field splices where possible. Provide cutouts, fittings, and anchorages as needed to coordinate assembly and installation with other work.
 - 1. Exterior Miscellaneous Steel Trim: Galvanize.

2.5 FINISHES

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes. Finish metal fabrications after assembly.
- B. Steel and Iron Finishes:
 - 1. Hot-dip galvanize items as indicated to comply with ASTM A 123/A 123M or ASTM A 153/A 153M as applicable.
 - 2. Preparation for Shop Priming: Prepare uncoated ferrous-metal surfaces to comply with requirements indicated below for environmental exposure conditions of installed metal fabrications:
 - a. Exteriors (SSPC Zone 1B) and Items Indicated to Receive Zinc-Rich Primer: SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 - b. Interiors (SSPC Zone 1A): SSPC-SP 3, "Power Tool Cleaning."

3. Shop Priming: Apply shop primer to uncoated surfaces of metal fabrications, except those with galvanized finishes and those to be embedded in concrete, sprayed-on fireproofing, or masonry, to comply with SSPC-PA 1, "Paint Application Specification No. 1: Shop, Field, and Maintenance Painting," for shop painting.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Perform cutting, drilling, and fitting required for installing metal fabrications. Set metal fabrications accurately in location, with edges and surfaces level, plumb, and true.
 1. Fit exposed connections accurately together. Weld connections that are not to be left as exposed joints but cannot be shop welded. Do not weld, cut, or abrade surfaces of exterior units that have been hot-dip galvanized after fabrication.
 2. Provide anchorage devices and fasteners where metal fabrications are required to be fastened to in-place construction.
 3. Provide temporary bracing or anchors in formwork for items that are to be built into concrete, masonry, or similar construction.
- B. Set bearing and leveling plates on cleaned surfaces using wedges, shims, or leveling nuts. After bearing members have been positioned and plumbed, tighten anchor bolts and pack solidly with nonshrink, nonmetallic grout.
- C. Touch up surfaces and finishes after erection.
 1. Painted Surfaces: Clean field welds, bolted connections, and abraded areas and touch up paint with the same material as used for shop painting.
 2. Galvanized Surfaces: Clean field welds, bolted connections, and abraded areas and repair galvanizing to comply with ASTM A 780.

END OF SECTION 05500

SECTION 06100 - ROUGH CARPENTRY

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Framing with dimension lumber.
2. Wood blocking, cants and nailers.
3. Wood furring and grounds.
4. Wood sleepers.
5. Plywood backing panels.

1.2 SUBMITTALS

A. Product Data: For each type of process and factory-fabricated product.

1. Include data for wood-preservative and fire-retardant treatment from chemical treatment manufacturer and certification by treating plant that treated materials comply with requirements..

B. Material Certificates: For dimension lumber specified to comply with minimum allowable unit stresses. Indicate species and grade selected for each use and design values approved by the American Lumber Standards Committee Board of Review.

C. Research/Evaluation Reports: For the following, showing compliance with building code in effect for Project:

1. Wood-preservative-treated wood.
2. Fire-retardant-treated wood.
3. Power-driven fasteners.
4. Powder-actuated fasteners.
5. Expansion anchors.
6. Metal framing anchors.

PART 2 - PRODUCTS

2.1 WOOD PRODUCTS, GENERAL

A. Lumber: DOC PS 20 and applicable rules of grading agencies indicated. If no grading agency is indicated, provide lumber that complies with the applicable rules of any rules-writing agency certified by the ALSC Board of Review. Provide lumber graded by an agency certified by the ALSC Board of Review to inspect and grade lumber under the rules indicated.

1. Factory mark each piece of lumber with grade stamp of grading agency.

2. For exposed lumber indicated to receive a stained or natural finish, mark grade stamp on end or back of each piece.
3. Provide dressed lumber, S4S, unless otherwise indicated.

2.2 WOOD-PRESERVATIVE-TREATED LUMBER

- A. Preservative Treatment by Pressure Process: AWPAC2, except that lumber that is not in contact with the ground and is continuously protected from liquid water may be treated according to AWPAC31 with inorganic boron (SBX)..
 1. Preservative Chemicals: Acceptable to authorities having jurisdiction and containing no arsenic or chromium.
- B. Kiln-dry lumber after treatment to a maximum moisture content of 19 percent.
- C. Mark lumber with treatment quality mark of an inspection agency approved by the ALSC Board of Review.
- D. Application: Treat items indicated on Drawings, and the following:
 1. Wood cants, nailers, curbs, equipment support bases, blocking, stripping, and similar members in connection with roofing, flashing, vapor barriers, and waterproofing.
 2. Wood sills, sleepers, blocking, furring, stripping, and similar concealed members in contact with masonry or concrete.
 3. Wood framing and furring attached directly to the interior of below-grade exterior masonry or concrete walls.
 4. Wood framing members that are less than 18 inches above the ground in crawlspaces or unexcavated areas.
 5. Wood floor plates that are installed over concrete slabs-on-grade.

2.3 FIRE-RETARDANT-TREATED MATERIALS

- A. General: Comply with performance requirements in AWPAC20 (lumber) and AWPAC27 (plywood).
 1. Use Exterior type for exterior locations and where indicated.
 2. Use Interior Type A, High Temperature (HT) for enclosed roof framing, framing in attic spaces, and where indicated.
 3. Use Interior Type A, unless otherwise indicated.
- B. Identify fire-retardant-treated wood with appropriate classification marking of testing and inspecting agency acceptable to authorities having jurisdiction.
- C. Application: Treat items indicated on Drawings, and the following:
 1. Concealed blocking.
 2. Plywood backing panels.

2.4 DIMENSION LUMBER FRAMING

- A. Maximum Moisture Content: 19 percent.
- B. Non-Load-Bearing Interior Partitions: Construction or No. 2 grade of any species.
- C. Framing Other Than Non-Load-Bearing Interior Partitions: Construction or No. 2 grade and the following species:
 - 1. Southern pine; SPIB.
- D. Framing Other Than Non-Load-Bearing Interior Partitions: Any species and grade with a modulus of elasticity of at least 1,500,000 psi and an extreme fiber stress in bending of at least 1000 psi for 2-inch nominal thickness and 12-inch nominal width for single-member use.
- E. Exposed Interior Framing Indicated to Receive a Stained or Natural Finish: Provide material hand-selected for uniformity of appearance and freedom from characteristics, on exposed surfaces and edges, that would impair finish appearance, including decay, honeycomb, knot-holes, shake, splits, torn grain, and wane.
 - 1. Species and Grade: As indicated above for load-bearing construction of same type.

2.5 MISCELLANEOUS LUMBER

- A. General: Provide miscellaneous lumber indicated and lumber for support or attachment of other construction, including the following:
 - 1. Blocking.
 - 2. Nailers.
 - 3. Rooftop equipment bases and support curbs.
 - 4. Cants.
 - 5. Furring.
 - 6. Grounds.
- B. For items of dimension lumber size, provide Construction or No. 2 grade lumber with 19 percent maximum moisture content of any species.
- C. For concealed boards, provide lumber with 15 percent maximum moisture content and any of the following species and grades:
 - 1. Mixed southern pine, No. 2 grade; SPIB.
 - 2. Eastern softwoods, No. 2 Common grade; NeLMA.
 - 3. Northern species, No. 2 Common grade; NLGA.
 - 4. Western woods, Construction or No. 2 Common grade; WCLIB or WWPA.

2.6 PLYWOOD BACKING PANELS

- A. Telephone and Electrical Equipment Backing Panels: DOC PS 1, Exposure 1, C-D Plugged, fire-retardant treated, in thickness indicated or, if not indicated, not less than 1/2-inch nominal thickness.

2.7 FASTENERS

- A. General: Provide fasteners of size and type indicated that comply with requirements specified.
 - 1. Where rough carpentry is exposed to weather, in ground contact, pressure-preservative treated, or in area of high relative humidity, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M.
- B. Power-Driven Fasteners: NES NER-272.
- C. Bolts: Steel bolts complying with ASTM A 307, Grade A; with ASTM A 563 hex nuts and, where indicated, flat washers.

2.8 METAL FRAMING ANCHORS

- A. Allowable Design Loads: Provide products with allowable design loads, as published by manufacturer, that meet or exceed those indicated. Manufacturer's published values shall be determined from empirical data or by rational engineering analysis and demonstrated by comprehensive testing performed by a qualified independent testing agency.
- B. Galvanized Steel Sheet: Hot-dip, zinc-coated steel sheet complying with ASTM A 653/A 653M, G60 coating designation.

2.9 MISCELLANEOUS MATERIALS

- A. Sill-Sealer Gaskets: Glass-fiber-resilient insulation, fabricated in strip form, for use as a sill sealer; 1-inch nominal thickness, compressible to 1/32 inch; selected from manufacturer's standard widths to suit width of sill members indicated.

PART 3 - EXECUTION**3.1 INSTALLATION**

- A. Set rough carpentry to required levels and lines, with members plumb, true to line, cut, and fitted. Fit rough carpentry to other construction; scribe and cope as needed for accurate fit. Locate furring, nailers, blocking, grounds, and similar supports to comply with requirements for attaching other construction.
- B. Framing Standard: Comply with AF&PA's "Details for Conventional Wood Frame Construction," unless otherwise indicated.

- C. Metal Framing Anchors: Install metal framing to comply with manufacturer's written instructions.
- D. Do not splice structural members between supports, unless otherwise indicated.
- E. Comply with AWP A M4 for applying field treatment to cut surfaces of preservative-treated lumber.
- F. Securely attach rough carpentry work to substrate by anchoring and fastening as indicated, complying with the following:
 - 1. NES NER-272 for power-driven fasteners.
 - 2. Table 2304.9.1, "Fastening Schedule," in ICC's International Building Code.

3.2 PROTECTION

- A. Protect wood that has been treated with inorganic boron (SBX) from weather. If, despite protection, inorganic boron-treated wood becomes wet, apply EPA-registered borate treatment. Apply borate solution by spraying to comply with EPA-registered label.

END OF SECTION 06100

SECTION 06160 - SHEATHING AND COMPOSITE DECKING

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Wall sheathing.
2. Building wrap.
3. Roof sheathing.
4. Composite decking.

1.2 SUBMITTALS

A. Product Data: For each type of process and factory-fabricated product. Indicate component materials and dimensions and include construction and application details.

1. Include data for wood-preservative treatment and fire-retardant treatment from chemical treatment manufacturer and certification by treating plant that treated plywood complies with requirements.

1.3 QUALITY ASSURANCE

A. Fire-Test-Response Characteristics: For assemblies with fire-resistance ratings, provide materials and construction identical to those of assemblies tested for fire resistance per ASTM E 119 by a testing and inspecting agency acceptable to authorities having jurisdiction.

1.4 DELIVERY, STORAGE, AND HANDLING

A. Stack plywood and other panels flat with spacers between each bundle to provide air circulation. Provide for air circulation around stacks and under coverings.

PART 2 - PRODUCTS

2.1 WOOD PANEL PRODUCTS, GENERAL

A. Plywood: DOC PS 1.

2.2 PRESERVATIVE-TREATED PLYWOOD

A. Preservative Treatment by Pressure Process: AWPAC9.

- B. Mark plywood with appropriate classification marking of an inspection agency acceptable to authorities having jurisdiction.
- C. Application: Treat items indicated on Drawings and plywood in contact with masonry or concrete or used with roofing, flashing, vapor barriers, and waterproofing.

2.3 FIRE-RETARDANT-TREATED PLYWOOD

- A. General: Comply with performance requirements in AWPAC 27.
 - 1. Use Exterior type for exterior locations and where indicated.
 - 2. Use Interior Type A, High Temperature (HT) for roof sheathing and where indicated.
 - 3. Use Interior Type A, unless otherwise indicated.
- B. Kiln-dry material after treatment to a maximum moisture content of 15 percent.
- C. Identify fire-retardant-treated plywood with appropriate classification marking of UL, U.S. Testing, Timber Products Inspection, or another testing and inspecting agency acceptable to authorities having jurisdiction.
- D. Application: Treat plywood indicated on Drawings.

2.4 WALL SHEATHING

- A. Plywood Wall Sheathing: Exterior, Structural I sheathing.
- B. Glass-Mat Gypsum Wall Sheathing: ASTM C 1177/1177M.
 - 1. Type and Thickness: Type X, 5/8 inch thick.
- C. Extruded-Polystyrene-Foam Wall Sheathing: ASTM C 578, Type IV, with tongue-and-groove or shiplap long edges as standard with manufacturer.
 - 1. Thickness: As indicated.

2.5 ROOF SHEATHING

- A. Plywood Roof Sheathing: Exterior, Structural I sheathing.

2.6 FASTENERS

- A. General: Provide fasteners of size and type indicated.
 - 1. For wall and roof sheathing panels, provide fasteners with corrosion-protective coating having a salt-spray resistance of more than 800 hours according to ASTM B 117.

2.7 WEATHER-RESISTANT SHEATHING PAPER

- A. Building Wrap: ASTM E 1677, Type I air retarder; with flame-spread and smoke-developed indexes of less than 25 and 450, respectively, when tested according to ASTM E 84; UV stabilized; and acceptable to authorities having jurisdiction.
 - 1. Water-Vapor Permeance: Not less than 535 g through 1 sq. m of surface in 24 hours per ASTM E 96, Desiccant Method (Procedure A).
- B. Building-Wrap Tape: Tape recommended by building-wrap manufacturer.

2.8 SHEATHING JOINT-AND-PENETRATION TREATMENT MATERIALS

- A. Sealant Glass-Mat Gypsum Sheathing Board: Elastomeric silicone joint sealant recommended by sheathing manufacturer.
- B. Sheathing Tape for Glass-Mat Gypsum Sheathing Board: Self-adhering glass-fiber tape, of type recommended by sheathing and tape manufacturers.
- C. Sheathing Tape for Foam-Plastic Sheathing: Tape recommended by sheathing manufacturer.

2.9 MISCELLANEOUS MATERIALS

- A. Adhesives for Field Gluing Panels to Framing: Formulation complying with APA AFG-01 that is approved for use indicated by manufacturers of both adhesives and panels.
- B. Flexible Flashing: Self-adhesive, rubberized-asphalt compound, bonded to a high-density, polyethylene film to produce an overall thickness of not less than 0.025 inch.

2.10 COMPOSITE DECKING Any proposed substitutions of the product listed below are to be submitted prior to bid and must be approved by owner prior to bid.

- A. Decking made from high density polyethylene (HDPE) and wood flour, extruded into sizes indicated.
- B. Manufacturer: Timber Tech Limited.
- C. Size: 1" x 5 7/16" x lengths of 12, 16, or 20 feet.
- D. Color: Earthwood Evolutions Terrain – silver maple.
- E. Fasteners: Timber Tech CONCEALoc hidden fastener with TimberTech Cortex Hidden Fastening System

PART 3 - EXECUTION**3.1 INSTALLATION, GENERAL**

- A. Securely attach to substrate by fastening as indicated, complying with the following:

1. NES NER-272 for power-driven fasteners.
2. Table 2304.9.1, "Fastening Schedule," in ICC's "International Building Code."

- B. Coordinate sheathing installation with flashing and joint-sealant installation so these materials are installed in sequence and manner that exclude exterior moisture.
- C. Do not bridge building expansion joints; cut and space edges of panels to match spacing of structural support elements.

3.2 WOOD STRUCTURAL PANEL INSTALLATION

- A. General: Comply with applicable recommendations in APA Form No. E30K, "APA Design/Construction Guide: Residential & Commercial."
 1. Comply with "Code Plus" installation provisions in guide referenced in paragraph above.
- B. Fastening Methods: Fasten panels as indicated below:
 1. Wall and Roof Sheathing:
 - a. Nail to wood framing
 - b. Screw to cold-formed metal framing.

3.3 GYPSUM SHEATHING INSTALLATION

- A. Comply with GA-253 and with manufacturer's written instructions.
 1. Fasten gypsum sheathing to wood framing with screws.
 2. Fasten gypsum sheathing to cold-formed metal framing with screws.
 3. Install boards with a 3/8-inch gap where non-load-bearing construction abuts structural elements.
 4. Install boards with a 1/4-inch gap where they abut masonry or similar materials.

3.4 FOAM-PLASTIC SHEATHING INSTALLATION

- A. Comply with manufacturer's written instructions.
- B. Foam-Plastic Wall Sheathing: Install vapor-relief strips or equivalent for permitting escape of moisture vapor that otherwise would be trapped in stud cavity behind sheathing.

3.5 WEATHER-RESISTANT SHEATHING-PAPER INSTALLATION

- A. General: Cover sheathing with weather-resistant sheathing paper as follows:
 1. Cut back barrier 1/2 inch on each side of the break in supporting members at expansion- or control-joint locations.
 2. Apply barrier to cover vertical flashing with a minimum 4-inch overlap, unless otherwise indicated.

B. Building Wrap: Comply with manufacturer's written instructions.

1. Seal seams, edges, fasteners, and penetrations with tape.
2. Extend into jambs of openings and seal corners with tape.

3.6 SHEATHING JOINT-AND-PENETRATION TREATMENT

A. Seal sheathing joints according to sheathing manufacturer's written instructions.

1. Apply elastomeric sealant to joints and fasteners and trowel flat. Seal other penetrations and openings.
2. Apply glass-fiber sheathing tape to glass-mat gypsum sheathing board joints, and apply and trowel silicone emulsion sealant to embed tape in sealant. Apply sealant to exposed fasteners. Seal other penetrations and openings.
3. Apply sheathing tape to joints between foam-plastic sheathing panels and at items penetrating sheathing. Apply at upstanding flashing to overlap both flashing and sheathing.

3.7 FLEXIBLE FLASHING INSTALLATION

A. Apply flexible flashing where indicated to comply with manufacturers written instructions.

1. Lap seams and junctures with other materials at least 4 inches, except that at flashing flanges of other construction, laps need not exceed flange width.
2. Lap flashing over weather-resistant building paper at bottom and sides of openings.
3. Lap weather-resistant building paper over flashing at heads of openings.
4. After flashing has been applied, roll surfaces with a hard rubber or metal roller.

3.8 PROTECTION

- A. Paper-Surfaced Gypsum Sheathing: Protect sheathing by covering exposed exterior surface of sheathing with weather-resistant sheathing paper securely fastened to framing. Apply covering immediately after sheathing is installed.

END OF SECTION 06160

SECTION 06402 - INTERIOR ARCHITECTURAL WOODWORK

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Interior standing and running trim.
 - 2. Plastic-laminate cabinets.
 - 3. Plastic-laminate countertops.
 - 4. Solid-surfacing-material countertops.
- B. Interior architectural woodwork includes wood furring, blocking, shims, and hanging strips unless concealed within other construction before woodwork installation.

1.2 SUBMITTALS

- A. Product Data: For solid-surfacing material, cabinet hardware and accessories, and finishing materials and processes.
- B. Shop Drawings: Show location of each item, dimensioned plans and elevations, large-scale details, attachment devices, and other components.
- C. Samples:
 - 1. Lumber and panel products for transparent finish, for each species and cut, finished on one side and one edge.
 - 2. Plastic-laminates, for each type, color, pattern, and surface finish.
 - 3. Thermoset decorative panels, for each type, color, pattern, and surface finish.
 - 4. Solid-surfacing materials.
- D. Woodwork Quality Standard Compliance Certificates: AWI Quality Certification Program certificates.

1.3 QUALITY ASSURANCE

- A. Installer Qualifications: Fabricator of woodwork.
- B. Quality Standard: Unless otherwise indicated, comply with AWI's "Architectural Woodwork Quality Standards."
 - 1. Provide AWI Quality Certification Program labels and certificates for woodwork, including installation.

1.4 PROJECT CONDITIONS

- A. Environmental Limitations: Do not deliver or install woodwork until building is enclosed, wet work is complete, and HVAC system is operating and maintaining temperature and relative humidity at occupancy levels during the remainder of the construction period.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Wood Species and Cut for Transparent Finish: Maple, plain sawn or sliced.
- B. Wood Species for Opaque Finish: Eastern white pine, sugar pine, or western white pine.
- C. Wood Products:
 - 1. Hardboard: AHA A135.4.
 - 2. Medium-Density Fiberboard: ANSI A208.2, Grade MD, made with binder containing no urea formaldehyde.
 - 3. Particleboard: ANSI A208.1, Grade M-2-Exterior Glue.
 - 4. Softwood Plywood: DOC PS 1, Medium Density Overlay.
- D. Thermoset Decorative Panels: Particleboard or medium-density fiberboard finished with thermally fused, melamine-impregnated decorative paper complying with LMA SAT-1.
- E. High-Pressure Decorative Laminate: NEMA LD 3, grades as indicated or, if not indicated, as required by woodwork quality standard.
- F. Solid-Surfacing Material: Homogeneous solid sheets of filled plastic resin complying with ISSFA-2.

2.2 FIRE-RETARDANT-TREATED MATERIALS

- A. Fire-Retardant-Treated Lumber and Plywood by Pressure Process: Comply with performance requirements of AWPAC20 (lumber) and AWPAC27 (plywood). Use Exterior Type or Interior Type A. Use fire-retardant-treatment formulations that do not bleed through or otherwise adversely affect finishes. Kiln-dry material after treatment.
- B. Fire-Retardant Particleboard: Panels made from softwood particles and fire-retardant chemicals mixed together at time of panel manufacture with flame-spread index of 25 or less and smoke-developed index of 25 or less per ASTM E 84.
- C. Fire-Retardant Fiberboard: ANSI A208.2 medium-density fiberboard panels made from softwood fibers, synthetic resins, and fire-retardant chemicals mixed together at time of panel manufacture with flame-spread index of 25 or less and smoke-developed index of 200 or less per ASTM E 84.

2.3 CABINET HARDWARE AND ACCESSORIES

- A. General: Provide cabinet hardware and accessory materials associated with architectural woodwork, except for items specified in Division 8 Section "Door Hardware (Scheduled by Describing Products)."
- B. Frameless Concealed Hinges (European Type): BHMA A156.9, B01602, 135 degrees of opening, self-closing.
- C. Wire Pulls: Back mounted, solid metal, 4 inches long, 5/16 inch in diameter.
- D. Catches: Ball friction catches, BHMA A156.9, B03013.
- E. Drawer Slides: BHMA A156.9, B05091.
 - 1. Heavy Duty (Grade 1HD-100 and Grade 1HD-200): Side mounted; full-overtravel-extension type; zinc-plated steel ball-bearing slides.
 - 2. Box Drawer Slides: Grade 1HD-100; for drawers not more than 6 inches high and 24 inches wide.
 - 3. File Drawer Slides: Grade 1HD-100; for drawers more than 6 inches high or 24 inches wide.
- F. Door Locks: BHMA A156.11, E07121.
- G. Drawer Locks: BHMA A156.11, E07041.
- H. Exposed Hardware Finishes: For exposed hardware, provide finish that complies with BHMA A156.18 for BHMA finish number indicated.
 - 1. Satin Stainless Steel: BHMA 630.

2.4 MISCELLANEOUS MATERIALS

- A. Furring, Blocking, Shims, and Hanging Strips: Softwood or hardwood lumber, fire-retardant-treated, kiln-dried to less than 15 percent moisture content.
 - 1. Extreme Fiber Stress in Bending, Edgewise: 2500 psi for 12-inch nominal depth members.
 - 2. Modulus of Elasticity, Edgewise: 1,800,000 psi .
- B. Adhesives, General: Do not use adhesives that contain urea formaldehyde.
- C. Fiberglass reinforced panels (FRP): .090" thick panels with extruded PVC thru-color trim.

2.5 FABRICATION

- A. General: Complete fabrication to maximum extent possible before shipment to Project site. Where necessary for fitting at site, provide allowance for scribing, trimming, and fitting.
 - 1. Interior Woodwork Grade: Premium.

2. Shop cut openings to maximum extent possible. Sand edges of cutouts to remove splinters and burrs. Seal edges of openings in countertops with a coat of varnish.
- B. Interior Standing and Running Trim:
1. For transparent-finished trim items wider than available lumber, use veneered construction. Do not glue for width.
 2. Backout or groove backs of flat trim members and kerf backs of other wide, flat members, except for members with ends exposed in finished work.
 3. Assemble casings in plant except where limitations of access to place of installation require field assembly.
- C. Plastic-Laminate Cabinets:
1. AWI Type of Cabinet Construction: Flush overlay.
 2. Laminate Cladding for Exposed Surfaces: High-pressure decorative laminate as follows:
 - a. Horizontal Surfaces Other Than Tops: Grade HGS.
 - b. Vertical Surfaces: Grade HGS.
 - c. Edges: Grade HGS.
 3. Materials for Semiexposed Surfaces Other Than Drawer Bodies: Thermoset decorative panels.
 4. Drawer Sides and Backs: Thermoset decorative panels.
 5. Drawer Bottoms: Hardwood plywood.
 6. Colors, Patterns, and Finishes: As selected by Architect from laminate manufacturer's full range of solid colors, matte finish.
- D. Plastic-Laminate Countertops:
1. High-Pressure Decorative Laminate Grade: HGS.
 2. Colors, Patterns, and Finishes: As selected by Architect from laminate manufacturer's full range of solid colors, matte finish.
 3. Edge Treatment: Same as laminate cladding on horizontal surfaces.
 4. Core Material at Sinks: exterior-grade plywood.
- E. Solid-Surfacing-Material Countertops:
1. Solid-Surfacing-Material Thickness: 1/2 inch.
 2. Colors, Patterns, and Finishes: As selected from manufacturer's full range.
 3. Fabricate tops in one piece with loose backsplashes for field application. Comply with solid-surfacing-material manufacturer's written recommendations for adhesives, sealers, fabrication, and finishing.
 4. Install integral sink bowls in countertops in shop.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Before installation, condition woodwork to average prevailing humidity conditions in installation areas. Examine shop-fabricated work for completion and complete work as required, including removal of packing and backpriming.
- B. Grade: Install woodwork to comply with requirements for the same grade specified in Part 2 for fabrication of type of woodwork involved.
- C. Install woodwork level, plumb, true, and straight to a tolerance of 1/8 inch in 96 inches. Shim as required with concealed shims.
- D. Scribe and cut woodwork to fit adjoining work, refinish cut surfaces, and repair damaged finish at cuts.
- E. Anchor woodwork to anchors or blocking built in or directly attached to substrates. Secure with countersunk, concealed fasteners and blind nailing as required for complete installation. Use fine finishing nails or finishing screws for exposed fastening, countersunk and filled flush with woodwork and matching final finish if transparent finish is indicated.
- F. Standing and Running Trim: Install with minimum number of joints possible, using full-length pieces (from maximum length of lumber available) to greatest extent possible. Scarf running joints and stagger in adjacent and related members. Fill gaps, if any, between top of base and wall with plastic wood filler, sand smooth, and finish same as wood base if finished.
- G. Cabinets: Install without distortion so doors and drawers fit openings properly and are accurately aligned. Adjust hardware to center doors and drawers in openings and to provide unencumbered operation.
 - 1. Fasten wall cabinets through back, near top and bottom, at ends and not more than 16 inches o.c..
- H. Countertops: Anchor securely by screwing through corner blocks of base cabinets or other supports into underside of countertop. Calk space between backsplash and wall with sealant specified in Division 7 Section "Joint Sealants."

END OF SECTION 06402

SECTION 07115 - BITUMINOUS DAMPPROOFING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Cold-applied, cut-back asphalt dampproofing.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.

1.3 PROJECT CONDITIONS

- A. Ventilation: Provide adequate ventilation during application of dampproofing in enclosed spaces. Maintain ventilation until dampproofing has cured.

PART 2 - PRODUCTS

2.1 COLD-APPLIED, CUT-BACK ASPHALT DAMPPROOFING

- A. Trowel Coats: ASTM D 4586, Type I, Class 1, fibered.
- B. Brush and Spray Coats: ASTM D 4479, Type I, fibered.
- C. VOC Content: 250 g/L or less.

2.2 COLD-APPLIED, EMULSIFIED-ASPHALT DAMPPROOFING

- A. Trowel Coats: ASTM D 1227, Type II, Class 1.
- B. Fibered Brush and Spray Coats: ASTM D 1227, Type II, Class 1.
- C. Brush and Spray Coats: ASTM D 1227, Type III, Class 1.
- D. VOC Content: 0.25 lb/gal. or less.

2.3 PROTECTION COURSE

- A. Protection Course, Asphalt-Board Type: ASTM D 6506, premolded, 1/8-inch- (3-mm-) thick, multi-ply, semirigid board consisting of a mineral-stabilized asphalt core sandwiched between layers of asphalt-saturated felt, and faced on 1 side with polyethylene film.

2.4 MISCELLANEOUS MATERIALS

- A. Cut-Back Asphalt Primer: ASTM D 41.
- B. Emulsified-Asphalt Primer: ASTM D 1227, Type III, Class 1, except diluted with water as recommended by manufacturer.
- C. Asphalt-Coated Glass Fabric: ASTM D 1668, Type I.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Clean substrates of projections and substances detrimental to work; fill voids, seal joints, and apply bond breakers if any, as recommended by prime material manufacturer.

3.2 APPLICATION, GENERAL

- A. Comply with manufacturer's written recommendations unless more stringent requirements are indicated or required by Project conditions to ensure satisfactory performance of dampproofing.
- B. Apply dampproofing to footings and foundation walls where opposite side of wall faces building interior.
 - 1. Apply from finished-grade line to top of footing, extend over top of footing, and down a minimum of 6 inches over outside face of footing.
 - 2. Extend 12 inches onto intersecting walls and footings, but do not extend onto surfaces exposed to view when Project is completed.
 - 3. Install flashings and corner protection stripping at internal and external corners, changes in plane, construction joints, cracks, and where shown as "reinforced," by embedding an 8-inch wide strip of asphalt-coated glass fabric in a heavy coat of dampproofing. Dampproofing coat for embedding fabric is in addition to other coats required.
- C. Apply dampproofing to provide continuous plane of protection on interior face of above-grade, exterior concrete, and, masonry walls unless walls are indicated to receive direct application of paint.

3.3 COLD-APPLIED, CUT-BACK ASPHALT DAMPPROOFING

- A. On Concrete Foundations and Parged Masonry Foundation Walls: Apply 2 brush or spray coats at not less than 1.25 gal./100 sq. ft. for first coat and 1 gal./100 sq. ft. for second coat, or 1 trowel coat at not less than 4 gal./100 sq. ft.
- B. On Unparged Masonry Foundation Walls: Apply primer and 1 trowel coat at not less than 4 gal./100 sq. ft.
- C. On Unexposed Face of Concrete Retaining Walls: Apply 1 brush or spray coat at not less than 1.25 gal./100 sq. ft.
- D. On Unexposed Face of Masonry Retaining Walls: Apply primer and 1 brush or spray coat at not less than 1.25 gal./100 sq. ft.
- E. On Exterior Face of Inner Wythe of Cavity Walls: Apply primer and 1 brush or spray coat at not less than 1 gal./100 sq. ft.

3.4 INSTALLATION OF PROTECTION COURSE

- A. Where indicated, install protection course over completed-and-cured dampproofing. Comply with dampproofing material manufacturer's written recommendations for attaching protection course.
 - 1. Support protection course with spot application of adhesive of type recommended by protection board manufacturer over cured coating.
 - 2. Install protection course within 24 hours of installation of dampproofing (while coating is tacky) to ensure adhesion.

END OF SECTION 07115

SECTION 07210 - BUILDING INSULATION

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Perimeter insulation under slabs-on-grade.
 - 2. Batt insulation.
 - 3. Vapor retarders.
 - 4. Sound attenuation insulation.

1.2 PERFORMANCE REQUIREMENTS

- A. Plenum Rating: Provide glass-fiber insulation where indicated in ceiling plenums whose test performance is rated as follows for use in plenums as determined by testing identical products per "Erosion Test" and "Mold Growth and Humidity Test" described in UL 181, or on comparable tests from another standard acceptable to authorities having jurisdiction.
 - 1. Erosion Test Results: Insulation shows no visible evidence of cracking, flaking, peeling, or delamination of interior surface of duct assembly, after testing for 4 hours at 2500-fpm air velocity.
 - 2. Mold Growth and Humidity Test Results: Insulation shows no evidence of mold growth, delamination, or other deterioration due to the effects of high humidity, after inoculation with *Chaetomium globosum* on all surfaces and storing for 60 days at 100 percent relative humidity in the dark.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples for Verification: Full-size units for each type of exposed insulation indicated.
- C. Product test reports.
- D. Research/Evaluation Reports: For foam-plastic insulation.

1.4 QUALITY ASSURANCE

- A. Retain ASTM test method below based on product and kind of fire-resistance characteristic specified for each product in Part 2. Fire-Test-Response Characteristics: Provide insulation and related materials with the fire-test-response characteristics indicated, as determined by testing identical products per ASTM E 84 for surface-burning characteristics] [and] [other methods indicated with product, by UL or another testing and inspecting agency acceptable to authorities

having jurisdiction. Identify materials with appropriate markings of applicable testing and inspecting agency.

PART 2 - PRODUCTS

2.1 FOAM-PLASTIC BOARD INSULATION

- A. Extruded-Polystyrene Board Insulation: ASTM C 578, Type IV, 1.60 lb/cu. ft. with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively:

2.2 GLASS-FIBER BLANKET INSULATION

- A. Unfaced, Glass-Fiber Blanket Insulation: ASTM C 665, Type I (blankets without membrane facing); consisting of fibers; with maximum flame-spread and smoke-developed indexes of 25 and 50, respectively; passing ASTM E 136 for combustion characteristics.
- B. Where glass-fiber blanket insulation is indicated by the following thicknesses, provide blankets in batt or roll form with thermal resistances indicated:
 - 1. 5-1/2 inches thick with a thermal resistance of 19 deg F x h x sq. ft./Btu at 75 deg F.

C. VAPOR RETARDERS

- C. Reinforced-Polyethylene Vapor Retarders: 2 outer layers of polyethylene film laminated to an inner reinforcing layer consisting of either nylon cord or polyester scrim and weighing not less than 25 lb/1000 sq. ft., with maximum permeance rating of 0.0507 perm.
- D. Vapor-Retarder Tape: Pressure-sensitive tape of type recommended by vapor-retarder manufacturer for sealing joints and penetrations in vapor retarder.
- E. Vapor-Retarder Fasteners: Pancake-head, self-tapping steel drill screws; with fender washers.
- F. Single-Component Nonsag Urethane Sealant: ASTM C 920, Type I, Grade NS, Class 25, Use NT related to exposure, and Use O related to vapor-barrier-related substrates.
- G. Adhesive for Vapor Retarders: Product recommended by vapor-retarder manufacturer and with demonstrated capability to bond vapor retarders securely to substrates indicated.

2.3 INSULATION FASTENERS

- A. Adhesively Attached, Spindle-Type Anchors: Plate formed from perforated galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square, welded to projecting copper-coated steel spindle 0.105 inch in diameter and of length capable of holding insulation of thickness indicated securely in position with 1-1/2-inch square or diameter self-locking washers complying with the following requirements:
 - 1. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch thick galvanized steel sheet, with beveled edge for increased stiffness.

- B. Anchor Adhesive: Product with demonstrated capability to bond insulation anchors securely to substrates indicated without damaging insulation, fasteners, and substrates.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Comply with insulation manufacturer's written instructions applicable to products and application indicated.
- B. Install insulation that is undamaged, dry, and unsoiled and that has not been left exposed at any time to ice, rain, and snow.
- C. Extend insulation in thickness indicated to envelop entire area to be insulated. Cut and fit tightly around obstructions and fill voids with insulation. Remove projections that interfere with placement.
- D. Water-Piping Coordination: If water piping is located within insulated exterior walls, coordinate location of piping to ensure that it is placed on warm side of insulation and insulation encapsulates piping.
- E. For preformed insulating units, provide sizes to fit applications indicated and selected from manufacturer's standard thicknesses, widths, and lengths. Apply single layer of insulation units to produce thickness indicated unless multiple layers are otherwise shown or required to make up total thickness.

3.2 INSTALLATION OF PERIMETER AND UNDER-SLAB INSULATION

- A. On vertical surfaces, set insulation units in adhesive applied according to manufacturer's written instructions. Use adhesive recommended by insulation manufacturer.
 - 1. If not otherwise indicated, extend insulation a minimum of 24 inches below exterior grade line.
- B. On horizontal surfaces, loosely lay insulation units according to manufacturer's written instructions. Stagger end joints and tightly abut insulation units.
- C. Protect below-grade insulation on vertical surfaces from damage during backfilling by applying protection course with joints butted. Set in adhesive according to insulation manufacturer's written instructions.
- D. Protect top surface of horizontal insulation from damage during concrete work by applying protection course with joints butted.

3.3 INSTALLATION OF GENERAL BUILDING INSULATION

- A. Apply insulation units to substrates by method indicated, complying with manufacturer's written instructions. If no specific method is indicated, bond units to substrate with adhesive or use mechanical anchorage to provide permanent placement and support of units.
- B. Seal joints between foam-plastic insulation units by applying adhesive, mastic, or sealant to edges of each unit to form a tight seal as units are shoved into place. Fill voids in completed installation with adhesive, mastic, or sealant as recommended by insulation manufacturer.
- C. Set vapor-retarder-faced units with vapor retarder to warm-in-winter side of construction, unless otherwise indicated.
 - 1. Tape joints and ruptures in vapor retarder, and seal each continuous area of insulation to surrounding construction to ensure airtight installation.
- D. Install mineral-fiber insulation in cavities formed by framing members according to the following requirements:
 - 1. Use insulation widths and lengths that fill the cavities formed by framing members. If more than one length is required to fill cavity, provide lengths that will produce a snug fit between ends.
 - 2. Place insulation in cavities formed by framing members to produce a friction fit between edges of insulation and adjoining framing members.
 - 3. Maintain 3-inch clearance of insulation around recessed lighting fixtures.
 - 4. For metal-framed wall cavities where cavity heights exceed 96 inches, support unfaced blankets mechanically and support faced blankets by taping flanges of insulation to flanges of metal studs.

3.4 INSTALLATION OF VAPOR RETARDERS

- A. General: Extend vapor retarder to extremities of areas to be protected from vapor transmission. Secure in place with adhesives or other anchorage system as indicated. Extend vapor retarder to cover miscellaneous voids in insulated substrates, including those filled with loose-fiber insulation.
- B. Seal vertical joints in vapor retarders over framing by lapping not less than two wall studs. Fasten vapor retarders to wood framing at top, end, and bottom edges; at perimeter of wall openings; and at lap joints. Space fasteners 16 inches o.c.
- C. Before installing vapor retarder, apply urethane sealant to flanges of metal framing including runner tracks, metal studs, and framing around door and window openings. Seal overlapping joints in vapor retarders with vapor-retarder tape according to vapor-retarder manufacturer's written instructions. Seal butt joints with vapor-retarder tape. Locate all joints over framing members or other solid substrates.
- D. Firmly attach vapor retarders to metal framing and solid substrates with vapor-retarder fasteners as recommended by vapor-retarder manufacturer.

- E. Seal joints caused by pipes, conduits, electrical boxes, and similar items penetrating vapor retarders with vapor-retarder tape to create an airtight seal between penetrating objects and vapor retarder.
- F. Repair tears or punctures in vapor retarders immediately before concealment by other work. Cover with vapor-retarder tape or another layer of vapor retarder.

END OF SECTION 07210

SECTION 07610 - SHEET METAL ROOFING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Standing-seam metal roofing, custom fabricated.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show installation layout of sheet metal roofing, including plans, elevations, expansion joint locations, and keyed details. Distinguish between shop- and field-assembled work.
 - 1. Include details for forming, joining, and securing sheet metal roofing, including pattern of seams, termination points, fixed points, expansion joints, roof penetrations, edge conditions, special conditions, connections to adjoining work, and details of accessory items.
- C. Samples: For each exposed product and for each finish specified.
- D. Coordination Drawings: Roof plans drawn to scale with coordinated details for penetrations and roof-mounted items.
- E. Product test reports.
- F. Maintenance data.
- G. Warranties: Sample of special warranties.

1.3 QUALITY ASSURANCE

- A. Sheet Metal Roofing Standard: Comply with SMACNA's "Architectural Sheet Metal Manual" unless more stringent requirements are specified or shown on Drawings.
- B. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for fabrication and installation.
 - 1. Build mockup of typical roof area and eave, including fascia, as shown on Drawings; approximately 48 inches long, 12 feet square by full thickness, including attachments, underlayment, and accessories.
- C. Preinstallation Conference: Conduct conference at Project site.

1.4 WARRANTY

- A. Special Warranty: Warranty form in which Installer agrees to repair or replace components of sheet metal roofing that fail in materials or workmanship within Two years from date of Substantial Completion.
- B. Special Warranty on Finishes: Manufacturer's standard form in which manufacturer agrees to repair finish or replace sheet metal roofing that shows evidence of deterioration of factory-applied finishes within 20 years from date of Substantial Completion.

PART 2 - PRODUCTS**2.1 ROOFING SHEET METALS**

- A. General: Protect mechanical and other finishes on exposed surfaces from damage by applying a strippable, temporary protective film before shipping.
- B. Metallic-Coated Steel Sheet: Restricted flatness steel sheet, metallic coated by the hot-dip process and prepainted by the coil-coating process to comply with ASTM A 755/A 755M.
 - 1. Aluminum-Zinc Alloy-Coated Steel Sheet: ASTM A 792/A 792M, Class AZ50 coating designation, Grade 40; structural quality.
 - 2. Thickness: Nominal 0.028 inch unless otherwise indicated.
 - 3. Surface: Smooth, flat.
 - 4. All steel on this project must be made in the United States of America as per Federal Highway Administration (FHWA) regulations.

2.2 UNDERLAYMENT MATERIALS

- A. Polyethylene Sheet: 6-mil thick polyethylene sheet complying with ASTM D 4397.
- B. Felts: ASTM D 226, Type II (No. 30), asphalt-saturated organic felts.
- C. Self-Adhering, High-Temperature Sheet: Minimum 30 to 40 mils thick, consisting of slip-resisting polyethylene-film top surface laminated to layer of butyl or SBS-modified asphalt adhesive, with release-paper backing; cold applied. Provide primer when recommended by underlayment manufacturer.
 - 1. Thermal Stability: ASTM D 1970; stable after testing at 240 deg F.
 - 2. Low-Temperature Flexibility: ASTM D 1970; passes after testing at minus 20 deg F.
- D. Slip Sheet: Building paper, 3-lb/100 sq. ft. minimum, rosin sized.

2.3 MISCELLANEOUS MATERIALS

- A. General: Provide materials and types of fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required for a complete roofing system and as recommended by primary sheet metal manufacturer unless otherwise indicated.

- B. Fasteners: Wood screws, annular-threaded nails, self-tapping screws, self-locking rivets and bolts, and other suitable fasteners designed to withstand design loads.
 - 1. General:
 - a. Fasteners for Flashing and Trim: Blind fasteners or self-drilling screws, gasketed, with hex-washer head.
 - b. Blind Fasteners: High-strength aluminum or stainless-steel rivets suitable for metal being fastened.
 - 2. Fasteners for Aluminum-Zinc Alloy-Coated Steel Sheet: Hot-dip galvanized steel according to ASTM A 153/A 153M, ASTM F 2329, or Series 300 stainless steel.
- C. Sealant Tape: Pressure-sensitive, 100 percent solids, gray polyisobutylene compound sealant tape with release-paper backing. Provide permanently elastic, nonsag, nontoxic, nonstaining tape 1/2 inch wide and 1/8 inch thick.
- D. Elastomeric Sealant: ASTM C 920, elastomeric polymer sealant: low modulus; of type, grade, class, and use classifications required to seal joints in sheet metal roofing and remain watertight.
- E. Bituminous Coating: Cold-applied asphalt emulsion complying with ASTM D 1187.

2.4 ACCESSORIES

- A. Sheet Metal Accessories: Provide components required for a complete sheet metal roofing assembly including trim, copings, fasciae, corner units, clips, flashings, sealants, gaskets, fillers, metal closures, closure strips, and similar items. Match material and finish of sheet metal roofing unless otherwise indicated.
 - 1. Cleats: For mechanically seaming into joints and formed from the following materials:
 - a. Metallic-Coated Steel Roofing: 0.025-inch thick stainless steel.
 - 2. Clips: Minimum 0.062-inch thick, stainless-steel panel clips designed to withstand negative-load requirements.
 - 3. Closure Strips: Closed-cell, expanded, cellular, rubber or crosslinked, polyolefin foam or closed-cell laminated polyethylene; minimum 1-inch thick, flexible-closure strips; cut or premolded to match sheet metal roofing profile. Provide closure strips where indicated or necessary to ensure weathertight construction.
 - 4. Flashing and Trim: Formed from same material and finish as sheet metal roofing, minimum thickness matching the sheet metal roofing.

2.5 FABRICATION

- A. General: Custom fabricate sheet metal roofing to comply with details shown and recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to the design, dimensions (panel width and seam height), geometry, metal thickness, and other characteristics of installation indicated. Fabricate sheet metal roofing and accessories at the shop to greatest extent possible.
 - 1. Standing-Seam Roofing: Form standing-seam panels with finished seam height of 1 inch.

- B. General: Fabricate roll-formed sheet metal roofing panels with UL-certified, portable roll-forming equipment capable of producing roofing panels for sheet metal roofing assemblies that comply with UL 580 for wind-uplift resistance classification specified in "Quality Assurance" Article. Fabricate roll-formed sheet metal according to equipment manufacturer's written instructions and to comply with details shown.
- C. Form exposed sheet metal work to fit substrates without excessive oil canning, buckling, and tool marks; true to line and levels indicated; and with exposed edges folded back to form hems.
 - 1. Form and fabricate sheets, seams, strips, cleats, valleys, ridges, edge treatments, integral flashings, and other components of metal roofing to profiles, patterns, and drainage arrangements shown on Drawings and as required for leakproof construction.
- D. Metal Protection: Where dissimilar metals will contact each other, protect against galvanic action by painting contact surfaces with bituminous coating, by applying self-adhering sheet underlayment to each contact surface, or by other permanent separation as recommended by fabricator of sheet metal roofing or manufacturers of the metals in contact.
- E. Sheet Metal Accessories: Custom fabricate flashings and trim to comply with recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to design, dimensions, metal, and other characteristics of item indicated. Obtain field measurements for accurate fit before shop fabrication.

PART 3 - EXECUTION

3.1 EXAMINATION AND PREPARATION

- A. Examine solid roof sheathing to verify that sheathing joints are supported by framing or blocking and that tops of fasteners are flush with surface.

3.2 UNDERLAYMENT INSTALLATION

- A. Polyethylene Sheet: Install polyethylene sheet on roof sheathing under sheet metal roofing. Use adhesive for anchorage. Apply at locations indicated on Drawings, in shingle fashion to shed water, with lapped and taped joints of not less than 2 inches.
- B. Felt Underlayment: Install felt underlayment on roof sheathing under sheet metal roofing. Use adhesive for temporary anchorage. Apply at locations indicated on Drawings, in shingle fashion to shed water, with lapped joints of not less than 2 inches.
- C. Self-Adhering Sheet Underlayment: Install self-adhering sheet underlayment, wrinkle free, on roof sheathing under sheet metal roofing. Comply with temperature restrictions of underlayment manufacturer for installation; use primer rather than nails for installing underlayment at low temperatures. Apply over entire roof, in shingle fashion to shed water, with end laps of not less than 6 inches staggered 24 inches between courses. Overlap side edges not less than 3-1/2 inches. Roll laps with roller. Cover underlayment within 14 days.
- D. Apply slip sheet before installing sheet metal roofing.

3.3 INSTALLATION, GENERAL

- A. General: Anchor sheet metal roofing and other components of the Work securely in place, with provisions for thermal and structural movement. Install fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required for a complete roofing system and as recommended by fabricator for sheet metal roofing.
1. Field cutting of sheet metal roofing by torch is not permitted.
 2. Provide metal closures at rake edges, rake walls, eaves and each side of ridge caps.
 3. Flash and seal sheet metal roofing with closure strips at eaves, rakes, and perimeter of all openings. Fasten with self-tapping screws.
 4. Locate and space fastenings in uniform vertical and horizontal alignment. Predrill panels for fasteners.
 5. Install ridge caps as sheet metal roofing work proceeds.
 6. Locate roofing splices over, but not attached to, structural supports. Stagger roofing splices and end laps to avoid a four-panel lap splice condition.
 7. Install sealant tape where indicated.
 8. Lap metal flashing over sheet metal roofing to allow moisture to run over and off the material.
- B. Thermal Movement. Rigidly fasten metal roof panels to structure at only one location for each panel. Allow remainder of panel to move freely for thermal expansion and contraction.
1. Point of Fixity: Fasten each panel along a single line of fixing located at ridge.
 2. Avoid attaching accessories through roof panels in a manner that will inhibit thermal movement.
- C. Fasteners: Use fasteners of sizes that will penetrate metal decking not less than recommended by fastener manufacturer to achieve maximum pull-out resistance.
- D. Metal Protection: Where dissimilar metals will contact each other or corrosive substrates, protect against galvanic action by painting contact surfaces with bituminous coating, by applying self-adhering sheet underlayment to each contact surface, or by other permanent separation as recommended by SMACNA.
- E. Conceal fasteners and expansion provisions where possible in exposed work and locate to minimize possibility of leakage. Cover and seal fasteners and anchors as required for a tight installation.

3.4 CUSTOM-FABRICATED SHEET METAL ROOFING INSTALLATION

- A. Fabricate and install work with lines and corners of exposed units true and accurate. Form exposed faces flat and free of buckles, excessive waves, and avoidable tool marks, considering temper and reflectivity of metal. Provide uniform, neat seams with minimum exposure of solder, welds, and sealant. Fold back sheet metal to form a hem on concealed side of exposed edges unless otherwise indicated.
1. Install cleats to hold sheet metal panels in position. Attach each cleat with two fasteners to prevent rotation.
 2. Fasten cleats not more than 12 inches o.c. Bend tabs over fastener head.

3. Provide expansion-type cleats and clips for roof panels that exceed 30 feet in length.
- B. Seal joints as shown and as required for watertight construction. For roofing with 3:12 slopes or less, use cleats at transverse seams. Prepare joints and apply sealants to comply with requirements in Division 7 Section "Joint Sealants."
- C. Rivets: Rivet joints in uncoated aluminum where indicated and where necessary for strength.
- D. Standing-Seam Roofing: Attach standing-seam metal panels to substrate with cleats, double fastened at 12 inches o.c. Install panels reaching from eave to ridge before moving to adjacent panels. Before panels are interlocked, apply continuous bead of sealant to top of flange of lower panel. Lock standing seams by folding over twice so cleat and panel edges are completely engaged.
 1. Lock each panel to panel below with sealed transverse seam.
 2. Loose-lock panels at eave edges to continuous cleats and flanges at roof edge at gutters.
 3. Leave seams upright after locking at ridges and hips.

3.5 ACCESSORY INSTALLATION

- A. General: Install accessories with positive anchorage to building and weathertight mounting and provide for thermal expansion. Coordinate installation with flashings and other components.
 1. Install components required for a complete sheet metal roofing assembly including trim, copings, seam covers, flashings, sealants, gaskets, fillers, metal closures, closure strips, and similar items.
 2. Install accessories integral to sheet metal roofing that are specified in Division 7 Section "Sheet Metal Flashing and Trim" to comply with that Section's requirements.
- B. Flashing and Trim: Comply with performance requirements, manufacturer's written installation instructions, and SMACNA's "Architectural Sheet Metal Manual." Provide concealed fasteners where possible, and set units true to line and level as indicated. Install work with laps, joints, and seams that will be permanently watertight and weather resistant.

3.6 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces of substances that interfere with uniform oxidation and weathering.
- B. Remove temporary protective coverings and strippable films as sheet metal roofing is installed unless otherwise indicated in manufacturer's written installation instructions.

END OF SECTION 07610

SECTION 07620 - SHEET METAL FLASHING AND TRIM

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Manufactured reglets and counterflashing.
2. Formed roof drainage sheet metal fabrications.
3. Formed low-slope roof sheet metal fabrications.
4. Formed wall sheet metal fabrications.

1.2 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Shop Drawings: Show installation layouts of sheet metal flashing and trim, including plans, elevations, expansion-joint locations, and keyed details. Distinguish between shop- and field-assembled work.

1. Include details for forming, joining, supporting, and securing sheet metal flashing and trim, including pattern of seams, termination points, fixed points, expansion joints, expansion-joint covers, edge conditions, special conditions, and connections to adjoining work.

C. Samples: For each exposed product and for each finish specified.

D. Maintenance data.

E. Warranty: Sample of special warranty.

1.3 QUALITY ASSURANCE

A. Sheet Metal Flashing and Trim Standard: Comply with SMACNA's "Architectural Sheet Metal Manual" unless more stringent requirements are specified or shown on Drawings.

B. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for fabrication and installation.

1. Build mockup of typical roof eave, including built-in gutter, fascia, and fascia trim, approximately 10 feet long, including supporting construction cleats, seams, attachments, underlayment, and accessories.

C. Preinstallation Conference: Conduct conference at Project site.

1.4 WARRANTY

- A. Special Warranty on Finishes: Manufacturer's standard form in which manufacturer agrees to repair finish or replace sheet metal flashing and trim that shows evidence of deterioration of factory-applied finishes within 20 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 SHEET METALS

- A. General: Protect mechanical and other finishes on exposed surfaces from damage by applying a strippable, temporary protective film before shipping.
- B. Metallic-Coated Steel Sheet: Restricted flatness steel sheet, metallic coated by the hot-dip process and prepainted by the coil-coating process to comply with ASTM A 755/A 755M.
 - 1. Aluminum-Zinc Alloy-Coated Steel Sheet: ASTM A 792/A 792M, Class AZ50 coating designation, Grade 40; structural quality.
 - 2. Surface: Manufacturer's standard clear acrylic coating on both sides.
 - 3. Exposed Coil-Coated Finish:
 - a. Three-Coat Fluoropolymer: AAMA 621. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in both color coat and clear topcoat.
 - 4. Color: As selected by Architect from manufacturer's full range.
 - 5. All steel on this project must be made in the United States of America as per Federal Highway Administration (FHWA) regulations

2.2 UNDERLAYMENT MATERIALS

- A. Polyethylene Sheet: 6-mil thick polyethylene sheet complying with ASTM D 4397.
- B. Felt: ASTM D 226, Type II (No. 30), asphalt-saturated organic felt, nonperforated.
- C. Self-Adhering, High-Temperature Sheet: Minimum 30 to 40 mils thick, consisting of slip-resisting polyethylene-film top surface laminated to layer of butyl or SBS-modified asphalt adhesive, with release-paper backing; cold applied. Provide primer when recommended by underlayment manufacturer.
 - 1. Thermal Stability: ASTM D 1970; stable after testing at 240 deg F.
 - 2. Low-Temperature Flexibility: ASTM D 1970; passes after testing at minus 20 deg F.
- D. Slip Sheet: Building paper, minimum, rosin sized.

2.3 MISCELLANEOUS MATERIALS

- A. General: Provide materials and types of fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required for complete sheet metal flashing and trim installation and recommended by manufacturer of primary sheet metal or manufactured item unless otherwise indicated.

- B. Fasteners: Wood screws, annular threaded nails, self-tapping screws, self-locking rivets and bolts, and other suitable fasteners designed to withstand design loads and recommended by manufacturer of primary sheet metal or manufactured item.
1. General: Blind fasteners or self-drilling screws, gasketed, with hex-washer head.
 - a. Exposed Fasteners: Heads matching color of sheet metal using plastic caps or factory-applied coating.
 - b. Blind Fasteners: High-strength aluminum or stainless-steel rivets suitable for metal being fastened.
 - c. Spikes and Ferrules: Same material as gutter; with spike with ferrule matching internal gutter width.
 2. Fasteners for Copper Sheet: Copper, hardware bronze or Series 300 stainless steel.
 3. Fasteners for Aluminum Sheet: Aluminum or Series 300 stainless steel.
 4. Fasteners for Stainless-Steel Sheet: Series 300 stainless steel.
 5. Fasteners for Aluminum-Zinc Alloy-Coated Steel Sheet: Hot-dip galvanized steel according to ASTM A 153/A 153M or ASTM F 2329 or Series 300 stainless steel.
- C. Sealant Tape: Pressure-sensitive, 100 percent solids, gray polyisobutylene compound sealant tape with release-paper backing. Provide permanently elastic, nonsag, nontoxic, nonstaining tape 1/2 inch wide and 1/8 inch thick.
- D. Elastomeric Sealant: ASTM C 920, elastomeric polymer sealant; low modulus; of type, grade, class, and use classifications required to seal joints in sheet metal flashing and trim and remain watertight.
- E. Bituminous Coating: Cold-applied asphalt emulsion complying with ASTM D 1187.

2.4 REGLETS

- A. Reglets: Units of type, material, and profile indicated, formed to provide secure interlocking of separate reglet and counterflashing pieces, and compatible with flashing indicated with interlocking counterflashing on exterior face, of same metal as reglet.
1. Material: Aluminum-Zinc Alloy-Coated Steel, 0.022 inch thick].
 2. Finish: With manufacturer's standard color coating.

2.5 FABRICATION, GENERAL

- A. General: Custom fabricate sheet metal flashing and trim to comply with recommendations in SMACNA's "Architectural Sheet Metal Manual" that apply to design, dimensions, geometry, metal thickness, and other characteristics of item indicated. Fabricate items at the shop to greatest extent possible.
1. Obtain field measurements for accurate fit before shop fabrication.
 2. Form sheet metal flashing and trim without excessive oil canning, buckling, and tool marks and true to line and levels indicated, with exposed edges folded back to form hems.

3. Conceal fasteners and expansion provisions where possible. Exposed fasteners are not allowed on faces exposed to view.
- B. Sealed Joints: Form nonexpansion but movable joints in metal to accommodate elastomeric sealant.
- C. Expansion Provisions: Where lapped expansion provisions cannot be used, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with butyl sealant concealed within joints.
- D. Fabricate cleats and attachment devices from same material as accessory being anchored or from compatible, noncorrosive metal.
- E. Seams: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with elastomeric sealant unless otherwise recommended by sealant manufacturer for intended use.

2.6 ROOF DRAINAGE SHEET METAL FABRICATIONS

- A. Hanging Gutters: Fabricate to cross section indicated, complete with end pieces, outlet tubes, and other accessories as required. Fabricate in minimum 96-inch long sections. Furnish flat-stock gutter spacers and gutter brackets fabricated from same metal as gutters, of size recommended by SMACNA but not less than twice the gutter thickness. Fabricate expansion joints, expansion-joint covers, gutter bead reinforcing bars, and gutter accessories from same metal as gutters.
 1. Accessories: Continuous removable leaf screen with sheet metal frame and hardware cloth screen.
- B. Built-in Gutters: Fabricate to cross section indicated, with riveted and soldered joints, complete with end pieces, outlet tubes, and other special accessories as required. Fabricate in minimum 96-inch long sections. Fabricate expansion joints and accessories from same metal as gutters unless otherwise indicated.
 1. Accessories: Continuous removable leaf screen with sheet metal frame and hardware cloth screen
 2. Fabricate from the following materials:
 - a. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.
- C. Downspouts: Fabricate round downspouts complete with mitered elbows. Furnish with metal hangers, from same material as downspouts, and anchors.
 1. Hanger Style: See drawings.
 2. Fabricate from the following materials:
 - a. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.

2.7 LOW-SLOPE ROOF SHEET METAL FABRICATIONS

- A. Roof-Edge Flashing (Gravel Stop) and Fascia Cap: Fabricate in minimum 96-inch long, but not exceeding 10-foot long, sections. Furnish with 6-inch wide, joint cover plates. Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.
- B. Copings: Fabricate in minimum 96-inch long, but not exceeding 10-foot long, sections. Fabricate joint plates of same thickness as copings. Furnish with continuous cleats to support edge of external leg and drill elongated holes for fasteners on interior leg. Miter corners, seal, and solder or weld watertight. Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.040 inch thick.
- C. Base Flashing: Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.
- D. Counterflashing[and Flashing Receivers]: Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.
- E. Roof-Penetration Flashing: Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch thick.

2.8 WALL SHEET METAL FABRICATIONS

- A. Through-Wall Flashing: Fabricate continuous flashings in minimum 96-inch long, but not exceeding 12-foot long, sections, under copings, at shelf angles, and where indicated. Fabricate discontinuous lintel, sill, and similar flashings to extend 6 inches beyond each side of wall openings. Form with 2-inch high, end dams where flashing is discontinuous. Fabricate from the following materials:
 - 1. Stainless Steel: 0.016 inch thick.
- B. Opening Flashings in Frame Construction: Fabricate head, sill, jamb, and similar flashings to extend 4 inches beyond wall openings. Form head and sill flashing with 2-inch high, end dams. Fabricate from the following materials:
 - 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch thick.

PART 3 - EXECUTION

3.1 UNDERLAYMENT INSTALLATION

- A. Polyethylene Sheet: Install polyethylene sheet with adhesive for anchorage. Apply in shingle fashion to shed water, with lapped and taped joints of not less than 2 inches.
- B. Felt Underlayment: Install felt underlayment with adhesive for temporary anchorage. Apply in shingle fashion to shed water, with lapped joints of not less than 2 inches.
- C. Self-Adhering Sheet Underlayment: Install self-adhering sheet underlayment, wrinkle free. Comply with temperature restrictions of underlayment manufacturer for installation; use primer rather than nails for installing underlayment at low temperatures. Apply in shingle fashion to

shed water, with end laps of not less than 6 inches staggered 24 inches between courses. Overlap side edges not less than 3-1/2 inches. Roll laps with roller. Cover underlayment within 14 days.

3.2 INSTALLATION, GENERAL

- A. General: Anchor sheet metal flashing and trim and other components of the Work securely in place, with provisions for thermal and structural movement so that completed sheet metal flashing and trim shall not rattle, leak, or loosen, and shall remain watertight. Use fasteners, solder, welding rods, protective coatings, separators, sealants, and other miscellaneous items as required to complete sheet metal flashing and trim system.
 - 1. Install sheet metal flashing and trim true to line and levels indicated. Provide uniform, neat seams with minimum exposure of solder, welds, and sealant.
 - 2. Install sheet metal flashing and trim to fit substrates and to result in watertight performance. Verify shapes and dimensions of surfaces to be covered before fabricating sheet metal.
 - 3. Space cleats not more than 12 inches apart. Anchor each cleat with two fasteners. Bend tabs over fasteners.
 - 4. Install exposed sheet metal flashing and trim without excessive oil canning, buckling, and tool marks.
 - 5. Install sealant tape where indicated.
 - 6. Torch cutting of sheet metal flashing and trim is not permitted.
- B. Metal Protection: Where dissimilar metals will contact each other or corrosive substrates, protect against galvanic action by painting contact surfaces with bituminous coating or by other permanent separation as recommended by SMACNA.
 - 1. Coat back side of uncoated aluminum sheet metal flashing and trim with bituminous coating where flashing and trim will contact wood, ferrous metal, or cementitious construction.
 - 2. Underlayment: Where installing metal flashing directly on cementitious or wood substrates, install a course of felt underlayment and cover with a slip sheet or install a course of polyethylene sheet.
- C. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at a maximum of 10 feet with no joints allowed within 24 inches of corner or intersection. Where lapped expansion provisions cannot be used or would not be sufficiently watertight, form expansion joints of intermeshing hooked flanges, not less than 1 inch deep, filled with sealant concealed within joints.
- D. Fastener Sizes: Use fasteners of sizes that will penetrate [wood sheathing not less than 1-1/4 inches for nails and not less than 3/4 inch for wood screws, metal decking not less than recommended by fastener manufacturer to achieve maximum pull-out resistance.
- E. Seal joints as shown and as required for watertight construction.
- F. Soldered Joints: Clean surfaces to be soldered, removing oils and foreign matter. Pre-tin edges of sheets to be soldered to a width of 1-1/2 inches, except reduce pre-tinning where pre-tinned surface would show in completed Work.

1. Do not solder metallic-coated steel and aluminum sheet.
 2. Do not use torches for soldering. Heat surfaces to receive solder and flow solder into joint. Fill joint completely. Completely remove flux and spatter from exposed surfaces.
 3. Stainless-Steel Soldering: Tin edges of uncoated sheets using solder recommended for stainless steel and acid flux. Promptly remove acid flux residue from metal after tinning and soldering. Comply with solder manufacturer's recommended methods for cleaning and neutralization.
 4. Copper Soldering: Tin edges of uncoated copper sheets using solder for copper.
- G. Rivets: Rivet joints in uncoated aluminum where indicated and where necessary for strength.

3.3 ROOF DRAINAGE SYSTEM INSTALLATION

- A. General: Install sheet metal roof drainage items to produce complete roof drainage system according to SMACNA recommendations and as indicated. Coordinate installation of roof perimeter flashing with installation of roof drainage system.
- B. Hanging Gutters: Join sections with riveted and soldered joints or with lapped joints sealed with sealant. Provide for thermal expansion. Attach gutters at eave or fascia to firmly anchored gutter brackets spaced not more than 36 inches apart. Provide end closures and seal watertight with sealant. Slope to downspouts.
1. Install gutter with expansion joints at locations indicated, but not exceeding, 50 feet apart. Install expansion-joint caps.
 2. Install continuous gutter screens on gutters with noncorrosive fasteners, removable for cleaning gutters.
- C. Built-in Gutters: Join sections with riveted and soldered or lapped joints sealed with sealant. Provide for thermal expansion. Slope to downspouts. Provide end closures and seal watertight with sealant.
1. Install felt underlayment layer in built-in gutter trough and extend to drip edge at eaves and under felt underlayment on roof sheathing. Lap sides a minimum of 2 inches over underlying course. Lap ends a minimum of 4 inches. Stagger end laps between succeeding courses at least 72 inches. Fasten with roofing nails. Install slip sheet over felt underlayment.
 2. Install gutter with expansion joints at locations indicated, but not exceeding, 50 feet apart. Install expansion-joint caps.
- D. Downspouts: Join sections with 1-1/2-inch telescoping joints. Provide hangers with fasteners designed to hold downspouts securely to walls. Locate hangers at top and bottom and at approximately 60 inches o.c. in between.
- E. Expansion-Joint Covers: Install expansion-joint covers at locations and of configuration indicated. Lap joints a minimum of 4 inches in direction of water flow.

3.4 ROOF FLASHING INSTALLATION

- A. General: Install sheet metal flashing and trim to comply with performance requirements, sheet metal manufacturer's written installation instructions, and SMACNA's "Architectural Sheet Metal Manual." Provide concealed fasteners where possible, set units true to line, and level as indicated. Install work with laps, joints, and seams that will be permanently watertight and weather resistant.
- B. Roof Edge Flashing: Anchor to resist uplift and outward forces according to recommendations in SMACNA's "Architectural Sheet Metal Manual" and as indicated. Interlock bottom edge of roof edge flashing with continuous cleat anchored to substrate at staggered 3-inch centers.
- C. Copings: Anchor to resist uplift and outward forces according to recommendations in SMACNA's "Architectural Sheet Metal Manual" and as indicated.
 - 1. Interlock exterior bottom edge of coping with continuous cleat anchored to substrate at 16-inch centers.
 - 2. Anchor interior leg of coping with washers and screw fasteners through slotted holes at 24-inch centers.
- D. Pipe or Post Counterflashing: Install counterflashing umbrella with close-fitting collar with top edge flared for elastomeric sealant, extending a minimum of 4 inches over base flashing. Install stainless-steel draw band and tighten.
- E. Counterflashing: Coordinate installation of counterflashing with installation of base flashing. Insert counterflashing in reglets or receivers and fit tightly to base flashing. Extend counterflashing 4 inches over base flashing. Lap counterflashing joints a minimum of 4 inches and bed with sealant.
- F. Roof-Penetration Flashing: Coordinate installation of roof-penetration flashing with installation of roofing and other items penetrating roof. Seal with elastomeric sealant and clamp flashing to pipes that penetrate roof.

3.5 WALL FLASHING INSTALLATION

- A. General: Install sheet metal wall flashing to intercept and exclude penetrating moisture according to SMACNA recommendations and as indicated. Coordinate installation of wall flashing with installation of wall-opening components such as windows, doors, and louvers.
- B. Through-Wall Flashing: Installation of through-wall flashing is specified in Division 4 Section "Unit Masonry Assemblies."
- C. Reglets: Installation of reglets is specified in Division 4 Section "Unit Masonry Assemblies."
- D. Opening Flashings in Frame Construction: Install continuous head, sill, jamb, and similar flashings to extend 4 inches beyond wall openings.

3.6 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces of substances that interfere with uniform oxidation and weathering.
- B. Remove temporary protective coverings and strippable films as sheet metal flashing and trim are installed unless otherwise indicated in manufacturer's written installation instructions.

END OF SECTION 07620

SECTION 07920 - JOINT SEALANTS**PART 1 - GENERAL****1.1 SUMMARY****A. Section Includes:**

1. Silicone joint sealants.
2. Urethane joint sealants.
3. Latex joint sealants.
4. Preformed joint sealants.
5. Acoustical joint sealants.

1.2 SUBMITTALS

- A. Product Data: For each joint-sealant product indicated.
- B. Samples: For each kind and color of joint sealant required.
- C. Joint-Sealant Schedule: Include the following information:
 1. Joint-sealant application, joint location, and designation.
 2. Joint-sealant manufacturer and product name.
 3. Joint-sealant formulation.
 4. Joint-sealant color.
- D. Product test reports.
- E. Preconstruction compatibility and adhesion test reports.
- F. Preconstruction field-adhesion test reports.
- G. Field-adhesion test reports.
- H. Warranties.

1.3 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Qualified according to ASTM C 1021 to conduct the testing indicated.
- B. Preinstallation Conference: Conduct conference at Project site.

1.4 WARRANTY

- A. Special Installer's Warranty: Manufacturer's standard form in which Installer agrees to repair or replace joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
 - 1. Warranty Period: Two years from date of Substantial Completion.
- B. Special Manufacturer's Warranty: Manufacturer's standard form in which joint-sealant manufacturer agrees to furnish joint sealants to repair or replace those that do not comply with performance and other requirements specified in this Section within specified warranty period.
 - 1. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MATERIALS, GENERAL

- A. VOC Content of Interior Sealants: Provide sealants and sealant primers for use inside the weatherproofing system that comply with the following limits for VOC content when calculated according to 40 CFR 59, Part 59, Subpart D (EPA Method 24):
 - 1. Architectural Sealants: 250 g/L.
 - 2. Sealant Primers for Nonporous Substrates: 250 g/L.
 - 3. Sealant Primers for Porous Substrates: 775 g/L.
- B. Liquid-Applied Joint Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied joint sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
 - 1. Suitability for Immersion in Liquids. Where sealants are indicated for Use I for joints that will be continuously immersed in liquids, provide products that have undergone testing according to ASTM C 1247. Liquid used for testing sealants is deionized water, unless otherwise indicated.
- C. Stain-Test-Response Characteristics: Where sealants are specified to be nonstaining to porous substrates, provide products that have undergone testing according to ASTM C 1248 and have not stained porous joint substrates indicated for Project.
- D. Suitability for Contact with Food: Where sealants are indicated for joints that will come in repeated contact with food, provide products that comply with 21 CFR 177.2600.

2.2 SILICONE JOINT SEALANTS (For use in restrooms)

- A. Mildew-Resistant Silicone Joint Sealant: ASTM C 920.
 - 1. Type: Single component (S).
 - 2. Grade: Nonsag (NS).

3. Class: 100/50.
4. Uses Related to Exposure: Nontraffic (NT).

2.3 URETHANE JOINT SEALANTS (Exterior use)

- A. Urethane Joint Sealant: ASTM C 920.
 1. Type: Multicomponent (M).
 2. Grade: Pourable (P) or nonsag (NS).
 3. Class: 100/50.
 4. Uses Related to Exposure: Traffic (T) or Nontraffic (NT).

2.4 LATEX JOINT SEALANTS (Interior use only)

- A. Joint Sealant: Acrylic latex or siliconized acrylic latex, ASTM C 834, Type OP, Grade NF.

2.5 PREFORMED JOINT SEALANTS

- A. Preformed Foam Joint Sealant: Manufacturer's standard preformed, precompressed, open-cell foam sealant manufactured from urethane foam with minimum density of 10 lb/cu. ft. and impregnated with a nondrying, water-repellent agent. Factory produce in precompressed sizes in roll or stick form to fit joint widths indicated; coated on one side with a pressure-sensitive adhesive and covered with protective wrapping.

2.6 ACOUSTICAL JOINT SEALANTS

- A. Acoustical Joint Sealant: Manufacturer's standard nonsag, paintable, nonstaining latex sealant complying with ASTM C 834. Product effectively reduces airborne sound transmission through perimeter joints and openings in building construction as demonstrated by testing representative assemblies according to ASTM E 90.

2.7 JOINT SEALANT BACKING

- A. Cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin), Type O (open-cell material), Type B (bicellular material with a surface skin), or any of the preceding types, as approved in writing by joint-sealant manufacturer for joint application indicated, and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance.
- B. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer.

2.8 MISCELLANEOUS MATERIALS

- A. **Primer:** Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. **Cleaners for Nonporous Surfaces:** Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials.
- C. **Masking Tape:** Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.

PART 3 - EXECUTION

3.1 PREPARATION

- A. **Surface Cleaning of Joints:** Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions.
 - 1. Remove laitance and form-release agents from concrete.
 - 2. Clean nonporous joint substrate surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants.
- B. **Joint Priming:** Prime joint substrates where recommended by joint-sealant manufacturer or as indicated by preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. **Masking Tape:** Use masking tape where required to prevent contact of sealant or primer with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

3.2 INSTALLATION

- A. **Sealant Installation Standard:** Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- B. **Install sealant backings of kind indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.**
 - 1. Do not leave gaps between ends of sealant backings.
 - 2. Do not stretch, twist, puncture, or tear sealant backings.
 - 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.

- C. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- D. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
 - 1. Place sealants so they directly contact and fully wet joint substrates.
 - 2. Completely fill recesses in each joint configuration.
 - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- E. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified in subparagraphs below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
 - 1. Remove excess sealant from surfaces adjacent to joints.
 - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
 - 3. Provide concave joint profile per Figure 8A in ASTM C 1193, unless otherwise indicated.
- F. Acoustical Sealant Installation: Comply with ASTM C 919 and with manufacturer's written recommendations.
- G. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

3.3 FIELD QUALITY CONTROL

- A. Field-Adhesion Testing: Field test joint-sealant adhesion to joint substrates as follows:
 - 1. Extent of Testing: Test completed and cured sealant joints as follows:
 - a. Perform 10 tests for the first 1000 feet of joint length for each kind of sealant and joint substrate.
 - b. Perform 1 test for each 1000 feet of joint length thereafter or 1 test per each floor per elevation.
 - 2. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C 1193 or Method A, Tail Procedure, in ASTM C 1521.
- B. Evaluation of Field-Adhesion Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

3.4 JOINT-SEALANT SCHEDULE

- A. Joint-Sealant Application: Exterior joints in horizontal traffic surfaces.
 - 1. Joint Locations:
 - a. Isolation and contraction joints in cast-in-place concrete slabs.
 - b. Joints between different materials listed above.
 - 2. Joint Sealant: Urethane.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- B. Joint-Sealant Application: Exterior joints in vertical surfaces and horizontal nontraffic surfaces.
 - 1. Joint Locations:
 - a. Construction joints in cast-in-place concrete.
 - b. Control and expansion joints in unit masonry.
 - c. Joints between metal panels.
 - d. Joints between different materials listed above.
 - e. Perimeter joints between materials listed above and frames of doors, windows, and louvers.
 - f. Control and expansion joints in ceilings and other overhead surfaces.
 - 2. Joint Sealant: Urethane.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- C. Joint-Sealant Application: Interior joints in horizontal traffic surfaces.
 - 1. Joint Locations:
 - a. Isolation joints in cast-in-place concrete slabs.
 - b. Control and expansion joints in tile flooring.
 - 2. Joint Sealant: Urethane.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- D. Joint-Sealant Application: Interior joints in vertical surfaces and horizontal nontraffic surfaces.
 - 1. Joint Locations:
 - a. Control and expansion joints on exposed interior surfaces of exterior walls.
 - b. Perimeter joints of exterior openings where indicated.
 - c. Tile control and expansion joints.
 - d. Perimeter joints between interior wall surfaces and frames of interior doors, windows and elevator entrances.
 - 2. Joint Sealant: Latex.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- E. Joint-Sealant Application: Mildew-resistant interior joints in vertical surfaces and horizontal nontraffic surfaces.
 - 1. Joint Sealant Location:

C203304-RA (K-3800)

BEAUFORT COUNTY

- a. Joints between plumbing fixtures and adjoining walls, floors, and counters.
 - b. Tile control and expansion joints where indicated.
 - 2. Joint Sealant: Silicone.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range of colors.
- F. Joint-Sealant Application: Interior acoustical joints in vertical surfaces and horizontal nontraffic surfaces.
- 1. Joint Location:
 - a. Acoustical joints where indicated.
 - b. Other joints as indicated.
 - 2. Joint Sealant: Acoustical.
 - 3. Joint-Sealant Color: As selected by Architect from manufacturer's full range.

END OF SECTION 07920

SECTION 08110 - STEEL DOORS AND FRAMES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Standard hollow metal doors and frames.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Include elevations, door edge details, frame profiles, metal thicknesses, preparations for hardware, and other details.
- C. Samples for Initial Selection: For units with factory-applied color finishes.
- D. Samples for Verification: For each type of exposed finish required.
- E. Schedule: Prepared by or under the supervision of supplier, using same reference numbers for details and openings as those on Drawings.

1.3 QUALITY ASSURANCE

- A. Fire-Rated Door Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, based on testing at positive pressure according to NFPA 252.
 - 1. Temperature-Rise Limit: At vertical exit enclosures and exit passageways, provide doors that have a maximum transmitted temperature end point of not more than 450 deg F above ambient after 30 minutes of standard fire-test exposure.
- B. Fire-Rated, Borrowed-Light Frame Assemblies: Assemblies complying with NFPA 80 that are listed and labeled, by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated, based on testing according to NFPA 257 or UL 9. Label each individual glazed lite.
- C. Smoke-Control Door Assemblies: Comply with NFPA 105 or UL 1784.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, CS, Type B; suitable for exposed applications.
- B. Hot-Rolled Steel Sheet: ASTM A 1011/A 1011M, CS, Type B.
- C. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum G60 metallic coating.
- D. Frame Anchors: ASTM A 591/A 591M, Commercial Steel (CS), 40Z coating designation; mill phosphatized.
 - 1. For anchors built into exterior walls, steel sheet complying with ASTM A 1008/A 1008M or ASTM A 1011/A 1011M, hot-dip galvanized according to ASTM A 153/A 153M, Class B.
- E. Inserts, Bolts, and Fasteners: Hot-dip galvanized according to ASTM A 153/A 153M.
- F. Grout: ASTM C 476, except with a maximum slump of 4 inches, as measured according to ASTM C 143/C 143M.
- G. Mineral-Fiber Insulation: ASTM C 665, Type I.
- H. Glazing: Division 8 Section "Glazing."
- I. Bituminous Coating: Cold-applied asphalt mastic, SSPC-Paint 12, compounded for 15-mil dry film thickness per coat.

2.2 STANDARD HOLLOW METAL DOORS

- A. General: Comply with ANSI/SDI A250.8.
 - 1. Design: Flush panel.
 - 2. Core Construction: Manufacturer's standard kraft-paper honeycomb, polystyrene, polyurethane, polyisocyanurate, mineral-board, or vertical steel-stiffener core.
 - a. Fire Door Core: As required to provide fire-protection and temperature-rise ratings indicated.
 - b. Thermal-Rated (Insulated) Doors: R-value of not less than 6.0 deg F x h x sq. ft./Btu when tested according to ASTM C 1363.
 - 3. Vertical Edges for Single-Acting Doors: Square edge.
 - 4. Top and Bottom Edges: Closed with flush or inverted 0.042-inch- thick, end closures or channels of same material as face sheets.
 - 5. Tolerances: SDI 117, "Manufacturing Tolerances for Standard Steel Doors and Frames."

- B. Exterior Doors: Face sheets fabricated from metallic-coated steel sheet. Comply with ANSI/SDI A250.8 for level and model and ANSI/SDI A250.4 for physical performance level:
 - 1. Level 2 and Physical Performance Level C (Heavy Duty), Model 1 (Full Flush).
 - a. Width: 1-3/4 inches.
- C. Interior Doors: Face sheets fabricated from cold-rolled steel sheet. Provide doors complying with requirements indicated below by referencing ANSI/SDI A250.8 for level and model and ANSI/SDI A250.4 for physical performance level:
 - 1. Level 1 and Physical Performance Level C (Standard Duty), Model 1 (Full Flush).
 - a. Width: 1-3/4 inches.
- D. Hardware Reinforcement: ANSI/SDI A250.6.

2.3 STANDARD HOLLOW METAL FRAMES

- A. General: Comply with ANSI/SDI A250.8.
- B. Exterior Frames: Fabricated from metallic-coated steel sheet.
 - 1. Fabricate frames with mitered or coped corners.
 - 2. Fabricate frames as full profile welded unless otherwise indicated.
 - 3. Frames for Level 2 Steel Doors: 0.053-inch thick steel sheet.
- C. Interior Frames: Fabricated from cold-rolled steel sheet.
 - 1. Fabricate frames with mitered or coped corners.
 - 2. Fabricate frames as full profile welded unless otherwise indicated.
 - 3. Frames for Level 1 Steel Doors: 0.042-inch thick steel sheet.
 - 4. Frames for Wood Doors: 0.042-inch- thick steel sheet.
 - 5. Frames for Borrowed Lights: 0.042-inch thick steel sheet.
- D. Hardware Reinforcement: ANSI/SDI A250.6.

2.4 FRAME ANCHORS

- A. Jamb Anchors:
 - 1. Masonry Type: Adjustable strap-and-stirrup or T-shaped anchors to suit frame size, not less than 0.042 inch thick, with corrugated or perforated straps not less than 2 inches wide by 10 inches long; or wire anchors not less than 0.177 inch thick.
 - 2. Stud-Wall Type: Designed to engage stud, welded to back of frames; not less than 0.042 inch thick.
 - 3. Compression Type for Drywall Slip-on Frames: Adjustable compression anchors.

4. **Postinstalled Expansion Type for In-Place Concrete or Masonry:** Minimum 3/8-inch diameter bolts with expansion shields or inserts. Provide pipe spacer from frame to wall, with throat reinforcement plate, welded to frame at each anchor location.
- B. **Floor Anchors:** Formed from same material as frames, not less than 0.042 inch thick, and as follows:
 1. **Monolithic Concrete Slabs:** Clip-type anchors, with two holes to receive fasteners.
 2. **Separate Topping Concrete Slabs:** Adjustable-type anchors with extension clips, allowing not less than 2-inch height adjustment. Terminate bottom of frames at finish floor surface.

2.5 HOLLOW METAL PANELS

- A. Provide hollow metal panels of same materials, construction, and finish as specified for adjoining hollow metal work.

2.6 STOPS AND MOLDINGS

- A. **Moldings for Glazed Lites in Doors:** Minimum 0.032 inch thick, same material as door face sheet.
- B. **Fixed Frame Moldings:** Formed integral with hollow metal frames, a minimum of 5/8 inch high unless otherwise indicated.
- C. **Loose Stops for Glazed Lites in Frames:** Minimum 0.032 inch thick, same material as frames.

2.7 LOUVERS

- A. Provide sightproof louvers for interior doors, where indicated, that comply with SDI 111C, with blades or baffles formed of 0.020-inch thick, cold-rolled steel sheet set into 0.032-inch thick steel frame.

2.8 ACCESSORIES

- A. **Mullions and Transom Bars:** Join to adjacent members by welding or rigid mechanical anchors.
- B. **Ceiling Struts:** Minimum 1/4-inch-thick by 1-inch wide steel.
- C. **Grout Guards:** Formed from same material as frames, not less than 0.016 inch thick.

2.9 FABRICATION

- A. **Tolerances:** Fabricate hollow metal work to tolerances indicated in SDI 117.
- B. **Hollow Metal Doors:**

1. Exterior Doors: Provide weep-hole openings in bottom of exterior doors. Seal joints in top edges of doors against water penetration.
 2. Glazed Lites: Factory cut openings in doors.
 3. Astragals: Provide overlapping astragal on one leaf of pairs of doors where required by NFPA 80 for fire-performance rating or where indicated.
- C. Hollow Metal Frames: Where frames are fabricated in sections, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
1. Welded Frames: Weld flush face joints continuously; grind, fill, dress, and make smooth, flush, and invisible.
 2. Sidelight and Transom Bar Frames: Provide closed tubular members with no visible face seams or joints, fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
 3. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated.
 4. Grout Guards: Weld guards to frame at back of hardware mortises in frames to be grouted.
 5. Floor Anchors: Weld anchors to bottom of jambs and mullions with at least four spot welds per anchor.
 6. Jamb Anchors: Provide number and spacing of anchors as follows:
 - a. Masonry Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Two anchors per jamb up to 60 inches high.
 - 2) Three anchors per jamb from 60 to 90 inches high.
 - 3) Four anchors per jamb from 90 to 120 inches high.
 - 4) Four anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 120 inches high.
 - b. Stud-Wall Type: Locate anchors not more than 18 inches from top and bottom of frame. Space anchors not more than 32 inches o.c. and as follows:
 - 1) Three anchors per jamb up to 60 inches high.
 - 2) Four anchors per jamb from 60 to 90 inches high.
 - 3) Five anchors per jamb from 90 to 96 inches high.
 - 4) Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches or fraction thereof above 96 inches high.
 - 5) Two anchors per head for frames more than 42 inches wide and mounted in metal-stud partitions.
 - c. Compression Type: Not less than two anchors in each jamb.
 - d. Postinstalled Expansion Type: Locate anchors not more than 6 inches from top and bottom of frame. Space anchors not more than 26 inches oc.
 7. Door Silencers: Except on weather-stripped doors, drill stops to receive door silencers.
 - a. Single-Door Frames: Three door silencers.
 - b. Double-Door Frames: Two door silencers.

- D. **Hardware Preparation:** Factory prepare hollow metal work to receive templated mortised hardware according to the Door Hardware Schedule and templates furnished as specified in Division 8 Section "Door Hardware."
 - 1. Locate hardware as indicated, or if not indicated, according to ANSI/SDI A250.8.
 - 2. Reinforce doors and frames to receive nontemplated, mortised and surface-mounted door hardware.
 - 3. Comply with applicable requirements in ANSI/SDI A250.6 and ANSI/DHI A115 Series specifications for preparation of hollow metal work for hardware.
 - 4. Coordinate locations of conduit and wiring boxes for electrical connections with Division 16 electrical Sections.

- E. **Stops and Moldings:** Provide stops and moldings around glazed lites where indicated. Form corners of stops and moldings with butted or mitered hairline joints.
 - 1. **Single Glazed Lites:** Provide fixed stops and moldings welded on secure side of hollow metal work.
 - 2. **Multiple Glazed Lites:** Provide fixed and removable stops and moldings so that each glazed lite is capable of being removed independently.
 - 3. Provide fixed frame moldings on outside of exterior and on secure side of interior doors and frames.
 - 4. Provide loose stops and moldings on inside of hollow metal work.
 - 5. Coordinate rabbet width between fixed and removable stops with type of glazing and type of installation indicated.

2.10 STEEL FINISHES

- A. **Prime Finish:** Apply manufacturer's standard primer immediately after cleaning and pretreating.
 - 1. **Shop Primer:** ANSI/SDI A250.10.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. **Hollow Metal Frames:** Comply with ANSI/SDI A250.11.
 - 1. Set frames accurately in position, plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete, remove temporary braces, leaving surfaces smooth and undamaged.
 - a. At fire-protection-rated openings, install frames according to NFPA 80.
 - b. Where frames are fabricated in sections because of shipping or handling limitations, field splice at approved locations by welding face joint continuously; grind, fill, dress, and make splice smooth, flush, and invisible on exposed faces.
 - c. Install frames with removable glazing stops located on secure side of opening.
 - d. Install door silencers in frames before grouting.

- e. Remove temporary braces necessary for installation only after frames have been properly set and secured.
 - f. Check plumbness, squareness, and twist of frames as walls are constructed. Shim as necessary to comply with installation tolerances.
 - g. Field apply bituminous coating to backs of frames that are filled with grout containing antifreezing agents.
- 2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with postinstalled expansion anchors.
 - a. Floor anchors may be set with powder-actuated fasteners instead of postinstalled expansion anchors if so indicated and approved on Shop Drawings.
- 3. Metal-Stud Partitions: Solidly pack mineral-fiber insulation behind frames.
- 4. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with grout.
- 5. Concrete Walls: Solidly fill space between frames and concrete with grout. Take precautions, including bracing frames, to ensure that frames are not deformed or damaged by grout forces.
- 6. In-Place Concrete or Masonry Construction: Secure frames in place with postinstalled expansion anchors. Countersink anchors, and fill and make smooth, flush, and invisible on exposed faces.
- 7. In-Place Gypsum Board Partitions: Secure frames in place with postinstalled expansion anchors through floor anchors at each jamb. Countersink anchors, and fill and make smooth, flush, and invisible on exposed faces.
- 8. Ceiling Struts: Extend struts vertically from top of frame at each jamb to overhead structural supports or substrates above frame unless frame is anchored to masonry or to other structural support at each jamb. Bend top of struts to provide flush contact for securing to supporting construction. Provide adjustable wedged or bolted anchorage to frame jamb members.
- 9. Installation Tolerances: Adjust hollow metal door frames for squareness, alignment, twist, and plumb to the following tolerances:
 - a. Squareness: Plus or minus 1/16 inch, measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
 - b. Alignment: Plus or minus 1/16 inch, measured at jambs on a horizontal line parallel to plane of wall.
 - c. Twist: Plus or minus 1/16 inch, measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
 - d. Plumbness: Plus or minus 1/16 inch, measured at jambs at floor.
- B. Hollow Metal Doors: Fit hollow metal doors accurately in frames, within clearances specified below. Shim as necessary.
 - 1. Non-Fire-Rated Standard Steel Doors:
 - a. Jambs and Head: 1/8 inch plus or minus 1/16 inch.
 - b. Between Edges of Pairs of Doors: 1/8 inch plus or minus 1/16 inch.
 - c. Between Bottom of Door and Top of Threshold: Maximum 3/8 inch.
 - d. Between Bottom of Door and Top of Finish Floor (No Threshold): Maximum 3/4 inch.

2. Fire-Rated Doors: Install doors with clearances according to NFPA 80.
 3. Smoke-Control Doors: Install doors according to NFPA 105.
- C. Glazing: Comply with installation requirements in Division 8 Section "Glazing" and with hollow metal manufacturer's written instructions.
1. Secure stops with countersunk flat- or oval-head machine screws spaced uniformly not more than 9 inches o.c. and not more than 2 inches o.c. from each corner.

3.2 ADJUSTING AND CLEANING

- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including hollow metal work that is warped, bowed, or otherwise unacceptable.
- B. Prime-Coat Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat and apply touchup of compatible air-drying, rust-inhibitive primer.
- C. Metallic-Coated Surfaces: Clean abraded areas and repair with galvanizing repair paint according to manufacturer's written instructions.

END OF SECTION 08110

SECTION 08211 - FLUSH WOOD DOORS**PART 1 - GENERAL****1.1 SUMMARY****A. Section Includes:**

1. Solid-core doors with wood-veneer faces.
2. Factory finishing flush wood doors.
3. Factory fitting flush wood doors to frames and factory machining for hardware.

B. Related Sections:

1. Division 8 Section "Glazing" for glass view panels in flush wood doors.

1.2 SUBMITTALS**A. Product Data:** For each type of door indicated. Include factory-finishing specifications.**B. Shop Drawings:** Indicate location, size, and hand of each door; elevation of each kind of door; construction details not covered in Product Data; location and extent of hardware blocking; and other pertinent data.

1. Indicate dimensions and locations of mortises and holes for hardware.
2. Indicate dimensions and locations of cutouts.
3. Indicate requirements for veneer matching.
4. Indicate doors to be factory finished and finish requirements.
5. Indicate fire-protection ratings for fire-rated doors.

C. Samples: For factory-finished doors.**1.3 QUALITY ASSURANCE****A. Quality Standard:** In addition to requirements specified, comply with AWI's "Architectural Woodwork Quality Standards Illustrated."**B. Fire-Rated Wood Doors:** Doors complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, based on testing at positive pressure according to NFPA 252.

PART 2 - PRODUCTS

2.1 DOOR CONSTRUCTION, GENERAL

- A. Low-Emitting Materials: Provide doors made with adhesives and composite wood products that do not contain urea formaldehyde.
- B. WDMA I.S.1-A Performance Grade:
 - 1. Heavy Duty unless otherwise indicated.
- C. Structural-Composite-Lumber-Core Doors:
 - 1. Structural Composite Lumber: WDMA I.S.10.
 - a. Screw Withdrawal, Face: 700 lbf
 - b. Screw Withdrawal, Edge: 400 lbf
- D. Fire-Protection-Rated Doors: Provide core specified or mineral core as needed to provide fire-protection rating indicated.
 - 1. Edge Construction: Provide edge construction with intumescent seals concealed by outer stile. Comply with specified requirements for exposed edges.
 - 2. Pairs: Provide fire-retardant stiles that are listed and labeled for applications indicated without formed-steel edges and astragals. Comply with specified requirements for exposed edges.
- E. Mineral-Core Doors:
 - 1. Core: Noncombustible mineral product complying with requirements of referenced quality standard and testing and inspecting agency for fire-protection rating indicated.
 - 2. Blocking: Provide composite blocking with improved screw-holding capability approved for use in doors of fire-protection ratings indicated as needed to eliminate through-bolting hardware.
 - 3. Edge Construction: At hinge stiles, provide laminated-edge construction with improved screw-holding capability and split resistance. Comply with specified requirements for exposed edges.

2.2 VENEERED-FACED DOORS FOR TRANSPARENT FINISH

- A. Interior Solid-Core Doors:
 - 1. Grade: Premium, with Grade A faces.
 - 2. Species: Select white maple.
 - 3. Cut: Plain sliced (flat sliced).
 - 4. Match between Veneer Leaves: Slip match.
 - 5. Assembly of Veneer Leaves on Door Faces: Balance match.
 - 6. Pair and Set Match: Provide for doors hung in same opening.
 - 7. Core: Glued wood stave.

8. Construction: Five or seven plies. Stiles and rails are bonded to core, then entire unit abrasive planed before veneering.

2.3 LOUVERS AND LIGHT FRAMES

A. Metal Louvers:

1. Metal and Finish: Hot-dip galvanized steel, 0.040 inch thick, with baked-enamel- or powder-coated finish.

- B. Wood-Veneered Beads for Light Openings in Fire-Rated Doors: Manufacturer's standard wood-veneered noncombustible beads matching veneer species of door faces and approved for use in doors of fire-protection rating indicated. Include concealed metal glazing clips where required for opening size and fire-protection rating indicated.

- C. Metal Frames for Light Openings in Fire-Rated Doors: Manufacturer's standard frame formed of 0.048-inch thick, cold-rolled steel sheet; with baked-enamel- or powder-coated finish; and approved for use in doors of fire-protection rating indicated.

2.4 FABRICATION

- A. Factory fit doors to suit frame-opening sizes indicated. Comply with clearance requirements of referenced quality standard for fitting unless otherwise indicated.

1. Comply with requirements in NFPA 80 for fire-rated doors.

- B. Factory machine doors for hardware that is not surface applied.

- C. Openings: Cut and trim openings through doors in factory.

1. Light Openings: Trim openings with moldings of material and profile indicated.
2. Glazing: Factory install glazing in doors indicated to be factory finished. Comply with applicable requirements in Division 8 Section "Glazing."
3. Louvers: Factory install louvers in prepared openings.

2.5 FACTORY FINISHING

- A. General: Comply with referenced quality standard for factory finishing. Complete fabrication, including fitting doors for openings and machining for hardware that is not surface applied, before finishing.

1. Finish faces, all four edges, edges of cutouts, and mortises. Stains and fillers may be omitted on top and bottom edges, edges of cutouts, and mortises.

- B. Finish doors at factory that are indicated to receive transparent finish. Field finish doors indicated to receive opaque finish.

- C. Transparent Finish:

1. Grade: Premium
2. Finish: AWI conversion varnish or catalyzed polyurethane system.
3. Staining: None required.
4. Effect: Semifilled finish, produced by applying an additional finish coat to partially fill the wood pores.
5. Sheen: Satin.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Hardware: For installation, see Division 8 Section "Door Hardware."
- B. Installation Instructions: Install doors to comply with manufacturer's written instructions and the referenced quality standard, and as indicated.
 1. Install fire-rated doors in corresponding fire-rated frames according to NFPA 80.
- C. Job-Fitted Doors: Align and fit doors in frames with uniform clearances and bevels; do not trim stiles and rails in excess of limits set by manufacturer or permitted for fire-rated doors. Machine doors for hardware. Seal edges of doors, edges of cutouts, and mortises after fitting and machining.
 1. Clearances: Provide 1/8 inch at heads, jambs, and between pairs of doors. Provide 1/8 inch from bottom of door to top of decorative floor finish or covering unless otherwise indicated. Where threshold is shown or scheduled, provide 1/4 inch from bottom of door to top of threshold unless otherwise indicated.
 - a. Comply with NFPA 80 for fire-rated doors.
- D. Factory-Fitted Doors: Align in frames for uniform clearance at each edge.
- E. Factory-Finished Doors: Restore finish before installation if fitting or machining is required at Project site.

END OF SECTION 08211

SECTION 08311 - ACCESS DOORS AND FRAMES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes access doors and frames for walls and ceilings.

1.2 SUBMITTALS

- A. Product Data: For each type of access door and frame indicated.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
- C. Samples: For each door face material in specified finish.
- D. Schedule: Types, locations, sizes, latching or locking provisions, and other data pertinent to installation.

1.3 QUALITY ASSURANCE

- A. Fire-Rated Access Doors and Frames: Units complying with NFPA 80 that are identical to assemblies tested for fire-test-response characteristics per the following test method and that are listed and labeled by UL or another testing and inspecting agency acceptable to authorities having jurisdiction:
 - 1. NFPA 252 for vertical access doors and frames.
 - 2. ASTM E 119 for horizontal access doors and frames.

1.4 COORDINATION

- A. Verification: Determine specific locations and sizes for access doors needed to gain access to concealed plumbing, mechanical, or other concealed work, and indicate in the schedule specified in "Submittals" Article.

PART 2 - PRODUCTS

2.1 STEEL MATERIALS

- A. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
 - 1. ASTM A 123/A 123M, for galvanizing steel and iron products.

- B. Rolled-Steel Floor Plate: ASTM A 786/A 786M, rolled from plate complying with ASTM A 36/A 36M or ASTM A 283/A 283M, Grade C or D.
 - 1. ASTM A 123/A 123M, for galvanizing steel and iron products.
- C. Steel Sheet: Uncoated or electrolytic zinc-coated, ASTM A 591/A 591M with cold-rolled steel sheet substrate complying with ASTM A 1008/A 1008M, Commercial Steel (CS), exposed.
- D. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS) with A60 zinc-iron-alloy (galvannealed) coating or G60 mill-phosphatized zinc coating.
- E. Drywall Beads: 0.0299-inch zinc-coated steel sheet to receive joint compound.
- F. Manufacturer's standard finish.

2.2 ACCESS DOORS AND FRAMES FOR WALLS AND CEILINGS

- A. Flush Access Doors and Trimless Frames: Fabricated from steel sheet.
 - 1. Locations: Wall and ceiling surfaces.
 - 2. Door: Minimum 0.060-inch thick sheet metal.
 - 3. Frame: Minimum 0.060-inch thick sheet metal with drywall bead flange.
 - 4. Hinges: Concealed-pin type.
 - 5. Latch: Cam latch with interior release.
- B. Fire-Rated, Insulated, Flush Access Doors and Trimless Frames: Fabricated from steel sheet.
 - 1. Locations: Wall and ceiling surfaces.
 - 2. Fire-Resistance Rating: Not less than that of adjacent construction.
 - 3. Temperature Rise Rating: 250 deg F at the end of 30 minutes.
 - 4. Door: Flush panel with a core of mineral-fiber insulation enclosed in sheet metal with a minimum thickness of 0.036 inch.
 - 5. Frame: Minimum 0.060-inch thick sheet metal with drywall bead.
 - 6. Hinges: Concealed-pin type.
 - 7. Latch: Self-latching device operated by ring turn with interior release.

2.3 FABRICATION

- A. General: Provide access door and frame assemblies manufactured as integral units ready for installation.
- B. Metal Surfaces: For metal surfaces exposed to view, provide materials with smooth, flat surfaces without blemishes.
- C. Doors and Frames: Grind exposed welds smooth and flush with adjacent surfaces. Furnish attachment devices and fasteners of type required to secure access panels to types of supports indicated.

- D. Latching Mechanisms: Furnish number required to hold doors in flush, smooth plane when closed.

1. For cylinder lock, furnish two keys per lock and key all locks alike.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with manufacturer's written instructions for installing access doors and frames.
- B. Set frames accurately in position and attach securely to supports with plane of face panels aligned with adjacent finish surfaces.
- C. Install doors flush with adjacent finish surfaces or recessed to receive finish material.

3.2 ADJUSTING AND CLEANING

- A. Adjust doors and hardware after installation for proper operation.
- B. Remove and replace doors and frames that are warped, bowed, or otherwise damaged.

END OF SECTION 08311

SECTION 08331 - OVERHEAD COILING DOORS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:

- 1. Service doors.

- B. Related Sections:

- 1. Division 5 Section "Metal Fabrications" for miscellaneous steel supports.
 - 2. Division 9 Section "Exterior Painting" and "Interior Painting" for finish painting of factory-primed doors.

1.3 SUBMITTALS

- A. Product Data: For each type and size of overhead coiling door and accessory. Include the following:

- 1. Construction details, material descriptions, dimensions of individual components, profiles for slats, and finishes.
 - 2. Rated capacities, operating characteristics, and furnished accessories.

- B. Shop Drawings: For each installation and for special components not dimensioned or detailed in manufacturer's product data. Include plans, elevations, sections, details, and attachments to other work.

- 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.

- C. Samples for Initial Selection: Manufacturer's finish charts showing full range of colors and textures available for units with factory-applied finishes.

- D. Samples for Verification: For each type of exposed finish required.

- E. Qualification Data: For qualified Installer.

- F. Maintenance Data: For overhead coiling doors to include in maintenance manuals.

1.4 QUALITY ASSURANCE

- A. **Installer Qualifications:** Manufacturer's authorized representative who is trained and approved for both installation and maintenance of units required for this Project.
- B. **Source Limitations:** Obtain overhead coiling doors from single source from single manufacturer.
 - 1. Obtain operators and controls from overhead coiling door manufacturer.

PART 2 - PRODUCTS

2.1 DOOR CURTAIN MATERIALS AND CONSTRUCTION

- A. **Door Curtains:** Fabricate overhead coiling-door curtain of interlocking metal slats, designed to withstand wind loading indicated, in a continuous length for width of door without splices. Unless otherwise indicated, provide slats of thickness and mechanical properties recommended by door manufacturer for performance, size, and type of door indicated, and as follows:
 - 1. **Steel Door Curtain Slats:** Zinc-coated (galvanized), cold-rolled structural steel sheet; complying with ASTM A 653/A 653M, with G90 zinc coating; nominal sheet thickness (coated) of 0.028 inch and as required to meet requirements.
- B. **Endlocks and Windlocks for Service Doors:** Malleable-iron casings galvanized after fabrication, secured to curtain slats with galvanized rivets or high-strength nylon. Provide locks on not less than alternate curtain slats for curtain alignment and resistance against lateral movement.
- C. **Bottom Bar for Service Doors:** Consisting of two angles, each not less than 1-1/2 by 1-1/2 by 1/8 inch thick; fabricated from manufacturer's standard hot-dip galvanized steel, stainless steel, or aluminum extrusions to match curtain slats and finish.
- D. **Curtain Jamb Guides:** Manufacturer's standard angles or channels and angles of same material and finish as curtain slats unless otherwise indicated, with sufficient depth and strength to retain curtain, to allow curtain to operate smoothly, and to withstand loading. Slot bolt holes for guide adjustment. Provide removable stops on guides to prevent overtravel of curtain, and a continuous bar for holding windlocks.

2.2 HOOD

- A. **General:** Form sheet metal hood to entirely enclose coiled curtain and operating mechanism at opening head. Contour to fit end brackets to which hood is attached. Roll and reinforce top and bottom edges for stiffness. Form closed ends for surface-mounted hoods and fascia for any portion of between-jamb mounting that projects beyond wall face. Equip hood with intermediate support brackets as required to prevent sagging.
 - 1. **Galvanized Steel:** Nominal 0.028-inch thick, hot-dip galvanized steel sheet with G90 zinc coating, complying with ASTM A 653/A 653M.

2.3 LOCKING DEVICES

- A. Slide Bolt: Fabricate with side-locking bolts to engage through slots in tracks for locking by padlock, located on both left and right jamb sides, operable from coil side.

2.4 CURTAIN ACCESSORIES

- A. Weatherseals: Equip each exterior door with weather-stripping gaskets fitted to entire perimeter of door for a weathertight installation, unless otherwise indicated.
 - 1. At door head, use 1/8-inch thick, replaceable, continuous sheet secured to inside of hood.
 - 2. At door jambs, use replaceable, adjustable, continuous, flexible, 1/8-inch thick seals of flexible vinyl, rubber, or neoprene.
- B. Push/Pull Handles: Equip each push-up-operated or emergency-operated door with lifting handles on each side of door, finished to match door.
 - 1. Provide pull-down straps or pole hooks for doors more than 84 inches high.

2.5 COUNTERBALANCING MECHANISM

- A. General: Counterbalance doors by means of manufacturer's standard mechanism with an adjustable-tension, steel helical torsion spring mounted around a steel shaft and contained in a spring barrel connected to top of curtain with barrel rings. Use grease-sealed bearings or self-lubricating graphite bearings for rotating members.
- B. Counterbalance Barrel: Fabricate spring barrel of manufacturer's standard hot-formed, structural-quality, welded or seamless carbon-steel pipe, of sufficient diameter and wall thickness to support rolled-up curtain without distortion of slats and to limit barrel deflection to not more than 0.03 in./ft. of span under full load.
- C. Spring Balance: One or more oil-tempered, heat-treated steel helical torsion springs. Size springs to counterbalance weight of curtain, with uniform adjustment accessible from outside barrel. Secure ends of springs to barrel and shaft with cast-steel barrel plugs.
- D. Torsion Rod for Counterbalance Shaft: Fabricate of manufacturer's standard cold-rolled steel, sized to hold fixed spring ends and carry torsional load.
- E. Brackets: Manufacturer's standard mounting brackets of either cast iron or cold-rolled steel plate.

2.6 MANUAL DOOR OPERATORS

- A. Equip door with manufacturer's recommended manual door operator unless another type of door operator is indicated.
- B. Push-up Door Operation: Design counterbalance mechanism so required lift or pull for door operation does not exceed 25 lbf.

2.7 DOOR ASSEMBLY

- A. Service Door: Overhead coiling door formed with curtain of interlocking metal slats.
- B. Operation Cycles: Not less than 20,000.
- C. Door Curtain Material: Galvanized steel.
- D. Door Curtain Slats: Curved profile slats of 1-1/2-inch center-to-center height.
- E. Curtain Jamb Guides: Galvanized steel.
- F. Hood: Match curtain material and finish.
 - 1. Shape: Round.
 - 2. Mounting: Face of wall.
- G. Locking Devices: Equip door with slide bolt for padlock.
 - 1. Locking Device Assembly: Single-jamb side.
- H. Manual Door Operator: Push-up operation.
- I. Door Finish:
 - 1. Factory Prime Finish: Manufacturer's standard color.
 - 2. Interior Curtain-Slat Facing: Match finish of exterior curtain-slat face.

2.8 GENERAL FINISH REQUIREMENTS

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
- B. Appearance of Finished Work: Noticeable variations in same piece are not acceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.

2.9 STEEL AND GALVANIZED-STEEL FINISHES

- A. Factory Prime Finish: Manufacturer's standard primer, compatible with field-applied finish. Comply with coating manufacturer's written instructions for cleaning, pretreatment, application, and minimum dry film thickness.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates areas and conditions, with Installer present, for compliance with requirements for substrate construction and other conditions affecting performance of the Work.

- B. Examine locations of electrical connections.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Install overhead coiling doors and operating equipment complete with necessary hardware, anchors, inserts, hangers, and equipment supports; according to manufacturer's written instructions and as specified.
- B. Install overhead coiling doors, hoods, and operators at the mounting locations indicated for each door.
- C. Accessibility: Install overhead coiling doors, switches, and controls along accessible routes in compliance with regulatory requirements for accessibility.

3.3 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
 - 1. Perform installation and startup checks according to manufacturer's written instructions.
 - 2. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

3.4 ADJUSTING

- A. Adjust hardware and moving parts to function smoothly so that doors operate easily, free of warp, twist, or distortion.
- B. Lubricate bearings and sliding parts as recommended by manufacturer.
- C. Adjust seals to provide weathertight fit around entire perimeter.

3.5 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain overhead coiling doors.

END OF SECTION 08331

SECTION 08411 - ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Exterior and interior storefront framing.
2. Storefront framing for window walls.
3. Storefront framing for ribbon walls.
4. Storefront framing for punched openings.
5. Exterior manual-swing entrance doors and door frame units.

1.2 PERFORMANCE REQUIREMENTS

A. General Performance: Aluminum-framed systems shall withstand the effects of the following performance requirements without exceeding performance criteria or failure due to defective manufacture, fabrication, installation, or other defects in construction:

1. Movements of supporting structure indicated on Drawings including, but not limited to, story drift and deflection from uniformly distributed and concentrated live loads.
2. Dimensional tolerances of building frame and other adjacent construction.
3. Failure includes the following:
 - a. Deflection exceeding specified limits.
 - b. Thermal stresses transferring to building structure.
 - c. Framing members transferring stresses, including those caused by thermal and structural movements to glazing.
 - d. Noise or vibration created by wind and by thermal and structural movements.
 - e. Loosening or weakening of fasteners, attachments, and other components.
 - f. Failure of operating units.

B. Delegated Design: Design aluminum-framed systems, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

C. Wind Loads: As shown on structural drawings.

D. Deflection of Framing Members:

1. Deflection Normal to Wall Plane: Limited to edge of glass in a direction perpendicular to glass plane shall not exceed $L/175$ of the glass edge length for each individual glazing lite or an amount that restricts edge deflection of individual glazing lites to $3/4$ inch, whichever is less.
2. Deflection Parallel to Glazing Plane: Limited to $L/360$ of clear span or $1/8$ inch, whichever is smaller.

- E. **Structural-Test Performance:** Provide aluminum-framed systems tested according to ASTM E 330 as follows:
 - 1. When tested at 150 percent of positive and negative wind-load design pressures, systems, including anchorage, do not evidence material failures, structural distress, and permanent deformation of main framing members exceeding 0.2 percent of span.
 - 2. Test Durations: 10 seconds.
- F. **Air Infiltration:** Provide aluminum-framed systems with maximum air leakage through fixed glazing and framing areas of 0.06 cfm/sq. ft. of fixed wall area when tested according to ASTM E 283 at a minimum static-air-pressure difference of 1.57 lbf/sq. ft.
- G. **Water Penetration under Static Pressure:** Provide aluminum-framed systems that do not evidence water penetration through fixed glazing and framing areas when tested according to ASTM E 331 at a minimum static-air-pressure difference of 20 percent of positive wind-load design pressure, but not less than 6.24 lbf/sq. ft.

1.3 SUBMITTALS

- A. **Product Data:** For each type of product indicated.
- B. **Shop Drawings:** For aluminum-framed systems. Include plans, elevations, sections, details, and attachments to other work.
 - 1. Include details of provisions for system expansion and contraction and for drainage of moisture in the system to the exterior.
- C. **Samples:** For each type of exposed finish required.
- D. **Other Action Submittals:**
 - 1. **Entrance Door Hardware Schedule:** Prepared by or under the supervision of supplier, detailing fabrication and assembly of entrance door hardware, as well as procedures and diagrams.
- E. **Delegated-Design Submittal:** For aluminum-framed systems indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
- F. **Product test reports.**
- G. **Field quality-control reports.**
- H. **Maintenance data.**
- I. **Warranties:** Sample of special warranties.

1.4 QUALITY ASSURANCE

- A. **Installer Qualifications:** Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. **Testing Agency Qualifications:** Qualified according to ASTM E 699 for testing indicated.
- C. **Engineering Responsibility:** Prepare data for aluminum-framed systems, including Shop Drawings, based on testing and engineering analysis of manufacturer's standard units in systems similar to those indicated for this Project.
- D. **Product Options:** Information on Drawings and in Specifications establishes requirements for systems' aesthetic effects and performance characteristics. Aesthetic effects are indicated by dimensions, arrangements, alignment, and profiles of components and assemblies as they relate to sightlines, to one another, and to adjoining construction. Performance characteristics are indicated by criteria subject to verification by one or more methods including preconstruction testing, field testing, and in-service performance.
- E. **Accessible Entrances:** Comply with applicable provisions in the U.S. Architectural & Transportation Barriers Compliance Board's ADA-ABA Accessibility Guidelines.
- F. **Source Limitations for Aluminum-Framed Systems:** Obtain from single source from single manufacturer.
- G. **Preinstallation Conference:** Conduct conference at Project site.

1.5 WARRANTY

- A. **Special Warranty:** Manufacturer's standard form in which manufacturer agrees to repair or replace components of aluminum-framed systems that do not comply with requirements or that fail in materials or workmanship within specified warranty period.
 - 1. **Warranty Period:** 10 years from date of Substantial Completion.
- B. **Special Finish Warranty:** Manufacturer's standard form in which manufacturer agrees to repair or replace components on which finishes do not comply with requirements or that fail in materials or workmanship within specified warranty period. Warranty does not include normal weathering.
 - 1. **Warranty Period:** 20 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. **Basis-of-Design Product:** Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. **EFCO Corporation.**

2. Kawneer North America; an Alcoa company.
3. Vistawall Architectural Products; The Vistawall Group; a Bluescope Steel company.

2.2 MATERIALS

- A. Aluminum: Alloy and temper recommended by manufacturer for type of use and finish indicated.
 1. Sheet and Plate: ASTM B 209.
 2. Extruded Bars, Rods, Profiles, and Tubes: ASTM B 221.
 3. Extruded Structural Pipe and Tubes: ASTM B 429.
 4. Structural Profiles: ASTM B 308/B 308M.
 5. Welding Rods and Bare Electrodes: AWS A5.10/A5.10M.
- B. Steel Reinforcement: Manufacturer's standard zinc-rich, corrosion-resistant primer, complying with SSPC-PS Guide No. 12.00; applied immediately after surface preparation and pretreatment. Select surface preparation methods according to recommendations in SSPC-SP COM and prepare surfaces according to applicable SSPC standard.
 1. Structural Shapes, Plates, and Bars: ASTM A 36/A 36M.
 2. Cold-Rolled Sheet and Strip: ASTM A 1008/A 1008M.
 3. Hot-Rolled Sheet and Strip: ASTM A 1011/A 1011M.

2.3 FRAMING SYSTEMS

- A. Framing Members: Manufacturer's standard extruded-aluminum framing members of thickness required and reinforced as required to support imposed loads.
 1. Construction: Thermally broken.
 2. Glazing System: Retained mechanically with gaskets on four sides.
 3. Glazing Plane: As indicated.
- B. Brackets and Reinforcements: Manufacturer's standard high-strength aluminum with nonstaining, nonferrous shims for aligning system components.
- C. Fasteners and Accessories: Manufacturer's standard corrosion-resistant, nonstaining, nonbleeding fasteners and accessories compatible with adjacent materials.
 1. Use self-locking devices where fasteners are subject to loosening or turning out from thermal and structural movements, wind loads, or vibration.
 2. Reinforce members as required to receive fastener threads.
 3. Use exposed fasteners with countersunk Phillips screw heads, finished to match framing system.
- D. Concrete and Masonry Inserts: Hot-dip galvanized cast-iron, malleable-iron, or steel inserts, complying with ASTM A 123/A 123M or ASTM A 153/A 153M.
- E. Concealed Flashing: Manufacturer's standard corrosion-resistant, nonstaining, nonbleeding flashing compatible with adjacent materials.

- F. Framing System Gaskets and Sealants: Manufacturer's standard, recommended by manufacturer for joint type.

2.4 GLAZING SYSTEMS

- A. Glazing: As specified in Division 8 Section "Glazing."
- B. Glazing Gaskets: Manufacturer's standard compression types; replaceable, molded or extruded, of profile and hardness required to maintain watertight seal.
- C. Spacers and Setting Blocks: Manufacturer's standard elastomeric type.

2.5 ENTRANCE DOOR SYSTEMS

- A. Entrance Doors: Manufacturer's standard glazed entrance doors for manual-swing operation.
 - 1. Door Construction: 1-3/4-inch overall thickness, with minimum 0.125-inch thick, extruded-aluminum tubular rail and stile members. Mechanically fasten corners with reinforcing brackets that are deeply penetrated and fillet welded or that incorporate concealed tie rods.
 - a. Thermal Construction: High-performance plastic connectors separate aluminum members exposed to the exterior from members exposed to the interior.
 - 2. Door Design: Medium stile; 3-1/2-inch nominal width.
 - a. Accessible Doors: Smooth surfaced for width of door in area within 10 inches above floor or ground plane.
 - 3. Glazing Stops and Gaskets: Square, snap-on, extruded-aluminum stops and preformed gaskets.
 - a. Provide nonremovable glazing stops on outside of door.
- B. Entrance Door Hardware: As specified in Division 8 Section "Door Hardware."

2.6 ENTRANCE DOOR HARDWARE

- A. General: Provide entrance door hardware for each entrance door to comply with requirements in this Section and as selected by Architect from manufacturer's full range.
 - 1. Entrance Door Hardware Sets: Provide quantity, item, size, finish or color indicated, and products complying with BHMA standard referenced.
 - 2. Sequence of Operation: Provide electrified door hardware function, sequence of operation, and interface with other building control systems indicated.
 - 3. Opening-Force Requirements:

- a. Egress Doors: Not more than 15 lbf to release the latch and not more than 30 lbf to set the door in motion and not more than 15 lbf to open the door to its minimum required width.
 - b. Accessible Interior Doors: Not more than 5 lbf to fully open door.
- B. Opening-Force Requirements:
 - 1. Latches and Exit Devices: Not more than 15 lbf. required to release latch.
- C. Pivot Hinges: BHMA A156.4, Grade 1.
 - 1. Offset-Pivot Hinges: Provide top, bottom, and intermediate offset pivots at each door leaf.
- D. Mortise Auxiliary Locks: BHMA A156.5, Grade 1.
- E. Manual Flush Bolts: BHMA A156.16, Grade 1.
- F. Automatic and Self-Latching Flush Bolts: BHMA A156.3, Grade 1.
- G. Panic Exit Devices: BHMA A156.3, Grade 1, listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for panic protection, based on testing according to UL 305.
- H. Cylinders: As specified in Division 8 Section "Door Hardware."
 - 1. Keying: Master key system. Permanently inscribe each key with a visual key control number and include notation "DO NOT DUPLICATE".
- I. Strikes: Provide strike with black-plastic dust box for each latch or lock bolt; fabricated for aluminum framing.
- J. Operating Trim: BHMA A156.6.
- K. Concealed Closers: BHMA A156.4, Grade 1, with accessories required for a complete installation, sized as required by door size, exposure to weather, and anticipated frequency of use; adjustable to meet field conditions and requirements for opening force.
- L. Concealed Overhead Holders: BHMA A156.8, Grade 1.
- M. Surface-Mounted Holders: BHMA A156.16, Grade 1.
- N. Door Stops: BHMA A156.16, Grade 1, floor or wall mounted, as appropriate for door location indicated, with integral rubber bumper.
- O. Weather Stripping: Manufacturer's standard replaceable components.
- P. Weather Sweeps: Manufacturer's standard exterior-door bottom sweep with concealed fasteners on mounting strip.
- Q. Silencers: BHMA A156.16, Grade 1.

- R. Thresholds: BHMA A156.21, raised thresholds beveled with a slope of not more than 1:2, with maximum height of 1/2 inch.
- S. Finger Guards: Manufacturer's standard collapsible neoprene or PVC gasket anchored to frame hinge-jamb at center-pivoted doors.

2.7 ACCESSORY MATERIALS

- A. Bituminous Paint: Cold-applied, asphalt-mastic paint complying with SSPC-Paint 12 requirements except containing no asbestos; formulated for 30-mil thickness per coat.

2.8 FABRICATION

- A. Form or extrude aluminum shapes before finishing.
- B. Weld in concealed locations to greatest extent possible to minimize distortion or discoloration of finish. Remove weld spatter and welding oxides from exposed surfaces by descaling or grinding.
- C. Framing Members, General: Fabricate components that, when assembled, have the following characteristics:
 - 1. Profiles that are sharp, straight, and free of defects or deformations.
 - 2. Accurately fitted joints with ends coped or mitered.
 - 3. Means to drain water passing joints, condensation within framing members, and moisture migrating within the system to exterior.
 - 4. Physical and thermal isolation of glazing from framing members.
 - 5. Accommodations for thermal and mechanical movements of glazing and framing to maintain required glazing edge clearances.
 - 6. Provisions for field replacement of glazing from exterior.
 - 7. Fasteners, anchors, and connection devices that are concealed from view to greatest extent possible.
- D. Mechanically Glazed Framing Members: Fabricate for flush glazing without projecting stops.
- E. Entrance Door Frames: Reinforce as required to support loads imposed by door operation and for installing entrance door hardware.
- F. Entrance Doors: Reinforce doors as required for installing entrance door hardware.
- G. Entrance Door Hardware Installation: Factory install entrance door hardware to the greatest extent possible. Cut, drill, and tap for factory-installed entrance door hardware before applying finishes.
- H. After fabrication, clearly mark components to identify their locations in Project according to Shop Drawings.

2.9 ALUMINUM FINISHES

- A. High-Performance Organic Finish: 4-coat fluoropolymer finish complying with AAMA 2605 and containing not less than 70 percent PVDF resin by weight in both color coat and clear topcoat.
 - 1. Color and Gloss: As selected by Architect from manufacturer's full range.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General:
 - 1. Comply with manufacturer's written instructions.
 - 2. Do not install damaged components.
 - 3. Fit joints to produce hairline joints free of burrs and distortion.
 - 4. Rigidly secure nonmovement joints.
 - 5. Install anchors with separators and isolators to prevent metal corrosion and electrolytic deterioration.
 - 6. Seal joints watertight unless otherwise indicated.
- B. Metal Protection:
 - 1. Where aluminum will contact dissimilar metals, protect against galvanic action by painting contact surfaces with primer or applying sealant or tape, or by installing nonconductive spacers as recommended by manufacturer for this purpose.
 - 2. Where aluminum will contact concrete or masonry, protect against corrosion by painting contact surfaces with bituminous paint.
- C. Install components to drain water passing joints, condensation occurring within framing members, and moisture migrating within the system to exterior.
- D. Set continuous sill members and flashing in full sealant bed as specified in Division 7 Section "Joint Sealants" to produce weathertight installation.
- E. Install components plumb and true in alignment with established lines and grades, and without warp or rack.
- F. Install glazing as specified in Division 8 Section "Glazing."
- G. Entrance Doors: Install doors to produce smooth operation and tight fit at contact points.
 - 1. Exterior Doors: Install to produce weathertight enclosure and tight fit at weather stripping.
 - 2. Field-Installed Entrance Door Hardware: Install surface-mounted entrance door hardware according to entrance door hardware manufacturers' written instructions using concealed fasteners to greatest extent possible.

3.2 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections.
- B. Testing Services: Testing and inspecting of representative areas to determine compliance of installed systems with specified requirements shall take place as follows. Do not proceed with installation of the next area until test results for previously completed areas show compliance with requirements.
 - 1. Water Spray Test: Before installation of interior finishes has begun, areas designated by Architect shall be tested according to AAMA 501.2 and shall not evidence water penetration.
 - a. Test Area: A minimum area of 75 feet by 1 story of aluminum-framed systems.
- C. Repair or remove work if test results and inspections indicate that it does not comply with specified requirements.
- D. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.
- E. Aluminum-framed assemblies will be considered defective if they do not pass tests and inspections.
- F. Prepare test and inspection reports.

END OF SECTION 08411

SECTION 08710 - DOOR HARDWARE**PART 1 - GENERAL****1.1 SUMMARY**

- A. This Section includes the following:
 - 1. Commercial door hardware.
 - 2. Cylinders for doors specified in other Sections.
- B. See Division 8 door sections for astragals and door silencers.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Details of electrified door hardware, including wiring diagrams.
- C. Other Action Submittals:
 - 1. Door Hardware Sets: Prepared by or under the supervision of Installer, detailing fabrication and assembly of door hardware, as well as procedures and diagrams.
 - a. Format: Use same scheduling sequence and format and use same door numbers as in the Contract Documents.
 - b. Content: Include the following information:
 - 1) Identification number, location, hand, fire rating, and material of each door and frame.
 - 2) Type, style, function, size, quantity, and finish of each door hardware item. Include description and function of each lockset and exit device.
 - 3) Complete designations of every item required for each door or opening including name and manufacturer.
 - 4) Description of each electrified door hardware function, including location, sequence of operation, and interface with other building control systems.
 - 2. Keying Schedule: Prepared under the supervision of the Architect, detailing Owner's final keying instructions for locks.

1.3 QUALITY ASSURANCE

- A. Installer Qualifications: An employer of workers trained and approved by lock manufacturer.
 - 1. Installer's responsibilities include supplying and installing door hardware and providing a qualified Architectural Hardware Consultant available during the course of the Work to consult with Contractor, Architect, and Owner about door hardware and keying.

- B. Architectural Hardware Consultant Qualifications: A person who is currently certified by DHI as an Architectural Hardware Consultant and who is experienced in providing consulting services for door hardware installations that are comparable in material, design, and extent to that indicated for this Project.
- C. Source Limitations: Provide electrified door hardware from same manufacturer as mechanical door hardware, unless otherwise indicated. Manufacturers that perform electrical modifications and that are listed by a testing and inspecting agency acceptable to authorities having jurisdiction are acceptable.
- D. Fire-Rated Door Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to NFPA 252.
 - 1. Test Pressure: Test at atmospheric pressure.
- E. Keying Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination." Incorporate keying conference decisions into final keying schedule after reviewing door hardware keying system.
- F. Preinstallation Conference: Conduct conference at Project site.

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Deliver keys to Owner by registered mail or overnight package service.

1.5 COORDINATION

- A. Templates: Distribute door hardware templates for doors, frames, and other work specified to be factory prepared for installing door hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing door hardware to comply with indicated requirements.

1.6 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of door hardware that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: Three years from date of Substantial Completion, except as follows:
 - a. Electromagnetic Locks: Five years from date of Substantial Completion.
 - b. Exit Devices: Two years from date of Substantial Completion.
 - c. Manual Closers: 10 years from date of Substantial Completion.
 - d. Concealed Floor Closers: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in this Section.
 - 1. Door Hardware Sets: Provide quantity, item, size, finish or color indicated, and products complying with BHMA standard referenced.

2.2 HINGES, GENERAL

- A. Template Requirements: Except for hinges and pivots to be installed entirely (both leaves) into wood doors and frames, provide only template-produced units.
- B. Hinge Base Metal: Unless otherwise indicated, provide the following:
 - 1. Exterior Hinges: Stainless steel, with stainless-steel pin.
 - 2. Interior Hinges: Stainless steel, with stainless-steel pin.
 - 3. Hinges for Fire-Rated Assemblies: Stainless steel, with stainless-steel pin.
- C. Nonremovable Pins: Provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for outswinging exterior doors.
- D. Fasteners: Comply with the following:
 - 1. Machine Screws: For metal doors and frames. Install into drilled and tapped holes.
 - 2. Wood Screws: For wood doors and frames.
 - 3. Threaded-to-the-Head Wood Screws: For fire-rated wood doors.
 - 4. Screws: Phillips flat-head; machine screws (drilled and tapped holes) for metal doors. Finish screw heads to match surface of hinges.

2.3 HINGES

- A. Butts and Hinges: BHMA A156.1.
- B. Template Hinge Dimensions: BHMA A156.7.
- C. Available Manufacturers:
 - 1. Baldwin Hardware Corporation (BH).
 - 2. Hager Companies (HAG).
 - 3. McKinney Products Company; an ASSA ABLOY Group company (MCK).
 - 4. Stanley Commercial Hardware; Div. of The Stanley Works (STH).

2.4 LOCKS AND LATCHES, GENERAL

- A. Accessibility Requirements: Provide operating devices that do not require tight grasping, pinching, or twisting of the wrist and that operate with a force of not more than 5 lbf (22 N).

- B. Latches and Locks for Means of Egress Doors: Comply with NFPA 101. Latches shall not require more than 15 lbf to release the latch. Locks shall not require use of a key, tool, or special knowledge for operation.
- C. Electrified Locking Devices: BHMA A156.25.
- D. Lock Trim:
 - 1. Levers: As selected from manufacturer's full range.
 - 2. Dummy Trim: Match lever lock trim and escutcheons.
- E. Lock Throw: Comply with testing requirements for length of bolts required for labeled fire doors.
- F. Backset: 2-3/4 inches, unless otherwise indicated.
- G. Strikes: Manufacturer's standard strike with strike box for each latchbolt or lock bolt, with curved lip extended to protect frame, finished to match door hardware set.

2.5 MECHANICAL LOCKS AND LATCHES

- A. Lock Functions: Function numbers and descriptions indicated in door hardware sets comply with the following:
 - 1. Mortise Locks: BHMA A156.13.
- B. Mortise Locks: Stamped steel case with steel or brass parts; BHMA A156.13, Grade 1 Series 1000.
 - 1. Available Manufacturers:
 - a. Corbin Russwin Architectural Hardware; an ASSA ABLOY Group company (CR).
 - b. SARGENT Manufacturing Company; an ASSA ABLOY Group company (SGT).
 - c. Schlage Commercial Lock Division; an Ingersoll-Rand Company (SCH).
 - d. Yale Commercial Locks and Hardware; an ASSA ABLOY Group company (YAL).
 - 2. Yale Commercial Locks and Hardware; an ASSA ABLOY Group company (YAL).

2.8 BOLTS

- A. Dustproof Strikes: BHMA A156.16, Grade 1.
- B. Manual Flush Bolts: BHMA A156.16, Grade 1; designed for mortising into door edge.
- C. Available Manufacturers:
 - a. Glynn-Johnson; an Ingersoll-Rand Company (GJ).
 - b. Hager Companies (HAG).
 - c. IVES Hardware; an Ingersoll-Rand Company (IVS).
 - d. Stanley Commercial Hardware; Div. of The Stanley Works (STH).

2.6 EXIT DEVICES

- A. Exit Devices: BHMA A156.3, Grade 1.
- B. Accessibility Requirements: Provide operating devices that do not require tight grasping, pinching, or twisting of the wrist and that operate with a force of not more than 5 lbf.
- C. Exit Devices for Means of Egress Doors: Comply with NFPA 101. Exit devices shall not require more than 15 lbf to release the latch. Locks shall not require use of a key, tool, or special knowledge for operation.
- D. Panic Exit Devices: Listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for panic protection, based on testing according to UL 305.
- E. Fire Exit Devices: Devices complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire and panic protection, based on testing according to UL 305 and NFPA 252.
- F. Outside Trim: Lever with cylinder; material and finish to match locksets, unless otherwise indicated.
 - 1. Match design for locksets and latchsets, unless otherwise indicated.
- G. Available Manufacturers:
 - 1. Corbin Russwin Architectural Hardware; an ASSA ABLOY Group company (CR).
 - 2. SARGENT Manufacturing Company; an ASSA ABLOY Group company (SGT).
 - 3. Von Duprin; an Ingersoll-Rand Company (VD).
 - 4. Yale Commercial Locks and Hardware; an ASSA ABLOY Group company (YAL).

2.7 LOCK CYLINDERS

- A. Standard Lock Cylinders: BHMA A156.5, Grade 1.
- B. Cylinders: Manufacturer's standard tumbler type, constructed from brass or bronze, stainless steel, or nickel silver, and complying with the following:
 - 1. Number of Pins: Seven.
 - 2. High-Security Grade: BHMA A156.5, Grade 1A, listed and labeled as complying with pick- and drill-resistant testing requirements in UL 437 (Suffix A).
- C. Permanent Cores: Manufacturer's standard; finish face to match lockset; with removable cores.
- D. Construction Keying: Comply with the following:
 - 1. Construction Master Keys: Provide cylinders with feature that permits voiding of construction keys without cylinder removal. Provide 10 construction master keys.
- E. Manufacturer: Same manufacturer as for locks and latches.

2.8 KEYING

- A. Keying System: Factory registered, complying with guidelines in BHMA A156.28, Appendix A. Incorporate decisions made in keying conference into grand master key system.
- B. Keys: Nickel silver; permanently inscribed with a visual key control number and including the notation "DO NOT DUPLICATE."
 - 1. Quantity: In addition to one extra key blank for each lock, provide three cylinder change keys and five grand master keys.

2.9 OPERATING TRIM

- A. Standard: BHMA A156.6.
- B. Materials: Fabricate from stainless steel, unless otherwise indicated.

2.10 CLOSERS

- A. Accessibility Requirements: Comply with the following maximum opening-force requirements:
 - 1. Interior, Non-Fire-Rated Hinged Doors: 5 lbf applied perpendicular to door.
 - 2. Fire Doors: Minimum opening force allowable by authorities having jurisdiction.
- B. Door Closers for Means of Egress Doors: Comply with NFPA 101. Door closers shall not require more than 30 lbf to set door in motion and not more than 15 lbf to open door to minimum required width.
- C. Hold-Open Closers/Detectors: Coordinate and interface integral smoke detector and closer device with fire alarm system.
- D. Flush Floor Plates: Provide finish cover plates for floor closers unless thresholds are indicated. Match door hardware finish, unless otherwise indicated.
- E. Size of Units: Unless otherwise indicated, comply with manufacturer's written recommendations for size of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Provide factory-sized closers, adjustable to meet field conditions and requirements for opening force.
- F. Surface Closers: BHMA A156.4, Grade 1. Provide type of arm required for closer to be located on non-public side of door, unless otherwise indicated.
 - 1. Available Manufacturers:
 - a. Corbin Russwin Architectural Hardware; an ASSA ABLOY Group company (CR).
 - b. LCN Closers; an Ingersoll-Rand Company (LCN).
 - c. SARGENT Manufacturing Company; an ASSA ABLOY Group company (SGT).
 - d. Yale Commercial Locks and Hardware; an ASSA ABLOY Group company (YAL).

G. Closer Holder Release Devices: BHMA A156.15.

1. Life-Safety Type: On release of hold open, door becomes self-closing. Automatic release is activated by smoke detection system.
2. Coordinators: BHMA A156.3.

2.11 STOPS AND HOLDERS

A. Stops and Bumpers: BHMA A156.16, Grade 1.

1. Provide floor stops for doors. Do not mount floor stops where they will impede traffic. Where floor stops are not appropriate, provide overhead holders.

B. Silencers for Door Frames: BHMA A156.16, Grade 1; neoprene or rubber; fabricated for drilled-in application to frame.

2.12 DOOR GASKETING

A. Standard: BHMA A156.22.

B. General: Provide continuous weather-strip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated or scheduled. Provide noncorrosive fasteners for exterior applications and elsewhere as indicated.

1. Perimeter Gasketing: Apply to head and jamb, forming seal between door and frame.
2. Meeting Stile Gasketing: Fasten to meeting stiles, forming seal when doors are closed.
3. Door Bottoms: Apply to bottom of door, forming seal with threshold when door is closed.

C. Smoke-Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke-control ratings indicated, based on testing according to UL 1784.

1. Provide smoke-labeled gasketing on 20-minute-rated doors and on smoke-labeled doors.

D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated, based on testing according to ASTM E 1408.

E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.

F. Gasketing Materials: ASTM D 2000 and AAMA 701/702.

2.13 THRESHOLDS

A. Standard: BHMA A156.21.

- B. Accessibility Requirements: Bevel raised thresholds with a slope of not more than 1:2. Provide thresholds not more than 1/2 inch.
- C. Thresholds for Means of Egress Doors: Comply with NFPA 101. Maximum 1/2 inch high.

2.14 FABRICATION

- A. Base Metals: Produce door hardware units of base metal, fabricated by forming method indicated, using manufacturer's standard metal alloy, composition, temper, and hardness. Furnish metals of a quality equal to or greater than that of specified door hardware units and BHMA A156.18. Do not furnish manufacturer's standard materials or forming methods if different from specified standard.
- B. Fasteners: Provide screws according to commercially recognized industry standards for application intended, except aluminum fasteners are not permitted. Provide Phillips flat-head screws with finished heads to match surface of door hardware, unless otherwise indicated.
 - 1. Comply with NFPA 80 for fasteners of door hardware in fire-rated applications.
- C. Finishes: BHMA A156.18, as indicated in door hardware sets.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Steel Doors and Frames: Comply with DHI A115 Series. Drill and tap doors and frames for surface-applied door hardware according to ANSI A250.6.
- B. Wood Doors: Comply with DHI A115-W Series.
- C. Mounting Heights: Mount door hardware units at heights indicated as follows unless otherwise indicated or required to comply with governing regulations.
 - 1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 - 2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
- D. Install each door hardware item to comply with manufacturer's written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9 Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.
- E. Key Control System: Tag keys and place them on markers and hooks in key control system cabinet, as determined by final keying schedule.

- F. **Boxed Power Supplies:** Locate power supplies as indicated or, if not indicated, above accessible ceilings. Verify location with Architect.
 - 1. **Configuration:** Provide the least number of power supplies required to adequately serve doors with electrified door hardware.
- G. **Thresholds:** Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- H. **Adjustment:** Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.
 - 1. **Door Closers:** Unless otherwise required by authorities having jurisdiction, adjust sweep period so that, from an open position of 70 degrees, the door will take at least 3 seconds to move to a point 3 inches from the latch, measured to the leading edge of the door.

END OF SECTION 08710

SECTION 08800 - GLAZING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes glazing for the following products and applications, including those specified in other Sections where glazing requirements are specified by reference to this Section:
 - 1. Windows.
 - 2. Doors.
 - 3. Glazed entrances.
 - 4. Interior borrowed lites.
 - 5. Storefront framing.

1.2 DEFINITIONS

- A. Interspace: Space between lites of an insulating-glass unit that contains dehydrated air or a specified gas.
- B. Deterioration of Coated Glass: Defects developed from normal use that are attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning coated glass contrary to manufacturer's written instructions. Defects include peeling, cracking, and other indications of deterioration in metallic coating.
- C. Deterioration of Insulating Glass: Failure of hermetic seal under normal use that is attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning insulating glass contrary to manufacturer's written instructions. Evidence of failure is the obstruction of vision by dust, moisture, or film on interior surfaces of glass.

1.3 PERFORMANCE REQUIREMENTS

- A. General: Provide glazing systems capable of withstanding normal thermal movement and wind and impact loads (where applicable) without failure, including loss or glass breakage attributable to the following: defective manufacture, fabrication, and installation; failure of sealants or gaskets to remain watertight and airtight; deterioration of glazing materials; or other defects in construction.
- B. Glass Design: Glass thickness designations indicated are minimums and are for detailing only. Confirm glass thicknesses by analyzing Project loads and in-service conditions. Provide glass lites in the thickness designations indicated for various size openings, but not less than thicknesses and in strengths (annealed or heat treated) required to meet or exceed the following criteria:

1. Glass Thicknesses: Select minimum glass thicknesses to comply with ASTM E 1300, according to the following requirements:
 - a. Specified Design Wind Loads: As required by the North Carolina Building Code, but not less than wind loads applicable to Project as required by ASCE 7 "Minimum Design Loads for Buildings and Other Structures": Section 6.0 "Wind Loads."
 - b. Probability of Breakage for Vertical Glazing: 8 lites per 1000 for lites set vertically or not more than 15 degrees off vertical and under wind action.
 - 1) Load Duration: 60 seconds or less.
 - c. Minimum Glass Thickness for Exterior Lites: Not less than 6.0 mm.
 - d. Thickness of Tinted and Heat-Absorbing Glass: Provide the same thickness for each tint color indicated throughout Project.
- C. Thermal Movements: Provide glazing that allows for thermal movements resulting from the following maximum change (range) in ambient and surface temperatures acting on glass framing members and glazing components. Base engineering calculation on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
 1. Temperature Change (Range): 120 deg F ambient; 180 deg F, material surfaces.
- D. Thermal and Optical Performance Properties: Provide glass with performance properties specified based on manufacturer's published test data, as determined according to procedures indicated below:
 1. For monolithic-glass lites, properties are based on units with lites 6.0 mm thick.
 2. For insulating-glass units, properties are based on units of thickness indicated for overall unit and for each lite 6.0 mm thick and a nominal 1/2-inch wide interspace.
 3. Center-of-Glass Values: Based on using LBL-44789 WINDOW 5.0 computer program for the following methodologies:
 - a. U-Factors: NFRC 100 expressed as Btu/ sq. ft. x h x deg F.
 - b. Solar Heat Gain Coefficient: NFRC 200.
 - c. Solar Optical Properties: NFRC 300.

1.4 SUBMITTALS

- A. Product Data: For each glass product and glazing material indicated.
 1. Product Data for Credit EQ 4.1: For glazing sealants used inside of the weatherproofing system, including printed statement of VOC content.
- B. Samples: 12-inch square, for each type of glass product indicated, other than monolithic clear float glass.
- C. Glazing Schedule: Use same designations indicated on Drawings.
- D. Preconstruction Adhesion and Compatibility Test Report: From glazing sealant manufacturer.

1.5 QUALITY ASSURANCE

- A. Preconstruction Adhesion and Compatibility Testing: Submit to elastomeric glazing sealant manufacturers, for testing according to ASTM C 1087, samples of each glazing material type, tape sealant, gasket, glazing accessory, and glass-framing member that will contact or affect elastomeric glazing sealants:
- B. Safety Glazing Products: Comply with testing requirements in 16 CFR 1201 and, for wired glass, ANSI Z97.1.
- C. Glazing Publications: Comply with published recommendations of glass product manufacturers and organizations below, unless more stringent requirements are indicated. Refer to these publications for glazing terms not otherwise defined in this Section or in referenced standards.
 - 1. IGMA Publication for Insulating Glass: SIGMA TM-3000, "Glazing Guidelines for Sealed Insulating Glass Units."
- D. Insulating-Glass Certification Program: Permanently marked either on spacers or on at least one component lite of units with appropriate certification label of the Insulating Glass Certification Council.
- E. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.
 - 1. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

1.6 WARRANTY

- A. Manufacturer's Special Warranty for Coated-Glass Products: Manufacturer's standard form, made out to Owner and signed by coated-glass manufacturer agreeing to replace coated-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
 - 1. Warranty Period: 10 years from date of Substantial Completion.
- B. Manufacturer's Special Warranty on Insulating Glass: Manufacturer's standard form, made out to Owner and signed by insulating-glass manufacturer agreeing to replace insulating-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
 - 1. Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:

1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products specified.
2. Product: Subject to compliance with requirements, provide product specified.
3. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, manufacturers specified.

2.2 GLASS PRODUCTS

- A. Annealed Float Glass: ASTM C 1036, Type I (transparent flat glass), Quality-Q3; of class indicated.
 1. Ultra-Clear (Low-Iron) Float Glass: Class I (clear); with a minimum 91 percent visible light transmission and a minimum solar heat gain coefficient of 0.87.
- B. Heat-Treated Float Glass: ASTM C 1048; Type I (transparent flat glass); Quality-Q3; of class, kind, and condition indicated.
 1. Fabrication Process: By horizontal (roller-hearth) process with roll-wave distortion parallel to bottom edge of glass as installed, unless otherwise indicated.
 2. Provide Kind HS (heat-strengthened) float glass in place of annealed float glass where needed to resist thermal stresses induced by differential shading of individual glass lites and to comply with glass design requirements specified in Part 1 "Performance Requirements" Article.
 3. For uncoated glass, comply with requirements for Condition A.
 4. For coated vision glass, comply with requirements for Condition C (other uncoated glass).
 5. Provide Kind FT (fully tempered) float glass in place of annealed or Kind HS (heat-strengthened) float glass where safety glass is indicated.
- C. Ceramic-Coated Vision Glass: Float glass with ceramic enamel applied by silk-screened process and complying with ASTM C 1048, Condition C (other coated glass), Type I (transparent flat glass), Quality-Q3, Specification No. 95-1-31 in GANA Tempering Division's "Engineering Standards Manual," and other requirements specified.
- D. Pyrolytic-Coated Float Glass: ASTM C 1376, float glass with metallic-oxide coating applied by pyrolytic deposition process during initial manufacture, and complying with other requirements specified.
- E. Sputter-Coated Float Glass: ASTM C 1376, float glass with metallic-oxide or -nitride coating deposited by vacuum deposition process after manufacture and heat treatment (if any), and complying with other requirements specified.
- F. Wired Glass: ASTM C 1036, Type II (patterned and wired flat glass), Class 1 (clear), Quality-Q-6; and of form and mesh pattern specified.
- G. Insulating-Glass Units, General: Factory-assembled units consisting of sealed lites of glass separated by a dehydrated interspace, and complying with ASTM E 774 for Class CBA units and with requirements specified in this Article and in Part 2 "Insulating-Glass Units" Article.

1. Provide Kind HS (heat-strengthened) float glass in place of annealed glass where needed to resist thermal stresses induced by differential shading of individual glass lites and to comply with glass design requirements specified in Part I "Performance Requirements" Article.
2. Overall Unit Thickness and Thickness of Each Lite: Dimensions indicated for insulating-glass units are nominal and the overall thicknesses of units are measured perpendicularly from outer surfaces of glass lites at unit's edge.
3. Sealing System: Dual seal.
4. Spacer Specifications: Manufacturer's standard spacer material and construction.
5. Corner Construction: Manufacturer's standard corner construction.

2.3 GLAZING GASKETS

- A. Dense Compression Gaskets: Molded or extruded gaskets of material indicated below, complying with standards referenced with name of elastomer indicated below, and of profile and hardness required to maintain watertight seal:
1. Neoprene, ASTM C 864.
 2. EPDM, ASTM C 864.
 3. Silicone, ASTM C 1115.
 4. Thermoplastic polyolefin rubber, ASTM C 1115.
 5. Any material indicated above.
- B. Soft Compression Gaskets: Extruded or molded, closed-cell, integral-skinned gaskets of material indicated below; complying with ASTM C 509, Type II, black; and of profile and hardness required to maintain watertight seal:
1. Neoprene.
 2. EPDM.
 3. Silicone.
 4. Thermoplastic polyolefin rubber.
 5. Any material indicated above.

2.4 GLAZING SEALANTS

- A. General: Provide products of type indicated, complying with the following requirements:
1. Compatibility: Select glazing sealants that are compatible with one another and with other materials they will contact, including glass products, seals of insulating-glass units, and glazing channel substrates, under conditions of service and application, as demonstrated by sealant manufacturer based on testing and field experience.
 2. Suitability: Comply with sealant and glass manufacturers' written instructions for selecting glazing sealants suitable for applications indicated and for conditions existing at time of installation.
 3. Colors of Exposed Glazing Sealants: As selected by Architect from manufacturer's full range.
- B. Elastomeric Glazing Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied chemically curing sealant specified, including those referencing

ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.

1. Single-Component Neutral- and Basic-Curing Silicone Glazing Sealants GS-<#>:
 - a. Type and Grade: S (single component) and NS (nonsag).
 - b. Class: 100/50.
 - c. Use Related to Exposure: NT (nontraffic).
 - d. Uses Related to Glazing Substrates: M, G, A, and, as applicable to glazing substrates indicated, O.

2.5 GLAZING TAPES

- A. Back-Bedding Mastic Glazing Tapes: Preformed, butyl-based elastomeric tape with a solids content of 100 percent; nonstaining and nonmigrating in contact with nonporous surfaces; with or without spacer rod as recommended in writing by tape and glass manufacturers for application indicated; packaged on rolls with a release paper backing; and complying with ASTM C 1281 and AAMA 800 for products indicated below:
 1. AAMA 804.3 tape, where indicated.
 2. AAMA 806.3 tape, for glazing applications in which tape is subject to continuous pressure.
 3. AAMA 807.3 tape, for glazing applications in which tape is not subject to continuous pressure.
- B. Expanded Cellular Glazing Tapes: Closed-cell, PVC foam tapes; factory coated with adhesive on both surfaces; packaged on rolls with release liner protecting adhesive; and complying with AAMA 800 for the following types:
 1. Type 1, for glazing applications in which tape acts as the primary sealant.
 2. Type 2, for glazing applications in which tape is used in combination with a full bead of liquid sealant.

2.6 MISCELLANEOUS GLAZING MATERIALS

- A. General: Provide products of material, size, and shape complying with referenced glazing standard, requirements of manufacturers of glass and other glazing materials for application indicated, and with a proven record of compatibility with surfaces contacted in installation.
- B. Cleaners, Primers, and Sealers: Types recommended by sealant or gasket manufacturer.
- C. Setting Blocks: Elastomeric material with a Shore, Type A durometer hardness of 85, plus or minus 5.
- D. Spacers: Elastomeric blocks or continuous extrusions with a Shore, Type A durometer hardness required by glass manufacturer to maintain glass lites in place for installation indicated.
- E. Edge Blocks: Elastomeric material of hardness needed to limit glass lateral movement (side walking).

2.7 FABRICATION OF GLAZING UNITS

- A. Fabricate glazing units in sizes required to glaze openings indicated for Project, with edge and face clearances, edge and surface conditions, and bite complying with written instructions of product manufacturer and referenced glazing publications, to comply with system performance requirements.

2.8 MONOLITHIC FLOAT-GLASS UNITS

- A. Uncoated Clear Float-Glass Units: Class 1 ultra-clear (low-iron) float glass, annealed or Kind HS (heat-strengthened) float glass where heat strengthening is required to resist thermal stresses induced by differential shading of individual glass lites and to comply with system performance requirements, Kind FT (fully tempered) float glass.

- 1. Thickness: 6.0 mm.

2.9 MONOLITHIC WIRED-GLASS UNITS

- A. Polished Wired-Glass Units: Form 1 (wired glass, polished both sides), Quality-Q6, Mesh 2 (M2) (Square), 6.0 mm thick.

2.10 INSULATING-GLASS UNITS

- A. Clear Low-E Insulating-Glass Units GL#1:

- 1. Available Products:
 - a. PPG Solarban 70.
- 2. Overall Unit Thickness: 1" Thickness of Each Lite: 6.0 mm.
- 3. Interspace Content: Argon.
- 4. Outdoor Lite: Class 1 (clear) float glass complying with ceramic-coated vision-glass requirements.
 - a. Kind HS (heat strengthened), Kind FT (fully tempered).
- 5. Indoor Lite: Class 1 (clear) float glass.
 - a. Kind HS (heat strengthened), Kind FT (fully tempered).
- 6. Low-E Coating: Pyrolytic or sputtered on second surface.
- 7. Visible Light Transmittance: 64 percent minimum.
- 8. Winter Nighttime U-Factor: 0.29 maximum.
- 9. Summer Daytime U-Factor: 0.27 maximum.
- 10. Solar Heat Gain Coefficient: 0.34 maximum.
- 11. Shading Coefficient: 0.39 maximum.
- 12. Outdoor Visible Reflectance: 12 percent maximum.

- B. Transucent Low-E Insulating-Glass Units GL #2:

1. Available Products:
 - a. PPG Solarban 70.
2. Overall Unit Thickness: 1" Thickness of Each Lite: 6.0 mm.
3. Interspace Content: Argon.
4. Outdoor Lite: Class 1 (clear) float glass complying with ceramic-coated vision-glass requirements.
 - a. Kind HS (heat strengthened), Kind FT (fully tempered).
5. Indoor Lite: Class 1 (clear) float glass.
 - a. Kind HS (heat strengthened), Kind FT (fully tempered).
6. 75% sand blasted finish on third surface.
7. Visible Light Transmittance: 50 percent minimum.
8. Winter Nighttime U-Factor: 0.29 maximum.
9. Summer Daytime U-Factor: 0.27 maximum.
10. Solar Heat Gain Coefficient: 0.34 maximum.
11. Shading Coefficient: 0.39 minimum
12. Outdoor Visible Reflectance: 0.12 percent maximum.

PART 3 - EXECUTION

3.1 GLAZING

- A. General: Comply with combined written instructions of manufacturers of glass, sealants, gaskets, and other glazing materials, unless more stringent requirements are indicated, including those in referenced glazing publications.
 1. Glazing channel dimensions, as indicated on Drawings, provide necessary bite on glass, minimum edge and face clearances, and adequate sealant thicknesses, with reasonable tolerances. Adjust as required by Project conditions during installation.
 2. Protect glass edges from damage during handling and installation. Remove damaged glass from Project site and legally dispose of off Project site. Damaged glass is glass with edge damage or other imperfections that, when installed, could weaken glass and impair performance and appearance.
 3. Apply primers to joint surfaces where required for adhesion of sealants, as determined by preconstruction sealant-substrate testing.
 4. Install setting blocks in sill rabbets, sized and located to comply with referenced glazing publications, unless otherwise required by glass manufacturer. Set blocks in thin course of compatible sealant suitable for heel bead.
 5. Do not exceed edge pressures stipulated by glass manufacturers for installing glass lites.
 6. Provide spacers for glass lites where length plus width is larger than 50 inches.
 7. Provide edge blocking where indicated or needed to prevent glass lites from moving sideways in glazing channel, as recommended in writing by glass manufacturer and according to requirements in referenced glazing publications.

- B. Tape Glazing: Position tapes on fixed stops so that, when compressed by glass, their exposed edges are flush with or protrude slightly above sightline of stops. Install tapes continuously, but not necessarily in one continuous length. Do not stretch tapes to make them fit opening.
1. Cover vertical framing joints by applying tapes to heads and sills first and then to jambs. Cover horizontal framing joints by applying tapes to jambs and then to heads and sills.
 2. Place joints in tapes at corners of opening with adjoining lengths butted together, not lapped. Seal joints in tapes with compatible sealant approved by tape manufacturer.
 3. Apply heel bead of elastomeric sealant.
 4. Center glass lites in openings on setting blocks and press firmly against tape by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings.
 5. Apply cap bead of elastomeric sealant over exposed edge of tape.
- C. Gasket Glazing (Dry): Fabricate compression gaskets in lengths recommended by gasket manufacturer to fit openings exactly, with allowance for stretch during installation.
1. Insert soft compression gasket between glass and frame or fixed stop so it is securely in place with joints miter cut and bonded together at corners.
 2. Center glass lites in openings on setting blocks and press firmly against soft compression gasket by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings. Compress gaskets to produce a weathertight seal without developing bending stresses in glass. Seal gasket joints with sealant recommended by gasket manufacturer.
 3. Install gaskets so they protrude past face of glazing stops.
- D. Sealant Glazing (Wet): Install continuous spacers, or spacers combined with cylindrical sealant backing, between glass lites and glazing stops to maintain glass face clearances and to prevent sealant from extruding into glass channel and blocking weep systems until sealants cure. Secure spacers or spacers and backings in place and in position to control depth of installed sealant relative to edge clearance for optimum sealant performance.
1. Force sealants into glazing channels to eliminate voids and to ensure complete wetting or bond of sealant to glass and channel surfaces.
 2. Tool exposed surfaces of sealants to provide a substantial wash away from glass.

3.2 CLEANING AND PROTECTION

- A. Protect exterior glass from damage immediately after installation by attaching crossed streamers to framing held away from glass. Do not apply markers to glass surface. Remove nonpermanent labels, and clean surfaces. Protect glass from contact with contaminating substances resulting from construction operations, including weld splatter. If, despite such protection, contaminating substances do come into contact with glass, remove substances immediately as recommended by glass manufacturer.
- B. Remove and replace glass that is broken, chipped, cracked, or abraded or that is damaged from natural causes, accidents, and vandalism, during construction period.

END OF SECTION 08800

SECTION 08830 - MIRRORS

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Annealed monolithic glass mirrors.

1.2 SUBMITTALS

- A. Product Data: For mirror hardware and mastic.
- B. Shop Drawings: Include mirror elevations, edge details, mirror hardware, and attachments to other work.
- C. Product Certificates: For each type of mirror and mirror mastic, signed by product manufacturer.

1.3 QUALITY ASSURANCE

- A. Glazing Publications: Comply with GANA's "Glazing Manual" and GANA Mirror Division's "Mirrors, Handle with Extreme Care: Tips for the Professional on the Care and Handling of Mirrors" unless more stringent requirements are indicated

1.4 DELIVERY, STORAGE, AND HANDLING

- A. Comply with mirror manufacturer's written instructions for shipping, storing, and handling mirrors as needed to prevent deterioration of silvering, damage to edges, and abrasion of glass surfaces and applied coatings. Store indoors, protected from moisture including condensation.

1.5 WARRANTY

- A. Special Warranty: Manufacturer's standard form, made out to Owner and signed by mirror manufacturer agreeing to replace mirrors that deteriorate, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated in second subparagraph below.
 - 1. Deterioration of Mirrors: Defects developed from normal use that are attributable to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning mirrors contrary to mirror manufacturer's written instructions. Defects include discoloration, black spots, and clouding of the silver film.
 - 2. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS**2.1 SILVERED FLAT GLASS MIRROR MATERIALS****A. Clear Glass Mirrors: ASTM C 1503, Mirror Select Quality.**

1. Nominal Thickness: 5.0 mm.

2.2 MISCELLANEOUS MATERIALS

- A. Setting Blocks: Elastomeric material with a Type A Shore durometer hardness of 85, plus or minus 5.
- B. Edge Sealer: Coating compatible with glass coating and approved by mirror manufacturer for use in protecting against silver deterioration at mirrored glass edges.
- C. Mirror Mastic: An adhesive setting compound, produced specifically for setting mirrors and certified by both mirror manufacturer and mastic manufacturer as compatible with glass coating and substrates on which mirrors will be installed.

2.3 MIRROR HARDWARE

- A. Mirror Bottom Clips: Manufacturer's standard.
- B. Mirror Top Clips: Manufacturer's standard..
- C. Fasteners: Fabricated of same basic metal and alloy as fastened metal and matching it in finished color and texture where fasteners are exposed.
- D. Anchors and Inserts: Provide devices as required for mirror hardware installation. Provide toothed or lead-shield expansion-bolt devices for drilled-in-place anchors. Provide galvanized anchors and inserts for applications on inside face of exterior walls and where indicated.

2.4 FABRICATION

- A. Mirror Sizes: To suit Project conditions, cut mirrors to final sizes and shapes.
- B. Cutouts: Fabricate cutouts for notches and holes in mirrors without marring visible surfaces. Locate and size cutouts so they fit closely around penetrations in mirrors.
- C. Mirror Edge Treatment: Flat polished edge.
 - 1. Seal edges of mirrors after edge treatment to prevent chemical or atmospheric penetration of glass coating.
 - 2. Require mirror manufacturer to perform edge treatment and sealing in factory immediately after cutting to final sizes.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Install mirrors to comply with mirror manufacturer's written instructions and with referenced GANA publications. Mount mirrors accurately in place in a manner that avoids distorting reflected images.
- B. Provide a minimum air space of 1/8 inch between back of mirrors and mounting surface for air circulation between back of mirrors and face of mounting surface.
- C. For wall-mounted mirrors, install with mastic and mirror hardware.
 - 1. Attach mirror hardware securely to mounting surfaces with mechanical fasteners installed with anchors or inserts as applicable. Install fasteners so heads do not impose point loads on backs of mirrors.
 - 2. For metal or plastic clips, place a felt or plastic pad between mirror and each clip to prevent spalling of mirror edges.
 - 3. Where indicated, install bottom and top clips symmetrically placed and evenly spaced.
 - 4. Install mastic as follows:
 - a. Apply barrier coat to mirror backing where approved in writing by manufacturers of mirrors and backing material.
 - b. Apply mastic to comply with mastic manufacturer's written instructions for coverage and to allow air circulation between back of mirrors and face of mounting surface.
 - c. After mastic is applied, align mirrors and press into place while maintaining a minimum air space of 1/8 inch between back of mirrors and mounting surface.
- D. Protect mirrors from breakage and contaminating substances resulting from construction operations.
- E. Do not permit edges of mirrors to be exposed to standing water.
- F. Maintain environmental conditions that will prevent mirrors from being exposed to moisture from condensation or other sources for continuous periods of time.

END OF SECTION 08830

SECTION 09111 - NON-LOAD-BEARING STEEL FRAMING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes non-load-bearing steel framing members for the following applications:
 - 1. Interior framing systems (e.g., supports for partition walls, framed soffits, furring, etc.).
 - 2. Interior suspension systems (e.g., supports for ceilings, suspended soffits, etc.).

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.

1.3 QUALITY ASSURANCE

- A. Fire-Test-Response Characteristics: For fire-resistance-rated assemblies that incorporate non-load-bearing steel framing, provide materials and construction identical to those tested in assembly indicated according to ASTM E 119 by an independent testing agency.
- B. Sound Transmission Characteristics: For STC-rated assemblies that incorporate non-load-bearing steel framing, provide materials and construction identical to those tested in assembly indicated according to ASTM E 90 and classified according to ASTM E 413 by an independent testing agency.

PART 2 - PRODUCTS

2.1 NON-LOAD-BEARING STEEL FRAMING, GENERAL

- A. Framing Members, General: Comply with ASTM C 754 for conditions indicated.
 - 1. Steel Sheet Components: Comply with ASTM C 645 requirements for metal, unless otherwise indicated.
 - 2. Protective Coating: Manufacturer's standard corrosion-resistant zinc coating, unless otherwise indicated.

2.2 SUSPENSION SYSTEM COMPONENTS

- A. Tie Wire: ASTM A 641/A 641M, Class 1 zinc coating, soft temper, 0.0625-inch diameter wire, or double strand of 0.0475-inch diameter wire.
- B. Hanger Attachments to Concrete:

1. Anchors: Fabricated from corrosion-resistant materials with holes or loops for attaching wire hangers and capable of sustaining, without failure, a load equal to 5 times that imposed by construction as determined by testing according to ASTM E 488 by an independent testing agency.
 2. Powder-Actuated Fasteners: Suitable for application indicated, fabricated from corrosion-resistant materials with clips or other devices for attaching hangers of type indicated, and capable of sustaining, without failure, a load equal to 10 times that imposed by construction as determined by testing according to ASTM E 1190 by an independent testing agency.
- C. Wire Hangers: ASTM A 641/A 641M, Class 1 zinc coating, soft temper, 0.162-inch diameter.
- D. Flat Hangers: Steel sheet, 1 by 3/16 inch by length indicated.
- E. Carrying Channels: Cold-rolled, commercial-steel sheet with a base-metal thickness of 0.0538 inch and minimum 1/2-inch wide flanges.
1. Depth: 2 inches.
- F. Furring Channels (Furring Members):
1. Cold-Rolled Channels: 0.0538-inch bare-steel thickness, with minimum 1/2-inch wide flanges, 3/4 inch deep.
 2. Steel Studs: ASTM C 645.
 - a. Minimum Base-Metal Thickness: 0.0312 inch.
 - b. Depth: 2-1/2 inches.
 3. Hat-Shaped, Rigid Furring Channels: ASTM C 645, 7/8 inch deep.
 - a. Minimum Base Metal Thickness: 0.0312 inch.
- G. Grid Suspension System for Ceilings: ASTM C 645, direct-hung system composed of main beams and cross-furring members that interlock.

2.3 STEEL FRAMING FOR FRAMED ASSEMBLIES

- A. Steel Studs and Runners: ASTM C 645.
1. Minimum Base-Metal Thickness: 0.0312 inch.
- B. Flat Strap and Backing Plate: Steel sheet for blocking and bracing in length and width indicated.
1. Minimum Base-Metal Thickness: 0.0312 inch.
- C. Cold-Rolled Channel Bridging: 0.0538-inch bare-steel thickness, with minimum 1/2-inch wide flanges.
1. Depth: 1-1/2 inches.

2. Clip Angle: Not less than 1-1/2 by 1-1/2 inches, 0.068-inch thick, galvanized steel.
- D. Hat-Shaped, Rigid Furring Channels: ASTM C 645.
 1. Minimum Base Metal Thickness: 0.0312 inch.
 2. Depth: 7/8 inch.
- E. Cold-Rolled Furring Channels: 0.0538-inch bare-steel thickness, with minimum 1/2-inch wide flanges.
 1. Depth: 3/4 inch.
 2. Furring Brackets: Adjustable, corrugated-edge type of steel sheet with minimum bare-steel thickness of 0.0312 inch.
 3. Tie Wire: ASTM A 641/A 641M, Class 1 zinc coating, soft temper, 0.0625-inch diameter wire, or double strand of 0.0475-inch diameter wire.
- F. Z-Shaped Furring: With slotted or nonslotted web, face flange of 1-1/4 inches, wall attachment flange of 7/8 inch, minimum bare-metal thickness of 0.0179 inch, and depth required to fit insulation thickness indicated.

2.4 AUXILIARY MATERIALS

- A. Fasteners for Metal Framing: Of type, material, size, corrosion resistance, holding power, and other properties required to fasten steel members to substrates.
- B. Isolation Strip at Exterior Walls: Provide one of the following:
 1. Asphalt-Saturated Organic Felt: ASTM D 226, Type I (No. 15 asphalt felt), nonperforated.
 2. Foam Gasket: Adhesive-backed, closed-cell vinyl foam strips that allow fastener penetration without foam displacement, 1/8 inch thick, in width to suit steel stud size.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Installation Standard: ASTM C 754.
 1. Gypsum Board Assemblies: Also comply with requirements in ASTM C 840 that apply to framing installation.

3.2 INSTALLING SUSPENSION SYSTEMS

- A. Isolate suspension systems from building structure where they abut or are penetrated by building structure to prevent transfer of loading imposed by structural movement.
- B. Suspend hangers from building structure as follows:

1. Install hangers plumb and free from contact with insulation or other objects within ceiling plenum that are not part of supporting structural or suspension system.
 - a. Splay hangers only where required to miss obstructions and offset resulting horizontal forces by bracing, countersplaying, or other equally effective means.
 2. Where width of ducts and other construction within ceiling plenum produces hanger spacings that interfere with locations of hangers required to support standard suspension system members, install supplemental suspension members and hangers in the form of trapezes or equivalent devices.
 - a. Size supplemental suspension members and hangers to support ceiling loads within performance limits established by referenced installation standards.
 3. Do not attach hangers to steel roof deck.
 4. Do not attach hangers to permanent metal forms. Furnish cast-in-place hanger inserts that extend through forms.
 5. Do not attach hangers to rolled-in hanger tabs of composite steel floor deck.
 6. Do not connect or suspend steel framing from ducts, pipes, or conduit.
- C. Fire-Resistance-Rated Assemblies: Wire tie furring channels to supports.
- D. Seismic Bracing: Sway-brace suspension systems with hangers used for support.
- E. Grid Suspension Systems: Attach perimeter wall track or angle where grid suspension systems meet vertical surfaces. Mechanically join main beam and cross-furring members to each other and butt-cut to fit into wall track.
- F. Installation Tolerances: Install suspension systems that are level to within 1/8 inch in 12 feet measured lengthwise on each member that will receive finishes and transversely between parallel members that will receive finishes.

3.3 INSTALLING FRAMED ASSEMBLIES

- A. Where studs are installed directly against exterior masonry walls or dissimilar metals at exterior walls, install isolation strip between studs and exterior wall.
- B. Install tracks (runners) at floors and overhead supports. Extend framing full height to structural supports or substrates above suspended ceilings, except where partitions are indicated to terminate at suspended ceilings. Continue framing around ducts penetrating partitions above ceiling.
1. Slip-Type Head Joints: Where framing extends to overhead structural supports, install to produce joints at tops of framing systems that prevent axial loading of finished assemblies.
 2. Door Openings: Screw vertical studs at jambs to jamb anchor clips on door frames; install runner track section (for cripple studs) at head and secure to jamb studs.
 - a. Install two studs at each jamb, unless otherwise indicated.

- b. Install cripple studs at head adjacent to each jamb stud, with a minimum 1/2-inch clearance from jamb stud to allow for installation of control joint in finished assembly.
 - c. Extend jamb studs through suspended ceilings and attach to underside of overhead structure.
- 3. Other Framed Openings: Frame openings other than door openings the same as required for door openings, unless otherwise indicated. Install framing below sills of openings to match framing required above door heads.
- 4. Fire-Resistance-Rated Partitions: Install framing to comply with fire-resistance-rated assembly indicated and support closures and to make partitions continuous from floor to underside of solid structure.
 - a. Firestop Track: Where indicated, install to maintain continuity of fire-resistance-rated assembly indicated.
- C. Direct Furring:
 - 1. Screw to wood framing.
 - 2. Attach to concrete or masonry with stub nails, screws designed for masonry attachment, or powder-driven fasteners spaced 24 inches o.c.
- D. Installation Tolerance: Install each framing member so fastening surfaces vary not more than 1/8 inch from the plane formed by faces of adjacent framing.

END OF SECTION 09111

SECTION 09250 - GYPSUM BOARD

PART 1 - GENERAL

1.1 SUMMARY

A. This Section includes the following:

1. Interior gypsum board.
2. Tile backing panels.

1.2 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Samples: For the following products:

1. Trim Accessories: Full-size Sample in 12-inch long length for each trim accessory indicated.

1.3 QUALITY ASSURANCE

A. Fire-Resistance-Rated Assemblies: For fire-resistance-rated assemblies, provide materials and construction identical to those tested in assembly indicated according to ASTM E 119 by an independent testing agency.

B. STC-Rated Assemblies: For STC-rated assemblies, provide materials and construction identical to those tested in assembly indicated according to ASTM E 90 and classified according to ASTM E 413 by an independent testing agency.

C. Mockups: Before beginning gypsum board installation, install mockups of at least 100 sq. ft. in surface area to demonstrate aesthetic effects and set quality standards for materials and execution.

1. Install mockups for the following:

- a. Each level of gypsum board finish indicated for use in exposed locations.
2. Apply or install final decoration indicated, including painting on exposed surfaces for review of mockups.
3. Simulate finished lighting conditions for review of mockups.
4. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

PART 2 - PRODUCTS**2.1 INTERIOR GYPSUM BOARD**

- A. General: Complying with ASTM C 36/C 36M or ASTM C 1396/C 1396M, as applicable to type of gypsum board indicated and whichever is more stringent.
- B. Regular and Type X:
 - 1. Thickness: 5/8 inch.
 - 2. Long Edges: Tapered and featured (rounded or beveled) for prefilling.
- C. Ceiling Type: Manufactured to have more sag resistance than regular-type gypsum board.
 - 1. Thickness: 1/2 inch.
 - 2. Long Edges: Tapered.
- D. Moisture- and Mold-Resistant Type: With moisture- and mold-resistant core and surfaces.
 - 1. Core: 5/8 inch, Type X.
 - 2. Long Edges: Tapered.

2.2 TILE BACKING PANELS

- A. Cementitious Backer Units: ANSI A108.1.
 - 1. Thickness: 5/8 inch.

2.3 TRIM ACCESSORIES

- A. Interior Trim: ASTM C 1047.
 - 1. Material: Galvanized or aluminum-coated steel sheet or rolled zinc.
 - 2. Shapes:
 - a. Cornerbead.
 - b. LC-Bead: J-shaped; exposed long flange receives joint compound.
 - c. L-Bead: L-shaped; exposed long flange receives joint compound.
 - d. Expansion (control) joint.

2.4 JOINT TREATMENT MATERIALS

- A. General: Comply with ASTM C 475/C 475M.
- B. Joint Tape:
 - 1. Interior Gypsum Wallboard: Paper.
 - 2. Tile Backing Panels: As recommended by panel manufacturer.

- C. Joint Compound for Interior Gypsum Wallboard: For each coat use formulation that is compatible with other compounds applied on previous or for successive coats.
 - 1. Prefilling: At open joints, rounded or beveled panel edges, and damaged surface areas, use setting-type taping compound.
 - 2. Embedding and First Coat: For embedding tape and first coat on joints, fasteners, and trim flanges, use drying-type, all-purpose compound.
 - a. Use setting-type compound for installing paper-faced metal trim accessories.
 - 3. Fill Coat: For second coat, use drying-type, all-purpose compound.
 - 4. Finish Coat: For third coat, use drying-type, all-purpose compound.
- D. Joint Compound for Tile Backing Panels:
 - 1. Cementitious Backer Units: As recommended by backer unit manufacturer.

2.5 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials that comply with referenced installation standards and manufacturer's written recommendations.
- B. Laminating Adhesive: Adhesive or joint compound recommended for directly adhering gypsum panels to continuous substrate.
 - 1. Use adhesives that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- C. Steel Drill Screws: ASTM C 1002, unless otherwise indicated.
 - 1. Use screws complying with ASTM C 954 for fastening panels to steel members from 0.033 to 0.112 inch thick.
 - 2. For fastening cementitious backer units, use screws of type and size recommended by panel manufacturer.
- D. Sound Attenuation Blankets: ASTM C 665, Type I (blankets without membrane facing) produced by combining thermosetting resins with mineral fibers manufactured from glass, slag wool, or rock wool.
 - 1. Fire-Resistance-Rated Assemblies: Comply with mineral-fiber requirements of assembly.
- E. Acoustical Sealant: As specified in Division 7 Section "Joint Sealants."
 - 1. Provide sealants that have a VOC content of [250] <Insert limit> g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- F. Thermal Insulation: As specified in Division 7 Section "Building Insulation."
- G. Vapor Retarder: As specified in Division 7 Section "Building Insulation."

PART 3 - EXECUTION**3.1 APPLYING AND FINISHING PANELS, GENERAL**

- A. Comply with ASTM C 840.
- B. Examine panels before installation. Reject panels that are wet, moisture damaged, and mold damaged.
- C. Isolate perimeter of gypsum board applied to non-load-bearing partitions at structural abutments, except floors. Provide 1/4- to 1/2-inch wide spaces at these locations, and trim edges with edge trim where edges of panels are exposed. Seal joints between edges and abutting structural surfaces with acoustical sealant.

3.2 APPLYING INTERIOR GYPSUM BOARD

- A. Install interior gypsum board in the following locations:
 - 1. Regular and Type X: Vertical surfaces.
 - 2. Ceiling Type: Ceiling surfaces.
 - 3. Moisture- and Mold-Resistant Type: As needed in moist areas.

3.3 APPLYING TILE BACKING PANELS

- A. Cementitious Backer Units: ANSI A108.1, at locations indicated to receive tile.
- B. Where tile backing panels abut other types of panels in same plane, shim surfaces to produce a uniform plane across panel surfaces.

3.4 INSTALLING TRIM ACCESSORIES

- A. General: For trim with back flanges intended for fasteners, attach to framing with same fasteners used for panels. Otherwise, attach trim according to manufacturer's written instructions.
- B. Control Joints: Install control joints according to ASTM C 840 and in specific locations approved by Architect for visual effect.
- C. Interior Trim: Install in the following locations:
 - 1. Cornerbead: Use at outside corners.
 - 2. LC-Bead: Use at exposed panel edges.
 - 3. L-Bead: Use where indicated.

3.5 FINISHING GYPSUM BOARD

- A. General: Treat gypsum board joints, interior angles, edge trim, control joints, penetrations, fastener heads, surface defects, and elsewhere as required to prepare gypsum board surfaces for decoration. Promptly remove residual joint compound from adjacent surfaces.
- B. Prefill open joints, rounded or beveled edges, and damaged surface areas.
- C. Apply joint tape over gypsum board joints, except those with trim having flanges not intended for tape.
- D. Gypsum Board Finish Levels: Finish panels to levels indicated below:
 - 1. Level 1: Ceiling plenum areas, concealed areas.
 - 2. Level 4: At panel surfaces that will be exposed to view, unless otherwise indicated.
 - a. Primer and its application to surfaces are specified in other Division 9 Sections.
- E. Cementitious Backer Units: Finish according to manufacturer's written instructions.

3.6 PROTECTION

- A. Protect installed products from damage from weather, condensation, direct sunlight, construction, and other causes during remainder of the construction period.
- B. Remove and replace panels that are wet, moisture damaged, and mold damaged.
 - 1. Indications that panels are wet or moisture damaged include, but are not limited to, discoloration, sagging, or irregular shape.
 - 2. Indications that panels are mold damaged include, but are not limited to, fuzzy or splotchy surface contamination and discoloration.

END OF SECTION 09250

SECTION 09310 - TILE

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Porcelain tile.
2. Crack isolation membrane.
3. Tile backing panels.

1.2 SUBMITTALS

A. Product Data: For each type of product indicated.

B. Samples:

1. Each type and composition of tile and for each color and finish required.
2. Assembled samples, with grouted joints, for each type and composition of tile and for each color and finish required.
3. Stone thresholds in 6-inch lengths.

1.3 QUALITY ASSURANCE

A. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.

1. Build mockup of each type of floor tile installation.
2. Build mockup of each type of wall tile installation.
3. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.
4. Mockups: Build mockups to verify selections made under sample submittals and to

B. Installer Experience:

1. Engage an experienced Installer who has successfully completed tile installations similar in material, design, and extent to that indicated in this Project and with a record of successful in-service performance.
2. Installer must document at least 10 previous heavy-use public projects. Documentation shall be submitted to the Owner prior to the commencement of work.

1.4 EXTRA MATERIALS

A. Furnish extra materials that match and are from same production runs as products installed and that are packaged with protective covering and identified with labels describing contents.

1. Tile and Trim Units: Furnish quantity of full-size units equal to 3 percent of amount installed for each type, composition, color, pattern, and size indicated.

PART 2 - PRODUCTS

2.1 TILE PRODUCTS

- A. ANSI Ceramic Tile Standard: Provide Standard grade tile that complies with ANSI A137.1 for types, compositions, and other characteristics indicated.
- B. Floor Tile Type: Porcelain, through body tile. Any proposed substitutions of the product listed below are to be submitted prior to bid and must be approved by owner prior to bid.
 1. Composition: Porcelain, through body tile
 2. Module Size: 12 by 12 inch
 3. Thickness: 3/8 inch.
 4. Face: Plain with cushion edges.
 5. Manuf: Stonepeak Ceramics, Inc.
 6. Tile Series and Color: Quartzite Series, Color – Iron
 7. Pattern: See architectural drawings for tile pattern and layout
 8. Grout Color: As selected by Architect from manufacturer's full range.
 9. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable, and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes.
 - a. Tapered Transition: Schluter Reno-U stainless steel transition.
 - b. Base Cove: Cove, module size 6 by 12 inch.
 - c. External corner for Base Cove
 - d. Internal corner for Base Cove
- C. Wall Tile Type: Porcelain, through body tile. Any proposed substitutions of the product listed below are to be submitted prior to bid and must be approved by owner prior to bid.
 1. Module Size: 12 x 24 inch and 6 x 24 inch
 2. Thickness: 3/8 inch.
 3. Face: Plain with modified square edges or cushion edges.
 4. Manuf: Stonepeak Ceramics, Inc.
 5. Tile Series and Color: Limestone Series, Color = Honey
 6. Pattern: See architectural drawings for tile pattern and layout.
 7. Grout Color: As selected by Architect from manufacturer's full range.
 8. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:
 - a. External Corners: Schluter-Rondec Stainless Steel rounded corner brushed finish.
 - b. Internal Corners: Field-buttet square corners. For coved base and cap use angle pieces designed to fit with stretcher shapes.

2.2 THRESHOLDS

- A. General: Fabricate to sizes and profiles indicated or required to provide transition between adjacent floor finishes.
 - 1. Bevel edges at 1:2 slope, with lower edge of bevel aligned with or up to 1/16 inch above adjacent floor surface. Finish bevel to match top surface of threshold. Limit height of threshold to 1/2 inch or less above adjacent floor surface.
 - 2. Tapered Transition: Schluter Reno-U stainless steel transition.

2.3 TILE BACKING PANELS

- A. Cementitious Backer Units: ANSI A118.9 or ASTM C 1325.
 - 1. Thickness: 5/8 inch.

2.4 CRACK ISOLATION MEMBRANE

- A. General: Manufacturer's standard product that complies with ANSI A118.12 for high performance and is recommended by the manufacturer for the application indicated.
- B. Chlorinated-Polyethylene Sheet: Nonplasticized, chlorinated polyethylene faced on both sides with nonwoven polyester fabric; 0.030-inch nominal thickness.

2.5 SETTING MATERIALS

- A. Portland Cement Mortar (Thickset) Installation Materials: ANSI A108.02.
- B. Water-Cleanable, Tile-Setting Epoxy: ANSI A118.3, with a VOC content of 65 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).

2.6 GROUT MATERIALS

- A. Water-Cleanable Epoxy Grout: ANSI A118.3.

2.7 ELASTOMERIC SEALANTS

- A. General: Provide sealants, primers, backer rods, and other sealant accessories that comply with the following requirements and with the applicable requirements in Division 7 Section "Joint Sealants."
 - 1. Use sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- B. One-Part, Mildew-Resistant Silicone Sealant: ASTM C 920; Type S; Grade NS; Class 25; Uses NT, G, A, and, as applicable to nonporous joint substrates indicated, O; formulated with

fungicide, intended for sealing interior ceramic tile joints and other nonporous substrates that are subject to in-service exposures of high humidity and extreme temperatures.

- C. Multipart, Pourable Urethane Sealant for Use T: ASTM C 920; Type M; Grade P; Class 25; Uses T, M, A, and, as applicable to joint substrates indicated, O.

2.8 MISCELLANEOUS MATERIALS

- A. Trowelable Underlayments and Patching Compounds: Latex-modified, portland cement-based formulation provided or approved by manufacturer of tile-setting materials for installations indicated.
- B. Metal Edge Strips: Angle or L-shape, stainless steel, ASTM A 666, 300 Series exposed-edge material.
- C. Grout Sealer: Manufacturer's standard silicone product for sealing grout joints and that does not change color or appearance of grout.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions where tile will be installed, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of installed tile.
 - 1. Verify that substrates for setting tile are firm, dry, clean, free of coatings that are incompatible with tile-setting materials including curing compounds and other substances that contain soap, wax, oil, or silicone; and comply with flatness tolerances required by ANSI A108.01 for installations indicated.

3.2 PREPARATION

- A. Fill cracks, holes, and depressions in concrete substrates for tile floors installed with thin-set mortar with trowelable leveling and patching compound specifically recommended by tile-setting material manufacturer.
- B. Blending: For tile exhibiting color variations, use factory blended tile or blend tiles at Project site before installing.
- C. Field-Applied Temporary Protective Coating: If indicated under tile type or needed to prevent grout from staining or adhering to exposed tile surfaces, precoat them with continuous film of temporary protective coating, taking care not to coat unexposed tile surfaces.

3.3 INSTALLATION

- A. Comply with TCA's "Handbook for Ceramic Tile Installation" for TCA installation methods specified in tile installation schedules. Comply with parts of the ANSI A108 Series "Specifications for Installation of Ceramic Tile" that are referenced in TCA installation methods, specified in tile installation schedules, and apply to types of setting and grouting materials used.
 - 1. For the following installations, follow procedures in the ANSI A108 Series of tile installation standards for providing 95 percent mortar coverage:
 - a. Tile floors in wet areas.
 - b. Tile floors composed of tiles 8 by 8 inches or larger.
 - c. Tile floors composed of rib-backed tiles.
- B. Extend tile work into recesses and under or behind equipment and fixtures to form complete covering without interruptions unless otherwise indicated. Terminate work neatly at obstructions, edges, and corners without disrupting pattern or joint alignments.
- C. Accurately form intersections and returns. Perform cutting and drilling of tile without marring visible surfaces. Carefully grind cut edges of tile abutting trim, finish, or built-in items for straight aligned joints. Fit tile closely to electrical outlets, piping, fixtures, and other penetrations so plates, collars, or covers overlap tile.
- D. Jointing Pattern: Lay tile in grid pattern unless otherwise indicated. Lay out tile work and center tile fields in both directions in each space or on each wall area. Lay out tile work to minimize the use of pieces that are less than half of a tile. Provide uniform joint widths unless otherwise indicated.
- E. Joint Widths: Unless otherwise indicated, install tile with the following joint widths:
 - 1. Paver Tile: 1/4 inch.
 - 2. Glazed Wall Tile: 1/16 inch.
- F. Lay out tile wainscots to dimensions indicated or to next full tile beyond dimensions indicated.
- G. Expansion Joints: Provide expansion joints and other sealant-filled joints, including control, contraction, and isolation joints, where indicated. Form joints during installation of setting materials, mortar beds, and tile. Do not saw-cut joints after installing tiles.
 - 1. Where joints occur in concrete substrates, locate joints in tile surfaces directly above them.
 - 2. Prepare joints and apply sealants to comply with requirements in Division 7 Section "Joint Sealants."
- H. Stone Thresholds: Install stone thresholds in same type of setting bed as adjacent floor unless otherwise indicated.
 - 1. At locations where mortar bed (thickset) would otherwise be exposed above adjacent floor finishes, set thresholds in latex-portland cement mortar (thin set).

- I. Grout Sealer: Apply grout sealer to grout joints in tile floors according to grout-sealer manufacturer's written instructions. As soon as grout sealer has penetrated grout joints, remove excess sealer and sealer from tile faces by wiping with soft cloth.
- J. Install cementitious backer units and treat joints according to ANSI A108.11 and manufacturer's written instructions for type of application indicated. Install waterproofing to comply with ANSI A108.13 and manufacturer's written instructions to produce waterproof membrane of uniform thickness and bonded securely to substrate.
- K. Install crack isolation membrane to comply with ANSI A108.17 and manufacturer's written instructions to produce membrane of uniform thickness and bonded securely to substrate.

3.4 INTERIOR TILE INSTALLATION SCHEDULE

A. Interior Floor Installations, Concrete Subfloor:

1. Tile Installation F131: Water-cleanable, tile-setting epoxy; epoxy grout; TCA F131.
 - a. Tile Type: Porcelain tile.
 - b. Grout: Water-cleanable epoxy grout.

B. Interior Wall Installations, Wood Studs or Furring:

1. Tile Installation W244: Thin-set mortar on cementitious backer units or fiber cement underlayment; TCA W244.
 - a. Tile Type: Porcelain tile.
 - b. Thin-Set Mortar: Latex- portland cement mortar.
 - c. Grout: Water-cleanable epoxy grout.

END OF SECTION 09310

SECTION 09653 - RESILIENT WALL BASE AND ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Resilient base.
2. Resilient molding accessories.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For each type of product indicated, in manufacturer's standard-size Samples but not less than 12 inches long, of each resilient product color, texture, and pattern required.

1.3 QUALITY ASSURANCE

- A. Fire-Test-Response Characteristics: As determined by testing identical products according to ASTM E 648 or NFPA 253 by a qualified testing agency.
 1. Critical Radiant Flux Classification: Class I, not less than 0.45 W/sq. cm.

1.4 PROJECT CONDITIONS

- A. Maintain ambient temperatures within range recommended by manufacturer in spaces to receive resilient products.
- B. Until Substantial Completion, maintain ambient temperatures within range recommended by manufacturer.
- C. Install resilient products after other finishing operations, including painting, have been completed.

PART 2 - PRODUCTS

2.1 RESILIENT BASE

- A. Resilient Base:
- B. Resilient Base Standard: ASTM F 1861.

1. Material Requirement: Type TS (rubber, vulcanized thermoset).
 2. Manufacturing Method: Group I (solid, homogeneous).
 3. Style: Cove (base with toe).
- C. Minimum Thickness: 0.125 inch.
- D. Height: 4 inches.
- E. Lengths: Coils in manufacturer's standard length.
- F. Outside Corners: Job formed or preformed.
- G. Inside Corners: Job formed or preformed.
- H. Finish: As selected by Architect from manufacturer's full range.
- I. Colors and Patterns: As selected by Architect from full range of industry colors.

2.2 RESILIENT MOLDING ACCESSORY

- A. Description: Carpet edge for glue-down applications, Reducer strip for resilient floor covering, Transition strips.
- B. Material: Rubber.
- C. Colors and Patterns: As selected by Architect from full range of industry colors.

2.3 INSTALLATION MATERIALS

- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland cement based or blended hydraulic-cement-based formulation provided or approved by manufacturer for applications indicated.
- B. Adhesives: Water-resistant type recommended by manufacturer to suit resilient products and substrate conditions indicated.
1. Use adhesives that comply with the following limits for VOC content when calculated according to 40 CFR 59, Subpart D (EPA Method 24):
 - a. Cove Base Adhesives: Not more than 50 g/L.
 - b. Rubber Floor Adhesives: Not more than 60 g/L.
- C. Floor Polish: Provide protective liquid floor polish products as recommended by resilient stair tread manufacturer.

PART 3 - EXECUTION**3.1 PREPARATION**

- A. Prepare substrates according to manufacturer's written instructions to ensure adhesion of resilient products.
- B. Concrete Substrates for Resilient Accessories: Prepare according to ASTM F 710.
 - 1. Verify that substrates are dry and free of curing compounds, sealers, and hardeners.
 - 2. Remove substrate coatings and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, using mechanical methods recommended by manufacturer. Do not use solvents.
 - 3. Alkalinity and Adhesion Testing: Perform tests recommended by manufacturer.
 - 4. Moisture Testing: Perform tests recommended by manufacturer and as follows. Proceed with installation only after substrates pass testing.
 - a. Perform anhydrous calcium chloride test, ASTM F 1869. Proceed with installation only after substrates have maximum moisture-vapor-emission rate of 3 lb of water/1000 sq. ft. in 24 hours.
 - b. Perform relative humidity test using in situ probes, ASTM F 2170. Proceed with installation only after substrates have maximum 75 percent relative humidity level measurement.
- C. Fill cracks, holes, and depressions in substrates with trowelable leveling and patching compound and remove bumps and ridges to produce a uniform and smooth substrate.
- D. Do not install resilient products until they are same temperature as the space where they are to be installed.
 - 1. Move resilient products and installation materials into spaces where they will be installed at least 48 hours in advance of installation.
- E. Sweep and vacuum clean substrates to be covered by resilient products immediately before installation.

3.2 RESILIENT BASE INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient base.
- B. Apply resilient base to walls, columns, pilasters, casework and cabinets in toe spaces, and other permanent fixtures in rooms and areas where base is required.
- C. Install resilient base in lengths as long as practicable without gaps at seams and with tops of adjacent pieces aligned.
- D. Tightly adhere resilient base to substrate throughout length of each piece, with base in continuous contact with horizontal and vertical substrates.

- E. Do not stretch resilient base during installation.

3.3 RESILIENT ACCESSORY INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient accessories.
- B. Resilient Molding Accessories: Butt to adjacent materials and tightly adhere to substrates throughout length of each piece. Install reducer strips at edges of resilient floor covering that would otherwise be exposed.

3.4 CLEANING AND PROTECTION

- A. Comply with manufacturer's written instructions for cleaning and protection of resilient products.
- B. Floor Polish: Remove soil, visible adhesive, and surface blemishes from resilient stair treads before applying liquid floor polish.
 - 1. Apply three coat(s).
- C. Cover resilient products until Substantial Completion.

END OF SECTION 09653

SECTION 09911 - EXTERIOR PAINTING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes surface preparation and the application of paint systems on the following exterior substrates:
 - 1. Steel.
 - 2. Galvanized metal.
 - 3. Wood.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For each finish and for each color and texture required.
- C. Product List: Printout of current "MPI Approved Products List" for each product category specified in Part 2, with the proposed product highlighted.

1.3 QUALITY ASSURANCE

- A. MPI Standards:
 - 1. Products: Complying with MPI standards indicated and listed in "MPI Approved Products List."
 - 2. Preparation and Workmanship: Comply with requirements in "MPI Architectural Painting Specification Manual" for products and paint systems indicated.
- B. Mockups: Apply benchmark samples of each paint system indicated and each color and finish selected to verify preliminary selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.
 - 1. Architect will select one surface to represent surfaces and conditions for application of each paint system specified in Part 3.
 - a. Vertical and Horizontal Surfaces: Provide samples of at least 100 sq. ft.
 - b. Other Items: Architect will designate items or areas required.
 - 2. Final approval of color selections will be based on benchmark samples.
 - a. If preliminary color selections are not approved, apply additional benchmark samples of additional colors selected by Architect at no added cost to Owner.

1.4 EXTRA MATERIALS

- A. Furnish extra materials described below that are from same production run (batch mix) as materials applied and that are packaged for storage and identified with labels describing contents.
 - 1. Quantity: Furnish an additional 5 percent, but not less than 1 gal. of each material and color applied.

PART 2 - PRODUCTS**2.1 PAINT, GENERAL**

- A. Material Compatibility:
 - 1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
 - 2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.
- B. Colors: As selected by Architect from manufacturer's full range.

2.2 PRIMERS/SEALERS

- A. Alkali-Resistant Primer: MPI #3.
 - 1. VOC Content: E Range of E1.
- B. Bonding Primer (Solvent Based): MPI #69.
 - 1. VOC Content: E Range of E1.
- C. Wood-Knot Sealer: Sealer recommended in writing by topcoat manufacturer for use in paint system indicated.

2.3 METAL PRIMERS

- A. Alkyd Anticorrosive Metal Primer: MPI #79.
 - 1. VOC Content: E Range of E1.

2.4 WOOD PRIMERS

- A. Exterior Alkyd Wood Primer: MPI #5.
 - 1. VOC Content: E Range of E2.

2.5 EXTERIOR LATEX PAINTS

- A. Exterior Latex (Semigloss): MPI #11 (Gloss Level 5).
 - 1. VOC Content: E Range of E1.

2.6 EXTERIOR ALKYD PAINTS

- A. Exterior Alkyd Enamel (Semigloss): MPI #94 (Gloss Level 5).
 - 1. VOC Content: E Range of E1.

2.7 QUICK-DRYING ENAMELS

- A. Quick-Drying Enamel (Semigloss): MPI #81 (Gloss Level 5).
 - 1. VOC Content: E Range of E1.

PART 3 - EXECUTION**3.1 EXAMINATION**

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
 - 1. Concrete: 12 percent.
 - 2. Masonry (Clay and CMU): 12 percent.
 - 3. Wood: 15 percent.
 - 4. Plaster: 12 percent.
 - 5. Gypsum Board: 12 percent.
- C. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- D. Begin coating application only after unsatisfactory conditions have been corrected and surfaces are dry.
 - 1. Beginning coating application constitutes Contractor's acceptance of substrates and conditions.

3.2 PREPARATION AND APPLICATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual" applicable to substrates and paint systems indicated.

- B. Clean substrates of substances that could impair bond of paints, including dirt, oil, grease, and incompatible paints and encapsulants.
 - 1. Remove incompatible primers and reprime substrate with compatible primers as required to produce paint systems indicated.
- C. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
- D. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- E. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.3 EXTERIOR PAINTING SCHEDULE

A. Steel Substrates:

- 1. Alkyd System: MPI EXT 5.1D.
 - a. Prime Coat: Alkyd anticorrosive metal primer.
 - b. Intermediate Coat: Exterior alkyd enamel matching topcoat.
 - c. Topcoat: Exterior alkyd enamel semigloss.

B. Galvanized-Metal Substrates:

- 1. Alkyd System: MPI EXT 5.3B.
 - a. Prime Coat: Cementitious galvanized-metal primer.
 - b. Intermediate Coat: Exterior alkyd enamel matching topcoat.
 - c. Topcoat: Exterior alkyd enamel semigloss.

C. Glue-Laminated Beam and Column Substrates:

- 1. Latex Over Alkyd Primer System: MPI EXT 6.1A.
 - a. Prime Coat: Exterior alkyd wood primer.
 - b. Intermediate Coat: Exterior latex matching topcoat.
 - c. Topcoat: Exterior latex semigloss.

D. Dressed Lumber Substrates: Including architectural woodwork.

- 1. Latex Over Alkyd Primer System: MPI EXT 6.3A.
 - a. Prime Coat: Exterior alkyd wood primer.
 - b. Intermediate Coat: Exterior latex matching topcoat.
 - c. Topcoat: Exterior latex semigloss.

C203304-RA (K-3800)

BEAUFORT COUNTY

E. Dimension Lumber Substrates, Nontraffic Surfaces: Including board framing, undersides of decking.

1. Latex Over Alkyd Primer System: MPI EXT 6.2A.
 - a. Prime Coat: Exterior alkyd wood primer.
 - b. Intermediate Coat: Exterior latex matching topcoat.
 - c. Topcoat: Exterior latex semigloss.

END OF SECTION 09911

SECTION 09912 - INTERIOR PAINTING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes surface preparation and the application of paint systems on the following interior substrates:
 - 1. Steel.
 - 2. Galvanized metal.
 - 3. Wood.
 - 4. Gypsum board.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For each finish and for each color and texture required.
- C. Product List: Printout of current "MPI Approved Products List" for each product category specified in Part 2, with the proposed product highlighted.

1.3 QUALITY ASSURANCE

- A. MPI Standards:
 - 1. Products: Complying with MPI standards indicated and listed in "MPI Approved Products List."
 - 2. Preparation and Workmanship: Comply with requirements in "MPI Architectural Painting Specification Manual" for products and paint systems indicated.
- B. Mockups: Apply benchmark samples of each paint system indicated and each color and finish selected to verify preliminary selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.
 - 1. Architect will select one surface to represent surfaces and conditions for application of each paint system specified in Part 3.
 - a. Wall and Ceiling Surfaces: Provide samples of at least 100 sq. ft.
 - b. Other Items: Architect will designate items or areas required.
 - 2. Apply benchmark samples after permanent lighting and other environmental services have been activated.
 - 3. Final approval of color selections will be based on benchmark samples.
 - a. If preliminary color selections are not approved, apply additional benchmark samples of additional colors selected by Architect at no added cost to Owner.

1.4 EXTRA MATERIALS

- A. Furnish extra materials described below that are from same production run (batch mix) as materials applied and that are packaged for storage and identified with labels describing contents.
1. Quantity: Furnish an additional 5 percent, but not less than 1 gal. of each material and color applied.

PART 2 - PRODUCTS

2.1 PAINT, GENERAL

- A. Material Compatibility:
1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
 2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.
- B. VOC Content of Field-Applied Interior Paints and Coatings: Provide products that comply with the following limits for VOC content, exclusive of colorants added to a tint base, when calculated according to 40 CFR 59, Subpart D (EPA Method 24); these requirements do not apply to paints and coatings that are applied in a fabrication or finishing shop:
1. Flat Paints, Coatings, and Primers: VOC content of not more than 50 g/L.
 2. Nonflat Paints, Coatings, and Primers: VOC content of not more than 150 g/L.
 3. Anti-Corrosive and Anti-Rust Paints Applied to Ferrous Metals: VOC not more than 250 g/L.
 4. Shellacs, Clear: VOC not more than 730 g/L.
 5. Primers, Sealers, and Undercoaters: VOC content of not more than 200 g/L.
 6. Dry-Fog Coatings: VOC content of not more than 400 g/L.
 7. Zinc-Rich Industrial Maintenance Primers: VOC content of not more than 340 g/L.
- C. Chemical Components of Field-Applied Interior Paints and Coatings: Provide topcoat paints and anti-corrosive and anti-rust paints applied to ferrous metals that comply with the following chemical restrictions; these requirements do not apply to paints and coatings that are applied in a fabrication or finishing shop:
1. Aromatic Compounds: Paints and coatings shall not contain more than 1.0 percent by weight of total aromatic compounds (hydrocarbon compounds containing one or more benzene rings).
 2. Restricted Components: Paints and coatings shall not contain any of the following:
 - a. Acrolein.
 - b. Acrylonitrile.
 - c. Antimony.
 - d. Benzene.

- e. Butyl benzyl phthalate.
- f. Cadmium.
- g. Di (2-ethylhexyl) phthalate.
- h. Di-n-butyl phthalate.
- i. Di-n-octyl phthalate.
- j. 1,2-dichlorobenzene.
- k. Diethyl phthalate.
- l. Dimethyl phthalate.
- m. Ethylbenzene.
- n. Formaldehyde.
- o. Hexavalent chromium.
- p. Isophorone.
- q. Lead.
- r. Mercury.
- s. Methyl ethyl ketone.
- t. Methyl isobutyl ketone.
- u. Methylene chloride.
- v. Naphthalene.
- w. Toluene (methylbenzene).
- x. 1,1,1-trichloroethane.
- y. Vinyl chloride.

D. Colors: As selected by Architect from manufacturer's full range .

2.2 PRIMERS/SEALERS

A. Interior Latex Primer/Sealer: MPI #50.

- 1. VOC Content: E Range of E1.
- 2. Environmental Performance Rating: EPR 1.

B. Interior Alkyd Primer/Sealer: MPI #45.

- 1. VOC Content: E Range of E1.

C. Wood-Knot Sealer: Sealer recommended in writing by topcoat manufacturer for use in paint systems indicated.

2.3 METAL PRIMERS

A. Alkyd Anticorrosive Metal Primer: MPI #79.

- 1. VOC Content: E Range of E1.

2.4 WOOD PRIMERS

A. Interior Latex-Based Wood Primer: MPI #39.

1. VOC Content: E Range of E1.
2. Environmental Performance Rating: EPR 1.

2.5 LATEX PAINTS

A. Institutional Low-Odor/VOC Latex (Flat): MPI #143 (Gloss Level 1).

1. VOC Content: E Range of E3.
2. Environmental Performance Rating: EPR 4.

B. Institutional Low-Odor/VOC Latex (Eggshell): MPI #145 (Gloss Level 3).

1. VOC Content: E Range of E3.
2. Environmental Performance Rating: EPR 4.5.

2.6 ALKYD PAINTS

A. Interior Alkyd (Semigloss): MPI #47 (Gloss Level 5).

1. VOC Content: E Range of E1.
2. Environmental Performance Rating: EPR 1.

2.7 QUICK-DRYING ENAMELS

A. Quick-Drying Enamel (Semigloss): MPI #81 (Gloss Level 5).

1. VOC Content: E Range of E1.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
 1. Concrete: 12 percent.
 2. Masonry (Clay and CMU): 12 percent.
 3. Wood: 15 percent.
 4. Gypsum Board: 12 percent.
- C. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.

- D. Begin coating application only after unsatisfactory conditions have been corrected and surfaces are dry.
 - 1. Beginning coating application constitutes Contractor's acceptance of substrates and conditions.

3.2 PREPARATION AND APPLICATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual" applicable to substrates indicated.
- B. Clean substrates of substances that could impair bond of paints, including dirt, oil, grease, and incompatible paints and encapsulants.
 - 1. Remove incompatible primers and reprime substrate with compatible primers as required to produce paint systems indicated.
- C. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
- D. Painting Mechanical and Electrical Work: Paint items exposed in equipment rooms and occupied spaces including, but not limited to, the following:
 - 1. Mechanical Work:
 - a. Uninsulated metal piping.
 - b. Uninsulated plastic piping.
 - c. Pipe hangers and supports.
 - d. Tanks that do not have factory-applied final finishes.
 - e. Visible portions of internal surfaces of metal ducts, without liner, behind air inlets and outlets.
 - f. Duct, equipment, and pipe insulation having cotton or canvas insulation covering or other paintable jacket material.
 - g. Mechanical equipment that is indicated to have a factory-primed finish for field painting.
 - 2. Electrical Work:
 - a. Switchgear.
 - b. Panelboards.
 - c. Electrical equipment that is indicated to have a factory-primed finish for field painting.
- E. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- F. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.3 INTERIOR PAINTING SCHEDULE

A. Steel Substrates:

1. Alkyd System: MPI INT 5.1E.

- a. Prime Coat: Alkyd anticorrosive metal primer.
- b. Intermediate Coat: Interior alkyd matching topcoat.
- c. Topcoat: Interior alkyd (semigloss).

B. Galvanized-Metal Substrates:

1. Alkyd System: MPI INT 5.3C.

- a. Prime Coat: Cementitious galvanized-metal primer.
- b. Intermediate Coat: Interior alkyd matching topcoat.
- c. Topcoat: Interior alkyd (semigloss).

C. Dressed Lumber Substrates: Including architectural woodwork.

1. Alkyd System: MPI INT 6.3B.

- a. Prime Coat: Interior alkyd primer/sealer.
- b. Intermediate Coat: Interior alkyd matching topcoat.
- c. Topcoat: Interior alkyd (semigloss).

D. Gypsum Board Substrates:

1. Institutional Low-Odor/VOC Latex System: MPI INT 9.2M.

- a. Prime Coat: Interior latex primer/sealer.
- b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
- c. Topcoat: Institutional low-odor/VOC interior latex (flat) and (eggshell).

END OF SECTION 09912

SECTION 096623 – EPOXY TERRAZZO FLOORING**PART 1 – GENERAL****1.01 RELATED DOCUMENTS**

- A. Drawings and general provisions of the contract, including general and supplementary conditions and division 1 specification sections, apply to this section.
- B. General contractor or other is to provide water, 220 volt single phase 100 amp breaker & 480 volt 3 phase 60 amp breaker electrical services with hookups and disconnects within 200 feet of any terrazzo area are to be provided by others at no cost to this subcontractor.
- C. Testing should be conducted according to ASTM F2170 only (determining relative humidity in concrete slabs using in situ probes. This test should be conducted by an independent tester.)

1.02 SUMMARY

- A. Section Includes:
 - 1. Thin-set epoxy terrazzo flooring including preparation of substrates
 - 2. Related accessories
- B. Related Sections:
 - 1. Section 03300, Cast-in-Place Concrete
 - 2. Section 04200, Unit Masonry
 - 3. Section 07900, Joint Sealants

1.03 SUBMITTALS

- A. Manufacturer's product data for each type of terrazzo and accessory: System will be evaluated on the basis of standards. For tests not listed in published data, manufacturer shall supply missing data according to standard referenced.
 - 1. Physical properties
 - 2. Performance properties
 - 3. Specified tests
 - 4. Material Safety Data Sheet
 - 5. Manufacturer's standard warranty
- B. Shop Drawings: Include terrazzo installation requirements. Include plans, elevations, sections, component details, and attachments to other work. Show layout of the following:
 - 1. Divider strips
 - 2. Control- and expansion-joint strips
 - 3. Base and border strips
- C. Samples for initial selection: Manufacturer's color plates showing the full range of colors and patterns available for each terrazzo type indicated.
- D. Samples for Verification: Match architect's samples for each type, material, color, and pattern of terrazzo and accessory required showing the full range of color, texture, and pattern variations expected. Label each terrazzo sample to identify manufacturer's matrix color and aggregate types, sizes, and proportions. Prepare samples of same thickness and from same material to be used for the work in size indicated below:
 - 1. Epoxy Terrazzo: Minimum 6" x 6" (152.4 mm x 152.4 mm) sample of each color and type of terrazzo.
 - 2. Accessories: 6" length (152.4 mm) of each kind of divider strip, stop strip, and control joint strip required.
- E. Manufacturer Experience:
 - 1. Submit proof of Associate membership in NTMA.
 - 2. Provide a list of at least 5 epoxy terrazzo projects installed during the previous 5 years using material being submitted for this project and of the same scope, complexity, and at least 75% of the square footage.
 - 3. Manufacturer must provide history of providing primary epoxy materials for a minimum of 10 years.
- F. Qualification Data: For qualified Installer.

1. Submit proof of Contractor membership in NTMA and provide a list of at least 5 epoxy terrazzo projects installed during the previous 5 years using material being submitted for this project and of the same scope, complexity, and at least 75% of the square footage.
2. Terrazzo contractor must prequalify prior to bid date.
- G. Material Test Reports: For moisture and / or relative humidity of substrate
- H. Maintenance Data: Submit 3 copies of NTMA maintenance recommendations and 3 copies of manufacturer's instructions

1.04 QUALITY ASSURANCE

- A. Installer Qualifications: A qualified installer who is acceptable to architect and epoxy terrazzo manufacturer to install manufacturer's products.
 1. Engage a terrazzo contractor with a minimum of 5 epoxy terrazzo projects installed during the previous 5 years using material being submitted for this project and of the same scope, complexity, and at least 75% of the square footage.
 2. Engage an installer who is a Contractor member of NTMA
- B. Source Limitations:
 1. Obtain primary epoxy terrazzo flooring system materials including membranes, primers, moisture vapor primers, resins, and hardening agents from a single manufacturer with proof of NTMA membership
 2. Manufacturer must provide history of providing primary materials for a minimum of 10 years
 3. Obtain aggregates, divider strips, sealers, cleaners from source recommended by primary materials manufacturer
- C. Pre-installation Conference: Conduct conference at project site to comply with requirements in section 01200 – Project Meetings. Review methods and procedures related to terrazzo including, but not limited to, the following:
 1. Inspect and discuss installation procedures, joint details, jobsite conditions, substrate specification, vapor barrier details, and coordination with other trades
 2. Review and finalize construction, schedule and verify availability of materials, Installer's personnel, equipment, and facilities needed to make progress and avoid delays
 3. Review special terrazzo designs and patterns
 4. Review dust control procedures
 5. Review plans for concrete curing and site drying to enable timely achievement of suitable slab moisture conditions
- D. NTMA Standards: Comply with NTMA's "Terrazzo Specifications and Design Guide" and with written recommendations for terrazzo type indicated unless more stringent requirements are specified
- E. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution
 1. Build mockups for terrazzo including accessories
 - a. Size: Minimum 100 sq. ft. (9.3 sq. m.) of typical poured-in-place flooring condition for each color and pattern in locations directed by Architect.
 - b. Approved mockup may become part of the completed work if undistributed at time of substantial completion
 - c. Option: A mockup 48 x 48 inches to be done in each color and pattern for flooring and delivered to the project site by sub contractor for approval by architect

1.05 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials to project site in supplier's original wrappings and containers, labeled with source or manufacturer name, material, or product brand name, and lot number, if any.
- B. Store materials in their original, undamaged packages and containers, inside a well-ventilated area protected from weather, moisture, soiling, extreme temperatures, and humidity.
 1. Storage temperatures should be between 60°F to 80°F

1.06 PROJECT CONDITIONS

- A. Terrazzo contractor shall, prior to surface preparation:
 1. Evaluate slab condition, including slab moisture content and extent of any required repairs.

2. Maintain the ambient room temperature at 60°F and floor/slab at 50°F or above for a period extending 72 hours before, during, and after floor installation. Concrete to receive epoxy terrazzo shall have cured for at least 28 days and be free of all curing compounds (unless moisture vapor primer is incorporated into the system). Test concrete substrate to determine acceptable moisture levels prior to installation.
- B. Acceptable Substrates:
1. Flatness tolerance: Concrete subfloor shall be flat with a maximum variation from level of $\frac{1}{4}$ " in any 10 feet. Any irregularity of the surface requiring patching and / or leveling shall be done using an appropriate terrazzo fill and selected aggregates as recommended by NTMA resin systems.
 2. Concrete floor shall be prepared mechanically by shot blasting. Grinding of slab is not sufficient surface preparation. Surface preparation results should achieve a CSP3-CSP5 profile according to International Concrete Repair Institute Guideline No. 03732.
 3. Concrete floor shall receive a steel trowel finish.
 4. Concrete shall be cured a minimum of 28 days. No curing agents are to be used in areas to receive terrazzo.
 5. Concrete slab shall have an efficient moisture vapor barrier (suggested minimum: fiber reinforced 15 mils thickness) directly under the concrete slab. Moisture barrier shall NOT be punctured.
 6. Saw cutting of control joints must be done between 12 – 24 hours after placement of the structural concrete and at a minimum of $\frac{1}{2}$ the concrete thickness.
- C. General contractor or owner to provide permanent lighting or, if permanent lighting is not in place, simulate permanent lighting conditions during terrazzo installation.
- D. General contractor or owner to provide protection from other trades prior to final acceptance by Owner.
- E. It is preferred that any drywall be installed after the terrazzo is rough ground. If schedule dictates otherwise, be installed $\frac{3}{4}$ " above the terrazzo thickness to prevent wicking during the polish grinding wet process.

PART 2 – PRODUCTS

2.01 EPOXY TERRAZZO

- A. Products: Systems Overview: Resin Systems Epoxy Matrix by: Acceptable Manufacturers:
1. Terrazzo & Marble Supply Company
 2. General Polymers Brand of Sherwin-Williams
 3. Master Terrazzo Technologies
1. Primer: Moisture Vapor Primer
 2. Physical properties of moisture mitigating primer shall have a maximum of 0.3 perms with 100% RH.
 3. Flexible Reinforcing Membrane: Iso-Crack Epoxy Membrane, for substrate crack preparation and reflective crack reduction.
 - a. Reinforcement: Fiberglass scrim.
 4. Epoxy Matrix: Epoxy matrix and in color required for mix indicated.
 - a. Physical properties without aggregates. All specimens cured for 7 days at 75°F plus or minus 2°F and 50% plus or minus 2% RH. This product shall meet the following requirements:

Property	Test Method	NTMA Requirements
Hardness	ASTM D-2240 using Shore-D Durometer	60-85
Tensile Strength	ASTM D-638	3,000 psi min.

Compressive Strength	ASTM D-695 Specimen B cylinder	10,000 psi min.
Flexural Strength	ASTM D-790	Not specified
Chemical Resistance	ASTM D-1308 seven days at room temperature by immersion method	No deleterious effects: ▪ Distilled Water ▪ Mineral Oil ▪ Isopropanol ▪ Ethanol ▪ 0.025 Detergent Solution ▪ 1% Soap Solution ▪ 10% Sodium Hydroxide ▪ 10% Hydrochloric Acid ▪ 30% Sulfuric Acid ▪ 5% Acetic Acid

- b. Physical properties with aggregates. For epoxy matrix blended with 3 volumes of Georgia White marble blended 60% #1 chip and 40% #0 chip, ground and grouted with epoxy resin according to installation specifications, finishing to a nominal $\frac{1}{4}$ " thickness. All specimens cured for 7 days at 75°F plus or minus 2°F and 50% RH plus or minus 2% RH. This finished epoxy matrix shall meet the following requirements:

Property	Test Method	NTMA Requirements
Flammability	ASTM D-635	Self-extinguishing, extent of burning 0.25 inches max.
Thermal Coefficient of Linear Expansion	ASTM D-696	25×10^{-6} inches per inch per degrees to 140°F
Bond Strength	ACI COMM 403, Bulletin 59-43 (pages 1139-1141)	300 psi (100% concrete failure)

5. Aggregates [OPTION: Marble, glass, mother of pearl] Complying with NTMA gradation standards for mix indicated and containing no deleterious or foreign matter.
 - a. Abrasion and impact resistance: Less than 40% loss per ASTM C 131.
 - b. 24-Hour absorption rate: Less than 0.74%.
 - c. Dust content: Less than 1.0% by weight.
6. Finishing Grout: NTMA approved resin systems.
- B. Mix: Comply with NTMA's "Terrazzo Specifications and Design Guide" and manufacturer's written instructions for matrix and aggregate proportions and mixing.
 1. Color and Pattern Schedule: As selected by the Architect.
 2. The chip blend will consist of 80% north american marble chips, 10% MOP, 10% one sided mirror and will not exceed size 1. (TM# 12-490)

2.02 STRIP MATERIALS

- A. Thin-set Divider Strips: L-type.
1. Material White-zinc alloy.
 2. Guide for commonly used L-type divider strips for thin-set epoxy terrazzo systems:

System Height	Strip Height	Strip Width
$\frac{3}{8}$ " System	$\frac{3}{8}$ "	$\frac{1}{4}$ "

- B. Control-Joint Strips: Separate double L-type angles, positioned back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. (Single L-type angle, positioned adjacent to the joint is also acceptable.) Fill joint

with 100% solids epoxy joint filler. Fill area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated. (For buried control joint): Fill saw cut concrete control joint with 100% solids epoxy filler, apply Iso-Crack Membrane 30-40 mils, embed 12" fiberglass fabric reinforcement. Saw cut control joints should be prefilled with hard epoxy and a single "L" divider with the vertical part placed precisely over the cut. If the saw cut control joint opening is $\frac{1}{4}$ " or wider, the strip treatment should be as a cold-pour construction below.

- C. Construction-Joint (Cold-Joint) Strips: Separate double L-type angles back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. Fill joint and area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated.
- D. Isolation-Joint Strips: Separate double L-type angles, positioned back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. Fill area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated.
- E. Accessory Strips: Match divider strip width, material, and color unless otherwise indicated. Use the following types of accessory strips if specified and detailed:
 - 1. Edge-bead for exposed edges of terrazzo

2.03 MISCELLANEOUS ACCESSORIES

- A. Strip Adhesive: 100% solids epoxy resin adhesive
 - 1. Use adhesive that has a VOC content of 50g / L or less when calculated according to 40 CFR 59, subpart D (EPA Method 24)
- B. Patching and Fill Material: Fill and selected aggregates as recommended and approved by NTMA Resin Systems
- C. Joint Compound: Joint filler, color to be selected by architect to match / compliment terrazzo
- D. Cleaner: Clean with a neutral cleaner with pH factor between 7 – 10 specifically designed for terrazzo

PART 3 – EXECUTION

3.01 EXAMINATION

- A. Examine substrates and areas, with terrazzo contractor present, for compliance with requirements for installation tolerances and other conditions affecting performance.
- B. Proceed with installation only after unsatisfactory conditions, including level tolerances, have been corrected.

3.02 PREPARATION

- A. Clean substrates of substances, including oil, grease, and curing compounds, that might impair Concrete Slabs:
 - 1. Provide sound concrete surface free of laitance, glaze, efflorescence, curing compounds, form-release agents, dust, dirt, grease, oil, and other contaminants incompatible with terrazzo.
 - a. Prepare concrete mechanically by shot-blasting. Grinding of slab is not sufficient surface preparation. Surface preparation results should achieve a CSP3-CSP5 profile according to International Concrete Repair Institute Guideline No. 03732.
 - b. Repair or flatten damaged and deteriorated concrete according to Terrazzo Resin Systems Technical Bulletin 008 Substrate Leveling Requirements for Thin-Set Epoxy Terrazzo
 - c. Repair cracks and non-expansion joints greater than $\frac{1}{16}$ " (1.6 mm) wide according to Resin Systems Technical Bulletin 009 Crack Detailing and Joint Treatments Resin Thin-set Epoxy Terrazzo.
 - 2. Verify that concrete substrates are visibly dry and free of moisture.
 - 3. Moisture Testing:
 - a. Test for moisture according to ASTM F2170 (determining relative humidity in concrete slabs using in situ probes). Proceed with installation only after substrates have a maximum relative humidity measurement reading less than 80%. If relative humidity measurement reading is greater than or equal to 80%, moisture vapor primer (MVP) is

recommended. Apply to terrazzo substrates according to resin systems MVP product data sheet.

3.03 EPOXY TERRAZZO INSTALLATION

A. General:

1. Comply with NTMA's written recommendations for terrazzo and accessory installation.
2. Place, rough grind, grout, cure grout, fine grind, and finish terrazzo according to resin systems epoxy matrix product data sheet and NTMA's "Terrazzo Specifications and Design Guide".
3. Ensure that matrix components and fluids from grinding operations do not stain terrazzo by reacting with divider and control-joint strips.
4. Delay fine grinding until heavy trade work is complete and construction traffic through area is restricted unless general contractor or owner is prepared to protect the final finish.

B. Thickness: $\frac{3}{8}$ " (9.5 mm)

C. Moisture Vapor Primer (MVP): Apply to terrazzo substrates according to resin systems moisture vapor primer product data sheet.

D. Primer: Apply to terrazzo substrates according to resin systems primer product data sheet.

E. Flexible Reinforcing Membrane for cracks only.

1. Membrane application for isolated cracking. Route out all cracks and fill with 100% solids epoxy. Apply Iso-Crack Epoxy Membrane (spread at 40 mils thickness) across the crack allowing a minimum of 9 inches on either side. Embed fiberglass scrim into wet membrane and saturate with additional membrane. Allow for 5% of total terrazzo square footage in lineal feet of crack detailing.

Example: 10,000 SF – allow for 500 LF of crack detailing.

F. Strip Materials:

1. Divider and Accessory Strips:

- a. Install strips in adhesive setting bed without voids below strips or mechanically anchor strips as required to attach strips to substrate.
- b. Control-Joint Strips: Separate double L-type angles, positioned back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. (single L-type angle, positioned adjacent to the joint is also acceptable.) Fill joint with 100% solids epoxy joint filler. Fill area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated.
 - i. Buried Control Joint: Fill saw cut concrete control joint with 100% solids epoxy filler. Apply Terroxy Iso-Crack Membrane 30-40 mils, embed 12" fiberglass fabric reinforcement.
 - ii. Eliminate double L and filler at control joints unless opening at saw cut is 1/4' or greater.
- c. Construction-Joint (Cold-Joint) Strips: Separate double L-type angles, positioned back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. Fill joint and area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated.
- d. Isolation-Joint Strips: Separate double L-type angles, positioned back to back with minimum $\frac{1}{8}$ " – $\frac{1}{4}$ " width between. Fill area between strips with elastomeric joint filler. Match material, thickness, and color of divider strips and depth required for topping thickness indicated.

G. Placing Terrazzo:

1. Mix epoxy matrix with chips and fillers in ratios directed by resin systems.
2. Trowel-apply terrazzo mixture over epoxy primer to provide a dense flat surface to top of divider strips. Allow to cure per Resin Systems recommendations before rough grinding.

H. Rough Grinding: Grind with 60 grit & 150 Diamond matrix stones until all terrazzo strips and marble chips are uniformly exposed.

I. Grouting:

1. Cleanse floor with clean water and rinse.
2. Remove excess rinse water by wet vacuum, dry, and fill voids with resin systems epoxy matrix or clear resin.

3. Allow grout to cure. Grout may be left on terrazzo until other trades work is completed. Remove excess grout with 150 grit diamonds and then follow with 200 grit diamonds.
- J. Polishing: Grinding with 400-grit diamonds until all grout is removed from surface. Repeat rough grinding, grout coat, and polishing if large terrazzo chip voids exist after initial polishing. Produce surface with a minimum of 70% aggregate exposure. Polish floor with 3000 grit diamond polishing pads and apply "3M ScotchgardTM Stone Floor Protector" high performance hardener.

3.05 CLEANING AND PROTECTION

- A. Cleaning: Remove grinding dust from installation and wash all surfaces with cleaner.
- B. After application of two coats of Acrylic (Water base) sealer in accordance with manufacturer's instructions, the work shall be ready for final inspection and acceptance by the Owner or his agent.
- C. The General Contractor shall protect terrazzo flooring from damage until project completion; any damage that does occur shall be the responsibility of the General Contractor to repair or replace to the satisfaction of the Architect.

END OF SECTION

SECTION 10155 - TOILET COMPARTMENTS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Solid-plastic toilet compartments configured as toilet enclosures and urinal screens.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For toilet compartments. Include plans, elevations, sections, details, and attachments to other work.
- C. Samples for each exposed product and for each color and texture specified.
- D. Product certificates.
- E. Maintenance data.

1.3 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: As determined by testing identical products according to ASTM E 84, or another standard acceptable to authorities having jurisdiction, by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
 - 1. Flame-Spread Index: 25 or less.
 - 2. Smoke-Developed Index: 450 or less.
- B. Regulatory Requirements: Comply with applicable provisions in the U.S. Architectural & Transportation Barriers Compliance Board's "Americans with Disabilities Act (ADA) and Architectural Barriers Act (ABA) Accessibility Guidelines for Buildings and Facilities" for toilet compartments designated as accessible.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Steel Sheet: Commercial steel sheet for exposed applications; mill phosphatized and selected for smoothness.
 - 1. Electrolytically Zinc Coated: ASTM A 879/A 879M, 01Z
 - 2. Hot-Dip Galvanized: ASTM A 653/A 653M, either hot-dip galvanized or galvannealed.

- B. Zamac: ASTM B 86, commercial zinc-alloy die castings.

2.2 SOLID-PLASTIC UNITS

- A. Toilet-Enclosure Style: Overhead braced
- B. Urinal-Screen Style: Overhead braced.
- C. Door, Panel, Screen, and Pilaster Construction: Solid, high-density polyethylene (HDPE) panel material, not less than 1 inch thick, seamless, with eased edges, no-sightline system, and with homogenous color and pattern throughout thickness of material.
 - 1. Piano style hinge: 16-gauge continuous piano hinge, stainless steel, with one-way stainless steel screws set into threaded inserts.
 - 2. Heat-Sink Strip: Manufacturer's standard continuous, stainless-steel strip fastened to exposed bottom edges of solid-polymer components to prevent burning.
 - 3. Polymer Panel & Finish: Any proposed substitutions of the product listed below are to be submitted prior to bid and must be approved by owner prior to bid.
 - a. Manufacturer: Scranton Products
 - b. Product: Hiny Hiders Solid Bathroom Partitions
 - c. Color and Texture: Color = Stainless Steel; Texture = EX
- D. Pilaster Shoes and Sleeves (Caps): Stainless steel.
- E. Brackets (Fittings):
 - 1. Full-Height (Continuous) Type: Stainless steel.

2.3 ACCESSORIES

- A. Hardware and Accessories: Manufacturer's standard design, heavy-duty operating hardware and accessories.
 - 1. Material: Stainless steel.
 - 2. Hinges: Manufacturer's standard continuous, spring-loaded type.
 - 3. Latch and Keeper: Manufacturer's heavy duty surface-mounted latch unit designed for emergency access and with combination rubber-faced door strike and keeper. Provide units that comply with regulatory requirements for accessibility at compartments designated as accessible.
 - 4. Coat Hook: Manufacturer's standard combination hook and rubber-tipped bumper, sized to prevent in-swinging door from hitting compartment-mounted accessories.
 - 5. Door Bumper: Manufacturer's standard rubber-tipped bumper at out-swinging doors.
 - 6. Door Pull: Manufacturer's standard unit at out-swinging doors that complies with regulatory requirements for accessibility. Provide units on both sides of doors at compartments designated as accessible.
- B. Overhead Bracing: Manufacturer's standard continuous, extruded-aluminum head rail with antigrip profile and in manufacturer's standard finish.

- C. Anchorages and Fasteners: Manufacturer's standard exposed fasteners of stainless steel or chrome-plated steel or brass, finished to match the items they are securing, with theft-resistant-type heads. Provide sex-type bolts for through-bolt applications. For concealed anchors, use stainless steel, hot-dip galvanized steel, or other rust-resistant, protective-coated steel.

2.4 FABRICATION

- A. Overhead-Braced Units: Provide manufacturer's standard corrosion-resistant supports, leveling mechanism, and anchors at pilasters to suit floor conditions. Provide shoes at pilasters to conceal supports and leveling mechanism.
- B. Door Size and Swings: Unless otherwise indicated, provide 24-inch wide, in-swinging doors for standard toilet compartments and 36-inch wide, out-swinging doors with a minimum 32-inch wide, clear opening for compartments designated as accessible.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Comply with manufacturer's written installation instructions. Install units rigid, straight, level, and plumb. Secure units in position with manufacturer's recommended anchoring devices.
- B. Clearances: Maximum 1/2 inch between pilasters and panels; 1 inch between panels and walls.

3.2 ADJUSTING

- A. Hardware Adjustment: Adjust and lubricate hardware according to hardware manufacturer's written instructions for proper operation. Set hinges on in-swinging doors to hold doors open approximately 30 degrees from closed position when unlatched. Set hinges on out-swinging doors to return doors to fully closed position.

END OF SECTION 10155

SECTION 10200 - LOUVERS AND VENTS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Fixed, extruded-aluminum louvers.
- B. See Division 15 Sections for louvers that are a part of mechanical equipment.

1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design louvers, including comprehensive engineering analysis by a qualified professional engineer, using structural and seismic performance requirements and design criteria indicated.
- B. Structural Performance: Louvers shall withstand the effects of gravity loads and the following loads and stresses within limits and under conditions indicated without permanent deformation of louver components, noise or metal fatigue caused by louver blade rattle or flutter, or permanent damage to fasteners and anchors.
1. Wind Loads: Determine loads based on a uniform pressure of 30 lbf/sq. ft., acting inward or outward.
- C. Seismic Performance: Louvers, including attachments to other construction, shall withstand the effects of earthquake motions determined according to SEI/ASCE 7.
1. Component Importance Factor is 1.0.
- D. Louver Performance Ratings: Provide louvers complying with requirements specified, as demonstrated by testing manufacturer's stock units identical to those provided, except for length and width according to AMCA 500-L.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
1. For louvers specified to bear AMCA seal, include printed catalog pages showing specified models with appropriate AMCA Certified Ratings Seals.
- B. Shop Drawings: For louvers and accessories. Include plans, elevations, sections, details, and attachments to other work. Show frame profiles and blade profiles, angles, and spacing.
- C. Samples: For each type of metal finish required.

- D. Delegated-Design Submittal: For louvers indicated to comply with structural[**and seismic**] performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
- E. Product Test Reports: Based on tests performed according to AMCA 500-L.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Aluminum Extrusions: ASTM B 221, Alloy 6063-T5, T-52, or T6.
- B. Aluminum Sheet: ASTM B 209, Alloy 3003 or 5005 with temper as required for forming, or as otherwise recommended by metal producer for required finish.
- C. Fasteners: Use types and sizes to suit unit installation conditions.
 - 1. For fastening aluminum, use aluminum or 300 series stainless-steel fasteners.
 - 2. For fastening galvanized steel, use hot-dip-galvanized steel or 300 series stainless-steel fasteners.
 - 3. For fastening stainless steel, use 300 series stainless-steel fasteners.
 - 4. For color-finished louvers, use fasteners with heads that match color of louvers.
- D. Bituminous Paint: Cold-applied asphalt emulsion complying with ASTM D 1187.

2.2 FABRICATION, GENERAL

- A. Fabricate frames, including integral sills, to fit in openings of sizes indicated, with allowances made for fabrication and installation tolerances, adjoining material tolerances, and perimeter sealant joints.
- B. Join frame members to each other and to fixed louver blades with fillet welds concealed from view unless otherwise indicated or size of louver assembly makes bolted connections between frame members necessary.

2.3 FIXED, EXTRUDED-ALUMINUM LOUVERS

- A. Horizontal, Drainable-Blade Louver :
 - 1. Louver Depth: 4 inches
 - 2. Frame and Blade Nominal Thickness: Not less than 0.060 inch for blades and 0.080 inch for frames.
 - 3. Louver Performance Ratings:
 - a. Free Area: Not less than 50%. Dimensions as shown on plans.
 - b. Point of Beginning Water Penetration: 900 fpm.
 - c. Air Performance: Not more than 0.10-inch wg static pressure drop at 750-fpm.

4. AMCA Seal: Mark units with AMCA Certified Ratings Seal.

2.4 LOUVER SCREENS

- A. General: Provide screen at each exterior louver.
- B. Louver Screen Frames: Same kind and form of metal as indicated for louver to which screens are attached.
- C. Louver Screening:
 1. Bird Screening: Aluminum, 1/2-inch square mesh, 0.063-inch wire.

2.5 ALUMINUM FINISHES

- A. High-Performance Organic Finish: 4-coat fluoropolymer finish complying with AAMA 2604 and containing not less than 70 percent PVDF resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 1. Color and Gloss: As selected by Architect from manufacturer's full range.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Locate and place louvers and vents level, plumb, and at indicated alignment with adjacent work.
- B. Use concealed anchorages where possible. Provide brass or lead washers fitted to screws where required to protect metal surfaces and to make a weathertight connection.
- C. Provide perimeter reveals and openings of uniform width for sealants and joint fillers, as indicated.
- D. Repair damaged finishes so no evidence remains of corrective work. Return items that cannot be refinished in the field to the factory and refinish entire unit or provide new units.
- E. Protect galvanized and nonferrous-metal surfaces that will be in contact with concrete, masonry, or dissimilar metals from corrosion and galvanic action by applying a heavy coating of bituminous paint.

END OF SECTION 10200

SECTION 10431 - SIGNAGE

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following selected by the Architect from an allowance provided by the Construction manager at Risk:
 - 1. Panel signs
 - 2. Dimensional characters.

1.3 DEFINITIONS

- A. ADA-ABA Accessibility Guidelines: U.S. Architectural & Transportation Barriers Compliance Board's "Americans with Disabilities Act (ADA) Accessibility Guidelines for Buildings and Facilities; Architectural Barriers Act (ABA) Accessibility Guidelines."

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show fabrication and installation details for signs.
 - 1. Show sign mounting heights, locations of supplementary supports to be provided by others, and accessories.
 - 2. Provide message list, typestyles, graphic elements, including tactile characters and Braille, and layout for each sign.
- C. Samples for Initial Selection: Manufacturer's color charts consisting of actual units or sections of units showing the full range of colors available for the following:
 - 1. Aluminum.
 - 2. Acrylic sheet.
 - 3. Polycarbonate sheet.
 - 4. Fiberglass sheet.
- D. Sign Schedule: Use same designations indicated on Drawings.
- E. Maintenance Data: For signs to include in maintenance manuals.

- F. Warranty: Special warranty specified in this Section.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Fabricator of products
- B. Fabricator Qualifications: Shop that employs skilled workers who custom-fabricate products similar to those required for this Project and whose products have a record of successful in-service performance.
- C. Source Limitations for Signs: Obtain each sign type indicated from one source from a single manufacturer.
- D. Regulatory Requirements: Comply with applicable provisions in ADA-ABA Accessibility Guidelines] [and] [ICC/ANSI A117.1.

1.6 PROJECT CONDITIONS

- A. Field Measurements: Verify recess openings by field measurements before fabrication and indicate measurements on Shop Drawings.

1.7 COORDINATION

- A. Coordinate placement of anchorage devices with templates for installing signs.

1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of signs that fail in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Deterioration of metal and polymer finishes beyond normal weathering.
 - b. Deterioration of embedded graphic image colors and sign lamination.
 - 2. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Aluminum Castings: ASTM B 26/B 26M, of alloy and temper recommended by sign manufacturer for casting process used and for use and finish indicated.

- B. Aluminum Sheet and Plate: ASTM B 209, alloy and temper recommended by aluminum producer and finisher for type of use and finish indicated, and with at least the strength and durability properties of Alloy 5005-H32.
- C. Aluminum Extrusions: ASTM B 221, alloy and temper recommended by aluminum producer and finisher for type of use and finish indicated, and with at least the strength and durability properties of Alloy 6063-T5.
- D. Polycarbonate Sheet: Of thickness indicated, manufactured by extrusion process, coated on both surfaces with abrasion-resistant coating:
 - 1. Impact Resistance: 16 ft-lbf/in. per ASTM D 256, Method A.
 - 2. Tensile Strength: 9000 lbf/sq. in. per ASTM D 638.
 - 3. Flexural Modulus of Elasticity: 340,000 lbf/sq. in. per ASTM D 790.
 - 4. Heat Deflection: 265 deg F at 264 lbf/sq. in. per ASTM D 648.
 - 5. Abrasion Resistance: 1.5 percent maximum haze increase for 100 revolutions of a Taber abraser with a load of 500 g per ASTM D 1044.

2.2 DIMENSIONAL CHARACTERS

- A. Dimension Characters: As selected by the Architect from the allowance noted in Section One – Allowances..

2.3 PANEL SIGNS

- A. Interior Panel Signs: As selected by the Architect from the allowance noted in Section One - Allowances..

2.4 ACCESSORIES

- A. Anchors and Inserts: Provide nonferrous-metal or hot-dip galvanized anchors and inserts for exterior installations and elsewhere as required for corrosion resistance. Use toothed steel or lead expansion-bolt devices for drilled-in-place anchors. Furnish inserts, as required, to be set into concrete or masonry work.

2.5 FABRICATION

- A. General: Provide manufacturer's standard signs of configurations indicated.
 - 1. Welded Connections: Comply with AWS standards for recommended practices in shop welding. Provide welds behind finished surfaces without distortion or discoloration of exposed side. Clean exposed welded surfaces of welding flux and dress exposed and contact surfaces.
 - 2. Mill joints to tight, hairline fit. Form joints exposed to weather to exclude water penetration.
 - 3. Preassemble signs in the shop to greatest extent possible. Disassemble signs only as necessary for shipping and handling limitations. Clearly mark units for reassembly and installation, in location not exposed to view after final assembly.

4. Conceal fasteners if possible; otherwise, locate fasteners where they will be inconspicuous.

2.6 FINISHES, GENERAL

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
- B. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- C. **Appearance of Finished Work:** Variations in appearance of abutting or adjacent pieces are acceptable if they are within one-half of the range of approved Samples. Noticeable variations in the same piece are not acceptable. Variations in appearance of other components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.

2.7 ALUMINUM FINISHES

- A. **Clear Anodic Finish:** Manufacturer's standard Class 1 clear anodic coating, 0.018 mm or thicker, over a satin (directionally textured) mechanical finish, complying with AAMA 611.
- B. **Color Anodic Finish:** Manufacturer's standard Class 1 integrally colored or electrolytically deposited color anodic coating, 0.018 mm or thicker, applied over a satin (directionally textured) mechanical finish, complying with AAMA 611.
- C. **Baked-Enamel Finish:** AA-C12C42R1x (Chemical Finish: cleaned with inhibited chemicals; Chemical Finish: acid-chromate-fluoride-phosphate conversion coating; Organic Coating: as specified below). Apply baked enamel complying with paint manufacturer's written instructions for cleaning, conversion coating, and painting.
 1. **Organic Coating:** Thermosetting, modified-acrylic enamel primer/topcoat system complying with AAMA 2603 except with a minimum dry film thickness of 1.5 mils, medium gloss.

2.8 STAINLESS-STEEL FINISHES

- A. Remove tool and die marks and stretch lines or blend into finish. Grind and polish surfaces to produce uniform, directionally textured, polished finish indicated, free of cross scratches. Run grain with long dimension of each piece.
- B. **Directional Satin Finish:** No. 4 finish.
- C. When polishing is completed, passivate and rinse surfaces. Remove embedded foreign matter and leave surfaces chemically clean.

2.9 ACRYLIC SHEET FINISHES

- A. Colored Coatings for Acrylic Sheet: For copy and background and frame colors, provide colored coatings, including inks, dyes, and paints, that are recommended by acrylic manufacturers for optimum adherence to acrylic surface and that are UV and water resistant for five years for application intended.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of work.
- B. Verify that items, including anchor inserts, are sized and located to accommodate signs.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Locate signs and accessories where indicated, using mounting methods of types described and complying with manufacturer's written instructions.
 - 1. Install signs level, plumb, and at heights indicated, with sign surfaces free of distortion and other defects in appearance.
 - 2. Interior Wall Signs: Install signs on walls adjacent to latch side of door where applicable. Where not indicated or possible, such as double doors, install signs on nearest adjacent walls. Locate to allow approach within 3 inches of sign without encountering protruding objects or standing within swing of door.
- B. Wall-Mounted Signs: Comply with sign manufacturer's written instructions.
- C. Dimensional Characters: Mount characters using standard fastening methods to comply with manufacturer's written instructions for character form, type of mounting, wall construction, and condition of exposure indicated. Provide heavy paper template to establish character spacing and to locate holes for fasteners.
 - 1. Flush Mounting: Mount characters with backs in contact with wall surface.
 - 2. Projected Mounting: Mount characters at projection distance from wall surface indicated.

3.3 CLEANING AND PROTECTION

- A. After installation, clean soiled sign surfaces according to manufacturer's written instructions. Protect signs from damage until acceptance by Owner.

END OF SECTION 10431

SECTION 10520 - FIRE-PROTECTION SPECIALTIES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes the following:
 - 1. Portable fire extinguishers.
 - 2. Fire-protection cabinets.
 - 3. Mounting brackets for fire extinguishers.

1.2 SUBMITTALS

- A. Product Data: For each type of product indicated.
 - 1. Fire Extinguishers: Include rating and classification.
 - 2. Fire-Protection Cabinets: Include door hardware, cabinet type, trim style, panel style, and details of installation.
- B. Maintenance data.

1.3 QUALITY ASSURANCE

- A. NFPA Compliance: Fabricate and label fire extinguishers to comply with NFPA 10, "Portable Fire Extinguishers."
- B. Fire Extinguishers: Listed and labeled for type, rating, and classification by an independent testing agency acceptable to authorities having jurisdiction.
- C. Coordinate size of fire-protection cabinets to ensure that type and capacity of fire extinguishers indicated are accommodated.

1.4 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of portable fire extinguishers that fail in materials or workmanship within specified warranty period.
 - 1. Failures include, but are not limited to, the following:
 - a. Failure of hydrostatic test according to NFPA 10.
 - b. Faulty operation of valves or release levers.
 - 2. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B.
- B. Aluminum: Alloy and temper recommended by aluminum producer and manufacturer for type of use and finish indicated, and as follows:
 - 1. Sheet: ASTM B 209.
- C. Tempered Float Glass: ASTM C 1048, Kind FT, Condition A, Type I, Quality q3, 3 mm thick, Class 1 (clear).

2.2 PORTABLE FIRE EXTINGUISHERS

- A. General: Provide fire extinguishers of type, size, and capacity for each fire-protection cabinet and mounting bracket indicated.
- B. Multipurpose Dry-Chemical Type in Steel Container: UL-rated 4-A:60-B:C, 10 lb nominal capacity, with monoammonium phosphate-based dry chemical in enameled-steel container.

2.3 FIRE-PROTECTION CABINET

- A. Cabinet Type: Suitable for fire extinguisher.
- B. Cabinet Construction: Nonrated in walls that carry no rating. Rated in walls that carry a rating.
- C. Cabinet Material: Enameled-steel sheet.
- D. Semirecessed Cabinet: Cabinet box partially recessed in walls of shallow depth to suit style of trim indicated; with one-piece combination trim and perimeter door frame overlapping surrounding wall surface with exposed trim face and wall return at outer edge (backbend).
 - 1. Rolled-Edge Trim: 2 ½ inch backbend depth.
- E. Cabinet Trim Material: Aluminum sheet .
- F. Door Material: Aluminum sheet .
- G. Door Style: Vertical duo panel with frame .
- H. Door Glazing: Tempered float glass (clear).
- I. Door Hardware: Manufacturer's standard door-operating hardware of proper type for cabinet type, trim style, and door material and style indicated.
 - 1. Provide recessed door pull and friction latch.
 - 2. Provide continuous hinge, of same material and finish as trim, permitting door to open 180 degrees.
- J. Accessories:
 - 1. Mounting Bracket: Manufacturer's standard steel, designed to secure fire extinguisher to fire-protection cabinet, with plated or baked-enamel finish.
 - 2. Identification: Lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as indicated by Architect.
 - a. Identify fire extinguisher in fire-protection cabinet with the words "FIRE EXTINGUISHER."
 - 1) Location: Applied to cabinet glazing.
 - 2) Application Process: Silk-screened .
 - 3) Lettering Color: Red .
 - 4) Orientation: Vertical .
- K. Finishes:
 - 1. Manufacturer's standard baked-enamel paint for the following:
 - a. Interior of cabinet.
 - 2. Aluminum: Class I, clear anodic coating complying with AAMA 611 .

2.4 MOUNTING BRACKETS

- A. Mounting Brackets: Manufacturer's standard steel, designed to secure fire extinguisher to wall or structure, of sizes required for types and capacities of fire extinguishers indicated, with plated or baked-enamel finish.
 - 1. Color: Black.
- B. Identification: Lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as indicated by Architect.
 - 1. Identify bracket-mounted fire extinguishers with the words "FIRE EXTINGUISHER" in red letter decals applied to mounting surface.
 - a. Orientation: Vertical.

2.5 FABRICATION

- A. Fire-Protection Cabinets: Provide manufacturer's standard box (tub), with trim, frame, door, and hardware to suit cabinet type, trim style, and door style indicated. Weld joints and grind smooth.
 - 1. Construct fire-rated cabinets with double walls fabricated from 0.0428 inch thick, cold-rolled steel sheet lined with minimum 5/8 inch thick, fire-barrier material. Provide factory-drilled mounting holes.
- B. Cabinet Doors: Fabricate doors according to manufacturer's standards, from materials indicated and coordinated with cabinet types and trim styles selected.
 - 1. Fabricate door frames with tubular stiles and rails and hollow-metal design, minimum 1/2 inch thick.
 - 2. Miter and weld perimeter door frames.
- C. Cabinet Trim: Fabricate cabinet trim in one piece with corners mitered, welded, and ground smooth.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Examine walls and partitions for suitable framing depth and blocking where semirecessed cabinets will be installed.
- B. Examine fire extinguishers for proper charging and tagging. Remove and replace damaged, defective, or undercharged units.
- C. Prepare recesses for semirecessed fire-protection cabinets as required by type and size of cabinet and trim style.
- D. Install fire-protection specialties in locations selected by the architect and at mounting heights indicated or, if not indicated, at heights acceptable to authorities having jurisdiction. Provide two cabinets and extinguishers per floor.
- E. Fire-Protection Cabinets: Fasten fire-protection cabinets to structure, square and plumb.
 - 1. Unless otherwise indicated, provide recessed fire-protection cabinets. If wall thickness is not adequate for recessed cabinets, provide semirecessed fire-protection cabinets.

2. Fasten mounting brackets to inside surface of fire-protection cabinets, square and plumb.
- F. Mounting Brackets: Fasten mounting brackets to surfaces, square and plumb, at locations . indicated.
- G. Identification: Apply decals at locations indicated.
- H. Adjust fire-protection cabinet doors to operate easily without binding. Verify that integral locking devices operate properly.
- I. Replace fire-protection cabinets that have been damaged or have deteriorated beyond successful repair.

END OF SECTION 10520

SECTION 10801 - TOILET AND BATH ACCESSORIES

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Paper Towel Dispenser and waste receptacles.
 - 2. Soap Dispenser.
 - 3. Mirrors.
 - 4. Grab bars.
 - 5. Toilet Paper Dispenser.
 - 6. Sanitary Napkin Disposal Units.
 - 7. Combination utility shelf / mop and broom holders.
 - 8. Hand Dryers.

1.02 SUBMITTALS

- A. Product Data.
- B. Shop Drawings.
- C. Manufacturer's Instructions.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. For each distinct type of toilet accessory, provide accessories fabricated by a single manufacturer.
- B. All model numbers specified are products of Bobrick Washroom Equipment, Inc.
- C. Only equivalent products of the following other manufacturers complying with the following Bobrick Washroom Equipment, Inc. provided they comply with requirements of the contract documents or approved equal, will be considered acceptable:
 - 1. A & J Washroom Accessories
 - 2. American Specialties, Inc. (ASI)
 - 3. Bradley Corporation

2.02 TOILET ACCESSORIES

- A. Recessed Towel Dispenser and Waste Receptacle: 600 C-fold paper towels, 12 gallon waste capacity bottom cabinet, locking doors/cabinets, recessed flush with wall, stainless steel; no sharp edges, seamless wall flanges, concealed piano hinges and formed plastic liner (accessory to specified unit).
 - 1. Product: "Classic" Model B-3944 manufactured by Bobrick.
- B. Soap Dispenser: Surface mounted, 40 oz. of soaps or lotions capacity, locking stainless cabinet (key), soap level slot.
 - 1. Product: "Classic" Model B-2111 manufactured by Bobrick.
- C. Mirrors: Stainless steel framed, ¼" thick float glass mirror.
 - 1. Size: 18' x 36".
 - 2. Frame: Radius edges, with mitered and welded and ground corners, and tamperproof hanging system; burr free satin finish.
 - 3. Product: Model B-290 1836 manufactured by Bobrick.
- D. Grab Bar 1:
 - 1. Basis of design: B-5806.99 - 42".
 - a. Stainless steel, nonslip gripping surface & concealed mounting, Bobrick Model B-5806.99.
- E. Grab Bar 2:
 - 1. Basis of design: B-5806.99 - 36".
 - a. Stainless steel, nonslip gripping surface and concealed mounting, Model B-5806.99, by Bobrick.
- F. Grab Bar 3:
 - 1. Basis of design: B-5806.99 - 18".
 - a. Stainless steel, nonslip gripping surface and concealed mounting, Model B-5806.99, by Bobrick.

- G. Toilet Paper Dispensers:
 - 1. 1. Basis of design: UP830 A&J Washroom Accessories.
 - a.
 - b. Jumbo 9" roll size
- H. Partition Mounted Sanitary Napkin Disposal:
 - 1. Basis of design: B-4354 Bobrick.
 - a. Stainless steel.
 - b. Serves 2-compartments.
- I. Semi-Recessed Sanitary Napkin Disposal:
 - 1. Basis of design: B-4353 Bobrick.
 - a. Stainless steel.
 - b. Single end compartments.
- J. Combination Utility Shelf/Mop and Broom Holder:
 - 1. Basis of design: B-223 x 24" long.
 - a. Stainless steel with 3 mop holders.
 - b. With 3-spring loaded rubber cam mop/broom holders, Model B-223x24, by Bobrick.
- K. Hand Dryers: (Option-Xlerator XL)
 - 1. Basis of design: Surface mounted sensor hand dryer "AirGuard" Model B-708, by Bobrick.
 - a. Automatic hand dryer, white porcelain finish, 115v, 20 amp, 2300w, 60 Hz.
 - b. Mount 48" above finish floor.

2.03 MATERIALS

- A. Stainless steel: Type-304 stainless steel with satin finish, typical for all accessories.
- B. Mounting Devices and Fasteners: Provide toilet accessory manufacturer's recommended items for substrates and conditions indicated.

2.04 FABRICATION

- A. Manufacturer's Trademarks and Model Numbers: Permanently affix manufacturer's name and model number to unexposed surface of accessory.

2.05 UNDER LAVATORY GUARD

A. Basis of Design Product: The design for accessories is based on product indicated. Subject to compliance with requirements, provide the named product or a comparable product by one of the following:

- 1. Plumerex Specialty Products Inc.
- 2. TCI Products
- 3. Truebro, Inc.

B. Under lavatory guard:

1. Description: Insulating pipe covering for supply and drain piping assemblies, that prevent direct contact with and burns from piping, and allow service access without removing coverings.

2. Material and finish: Antimicrobial, molded-plastic, white.

C. Exception: If Division 15 specifications or plumbing drawings indicate a different product, requirements or manufacturers, then those specifications take precedence over those listed above.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Perform installation in accordance with manufacturer's instructions, except where more stringent requirements are shown or specified, and except where project conditions require extra precautions or provisions to ensure satisfactory performance of the work.
- B. Accessories Installed for Use by Handicapped Persons: Install as indicated on drawings and in accordance with the 2012 NC Building Code, Chapter 11, Accessibility, and ICC A117.1.

END OF SECTION 10801

C203304-RA (K-3800)

BEAUFORT COUNTY

SECTION 13000- COMPENSATION FOR GENERAL CONSTRUCTION

1.1 COMPENSATION

- A. The work of furnishing materials and constructing the Rest Area Building and the Storage Building in accordance with the plans and specifications, completed and accepted, will be paid for at the contract lump sum price for the "General Construction of Rest Area Building", and the "General Construction of Storage Building". Such price and payment will be full compensation for all work of constructing the Rest Area Building and Storage Building, including but not limited to furnishing all transportation, materials, labor, tools, equipment, fees and incidentals necessary to complete the work. Payment will be made under:

"General Construction of Rest Area Building"Lump Sum

"General Construction of Storage Building"Lump Sum

SECTION 15010 - BASIC PLUMBING REQUIREMENTS**PART I - GENERAL****1.1 GENERAL CONDITIONS**

- A. The stipulations and conditions stated in this Section, together with all provisions of the "Instructions to Bidders", "General Conditions", "Supplemental General Conditions", and "Special Conditions", hereinbefore set forth, shall apply to this and the other Sections of Division 15A.

1.2 GENERAL REQUIREMENTS

- A. The General Requirements hereinafter listed apply to the Plumbing Work Division. If there is any conflict between the General Requirements and the General Conditions, the General Conditions shall take precedence.

1.3 ALTERNATES

- A. Carefully examine all alternates at the back of this specification to determine if any work described under the Plumbing Section will be affected thereby.

1.4 INTENT

- A. The intent of these drawings and specifications are to describe the installation of a complete, fully adjusted and operational system. Therefore, any items shown on drawings and not specifically called for in the specifications, or any items specified and not specifically indicated or detailed on the drawings, or any items neither specified or shown, but which are reasonably incidental to and commonly required to make a complete job, will be furnished and installed by the Plumbing Contractor at his own expense.

1.5 DEFINITIONS

- A. The Plumbing Contractor shall provide all supervision, labor, material equipment, machinery, plant, and any and all other items necessary to complete the plumbing systems. All items of equipment are specified in the singular; however, the Plumbing Contractor shall provide the number of items of equipment as indicated on the drawings, and as required for complete systems.

Where the word "provide" is used, it shall mean "furnish and install complete and ready to use".

1.6 VISIT TO THE SITE

The Plumbing Contractor shall visit the site before submitting his bid so as to be thoroughly familiar with the job conditions and/or peculiarities. No extra payment will be allowed for anything which could have been anticipated from a visit to the site.

1.7 REGULATORY REQUIREMENTS

- A. All work under this Section shall be accomplished in strict accordance with State codes. Where these plans and specifications conflict with such codes, the codes shall govern. The Plumbing Contractor shall notify the Architect or Engineer of such conflicts in writing prior to receipt of bids.

1.8 PERMITS AND FEES

- A. NA

1.9 DRAWINGS AND SPECIFICATIONS

- A. The Plumbing Drawings and Specifications are intended to cover all the work enumerated under the respective headings. The drawings are diagrammatic only. No Contractor shall take advantage of conflict or error between Drawings and Specifications, or between General Drawings and Mechanical, Plumbing and/or Electrical Drawings, but shall request a clarification of such from the Architect/Engineer, should this condition exist. If there is insufficient time to issue an Addendum for this clarification, the Plumbing Contractor shall figure on the most expensive of the items in conflict.
- B. The Plumbing Contractor shall refer to the Architectural and Structural Drawings and Specifications for the general construction of the building, for floors and ceiling heights, for locations of walls, partitions, beams, etc., and shall be guided accordingly for setting of all sleeves, inserts and equipment. The Plumbing Contractor shall not under any circumstances scale drawings for the location of equipment. The Plumbing Contractor shall verify the locations of all utility services.
- C. The Plumbing Contractor shall keep at least one set of corrected Shop and Design Drawings at the site. Drawings are to be current, denoting approved modifications and actual installed departure. Submit drawings to Architect/Engineer before final payment is made.

1.10 SUPERVISION

- A. The Plumbing Contractor performing the work specified shall be required to employ a qualified Superintendent or Foreman to continuously supervise the installation of their work, with authorization to act as agent. Contractors: He shall be capable of checking layouts, coordinating and supervising the work, establishing grades and levels, and locating chases, openings, hangers, inserts, sleeves, etc.

PART II - PRODUCTS**2.1 STANDARD PRODUCTS**

- A. Unless otherwise indicated in writing by the Architect/Engineer, the materials to be provided under this Specification shall be standard products of manufacturers regularly engaged in the production of such equipment and shall be the manufacturer's latest design. All items of the same type or rating shall be identical.

2.2 SUBMITTAL

- A. The Plumbing Contractor shall submit, for approval, detailed shop drawings on all major equipment and where requested. No materials or equipment may be delivered to the job site or installed until the Plumbing Contractor has in his possession the approved shop drawing for the particular material or equipment. The Plumbing Contractor shall furnish the number of copies required by the General or Special Conditions of the contract, but no case less than six (6) copies.
- B. Submitted material shall be properly labeled indicating specific service for which material or equipment to be used, section and article number of specifications governing, Contractor's name and name of job.

- C. Approval of equipment will not relieve the Plumbing Contractor of compliance with the Specifications even if such approval is made in writing, unless the attention of the Engineer is called to the non-complying features by letter accompanying the submittal data. Approval of Submittal Data by the Engineer shall not be construed as a complete check of approval of detailed dimensions, weights, gauges, and similar details with the proposed articles. The conformance with the necessary coordination between the various other Contractors and suppliers shall be solely the responsibility of the Plumbing Contractor and with no additional expense to the Owner.

2.3 SUBSTITUTIONS

- A. Manufacturer's lists are to establish a standard of quality and not intended to limit the selection to these manufacturers. All materials and equipment which are essential and have not been specified or shown, shall be new and of the highest grade and quality and free from defect or other imperfections. It should be understood that where the words "furnished and installed" are used, it is intended that the Plumbing Contractor shall purchase and install all materials required.
- B. All materials and equipment proposed as substitutes for these specified shall require a ten (10) day prior approval from the Engineer prior to the bid date. No substitutions will be allowed after the ten (10) day period before the bid date.

2.4 PRODUCT HANDLING

- A. Equipment and materials shall be properly stored, adequately protected, and carefully handled to prevent damage before and during installation. Equipment and materials shall be handled, stored and protected in accordance with the manufacturer's recommendations and as approved by the Architect/Engineer. Equipment installed with a factory finish shall be fully protected during construction and shall be maintained free of dust, dirt, and foreign matter. Dents and other surface damage shall be repaired or replaced to the satisfaction of the Architect/Engineer at no additional cost to the Owner.
- B. The Plumbing Contractor shall clean up and remove from the job site all waste materials, packaging, crating, and refuse resulting from his work on a daily basis.

2.5 MATERIALS AND WORKMANSHIP

- A. The Plumbing Contractor shall perform a first class job, both in material and workmanship. None other will be accepted. Deviations from either will be corrected by the Plumbing Contractor at the Plumbing Contractor's expense.
- B. The material used throughout the work, except when otherwise noted, shall be new and of the best of its kind. No substitutes shall be used unless approved by the Architect/Engineer. All work shall be executed with a maximum speed consistent with safety and good workmanship.
- C. Any equipment furnished by the Plumbing Contractor that is larger than those indicated on the drawings and described in these Specifications or have different electrical characteristics, the increase in cost to the Electrical Contractor for larger wires, conduit, circuit breakers, switches, etc. or for changes in work already installed shall be borne by the instigating Contractor.

PART III - EXECUTION**3.1 EXCAVATION AND BACKFILL**

- A. The Plumbing Contractor shall preform any and all trench and pit excavation and backfilling required for the installation of his work. Trenches shall be made with the sides vertical and shall be shored where necessary for the protection of men and equipment. All excavation work shall be done in a careful manner to avoid damage to footers and foundations. The backfilling shall be placed in layers not exceeding 4 inches in depth, wetting each layer as it is placed, and thoroughly compacting each layer with mechanical tamper or other approved means. Any damage done during excavation and backfilling operations to roads, sidewalks, curbs, shrubs, sod, footers, foundations, etc. shall be replaced to its condition prior to construction at no expense to the Owner.

3.2 SCAFFOLDING, RIGGING AND HOISTING

- A. The Plumbing Contractor shall furnish all necessary scaffolding, staging, rigging and hoisting required for the completion of his work. All such scaffolding, etc., shall be removed from the premises when its use is no longer required on the job.

3.3 CUTTING AND PATCHING

- A. The Plumbing Contractor shall provide all cutting and patching necessary to install the work specified in this section. The patching shall match adjacent surfaces.
- B. No structural member shall be cut without the approval of the Engineer, and all such cutting shall be done in a manner directed by him.

3.4 EQUIPMENT SPACE AND ARRANGEMENT

- A. The equipment shall fit into the space allotted and shall allow adequate clearance for entry, installation, replacement, servicing, and maintenance. The Plumbing Contractor shall coordinate the work to ensure that equipment may be moved into place without altering building components or other installations. Access space shall not be less than the equipment manufacturer's requirements.
- B. These drawings indicate the extent and general arrangement of equipment, piping, and ductwork. If any departures are deemed necessary by the Plumbing Contractor, details of such departures and the reasons therefore shall be submitted to the Architect/Engineer for approval as soon as practicable and within 30 days after award of the contract. No departure shall be made without written approval of the Architect/Engineer.

3.5 DAMAGE TO WORK ALREADY IN PLACE

- A. The Plumbing Contractor shall assume full responsibility for any damage done by him, his agents or employees, to any work already in place. Any such damage done shall be repaired at the Contractor's expense by mechanics skilled at their respective trades to the approval of the Architect/Engineer.

3.6 JURISDICTION OF WORK

- A. It may become necessary for the Plumbing Contractor to furnish labor or materials which is not generally accepted as part of this trade. In cases of this type, he shall contract the work or shall furnish materials and employ workmen of the trade involved in order not to cause any delay or stoppage of work caused by infringement of trade agreements as to jurisdiction, alleged or actual.

3.7 COORDINATION WITH OTHER TRADES

- A. All work shall be coordinated with other trades involved in the construction project. All work shall be carefully laid out in advance to coordinate Architectural, Structural, Mechanical, Plumbing and Electrical features of construction. The Plumbing Contractor shall verify at the site all locations, grades, elevations, and utility service connections indicated. Any conflicts due to lack of proper coordination shall be brought to the attention of the Architect/Engineer for resolution. The Plumbing Contractor shall make required changes or relocations at no additional cost to the Owner.
- B. Installation, inspection, and testing of work above ceilings shall be completed and approved by the Architect/Engineer prior to installation of the specified finished ceilings. However, ceiling suspension system may be installed as required for coordination.
- C. The Plumbing Contractor shall consult with the other trades at the start of the work and periodically thereafter, as required to properly coordinate the various items of work, and to avoid interferences. Should any interferences of any nature develop as the work progresses, such interferences shall be resolved and eliminated as directed. The cost of any work directed shall be borne by the Subcontractor or Contractors directed to do this work.

3.8 DIVISION OF WORK

- A. This paragraph is intended to show exactly the point of division of work between the Electrical Division and the Plumbing Division.
- B. All equipment covered in the Plumbing Division of the specifications shall be furnished, mounted, and aligned under the Plumbing Division. All individual motor starters, unless indicated as part of a motor control center, for this equipment shall be furnished and installed by the Plumbing Contractor.
- C. All final electrical connections to equipment covered in the Plumbing Division of the specifications shall be completed under the Plumbing Division.
- D. The Electrical Contractor shall provide a disconnect switch or junction box for each item of equipment under Division 16.
- E. Electrical equipment and wiring that is provided by the Plumbing Contractor shall be in accordance with the Electrical specification.

3.9 EQUIPMENT INSTALLATION

- A. Final connections to equipment, including pipe, duct, and controls, shall be provided under applicable sections of this Division, unless otherwise specified or indicated.
- B. Manufacturer's Instructions: Equipment shall be installed as recommended by the manufacturer to conform to the requirements of the particular application, in accordance with these drawings and specifications.

3.10 OPERATION AND MAINTENANCE MANUALS

- A. One complete manual as outlined herein shall be submitted for approval before conducting instruction sessions in operation, before systems or equipment tests are performed, and before final or beneficial occupancy.
- B. Manuals shall have rigid covers and index tabs for each major piece of equipment, auxiliaries, and systems. The following shall be inscribed on the cover: the words "OPERATION AND MAINTENANCE MANUAL", the name and location of the building,

the name of the Section, such as "Plumbing" and the name of the Plumbing Contractor. Two copies of each approved manual shall be submitted to the Owner and one copy shall be submitted to the Architect/Engineer.

- C. Each piece of equipment shall be listed and identified with the same name, mark, number, or other identification as noted or scheduled in the Contract Documents.
- D. Manuals shall include the following:
 - 1. Complete operating installations, covering start-up and shutdown for all components installed.
 - 2. Legible copies of all shop drawings. Any comments incorporated in "as noted" approvals of shop drawings shall be recorded on the drawings included in the manuals.
 - 3. All equipment Maintenance and Service Manuals.
- E. A complete parts list for each piece of equipment.
- F. All descriptive literature for the equipment.
- G. Operating characteristics, performance data, ratings, and curves for each piece of equipment.
- H. Internal wiring and control diagrams.
- I. All other information pertinent to the maintenance and servicing of equipment and systems provided in the project.
- J. Name, address, and telephone number for service on each manufacturer's equipment.

3.11 OPERATING INSTRUCTIONS

- A. After all equipment and services are in operation, and the Operation and Maintenance Manuals are available, an instruction and training session shall be conducted for the Owner's operating personnel.
- B. Instruction sessions shall be conducted during the Owner's normal working periods, and at times and locations satisfactory to the Owner.

3.12 EQUIPMENT START-UP

- A. No equipment shall be placed in operation until it has been inspected by a qualified representative of the manufacturer and Certified to be ready for operation. The manufacturer's representative shall supervise the start-up operation and shall be responsible for all adjustments required to meet design conditions. Such services shall be at no additional cost to the Owner.

3.13 GUARANTEE

- A. The Plumbing Contractor shall present to the Owner a written guarantee covering his work, including all equipment, material and workmanship. This guarantee shall be against all defects in any of the above work, and shall run for a period of one (1) year from the date of written acceptance of the Contractor's work.

C203304-RA (K-3800)

BEAUFORT COUNTY

- B. Any defective work, equipment, material and/or workmanship that develops within the guarantee period, which is not caused by ordinary wear or abuse by other persons, shall be replaced by the Plumbing Contractor without cost to the Owner.

3.14 FINAL INSPECTION

- A. When the entire Contract has been completed and the work is ready for final inspection, the Architect/Engineer or his duly authorized representative will make the inspection. At the time of inspection, the Plumbing Contractor shall demonstrate to the Architect/Engineer that the various systems and pieces of equipment have been adjusted to operate in accordance with the requirements of the Contract.

3.15 FINAL PAYMENTS

- A. All final payments are contingent upon all necessary Certificates and/or Approvals cited above, together with the written Guarantee being presented to the Owner.

END OF SECTION 15010

SECTION 15140 - HANGERS AND SUPPORTS**PART I – GENERAL****PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawing and General Provisions of the Contract, including the General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Hangers and Supports for Plumbing Systems Piping and Equipment.

PART II – PROD**PIPE HANGERS AND SUPPORTS**

- A. Hangers: Galvanized carbon steel, adjustable, clevis
- B. Multiple or Trapeze Hangers: Steel channels with welded spacers and hanger rods.
- C. Vertical Support: Steel riser clamp
- D. Copper Pipe Support: Carbon steel ring, adjustable, copper plated.
- E. Shield for Insulated Piping 2 Inches and Smaller: 18 gauge galvanized steel shield over insulation in 180 degree segments, minimum 12 inches long at pipe support.
- F. Shields for Insulated Piping 2½ Inches and Larger: Hard block non-conducting saddles in 90 degree segments, 12 inch minimum length, block thickness same as insulation thickness.
- G. Sheet metal saddles must be ½ the circumference of the insulation, turned up or rounded at the corners to avoid damage to the vapor barrier.

2.2 HANGER RODS

- A. Steel Hanger Rods: Threaded both ends or continuous threaded.

2.3 FLASHING

- A. Metal Flashing: 26 gauge galvanized steel
- B. Flexible Flashing: 47 mil thick sheet butyl; compatible with roofing

2.4 SLEEVES

- A. Sleeves for Pipes: Form with schedule 40, galvanized steel pipe
- B. Fire Stopping Insulation: Glass fiber type, non-combustible
- C. Caulk: Fire Barrier type sealant

2.5 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, steel plates, shapes, and bars, black and galvanized
- Hangers & Supports

- B. Bolts and Nuts: ASME B18.10 or ASTM A 183, steel, hex-head, track bolts and nuts
- C. Washers: ASTM F 844, steel, plain, flat washers
- D. Grout: ASTM C 1107, Grade B, non-shrink, non-metallic
 - 1. Characteristics include post-hardening, volume-adjusting, dry, hydraulic cement-type grout that is non-staining, non-corrosive, non-gaseous and is recommended for both interior and exterior applications.
 - 2. Design Mix: 5000-psi (34.5MPa), 28-day compressive strength
 - 3. Water: Potable
 - 4. Packaging: Pre-mixed and factory-packaged

2.6 ATTACHMENTS

- A. Mechanical Anchor Fasteners: Insert-type attachments with pull-out and shear capacities appropriate for supported loads and building materials where used. Permitted in concrete over four (4) inches thick.
- B. Weld: Type 22
- C. Beam clamps: Types 20, 21, 28 or 29
- D. Wood: Wood screws or lag bolts

PART III - EXECUTION

3.1 HANGERS AND SUPPORTS INSTALLATION

- A. Install hangers, supports, clamps, and attachments as required to properly support piping from building structure.
- B. Install building attachments within concrete or to structural steel. Install additional attachments at concentrated loads, including valves, flanges, guides, strainers, expansion joints, and at changes in direction of piping.
- C. Install hangers and support complete with necessary inserts, bolts, rods, nuts, washers and other accessories.
- D. Install hangers and supports to allow controlled movement of piping systems, permit freedom of movement between pipe anchors, and facilitate action of expansion joints, expansion loops, expansion bends and similar units.
- E. Install hangers and supports so that piping live and dead loading and stresses from movement will not be transmitted to connected equipment.

- F. Support horizontal piping as follows:

<u>PIPE SIZE</u>	<u>HANGER SPACING</u>	<u>MAXIMUM DIAMETER</u>
1/2 to 1-1/4 inch	6'-6"	3/8"
1-1/2 to 2 inch	10'-0"	3/8"
2-1/2 to 3 inch	10'-0"	1/2"
4 to 6 inch	10'-0"	5/8"
Waste Pipe	5'-0"	3/8"

- G. Install hangers to provide minimum 1/2 inch space between finished covering and adjacent work
- H. Place a hanger within 12 inches of each horizontal elbow.
- I. Use hangers with 1 1/2 inch minimum vertical adjustment
- J. Support vertical piping at every floor. Support vertical cast iron pipe at each floor at hub.
- K. Support horizontal cast iron pipe adjacent to each hub with 5 feet maximum spacing between hangers.
- L. Where several pipes can be installed in parallel and at same elevation, provide multiple or trapeze hangers.
- M. Support riser piping independently of connected horizontal piping.
- N. Prime coat exposed steel hangers and supports. Hangers and supports located in crawl spaces, pipe shafts, and suspended ceiling spaces are not considered exposed.

3.2 EQUIPMENT BASES AND SUPPORTS

- A. Provide equipment bases of concrete.
- B. Provide templates, anchor bolts, and accessories for mounting and anchoring equipment.

3.3 EQUIPMENT SUPPORTS

- A. Fabricate structural steel stands to suspend equipment from structure above or support equipment above floor.
- B. Grouting: Place grout under supports for equipment, and make a smooth bearing surface.

3.4 METAL FABRICATION

- A. Cut, drill, and fit miscellaneous metal fabrications for pipe and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1 procedures for manual shielded metal arc welding, appearance and quality of welds.

3.5 FLASHING

- A. Provide flashing and counter-flashing where piping penetrates weather-proofed walls, floors and roofs.

- B. Flash vent and soil pipes projecting six (6) inches minimum above finished roof surface with lead worked one (1) inch minimum into hub. For pipes through outside walls, turn flanges back into wall and caulk, metal counter-flash and seal.

3.6 SLEEVES

- A. Size sleeves large enough to allow for movement due to expansion and contraction. Provide for continuous insulation wrapping.
- B. Design hangers without disengagement of supported pipe
- C. Extend sleeves through floors one (1) inch above finished floor level. Caulk sleeves full depth and provide floor plate.
- D. Where piping penetrates floor, ceiling, or wall, close off space between pipe and adjacent work with fire stopping insulation and caulk seal air-tight. Provide close fitting metal collar or escutcheon covers at both sides of penetration.
- E. Install chrome plated steel or stainless steel escutcheons at finished surfaces.
- F. Pipe strapping will not be allowed.

END OF SECTION 15140

SECTION 15190 - PLUMBING IDENTIFICATION**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes plumbing identification materials and devices.

1.3 QUALITY ASSURANCE

- A. Comply with ASME A13.1 for lettering size, length of color field, colors, and viewing angles of identification devices.

1.4 SEQUENCING AND SCHEDULING

- A. Coordinate installation of identifying devices after completion of covering and painting where devices are applied to surfaces. Install identifying devices prior to installation of acoustical ceilings and similar concealment.

PART II - PRODUCTS**2.1 MATERIALS**

- A. Color: Unless specified otherwise, conform with ANSI/ASME A13.1.
 - 1. Plastic Nameplates: Laminated three-layer plastic with engraved black letters on light contrasting background color.
 - 2. Plastic Tags: Laminated three-layer plastic with engraved black letters on light contrasting background color. Tag size minimum 1½ inch diameter.
 - 3. Plastic Tape Pipe Markers: Flexible, vinyl film tape with pressure sensitive adhesive backing and printed markings.
 - 4. Underground Plastic Pipe Markers: Bright colored continuously printed plastic ribbon tape of not less than 6 inch wide by 4 mil thick, manufactured for direct burial service.

PART III - EXECUTION**3.1 PREPARATION**

- A. Degrease and clean surfaces to receive adhesive for identification materials.

3.2 INSTALLATION

- A. Plastic Nameplates: Install with corrosive-resistant mechanical fasteners.
- B. Plastic Tags: Install with corrosive-resistant chain.

- C. Plastic Tape Pipe Markers: Install complete around pipe in accordance with the manufacturer's instructions
- D. Underground Plastic Pipe Markers: Install 6 to 8 inches below finished grade, directly above the buried pipe.
- E. Equipment: Identify pumps, heat transfer equipment, tanks, and water treatment devices with plastic nameplates. Small devices, such as in-line pumps, may be identified with plastic tags
- F. Controls: Identify control panels and major control components outside panels with plastic nameplates.
- G. Piping: Identify piping, concealed or exposed, with plastic tape pipe markers. Tags may be used on small diameter piping. Identify service, flow direction, and pressure. Install in clear view and align with axis of piping. Locate identification not to exceed 20 feet on straight runs including risers and drops, adjacent to each valve and "T", at each side of penetration of structure or enclosure, and at each obstruction.

END OF SECTION 15190

SECTION 15250 - PLUMBING PIPING INSULATION**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Plumbing Pipe Insulation.

1.3 QUALITY ASSURANCE

- A. Fire Performance Characteristics: Conform to the following characteristics for insulation including facings, cements, and adhesives, when tested according to ASTM E 84, by UL or other testing or inspecting organization acceptable to the authority having jurisdiction. Label insulation with appropriate markings of testing laboratory.
 - 1. Interior Insulation: Flame spread rating of 25 or less and a smoke developed rating of 50 or less.

1.4 SEQUENCING AND SCHEDULING

- A. Schedule insulation application after testing of piping systems.
- B. Schedule insulation application after installation and testing of heat trace tape.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Glass Fiber:
 - a. Certain Teed Corporation
 - b. Knauf Fiberglass GmbH
 - c. Manville
 - d. Owens-Corning Fiberglas Corporation
 - e. USG Interiors, Inc. - Thermafiber Division

2.2 GLASS FIBER

- A. Material: Inorganic glass fibers, bonded with a thermosetting resin. Jacket: All purpose, factory applied, laminated glass fiber- reinforced, flame retardant Kraft paper and aluminum foil having self-sealing lap.
- B. Preformed Pipe Insulation: ASTM C 547, Class 1, rigid pipe insulation, jacketed.
 - 1. Thermal Conductivity: 0.26 average maximum at 75 degrees F mean temperature.
 - 2. Density: 10 average maximum.
- C. Adhesive: Produced under the UL Classification and Follow-up Service.

1. Type: Non-flammable, solvent-based.
2. Service Temperature Range: Minus 20 degrees to 180 degrees F.

2.3 INSULATING CEMENTS

- A. Mineral Fiber, Hydraulic-Setting Insulating and Finishing Cement: ASTM C 449
 1. Thermal Conductivity: 1.2 average maximum at 400 degrees F mean temperature.
 2. Compressive Strength: 100 psi at 5 percent deformation.

2.4 ADHESIVES

- A. Lagging Adhesive: MIL-A-3316C, non-flammable adhesive in the following Classes and Grades.
 1. Class 1, Grade A for bonding glass cloth and tape to un-faced glass fiber insulation, sealing edges of glass fiber insulation, and bonding lagging cloth to un-faced glass fiber insulation.
 2. Class 2, Grade A for bonding glass fiber insulation to metal surfaces.

2.5 JACKETS

- A. PVC Fitting Covers: Factory-fabricated fitting covers manufactured from 20-mil thick, high impact, ultra-violet resistant PVC.
 1. Adhesive: As recommended by insulation manufacturer.

2.6 SEALING COMPOUNDS

- A. Vapor Barrier Compound: Water-based, fire-resistive composition
 1. Water Vapor Permeance: 0.08 perm maximum
 2. Temperature Range: Minus 20 degrees to 180 degrees F

PART III - EXECUTION

3.1 PREPARATION

- A. Surface Preparation: Clean, dry, and remove foreign materials such as rust, scale, and dirt.

3.2 INSTALLATION - GENERAL

- A. Select accessories compatible with materials suitable for the service. Select accessories that do not corrode, soften, or otherwise attack the insulation or jacket in either the wet or dry state.
- B. Apply insulation material, accessories, and finishes according to the manufacturer's printed instructions.
- C. Keep insulation materials dry during application and finishing.

- D. Apply insulation continuously over fittings, valves and specialties.
- E. Apply insulation with a minimum number of joints.
- F. Apply insulation with integral jackets as follows:
 - 1. Pull jacket tight and smooth.
 - 2. Cover circumferential joints with butt strips, at least three (3) inches wide, and of same material as insulation jacket. Secure with adhesive and outward clinching staples along both edges of butt strip and space 4 inches on center.
 - 3. Longitudinal Seams: Overlap seams at least 1½ inches. Apply insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at four (4) inches on center.
 - 4. Vapor Barrier Coatings: Apply on seams and joints, over staples, and at ends butt to flanges, unions, valves, and fittings.
 - 5. At penetrations in jackets for thermometers and pressure gauges, fill and seal voids with vapor barrier coating.
 - 6. Repair damaged insulation jackets, except metal jackets, by applying jacket material around damaged jacket. Adhere, staple, and seal. Extend patch at least 2 inches in both directions beyond damaged insulation jacket and around the entire circumference of the pipe.
- G. Interior Walls and Partitions Penetrations: Apply insulation continuously through walls and partitions, except fire rated walls and partitions.
- H. Flanges, Fittings, and Valves: Apply pre-molded, pre-cut, or field fabricated segments of insulation around flanges, unions, valves, and fittings. Make joints tight. Bond with adhesive.
 - 1. Use same material and thickness as adjacent pipe insulation.
 - 2. Overlap nesting insulation by 2 inches or 1 pipe diameter, whichever is greater.
 - 3. Apply materials with adhesive, fill voids with mineral fiber insulating cement. Secure with wire or tape.
 - 4. Insulate elbows and tees smaller than three (3) inches pipe size with pre-molded insulation.
 - 5. Insulate elbows and tees Three (3) inches and larger with pre-molded insulation or insulation material segments. Use at least three (3) segments for each elbow.
 - 6. Cover insulation, except for metal jacketed insulation, with PVC fitting covers and seal circumferential joints with butt strips.
- I. Hangers and Anchors: Apply insulation continuously through hangers and around anchor attachments. Install saddles, shields, and inserts as specified.
 - 1. Inserts and Shields: Cover hanger inserts and shields with jacket material matching adjacent pipe insulation.

3.3 GLASS FIBER INSULATION INSTALLATION

- A. Bond insulation to pipe with lagging adhesive.
- B. Seal exposed ends with lagging adhesive.
- C. Seal seams and joints with vapor barrier compound.

3.4 PIPE INSULATION SCHEDULES

<u>PIPING</u>	<u>INSULATION TYPE</u>	<u>THICKNESS IN INCHES</u>
Domestic Hot Water Supply	GLASS FIBER	1
Domestic Hot Water Re-Circulating	GLASS FIBER	1
Domestic Cold Water (INTERIOR)	GLASS FIBER	1/2
"P" Trap at Handicapped Fixtures	ELASTOMERIC	1/2

END OF SECTION 15250

SECTION 15410 - PLUMBING PIPING**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes plumbing piping systems to a point shown on the civil drawings. Systems include the following:
 - 1. Potable water distribution, including cold and hot water supply and hot water circulation.
 - 2. Sanitary Drainage and Vent Systems.

1.3 SYSTEM PERFORMANCE REQUIREMENTS

- A. Provide components and installation capable of producing piping systems with the following minimum working pressure ratings, except where indicated otherwise:
 - 1. Water Distribution Systems, Below Ground: 150 psig.
 - 2. Water Distribution Systems, Above Ground: 125 psig.
 - 3. Soil, Waste and Vent Systems: 10-foot head of water

PART II - PRODUCTS**2.1 SANITARY SEWER PIPING - BURIED**

- A. Sch. 40 PVC Pipe: ASTM D2665. Fittings: PVC. Joints: ASTM D2564, solvent weld.

2.2 SANITARY SEWER PIPING - ABOVE GRADE

- A. Sch. 40 PVC Pipe: ASTM D2665. Fittings: PVC. Joints: ASTM D2564, solvent weld.

2.3 WATER PIPING - BURIED

- A. Copper Tubing: ASTM B88, Type K, annealed. Fittings: ANSI/ASME B16.29, wrought copper. Joints: ANSI/ASTM B32, solder, Grade 95TA.

2.4 WATER PIPING - ABOVE GRADE

- A. Copper Tubing: ASTM B88, Type L, hard drawn. Fittings: ANSI/ASME B16.23, cast brass, or ANSI/ASME B16.29, wrought copper. Joints: ANSI/ASTM B32, solder, Grade 95TA.

2.5 MANUFACTURERS

- A. Acceptable Manufacturers-Valves:
 - 1. Crane
 - 2. Grinnell

3. Nibco
4. Apollo

2.6 GATE VALVES

- A. 150 psig rated, bronze body, lever ball type, Apollo or equal.

PART III - EXECUTION

3.1 PREPARATION

- A. Ream pipe and tube ends. Remove burrs. Bevel plain end ferrous pipe.
- B. Remove scale and dirt, on inside and outside, before assembly.
- C. Prepare piping connections to equipment with flanges or unions.

3.2 INSTALLATION

- A. Provide non-conducting dielectric connections wherever jointing dissimilar metals.
- B. Route piping in orderly manner and maintain gradient.
- C. Install piping to conserve building space and not interfere with use of space.
- D. Group piping whenever practical at common elevations.
- E. Install piping to allow for expansion and contraction without stressing pipes, joints, or connected equipment.
- F. Provide clearance for installation of insulation and access to valves and fittings.
- G. Slope water piping and arrange to drain at low points.
- H. Establish elevations of buried piping outside the building to ensure not less than 1 ft of cover.
- I. Where pipe support members are welded to structural building framing, scrape, brush clean, and apply one coat of zinc rich primer to welding.
- J. Prepare pipe, fittings, supports, and accessories not pre-finished, ready for finish painting.
- K. Establish invert elevations, slopes for drainage to 1/8 inch per foot minimum. Maintain gradients.
- L. Excavate in accordance with Sections 15010.
- M. Backfill in accordance with Sections 15010.
- N. Install bell and spigot pipe with bell end upstream.
- O. Copper piping 2" and larger shall be silver-soldered.
- P. Install valves with stems upright or horizontal, not inverted.

3.3 APPLICATION

- A. Install unions downstream of valves and at equipment or apparatus connections.
- B. Install brass male adapters each side of valves in copper piped system. Sweat solder adapters to pipe.
- C. Install gate or ball valves for shut-off and to isolate equipment, part of systems, or vertical risers.
- D. Install globe or ball valves for throttling, bypass, or manual flow control services.

3.4 DISINFECTION OF DOMESTIC WATER PIPING SYSTEM

- A. Prior to starting work, verify system is complete, flushed and clean.
- B. Inject disinfectant solution containing 100 ppm of available chlorine and allow to stand for 2 hours before flushing.
- C. Flush disinfectant from system until residual is equal to that of incoming water or 1.0 mg/L.
- D. Take samples from outlets and analyze in accordance with AWWA C601. Contractor shall engage an independent laboratory to conduct bacteriological and post chlorination tests certifying that the water meets the quality of drinking water. After acceptance by the Engineer of Record, "The Water Test Report for Use" is required to be submitted to SCO prior to requesting the Occupancy Permit.

3.5 SERVICE CONNECTIONS

- A. Provide new sanitary sewer services. Before commencing work check invert elevations required for sewer connections, confirm inverts and ensure that these can be properly connected with slope for drainage and cover to avoid freezing.

END OF SECTION 15410

SECTION 15430 - PLUMBING SPECIALTIES**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Plumbing Specialties for water distribution systems; and soil, waste and vent systems.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Submit product data including rated capacities of selected models and weights (shipping, installation, and operation). Indicate materials, finishes, dimensions, required clearances, and methods of assembly of components; and piping and wiring connections.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Backflow Preventers:
 - a. Ames Co., Inc.
 - b. Hersey Products, Inc., Grinnell Corp.
 - c. Watts Regulator Co.
 - d. Wilkins Regulator Div., Zurn Industries, Inc.
 - 2. Water Pressure Regulators:
 - a. Spence Engineering Co., Inc.
 - b. Watts Regulator Co.
 - c. Wilkins Regulator Div., Zurn Industries, Inc.
 - 3. Specialties:
 - a. Josam Co.
 - b. Smith by Jay R. Smith Mfg. Co. Div., Smith Industries, Inc.
 - c. Watts Regulator Co.
 - d. Woodford Manufacturing Co. Div., WCM Industries, Inc.
 - e. Zurn by Hydromechanics Div., Zurn Industries, Inc.

2.2 CLEANOUTS

- A. Exterior Surfaced Areas: Round cast nickel-bronze access frame and non-skid cover.
- B. Exterior Un-Surfaced Areas: Line type with lacquered cast iron body and round epoxy coated gasketed cover.

- C. Interior Finished Floor Areas: Lacquered cast iron, two piece body, round with scoriated cover in service areas and round with depressed cover to accept floor finish in finished floor areas.
- D. Interior Finished Wall Areas: Line type with lacquered cast iron body and round epoxy coated gasketed cover, and round stainless steel access cover secured with machine screw.

2.3 WATER HAMMER ARRESTORS

- A. ANSI A112.26.1; sized in accordance with PDI WH-201, pre-charged suitable for operation in temperature range -100 to 300 degrees F and maximum 250 psig working pressure.

2.4 TRAP SEAL PRIMER VALVE:

- A. ASSE 1018; water supply fed type, fully automatic 125psig minimum working pressure, Bronze body with atmospheric vented drain chamber, ½ inch threaded or solder joint inlet and outlet connections, Chrome plated, or rough bronze finish. Unit shall be capable of being located on any active water line.

2.5 BACKFLOW PREVENTERS

- A. Reduced Pressure Back-flow Preventers: ANSI/ASSE 1013; bronze body with bronze and plastic internal parts and stainless steel springs; two independently operating, spring loaded check valves; diaphragm type differential pressure relief valve located between check valves; third check valve which opens under back pressure in case of diaphragm failure; non-threaded vent outlet; assembled with two gate valves, strainer, and four test cocks.

PART III - EXECUTION

3.1 PREPARATION

- A. Coordinate construction areas to receive drains to the required invert elevations.

3.2 INSTALLATION AND APPLICATION

- A. Install specialties in accordance with manufacturer's instructions to permit intended performance.
- B. Extend clean-outs to finished floor. Lubricate threaded clean-out plugs Teflon pipe dope. Ensure clearance at clean-out for rodding of drainage system.
- C. Encase exterior clean-outs in concrete flush with grade.
- D. Install water hammer arrestors complete with accessible isolation valve.

END OF SECTION 15430

SECTION 15450 - WATER HEATERS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Electric Water Heaters and In-Line Circulators.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data including rated capacities of selected models, weights (shipping, installed, and operating), furnished specialties, and accessories, and indicating dimensions, required clearances, and methods of assembly of components, and piping and wiring connections.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Water Heaters:
 - (a) Bradford-White Corp.
 - (b) A.O. Smith Water Products Co. Div.
 - (c) State Industries, Inc.
 - (d) Ruud

2.2 COMMERCIAL ELECTRIC WATER HEATERS

- A. Factory assembled and wired, electric, [vertical] [horizontal] storage type, 150 psig maximum working pressure.
- B. Glass lined welded steel tank; four (4) inch diameter inspection port, thermally insulated with minimum two (2) inches glass fiber encased in corrosion-resistant steel jacket; baked-on enamel finish.
- C. Brass water connections and dip tube, drain valve, high-density magnesium anode, and ASME rated temperature and pressure relief valve.
- D. Flange-mounted immersion heating electrical elements; individual elements sheathed with Incoloy corrosion-resistant metal alloy, rated less than 75 Watts per square inch.

2.3 IN-LINE CIRCULATOR PUMPS

- A. Casing: Bronze, rated for 125 psig working pressure
- B. Impeller: Bronze

- C. Shaft: Alloy steel with integral thrust collar and two (2) oil lubricated bronze sleeve bearings.
- D. Seal: Carbon rotating against a stationary ceramic seat.
- E. Drive: Flexible coupling

2.4 THERMAL EXPANSION TANKS

- A. Construction: Welded steel, tested and stamped in accordance with Section 8D of ANSI/ASME Code; supplied with National Board Form U-1, rated for working pressure of 125 psig, maximum operating temperature 210 degrees F., with flexible EPDM diaphragm sealed into tank.
- B. Accessories: Pressure gage and air-charging fitting, tank drain; pre-charge to 55 psig.
- C. Size: 10.5" diameter, 16" overall length, 5 gallon capacity.

PART III - EXECUTION

3.1 WATER HEATER INSTALLATION

- A. Install water heaters in accordance with manufacturer's instructions and to UL requirements.
- B. Coordinate with plumbing piping and related [fuel piping] [gas venting] [electrical] work to achieve operating system.

3.2 PUMP INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide air cock and drain connection on horizontal pump casings.
- C. Decrease from line size, with long radius reducing elbows or reducers. Support piping adjacent to pump such as that no weight is carried on pump casings.

Ensure pumps operate at specified system fluid temperatures without vapor binding and cavitation, are non-overloading in parallel or individual operation, and operate within 25 percent of midpoint of published maximum efficiency curve.

END OF SECTION 15450

SECTION 15452 - SOLAR WATER HEATING SYSTEM**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes a pre-packaged solar hot water heating system utilizing a closed loop glycol design including a heat exchange tank, collectors, multi-speed pump, mixing valve, glycol solution, thermal expansion tank and controls as required for a complete operating system.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data including rated capacities of selected models, weights (shipping, installed, and operating), furnished specialties, and accessories, and indicating dimensions, required clearances, and methods of assembly of components, and piping and wiring connections.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Solar Water Heating Systems:
 - (a) Rheem.
 - (b) A.O. Smith Water Products Co. Div.
 - (c) Bradford White

2.2 Heat Exchange Tanks

- A. Factory assembled and wired, electric, vertical storage type, 150 psig maximum working pressure.
- B. Glass lined welded steel tank; four (4) inch diameter inspection port, thermally insulated with minimum two (2) inches glass fiber encased in corrosion-resistant steel jacket; baked-on enamel finish.
- C. Brass water connections and dip tube, drain valve, high-density magnesium anode, and ASME rated temperature and pressure relief valve.
- D. Flange-mounted immersion heating electrical elements; individual elements sheathed with Incoloy corrosion-resistant metal alloy, rated less than 75 Watts per square inch.

2.3 Collectors

- A. Flat plate design with integral mounting channel.
- B. Copper absorber plat with black absorber coating.

- C. Stainless steel fasteners.
- D. OG-100 certified by SRCC.

2.4 IN-LINE CIRCULATOR PUMPS

- A. Casing: Bronze, rated for 125 psig working pressure
- B. Impeller: Bronze
- C. Shaft: Alloy steel with integral thrust collar and two (2) oil lubricated bronze sleeve bearings.
- D. Seal: Carbon rotating against a stationary ceramic seat.
- E. Multi-speed motor.

2.5 THERMAL EXPANSION TANKS

- A. Construction: Welded steel, tested and stamped in accordance with Section 8D of ANSI/ASME Code; supplied with National Board Form U-1, rated for working pressure of 125 psig, maximum operating temperature 210 degrees F., with flexible EPDM diaphragm sealed into tank.
- B. Accessories: Pressure gage and air-charging fitting, tank drain; pre-charge to 55 psig.

PART III - EXECUTION

3.1 SOLAR WATER HEATING SYSTEM INSTALLATION

- A. Provide a complete, packaged system with all components for a proper operation as specified. Install the system in accordance with manufacturer's instructions and to UL requirements.
- B. Provide complete shop drawings outlining the entire system, including all components, piping, glycol solution and controls.
- C. Coordinate with plumbing piping and related electrical work to achieve operating system.
- D. Securely mount all components to structure.
- E. Provide all controls as required to operate system.
- F. Provide system check out and balancing by factory representatives.
- G. Provide a minimum of (2) two hours of owner training by the factory representatives.

3.2 SOLAR COLLECTOR INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide stainless steel mounting hardware on roof to support unit. Place at optimum angle for each location.

C203304-RA (K-3800)

BEAUFORT COUNTY

- C. Properly seal all roof/wall penetrations as required for the building type

Ensure pumps operate at specified system fluid temperatures without vapor binding and cavitation, are non-overloading in parallel or individual operation, and operate within 25 percent of midpoint of published maximum efficiency curve.

3.3 WARRANTY

- A. Provide a minimum of 6 year tank warranty, 10 year collector warranty and 2 year pump and controls warranty.
- B. Provide a complete 1 year labor and materials warranty on the entire system.

END OF SECTION 15452

DIVISION 15A- COMPENSATION FOR PLUMBING

COMPENSATION

- A. The work of furnishing materials and constructing the Plumbing installation for the Rest Area Building and the Storage Building Yard Hydrant in accordance with the plans and specifications, completed and accepted, will be paid for at the contract lump sum price for the "Plumbing Installation of Rest Area Building". Such price and payment will be full compensation for all work of constructing the Plumbing installation for the Rest Area Building as well as the storage building yard hydrant, except for the Solar Water Heating System, including but not limited to furnishing all transportation, materials, labor, tools, equipment, fees and incidentals necessary to complete the work. Payment will be made under:

"Plumbing Installation of Rest Area Building"Lump Sum

- B. The work of furnishing materials and constructing the Solar Water Heating System for the Rest Area Building in accordance with the plans and specifications, complete and accepted, will be paid for at the contract lump sum price for "Rest Area Solar Water Heating System". Such price will be full compensation for all work of constructing the Solar Water Heating System, including but not limited to furnishing all transportation, materials, labor, tools, equipment, fees and incidentals necessary to complete the work. Payment will be made under:

"Rest Area Solar Water Heating System"Lump Sum

SECTION 15500 BASIC MECHANICAL REQUIREMENTS**PART I - GENERAL****1.1 GENERAL CONDITIONS**

- A. The Stipulations and Conditions stated in this Section, together with all provisions of the "Instructions to Bidders", "General Conditions", "Supplemental General Conditions", and "Special Conditions", herein before set forth, shall apply to this and the other Sections of Division 15.

1.2 GENERAL REQUIREMENTS

- A. The General Requirements hereinafter listed apply to the Mechanical Work Division. If there is any conflict between the General Requirements and the General Conditions, the General Conditions shall take precedence.

1.3 ALTERNATES

- A. Carefully examine all Alternates at the back of this Specification to determine if any work described under the Mechanical Section will be affected thereby.

1.4 INTENT

- A. The intent of these Drawings and Specifications are to describe the installation of a complete, fully adjusted, and operational system. Therefore, any items shown on Drawings and not specifically called for in the Specifications, or any items specified and not specifically indicated or detailed on the Drawings, or any items neither specified or shown, but which are reasonably incidental to and commonly required to make a complete job, will be furnished and installed by the Mechanical Contractor at his own expense.

1.5 DEFINITIONS

- A. The Mechanical Contractor shall provide all supervision, labor, material equipment, machinery, plant, and any and all other items necessary to complete the mechanical systems. All items of equipment are specified in the singular; however, the Mechanical Contractor shall provide the number of items of equipment as indicated on the Drawings, and as required for complete systems.

Where the word "provide" is used, it shall mean "furnish and install complete and ready to use".

1.6 VISIT TO THE SITE

- A. The Mechanical Contractor shall visit the site before submitting his bid, so as to be thoroughly familiar with the job conditions and/or peculiarities. No extra payment will be allowed for anything that could have been anticipated from a visit to the site.

1.7 REGULATORY REQUIREMENTS

- A. All work under this Section shall be accomplished in strict accordance with State codes. Where these Plans and Specifications conflict with such codes, the codes shall govern. The Mechanical Contractor shall notify the Architect or Engineer of such conflicts in writing prior to receipt of bids.

1.8 PERMITS AND FEES

- A. The Mechanical Contractor shall make all necessary arrangements, obtain all necessary approval, obtain all permits and pay fees required for the installation of any of the work covered under the Mechanical Work Division of the Specifications. Any fees required by any utility companies or municipal authorities for the final connections for these services shall be paid by the Mechanical Contractor under whose work such services appear. Before the job is certified as substantially complete, a Certificate of Approval from all authorities involved must be obtained and turned over to the Architect/Engineer.

1.9 DRAWINGS AND SPECIFICATIONS

- A. The Mechanical Drawings and Specifications are intended to cover all the work enumerated under the respective headings. The drawings are diagrammatic only. No Contractor shall take advantage of conflict or error between Drawings and Specifications, or between general Drawings and Mechanical, Plumbing and/or Electrical Drawings, but shall request a clarification of such from the Architect/Engineer, should this condition exist. If there is insufficient time to issue an Addendum for this clarification, the Mechanical Contractor shall figure on the most expensive of the items in conflict.
- B. The Mechanical Contractor shall refer to the Architectural and Structural Drawings and Specifications for the general construction of the building, for floors and ceiling heights, for locations of walls, partitions, beams, etc., and shall be guided accordingly for setting of all sleeves, inserts and equipment. No Contractor shall under any circumstances scale Drawings for the location of equipment. The Mechanical Contractor shall verify the locations of all utility services.
- C. The Mechanical Contractor shall keep at least one (1) set of corrected Shop and Design Drawings at the site. Drawings are to be current, denoting approved modifications and actual installed departure. Submit drawings to Architect/Engineer before final payment is made.

1.10 SUPERVISION

- A. The Mechanical Contractor performing the work specified shall be required to employ a qualified superintendent or foreman to continuously supervise the installation of their work, with authorization to act as agent Contractors. He shall be capable of checking layouts, coordinating and supervising the work, establishing grades and levels and locating chases, openings, hangers, inserts, sleeves, etc.

PART II - PRODUCTS**2.1 STANDARD PRODUCTS**

- A. Unless otherwise indicated in writing by the Architect/Engineer, the materials to be provided under this Specification shall be standard products of manufacturers regularly engaged in the production of such equipment and shall be the manufacturer's latest design. All items of the same type or rating shall be identical.

2.2 SUBMITTAL

- A. The Mechanical Contractor shall submit, for approval, detailed Shop Drawings on all major equipment and where requested. No materials or equipment may be delivered to the job site or installed until the Mechanical Contractor has in his possession the approved shop drawing for the particular material or equipment. The Mechanical

Contractor shall furnish the number of copies required by the General or Special Conditions of the contract, but in no case less than six (6) copies.

- B. Submitted material shall be properly labeled indicating specific Service for which material or equipment to be used, Section and Article Number of Specifications governing, Contractor's name and name of job.
- C. Approval of equipment will not relieve the Mechanical Contractor of compliance with the specifications even if such approval is made in writing, unless the attention of the Engineer is called to the non-complying features by letter accompanying the submittal data. Approval of submittal data by the Engineer shall not be construed as a complete check of approval of detailed dimensions, weights, gauges and similar details with the proposed articles. The conformance with the necessary coordination between the various other contractors and suppliers shall be solely the responsibility of the Mechanical Contractor and with no additional expense to the Owner.

2.3 SUBSTITUTIONS

- A. Manufacturer's lists are to establish a Standard of Quality and not intended to limit the selection to these manufacturers. All materials and equipment which are essential and have not been specified or shown shall be new and of the highest grade and quality. Free from defect or other imperfections. It should be understood that where the words "furnished and installed" are used, it is intended that the Mechanical Contractor shall purchase and install all materials required.
- B. All materials and equipment proposed as substitutes for these specified shall require a ten (10) day prior approval from the Engineer prior to the bid date. No substitutions will be allowed after the ten (10) day period before the bid date.

2.4 PRODUCT HANDLING

- A. Equipment and materials shall be properly stored, adequately protected, and carefully handled to prevent damage before and during installation. Equipment and materials shall be handled, stored and protected in accordance with the manufacturer's recommendations and as approved by the Architect/Engineer. Equipment installed with a factory finish shall be fully protected during construction and shall be maintained free of dust, dirt, and foreign matter. Dents and other surface damage shall be repaired or replaced to the satisfaction of the Architect/Engineer at no additional cost to the Owner.
- B. The Mechanical Contractor shall clean up and remove from the job site all waste materials, packaging, crating, and refuse resulting from his work on a daily basis.

2.5 MATERIALS AND WORKMANSHIP

- A. The Mechanical Contractor shall perform a first class job, both in material and workmanship. None other will be accepted. Deviations from either will be corrected by the Mechanical Contractor at the Mechanical Contractor's expense.
- B. The material used throughout the work, except when otherwise noted, shall be new and of the best of its kind. No substitutes shall be used unless approved by the Architect/Engineer. All work shall be executed with a maximum speed consistent with safety and good workmanship.
- C. Any equipment furnished by the Mechanical Contractor that is larger than those indicated on the Drawings and described in these Specifications or have different electrical characteristics, the increase in cost to the Electrical Contractor for larger wires, conduit, circuit breakers, switches, etc. or for changes in work already installed shall be borne by the instigating Contractor.

PART III - EXECUTION**3.1 EXCAVATION AND BACKFILL**

- A. The Mechanical Contractor shall preform any and all trench and pit excavation and backfilling required for the installation of his work. Trenches shall be made with the sides vertical and shall be shored where necessary for the protection of men and equipment. All excavation work shall be done in a careful manner to avoid damage to footers and foundations. The backfilling shall be placed in layers not exceeding four (4) inches in depth, wetting each layer as it is placed, and thoroughly compacting each layer with mechanical tamper or other approved means. Any damage done during excavation and back-filling operations to roads, sidewalks, curbs, shrubs, sod, footers, foundations, etc. shall be replaced to its condition prior to construction at no expense to the Owner.

3.2 SCAFFOLDING, RIGGING AND HOISTING

- A. The Mechanical Contractor shall furnish all necessary scaffolding, staging, rigging and hoisting required for the completion of his work. All such scaffolding, etc., shall be removed from the premises when its use is no longer required on the job.

3.3 CUTTING AND PATCHING

- A. The Mechanical Contractor shall provide all cutting and patching necessary to install the work specified in this Section. The patching shall match adjacent surfaces.
- B. No Structural member shall be cut without the approval of the Engineer and all such cutting shall be done in a manner directed by him.

3.4 EQUIPMENT SPACE AND ARRANGEMENT

- A. The equipment shall fit into the space allotted and shall allow adequate clearance for entry, installation, replacement, servicing and maintenance. The Mechanical Contractor shall coordinate the work to ensure that equipment may be moved into place without altering building components or other installations. Access space shall not be less than the equipment manufacturer's requirements.
- B. These drawings indicate the extent and general arrangement of equipment, piping, and ductwork. If any departures are deemed necessary by the Mechanical Contractor, details of such departures and the reasons therefore shall be submitted to the Architect/Engineer for approval as soon as practicable and within 30 days after Award of Contract. No departure shall be made without written Approval of the Architect/Engineer.

3.5 DAMAGE TO WORK ALREADY IN PLACE

- A. The Mechanical Contractor shall assume full responsibility for any damage done by him, his agents or employees, to any work already in place. Any such damage done shall be repaired at the Contractor's expense by mechanics skilled at their respective trades, to the approval of the Architect/Engineer.

3.6 JURISDICTION OF WORK

- A. It may become necessary for the Mechanical Contractor to furnish labor or material which is not generally accepted as part of this trade. In cases of this type, he shall contract the work, or shall furnish materials and employ workmen of the trade involved in order not to cause any delay or stoppage of work caused by infringement of trade agreements as to jurisdiction, alleged or actual.

3.7 COORDINATION WITH OTHER TRADES

- A. All work shall be coordinated with other trades involved in the construction project. All work shall be carefully laid out in advance to coordinate Architectural, Structural, Mechanical, Plumbing and Electrical features of construction. The Contractor shall verify at the site all locations, grades, elevations, and utility service connections indicated. Any conflicts due to lack of proper coordination shall be brought to the attention of the Architect/Engineer for resolution. The Mechanical Contractor shall make required changes or relocations at no additional cost to the Owner.
- B. Installation, inspection, and testing of work above ceilings shall be completed and approved by the Architect/Engineer prior to installation of the specified finished ceilings. However, ceiling suspension system may be installed as required for coordination.
- C. The Mechanical Contractor shall consult with the other trades at the start of the work and periodically thereafter, as required to properly coordinate the various items of work, and to avoid interferences. Should any interferences of any nature develop as the work progresses, such interferences shall be resolved and eliminated as directed. The cost of any work directed will be borne by the subcontractor or contractors directed to do this work.

3.8 DIVISION OF WORK

- A. This paragraph is intended to show exactly the point of division of work between the Electrical Division and the Mechanical Division.
- B. All equipment covered in the Mechanical Division of the Specifications shall be furnished, mounted and aligned under the Mechanical Division. All individual motor starters, unless indicated as part of a motor control center, for this equipment shall be furnished and installed by the Mechanical Contractor.
- C. All final electrical connections to equipment covered in the Mechanical Division of the Specifications shall be completed under the Mechanical Division.
- D. The Electrical Contractor shall provide a disconnect switch or junction box for each item of equipment under Division 16.
- E. Electrical equipment and wiring that is provided by the Mechanical Contractor shall be in accordance with the Electrical specification.

3.9 EQUIPMENT INSTALLATION

- A. Final connections to equipment, including pipe, duct, and controls, shall be provided under applicable sections of this Division, unless otherwise specified or indicated.
- B. Manufacturer's Instructions: Equipment shall be installed as recommended by the manufacturer to conform to the requirements of the particular application, in accordance with these Drawings and Specifications.

3.10 OPERATION AND MAINTENANCE MANUALS

- A. One complete Manual as outlined herein shall be submitted for approval before conducting instruction sessions in operation, before systems or equipment tests are performed, and before final or beneficial occupancy.
- B. Manuals shall have rigid covers and index tabs for each major piece of equipment, auxiliaries, and systems. The following shall be inscribed on the cover: the words

"OPERATION AND MAINTENANCE MANUAL", the name and location of the building, the name of the Section, such as "Heating" and the name of the Mechanical Contractor. Two (2) copies of each approved manual shall be submitted to the Owner and one (1) copy shall be submitted to the Architect/Engineer.

- C. Each piece of equipment shall be listed and identified with the same name, mark, number, or other identification as noted or scheduled in the Contract Documents.
- D. Manuals shall include the following:
 - 1. Complete Operating Installations, covering start-up and shutdown for all components installed.
 - 2. Legible copies of all Shop Drawings. Any comments incorporated in "as noted" approvals of Shop Drawings shall be recorded on the Drawings included in the Manuals.
 - 3. All equipment Maintenance and Service Manuals.
 - 4. A complete parts list for each piece of equipment.
 - 5. All descriptive literature for the equipment.
 - 6. Operating characteristics, performance data, ratings, and curves for each piece of equipment such as condensers, fans and air handling units.
 - 7. Internal wiring and control diagrams.
 - 8. Automatic temperature control diagrams, part descriptions and numbers, and sequences of operation. Drawings shall be neatly folded and inserted in a separate clear plastic binder. The plastic binders shall be bound in the back of each Manual.
 - 9. Final Testing and Balancing Reports.
 - 10. All other information pertinent to the maintenance and servicing of equipment and systems provided in the Project.
 - 11. Name, address, and telephone number for service on each manufacturer's equipment.

3.11 OPERATING INSTRUCTIONS

- A. After all equipment and services are in operation, and the Operation and Maintenance Manuals are available, an instruction and training session shall be conducted for the Owner's operating personnel.
- B. Instruction sessions shall be conducted during the Owner's normal working periods, and at times and locations satisfactory to the Owner.

3.12 EQUIPMENT START-UP

- A. No equipment shall be placed in operation until it has been inspected by a qualified representative of the manufacturer and certified to be ready for operation. The manufacturer's representative shall supervise the start-up operation and shall be responsible for all adjustments are required to meet design conditions. Such services shall be at no additional cost to the Owner.

C203304-RA (K-3800)

BEAUFORT COUNTY

3.13 GUARANTEE

- A. The Mechanical Contractor shall present to the Owner a written Guarantee covering his work, including all equipment, material and workmanship. This Guarantee shall be against all defects in any of the above work, and shall run for a period of one (1) year from the date of written acceptance of the Contractor's work.
- B. Any defective work, equipment, material and/or workmanship that develops within the Guarantee period, which is not caused by ordinary wear or abuse by other persons, shall be replaced by the Mechanical Contractor without cost to the Owner.

3.14 FINAL INSPECTION

- A. When the entire Contract has been completed and the work is ready for final inspection, the Architect/Engineer or his duly authorized representative will make the inspection. At the time of inspection, the Mechanical Contractor shall demonstrate to the Architect/Engineer that the various systems and pieces of equipment have been adjusted to operate in accordance with the requirements of the Contract.

3.15 FINAL PAYMENTS

- A. All Final Payments are contingent upon all necessary Certificates and/or Approvals cited above, together with the written Guarantee being presented to the Owner.

END OF SECTION 15500

SECTION 15501 - HANGERS AND SUPPORTS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawing and General Provisions of the Contract, including the General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- B. This Section includes Hangers and Supports for Mechanical Systems Piping and Equipment.

PART II - PRODUCTS**2.1 PIPE HANGERS AND SUPPORTS**

- A. Hangers: Galvanized carbon steel, adjustable, clevis.
- B. Copper Pipe Support: Carbon steel ring, adjustable, copper plated.
- C. Shield for Insulated Piping 2 Inches and Smaller: 18 gage galvanized steel shield over insulation in 180 degree segments, minimum 12 inches long at pipe support.

2.2 HANGER RODS

- A. Steel Hanger Rods: Threaded both ends or continuous threaded.

2.3 FLASHING

- A. Metal Flashing: 26 gage galvanized steel.
- B. Flexible Flashing: 47 mil thick sheet butyl; compatible with roofing.

2.4 SLEEVES

- A. Sleeves for Pipes: Form with schedule 40, galvanized steel pipe
- B. Sleeves for Pipes Through Fire Rated and Fire Resistive Floors and Walls, and Fireproofing: Prefabricated fire rated sleeves including seals, UL listed.
- C. Sleeves for Round Ductwork: Form with galvanized steel.
- D. Sleeves for Rectangular Ductwork: Form with galvanized steel or wood.
- E. Fire Stopping Insulation: Glass fiber type, non-combustible.
- F. Caulk: Fire Barrier type sealant.

2.5 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, steel plates, shapes, and bars, black and galvanized.
- B. Bolts and Nuts: ASME B18.10 or ASTM A 183, steel, hex-head, track bolts and nuts.

- C. Washers: ASTM F 844, steel, plain, flat washers.

2.6 ATTACHMENTS

- A. Mechanical-Anchor Fasteners: Insert-type attachments with pull-out and shear capacities appropriate for supported loads and building materials where used. Permitted in concrete over 4 inches thick.
- B. Beam Clamps: Types 20, 21, 28 or 29
- C. Wood: Wood screws or lag bolts

PART III - EXECUTION

3.1 HANGERS AND SUPPORTS INSTALLATION

- A. Install hangers, supports, clamps, and attachments as required to properly support piping from building structure.
- B. Install building attachments within concrete or to structural steel. Install additional attachments at concentrated loads, including valves, flanges, guides, strainers, expansion joints, and at changes in direction of piping.
- C. Install hangers and support complete with necessary inserts, bolts, rods, nuts, washers, and other accessories.
- D. Install hangers and supports to allow controlled movement of piping systems, permit freedom of movement between pipe anchors, and facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- E. Install hangers and supports so that piping live and dead loading and stresses from movement will not be transmitted to connected equipment.
- F. Support horizontal piping as follows:

PIPE SIZE	HANGER SPACING	MAXIMUM HANGER DIAMETER
1/2 to 1-1/4 inch	6' - 6"	3/8"
1-1/2 to 2 inch	10' - 0"	3/8"

- G. Install hangers to provide minimum 1/2 inch space between finished covering and adjacent work.
- H. Place a hanger within 12 inches of each horizontal elbow.
- I. Use hangers with 1 1/2 inch minimum vertical adjustment.
- J. Support vertical piping at every floor.
- L. Support riser piping independently of connected horizontal piping.
- M. All pipe hangers shall be galvanized steel or copper.
- N. Pipe strapping, duct tape or zip ties will not be allowed.

3.2 EQUIPMENT BASES AND SUPPORTS

- A. Provide equipment bases of concrete.
- B. Provide templates, anchor bolts, and accessories for mounting and anchoring equipment.

3.3 EQUIPMENT SUPPORTS

- A. Fabricate structural steel stands to suspend equipment from structure above or support equipment above floor.
- B. Grouting: Place grout under supports for equipment, and make a smooth bearing surface.

3.4 METAL FABRICATION

- A. Cut, drill, and fit miscellaneous metal fabrications for pipe and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1 procedures for manual shielded metal arc welding, appearance and quality of welds.

3.5 FLASHING

- A. Provide flexible flashing and metal counter-flashing where piping and ductwork penetrate weather or waterproofed walls, floors, and roofs.
- B. Provide curbs for mechanical roof installations 14 inches minimum high above roofing surface. Flexible sheet flash and counter-flash with sheet metal; seal watertight.

3.6 SLEEVES

- A. Size sleeves large enough to allow for movement due to expansion and contraction. Provide for continuous insulation wrapping.
- B. Design hangers without disengagement of supported pipe.
- C. Where piping penetrates floor, ceiling, or wall, close off space between pipe and adjacent work with fire stopping insulation and caulk seal air tight. Provide close fitting metal collar or escutcheon covers at both sides of penetration.
- D. Install chrome plated steel or stainless steel escutcheons at finished surfaces.

END OF SECTION 15501

SECTION 15504 - PIPING INSULATION-REFRIGERANT/CONDENSATE**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Mechanical Pipe Insulation.

1.3 QUALITY ASSURANCE

- A. Fire Performance Characteristics: Conform to the following characteristics for insulation including facings, cements, and adhesives, when tested according to ASTM E 84, by UL or other testing or inspecting organization acceptable to the authority having jurisdiction. Label insulation with appropriate markings of testing laboratory.
 - 1. Interior Insulation: Flame spread rating of 25 or less and a smoke developed rating of 50 or less.
 - 2. Exterior Insulation: Flame spread rating of 75 or less and a smoke developed rating of 150 or less.

1.4 SEQUENCING AND SCHEDULING

- A. Schedule insulation application after testing of piping systems.
- B. Schedule insulation application after installation and testing of heat trace tape.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers
 - 1. Flexible Elastomeric Cellular:
 - a. Armstrong World Industries, Inc.
 - b. Halstead Industrial Products
 - c. IMCOA
 - d. Rubatex Corporation

2.2 FLEXIBLE ELASTOMERIC CELLULAR

- A. Material: Flexible expanded closed-cell structure with smooth skin on both sides.
- B. Form: Tubular materials conforming to ASTM C 534, Type I.
- C. Thermal Conductivity: 0.30 average maximum at 75 degrees F.
- D. Coating: Water based latex enamel coating recommended by insulation manufacturer.

2.3 ADHESIVES

- A. Flexible Elastomeric Cellular Insulation Adhesive: Solvent-based, contact adhesive recommended by insulation manufacturer.

2.4 SEALING COMPOUNDS

- A. Weatherproof Sealant: Flexible elastomer based, vapor barrier sealant designed to seal metal joints.
 - 1. Water Vapor Permeance: 0.02 perm maximum
 - 2. Temperature Range: Minus 50 to 250 degrees F

PART III - EXECUTION**3.1 PREPARATION**

- A. Surface Preparation: Clean, dry, and remove foreign materials such as rust, scale, and dirt.

3.2 INSTALLATION - GENERAL

- A. Select accessories compatible with materials suitable for the service. Select accessories that do not corrode, soften, or otherwise attack the insulation or jacket in either the wet or dry state.
- B. Apply insulation material, accessories, and finishes according to the manufacturer's printed instructions.
- C. Keep insulation materials dry during application and finishing.
- D. Apply insulation continuously over fittings, valves, and specialties.
- E. Apply insulation with a minimum number of joints.
- F. Interior Walls and Partitions Penetrations: Apply insulation continuously through walls and partitions, except fire-rated walls and partitions.
- G. Fire-Rated Walls and Partitions Penetrations: Terminate insulation at penetrations through fire rated walls and partitions. Seal insulation ends with vapor barrier coating. Seal around penetration with fire stopping or fire resistant joint sealer.
- H. Flanges, Fittings, and Valves: Apply pre-molded, pre-cut, or field fabricated segments of insulation around flanges, unions, valves, and fittings. Make joints tight. Bond with adhesive.
 - 1. Use same material and thickness as adjacent pipe insulation.
 - 2. Overlap nesting insulation by 2 inches or 1-pipe diameter, whichever is greater.
 - 3. Apply materials with adhesive, fill voids with mineral fiber insulating cement. Secure with wire or tape.
 - 4. Insulate elbows and tees smaller than 3-inches pipe size with pre-molded insulation.
 - 5. Insulate elbows and tees Three (3) inches and larger with pre-molded insulation or insulation material segments. Use at least 3 segments for each elbow.
- I. Hangers and Anchors: Apply insulation continuously through hangers and around anchor attachments. Install saddles, shields, and inserts as specified.

1. Inserts and Shields: Cover hanger inserts and shields with jacket material matching adjacent pipe insulation.

3.3 FLEXIBLE ELASTOMERIC CELLULAR INSULATION INSTALLATION

- A. Slip insulation on the pipe before making connections wherever possible. Seal joints with adhesive. Where the slip-on technique is not possible, cut one side longitudinally and apply to the pipe. Seal seams and joints with adhesive.
- B. Valves, Fittings, and Flanges: Cut insulation segments from pipe or sheet insulation. Bond to valve, fitting, and flange and seal joints with adhesive.
 1. Miter cut materials to cover soldered elbows and tees.
 2. Fabricate sleeve fitting covers from flexible elastomeric cellular insulation for screwed valves, fittings, and specialties. Miter cut materials. Overlap adjoining pipe insulation.

3.4 FINISHES

- A. Flexible Elastomeric Cellular Insulation: After adhesive has fully cured, apply 2 coats of protective coating to exposed insulation. Paint all exterior insulation with UV resistant paint as recommended by Insulation manufacturer.

INTERIOR COLD CONDENSATE DRAINS

<u>PIPE SIZES (NPS)</u>	<u>MATERIALS</u>	<u>THICKNESS IN INCHES</u>
1/2 TO 4	FLEXIBLE ELASTOMERIC	3/4

REFRIGERANT SUCTION

<u>PIPE SIZES (NPS)</u>	<u>MATERIALS</u>	<u>THICKNESS IN INCHES</u>
1/2 TO 1-1/4	FLEXIBLE ELASTOMERIC	3/4
1-1/2 TO 4	FLEXIBLE ELASTOMERIC	1

END OF SECTION 15505

SECTION 15507 - DUCTWORK INSULATION**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Duct and Plenum Insulation.

1.3 QUALITY ASSURANCE

- A. Fire Performance Characteristics: Conform to the following characteristics for insulation including linings, cements, and adhesives, when tested according to ASTM E 84, by UL or other testing or inspecting organization acceptable to the authority having jurisdiction. Label insulation with appropriate markings of testing laboratory.
 - 1. Interior Insulation: Flame spread rating of 25 or less and a smoke developed rating of 50 or less.
 - 2. Exterior Insulation: Flame spread rating of 75 or less and a smoke developed rating of 150 or less.

PART II – PRODUCTS**2.1 MANUFACTURERS**

- A. ACCEPTABLE MANUFACTURERS:
 - 1. Glass Fiber:
 - a. Certain Teed Corporation
 - b. Knauf Fiberglass GmbH
 - c. Manville
 - d. Owens-Corning Fiberglass Corporation
 - e. USG Interiors, Inc. - Thermafiber Division

2.2 INSTALLATION

- A. GLASS FIBER
 - 1. Material: Inorganic glass fibers, bonded with a thermosetting resin.
- B. Jacket: All purpose, factory-applied, laminated glass fiber reinforced, flame retardant Kraft paper and aluminum foil having self-sealing lap.
- C. Blanket: ASTM C 553, Type II, Class F-1, jacketed flexible blankets-2" thick.
 - 1. Thermal Conductivity: 0.32 average maximum, at 75 degrees F mean temperature.
- D. Adhesive: Produced under the UL Classification and follow-up service.
 - 1. Type: Non-Flammable, solvent-based.
 - 2. Service Temperature Range: Minus 20 to 180 degrees F.

2.3 ACCESSORIES AND ATTACHMENTS

- A. Corner Angles: 28-gauge, 1-inch by 1-inch aluminum, adhered to 2-inch by 2-inch Kraft paper.
- B. Anchor Pins: Capable of supporting 20 pounds each. Provide anchor pins and speed washers of sizes and diameters as recommended by the manufacturer for insulation type and thickness.

2.4 SEALING COMPOUNDS

- A. Vapor Barrier Compound: Water-based, fire-resistive composition
 - 1. Water Vapor Permeance: 0.08 perm maximum
 - 2. Temperature Range: Minus 20 to 180 degrees F

PART III - EXECUTION**3.1 PREPARATION**

- A. Surface Preparation: Clean, dry, and remove foreign materials such as rust, scale and dirt.

3.2 INSTALLATION

- A. Select accessories compatible with materials suitable for the service. Select accessories that do not corrode, soften, or otherwise attack the insulation or jacket in either the wet or dry state.
- B. Apply insulation material, accessories, and finishes according to the manufacturer's printed instructions.
- C. Install insulation with smooth, straight, and even surfaces.
- D. Seal joints and seams to maintain vapor barrier.
- E. Seal penetrations for hangers, supports, anchors and other projections.
- F. Keep insulation materials dry during application and finishing.
- G. Blanket Insulation: Install tight and smooth. Secure to ducts having long sides or diameters as follows:
 - 1. Smaller Than 24 Inches: Bonding adhesive applied in 6-inch wide transverse strips on 12-inch centers.
 - 2. Twenty-four (24) Inches and Larger: Anchor pins spaced 12 inches apart each way. Apply bonding adhesive to prevent sagging of the insulation.
 - 3. Overlap joints three (3) inches.
 - 4. Seal joints, breaks, and punctures with vapor barrier compound.

END OF SECTION 15507

SECTION 15510A - HYDRONIC PIPING**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Hydronic Piping Systems.

PART II - PRODUCTS**2.1 GROUND LOOP HEAT PUMP PIPING - ABOVE GRADE**

- A. Steel Pipe: ASTM A53 or A120, Schedule 40, black. Fittings: ANSI/ASTM B16.3, malleable iron or ASTM A234, forged steel. Joints: Screwed for pipe 2 inches and under; ANSI/AWS D1.1 welded for pipe over 2 inches.
- B. Copper Tubing: ASTM B88, Type [M,] [L,] [K,] hard drawn. Fittings: ANSI/ASME B16.23 cast brass or ANSI/ASME B16.29 solder wrought copper. Joints: ANSI/AWS A5.8, BCuP silver braze.

2.2 EQUIPMENT DRAINS AND OVERFLOWS

- A. Copper Tubing: ASTM B88, Type K, hard drawn. Fittings: ANSI/ASME B16.23 cast brass or ANSI/ASME B16.29 solder wrought copper. Joints: ANSI/ASTM B32, solder, Grade 95TA.

2.3 FLANGES, UNIONS AND COUPLINGS

- A. Pipe Size 2 Inches and under: 150 psig malleable iron unions for threaded ferrous piping.
- B. Pipe Size Over 2 Inches: 150 psig forged steel slip-on flanges for ferrous piping.

2.4 MANUFACTURERS

- A. Acceptable Manufacturers:
 - 1. Valves:
 - a. Crane Co.
 - b. Grinnell Co.
 - c. Nibco, Inc.

2.5 GATE VALVES

- A. Up to 2 Inches: 150 psig rated, bronze body, bronze trim, rising stem, hand wheel, inside screw, double wedge or disc, threaded ends.
- B. Over 2 Inches: 150 psig rated, iron body, bronze trim, rising stem, hand wheel, OS&Y, double wedge, flanged ends.

2.6 GLOBE VALVES

- A. Up to 2 Inches: 150 psig rated, bronze body, bronze trim, rising stem and hand wheel, inside screw, renewable composition disc, screwed ends, with back seating capacity re-

packable under pressure.

- B. Over 2 Inches: 150 psig rated, iron body, bronze trim, rising stem, hand wheel, OS&Y, plug-type disc, flanged ends, renewable seat and disc.

2.7 BALL VALVES

- A. Up to 2 Inches: 150 psig rated, bronze or Stainless steel two- piece body, stainless steel ball, Teflon seats and stuffing box ring, lever handle, and balancing stops, threaded ends.
- B. Over 2 Inches: 150 psig rated, cast steel body, chrome plated steel ball, Teflon seat and stuffing box seals, lever handle, or gear drive hand wheel for sizes 10 inches and over, flanged.

2.8 PLUG COCKS

- A. Up to 2 Inches: 150 psig rated, bronze body, bronze tapered plug, non-lubricated, Teflon packing, threaded ends, with one wrench operator for every ten plug cocks.
- B. Over 2 Inches: 150 psig rated, cast iron body and plug, pressure lubricated, Teflon packing, flanged ends, with wrench operator with set screw.

2.9 SWING CHECK VALVES

- A. Up to 2 Inches: 150 psig rated, bronze 45 degree swing disc, screwed ends.
- B. Over 2 Inches: 150 psig rated, iron body, bronze trim, 45 degree swing disc, renewable disc and seat, flanged ends.

PART III - EXECUTION

3.1 PREPARATION

- A. Ream pipe and tube ends. Remove burrs. Bevel plain end ferrous pipe.
- B. Remove scale and dirt on inside and outside before assembly.
- C. Prepare piping connections to equipment with flanges or unions.
- D. After completion, fill, clean, and treat systems.

3.2 INSTALLATION

- A. Route piping in orderly manner, plumb and parallel to building structure and maintain gradient.
- B. Install piping to conserve building space, and not interfere with use of space and other work.
- C. Group piping whenever practical at common elevations.
- D. Install piping to allow for expansion and contraction without stressing pipe, joints, or connected equipment.
- E. Provide clearance for installation of insulation and access to valves and fittings.

C203304-RA (K-3800)

BEAUFORT COUNTY

- F. Slope piping and arrange systems to drain at low points. Use eccentric reducers to maintain top of pipe level.
- G. Where pipe support members are welded to structural building framing, scrape, brush clean, and apply one coat of zinc rich primer to welding.
- H. Prepare pipe, fittings, supports, and accessories for finish painting.
- I. Install valves with stems upright or horizontal, not inverted.

3.3 APPLICATION

- A. Install unions downstream of valves and at equipment or apparatus connections.
- B. Install brass male adapters each side of valves in copper piped system. Sweat solder adapters to pipe.
- C. Install gate or butterfly valves for Shut-Off and to isolate equipment, part of systems, or vertical risers.
- D. Install globe or butterfly valves for throttling, bypass, or manual flow control services.
- E. Use plug cocks for throttling service. Use non-lubricated plug cocks only when Shut-Off or isolating valves are also provided.
- F. Use Butterfly valves interchangeably with gate and globe valves.
- G. Provide $\frac{3}{4}$ inch gate drain valves at main shut-off valves, low points of piping, bases of vertical risers, and at equipment. Pipe to nearest drain.

END OF SECTION 15510A

SECTION 15510B – GROUND-LOOP HEAT-PUMP PIPING**PART I - GENERAL****1.1 SUMMARY**

- A. This section includes piping for vertical, direct-buried, ground-loop, heat-pump systems that operate between 23 and 104 deg F (minus 5 and plus 40 deg C).

1.2 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressure, unless otherwise indicated:
 - 1. Ground-Loop, Heat-Pump Piping: 200 psig (1380 kPa).

1.3 SUBMITTALS

- A. Product Data: For the following:
 - 1. Pipe and fittings.
 - 2. Joining method and equipment.
- B. Field quality-control test reports.

PART II – PRODUCTS**2.1 PIPES AND FITTINGS**

- A. PE Pipe: ASTM D 2239, SDR Numbers 5.3, 7, 9, or 11.5; with PE compound number required to achieve required system working pressure.
 - 1. Molded PE Fittings: ASTM D 2683 or ASTM D 3261, PE resin, socket- or butt-fusion type, made to match PE pipe dimensions and class.
- B. U-Bend Assembly: Factory fabricated with embossed depth stamp every 36 inches (900 mm) from U-bend.

2.2 BOREHOLE BACKFILL

- A. Surface Seal: Bentonite with thermal conductivity greater than 1.2 Btu/h x sq. ft. x deg F (0.7 W/sq. m x K).
- B. Backfill below Surface Seal: Natural or manufactured sand specified in Division 31 Section "Earth Moving".

PART III - EXECUTION**3.1 EARTHWORK**

- A. Excavating, trenching, warning tape, and backfilling are specified in Division 31 Section "Earth Moving".

3.2 VERTICAL PIPING INSTALLATION

- A. Install PE piping in boreholes according to ASTM D 2774 or ASTM F 645.
 - 1. Clean PE pipe and fittings and make heat-fusion joints according to ASTM D 2657. Minimize number of joints.
- B. Purge, flush, and pressure test piping before backfilling boreholes.
- C. After installation of loop pipe in borehole, fill piping loop with water or antifreeze solution, and pump backfill into borehole to discharge at base of borehole.
- D. Fill borehole with backfill to a point at least 60 inches (1524 mm) below grade and backfill remainder with surface seal material.
- E. Extend piping and connect to water-source, ground-loop, heat-pump piping systems at outside face of building wall in locations and pipe sizes indicated.
 - 1. Terminate water-service piping at building wall until building water-source, ground-loop, heat-pump piping systems are installed. Terminate piping with caps. Make connections to building water-source, ground-loop, heat-pump piping systems when those systems are installed.
- F. Wall sleeves are specified in Division 15 Section 15050 – Basic Materials and Methods.
- G. Mechanical Sleeve seals are specified in Division 15 Section 15050 – Basic Materials and Methods.
 - 1. Smaller Than 24 Inches: Bonding adhesive applied in 6-inch wide transverse strips on 12-inch centers.
 - 2. Twenty-four (24) Inches and Larger: Anchor pins spaced 12 inches apart each way. Apply bonding adhesive to prevent sagging of the insulation.
 - 3. Overlap joints three (3) inches.
 - 4. Seal joints, breaks, and punctures with vapor barrier compound.

3.3 CONNECTIONS

- A. Drawings indicate general arrangement of piping, fittings, and specialties.

3.4 FIELD QUALITY CONTROL

- A. Piping Tests: Fill piping 24 hours before testing and apply test pressure to stabilize piping. Use potable water only.
- B. Hydrostatic Tests: Test at not less than 1-1/2 times the pipe working-pressure rating allowing for static pressure of borehole depth.
 - 1. Increase pressure in 50-psig (345-kPa) increments and inspect each joint between increments. Hold at test pressure for 30 minutes. Slowly increase to next test pressure increment and hold for 30 minutes. After testing at maximum test pressure, reduce pressure to 30 psig (207 kPa). Hold for 90 minutes, and measure pressure at 30-minute intervals. Repair leaks and retest until no leaks exist.
 - 2. Prepare reposts of testing activity.

END OF SECTION 15510B

SECTION 15513 – REFRIGERANT PIPING**PART I - GENERAL**

- 1.1 A. This section includes all pipe, pipe fittings, hangers, supports, etc. as may be required to provide a complete refrigerant piping system.
- B. Testing of all piping shall be made in the presence of a designated representative of the owner. No piping shall be covered or put into operation before such testing has been approved.
- C. The actual arrangement of the piping shall follow the general locations shown on the drawings such that clearances, line drainage, etc. shall be maintained.

PART II - PRODUCTS**2.1 PIPING**

- A. Refrigerant piping shall be type "ACR" hard drawn copper conforming to ANSI B-31.5 or ASTM B280.

2.2 PIPE FITTINGS

- A. Copper pipe fittings shall be wrought metal solder joint type conforming to ANSI B16.22.

PART III - EXECUTION**3.1 PIPING**

- A. The installation of piping and related items shall be made neatly and in such a manner as not to interfere with access to valves or equipment.
- B. All piping shall be reamed to remove all burrs, fins and foreign material. Pipe shall be thoroughly cleaned before soldering.
- C. "Sil-Fos" or silver solder shall be used with non-corrosive flux. During the soldering operation, the pipe shall be purged with nitrogen.
- D. Piping shall be arranged (and traps installed where necessary) to allow the proper return of oil to the compressor.

3.2 HANGERS AND SUPPORTS

- A. The spacing of hangers and supports shall not exceed five feet.
- B. Pipe covering protection saddles shall be used at all supports for insulated piping. Sheet metal shields shall be 10 gauge, one half the circumference of the insulation and minimum of twelve inches long.

3.3 TESTING

- A. All refrigerant equipment not tested at the factory shall be shut off from the rest of the system and tested. Piping systems shall be tested after installation is complete and before any insulation is applied. All controls and other apparatus that may be damaged by the test pressure shall be removed before tests are made.

- B. Refrigerant lines shall be tested at 150 psig with dry nitrogen. Pressure shall be maintained for 60 minutes without loss of pressure. Each joint shall be checked for leaks with a soap solution. Testing and repair shall continue until there is no loss of pressure. After a satisfactory pressure test, high vacuum pumps shall be connected to the system and the system evacuated to a pressure of 0.20 inches of mercury with the ambient temperature at not less than 36 degrees F. After this has been attained, the vacuum shall be broken by charging the system with refrigerant as soon as possible.

END OF SECTION 15055

SECTION 15672 - SPLIT SYSTEM HEAT PUMP**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and a Division 1 Specification Sections, apply to work of this Section.

1.2 SUMMARY

- A. Section includes Split System Heat Pumps.

1.3 SUBMITTALS

- A. Product Data: Submit manufacturer's technical product data, including rated capacities of selected model clearly indicated, weights (shipping, installed, and operating), dimensions, required clearances, and methods of assembly of components, furnished specialties and accessories and installation and start-up instructions.
- B. Wiring Diagrams: Submit ladder-type wiring diagrams for power and control wiring required for final installation of heat pump units and controls. Clearly differentiate between portions of wiring which are factory-installed and portions to be field-installed.
- C. Operation and Maintenance Data: Submit maintenance data and parts list for each heat pump unit, control, and accessory; including "trouble shooting" maintenance guide; plus servicing, and preventative maintenance procedures and schedule. Include this data and product data in maintenance manual in accordance with requirements of Division 1.

1.4 WARRANTY

- A. Provide Five (5) Year Warranty.
- B. Warranty: Include coverage for Refrigerant Compressors.

PART II - PRODUCTS**2.1 SPLIT SYSTEM HEAT PUMPS**

- A. Acceptable Manufacturers:
 - 1. Carrier Air Conditioning: Division of Carrier Corp.
 - 2. Trane (The) Co.: Division of American Standard Inc.
 - 3. York: Division of York International

2.2 GENERAL

- A. Split System: The split-system unit shall be an outdoor heat pump unit and indoor factory-fabricated single-zone draw-through air-handling unit. Both indoor and outdoor unit shall be by the same manufacturer. The net capacities shall be as indicated and shall not exceeded by more than 5%. The minimum efficiency for systems less than 65,000 BTUH shall be 15.0 SEER. The minimum efficiency for systems of 65,000 BTUH or greater shall be in accordance with the 2012 N. C. State Building Code: Energy Conservation Code.

2.3 AIR HANDLER

- A. Direct Expansion Coil: Coil shall be provided with pressure-type brass distributors and solder connections. The coil shall be dehydrated after testing and charged with dry air. Maximum working conditions shall be 300 psig at 200 degrees F for cooling. Tests shall be conducted, subjecting the coil to a minimum air pressure of 350 psig with the coil submerged in water. The cooling coil shall be subject to ASHRAE 15-1978 Safety code for Mechanical Refrigeration. Coils shall be of the cartridge type, removable from other side of casing and supported the entire length in tracks. Staggered tube pattern shall be provided for all coils of more than one row deep. Tubing shall have a minimum outside diameter of 1/2 inch. Tubing shall be individually finned with smooth aluminum or copper fins, wound under tension. Tube joints for all coils shall be made with high temperature brazing alloys.
- B. Cabinet: Unit shall be provided with baked enamel finish and internally insulated. Fan shall be forward curved, and dynamically and statically balanced at the factory. Fan shall be belt driven. Provide adjustable sheaves for each air handler. Fan and motor bearings shall be permanently lubricated type.

2.4 OUTDOOR HEAT PUMP UNIT

- A. Unit shall be factory-assembled and tested. Unit shall provide liquid lift as required to suit installation. Unit shall deliver the specified capacity to the cooling coil with an ambient air temperature of 95 degrees F. Units shall be certified per ARI 240 and 270.
- B. Coil shall have aluminum plate fins, mechanically bonded to 1/2 inch aluminum tubes. Coil shall be circuited for sub-cooling.
- C. Outdoor Fans and Motors: Unit shall be furnished with direct-driven, propeller-type fans arranged for vertical discharge. Condenser fan motors shall have Class B motor insulation and built in current and thermal overload protection, and shall be of the permanently lubricated type, resiliently mounted. Each fan shall have a safety guard.
- D. Compressor: Unit shall have compressors of serviceable hermetic design with external spring isolators and an automatically reversible oil pump. Compressor motors shall have across-the-line start.
- E. Controls shall be factory-wired and located in a separate enclosure. Safety devices shall consist of high and low pressure stats and compressor overload devices. Unit wiring shall incorporate a time delay relay to prevent short-cycling of the compressor. Relay shall prevent compressor from restarting for a 5-minute period. The unit shall include a transformer for 24-volt control circuit, pressure relief valves and circuit breakers.
- F. Casing shall make unit fully weatherproof for outdoor installation. Casing shall be of galvanized steel, zinc phosphatized and finished with baked enamel. Openings shall be provided for power and refrigerant connections. Panel shall be removable to provide access for servicing. The unit shall be mounted on manufacturer's standard legs anchored to concrete pedestals with steel bearing plates and neoprene pads.
- G. Connections: Only one liquid line, one suction line, required for units under 15 tons in capacity shall be provided. A 15-ton unit shall be dual circuited. Double suction risers for the refrigerant lines shall be provided.
- H. Piping shall be sized by the manufacturer.

2.5 TEMPERATURE CONTROL SYSTEM

- A. See Section 15973, Direct Digital Controls

2.6 FILTRATION

- A. Provide a filter rack and a 1" replaceable pleated throwaway filter. Filter rack size shall be as required by AHU manufacture.
- B. Provide additional sets of filters (minimum of 3) as required during construction. Install a clean set of filters for the Final Inspection.

PART III - EXECUTION**3.1 INSTALLATION**

- A. Install in accordance with manufacturer's instructions.
- B. Provide for connection to electrical service.
- C. Install units with vibration isolation.
- D. Install units on concrete base as indicated.

3.2 MANUFACTURER'S FIELD SERVICES

- A. Prepare start systems under provisions of Section 15500.
- B. Provide initial start-up.
- C. Supply initial charge of refrigerant and oil for each refrigerant circuit. Replace losses of refrigerant and oil.

END OF SECTION 15672

SECTION 15674 DUCT FREE SPLIT SYSTEM AIR CONDITIONER**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and a Division 1 Specification Sections, apply to work of this Section.

1.2 SUBMITTALS

- A. Product Data: Submit manufacturer's technical product data, including rated capacities of selected model clearly indicated, weights (shipping, installed, and operating), dimensions, required clearances, and methods of assembly of components, furnished specialties and accessories and installation and start-up instructions.
- B. Wiring Diagrams: Submit ladder-type wiring diagrams for power and control wiring required for final installation of heat pump units and controls. Clearly differentiate between portions of wiring which are factory-installed and portions to be field-installed.
- C. Operation and Maintenance Data: Submit maintenance data and parts list for each heat pump unit, control, and accessory; including "trouble shooting" maintenance guide; plus servicing, and preventative maintenance procedures and schedule. Include this data and product data in maintenance manual in accordance with requirements of Division 1.

1.3 WARRANTY

- A. Provide Five (5) Year Warranty.
- B. Warranty: Include coverage for Refrigerant Compressors.

PART II - PRODUCTS**2.1 SPLIT SYSTEM AIR CONDITIONER**

- A. Acceptable Manufacturers:

- 1. Mitsubishi
- 2. Sanyo.
- 3. Freidrich
- 4. Amana

2.2 GENERAL

- A. Split System: The split-system unit shall be an outdoor condensing unit and indoor factory-fabricated single-zone draw-through air-handling unit. Both indoor and outdoor unit shall be by the same manufacturer. The net capacities shall be as indicated and shall not be exceeded by more than 5%. The minimum efficiency for systems less than 65,000 BTUH shall be 13.0 SEER and shall be in accordance with the 2012 N. C. State Building Code: Energy Conservation Code.

2.3 AIR HANDLER

- A. Direct Expansion Coil: Coil shall be provided with pressure-type brass distributors and solder connections. The coil shall be dehydrated after testing and charged with dry air. Maximum working conditions shall be 300 psig at 200 degrees F for cooling. Tests shall be conducted, subjecting the coil to a minimum air pressure of 350 psig with the coil

submerged in water. The cooling coil shall be subject to ASHRAE 15-1978 Safety code for Mechanical Refrigeration. Staggered tube pattern shall be provided for all coils of more than one row deep. Tubing shall have a minimum outside diameter of 1/2 inch. Tubing shall be individually finned with smooth aluminum or copper fins, wound under tension. Tube joints for all coils shall be made with high temperature brazing alloys.

- B. Cabinet: Unit shall be provided with baked enamel finish and internally insulated. Fan shall be forward curved, and dynamically and statically balanced at the factory. Fan and motor bearings shall be permanently lubricated type.

2.4 OUTDOOR CONDENSING UNIT

- A. Unit shall be factory-assembled and tested. Unit shall provide liquid lift as required to suit installation. Unit shall deliver the specified capacity to the cooling coil with an ambient air temperature of 95 degrees F. Units shall be certified per ARI 240 and 270.
- B. Coil shall have aluminum plate fins, mechanically bonded to 1/2 inch aluminum tubes. Coil shall be circuited for sub-cooling.
- C. Outdoor Fans and Motors: Unit shall be furnished with direct-driven, propeller-type fans arranged for vertical discharge. Condenser fan motors shall have Class B motor insulation and built in current and thermal overload protection, and shall be of the permanently lubricated type, resiliently mounted. Each fan shall have a safety guard.
- D. Compressor: Unit shall have compressors of serviceable hermetic design with external spring isolators and an automatically reversible oil pump. Compressor motors shall have across-the-line start.
- E. Controls shall be factory-wired and located in a separate enclosure. Safety devices shall consist of high and low pressure stats and compressor overload devices. Unit wiring shall incorporate a time delay relay to prevent short-cycling of the compressor. Relay shall prevent compressor from restarting for a 5-minute period. The unit shall include a transformer for 24-volt control circuit, AND pressure relief valve.
- F. Casing shall make unit fully weatherproof for outdoor installation. Casing shall be of galvanized steel, zinc phosphatized and finished with baked enamel. Openings shall be provided for power and refrigerant connections. Panel shall be removable to provide access for servicing. The unit shall be mounted on manufacturer's standard legs anchored to concrete pedestals with steel bearing plates and neoprene pads.
- G. Piping shall be sized by the manufacturer.

2.5 FILTRATION

- A. Provide a throw away filter.
- B. Provide additional sets of filters (minimum of 3) as required during construction. Install a clean set of filters for the Final Inspection.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Provide for connection to electrical service.
- C. Install units with vibration isolation.

- D. Install units on concrete base as indicated.

3.2 MANUFACTURER'S FIELD SERVICES

- A. Prepare start systems under provisions of Section 15500.
- B. Provide initial start-up.
- C. Supply initial charge of refrigerant and oil for each refrigerant circuit. Replace losses of refrigerant and oil.

END OF SECTION

SECTION 15745 –Water-Source Geothermal Heat Pumps**PART I - GENERAL****1.1 SUMMARY**

- A. This section includes the following types of water-source heat pumps:
 - 1. Vertical units.

1.2 SUBMITTALS

- A. Product Data: Include rated capacities, furnished specialties, and accessories for each model.
- B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights loads, required clearances, method of field assembly, components, and location and size of each field connection.
 - 1. Wiring Diagrams: Power, signal, and control wiring.
- C. Field quality-control test reports.
- D. Operation and maintenance data.
- E. Special warranties

1.3 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with ASHRAE 15.
- C. Comply with minimum COP/efficiency levels according to ASHRAE/IESNA 90.1.
- D. Comply with NFPA 70.
- E. Comply with safety requirements in UL 484 for assembly of free-delivery water-source heat pumps.
- F. Comply with safety requirements in UL1995 for duct-system connections.
- G. Coordination Drawings: Floor plans, reflected ceiling plans, and other details, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
 - 1. Suspended ceiling components.
 - 2. Structural members to which heat pumps will be attached.
 - 3. Method of attaching hangers to building structure.
 - 4. Size and location of initial access modules for acoustical tile.
 - 5. Items penetrating finished ceiling, including the following:
 - a. Lighting fixtures.
 - b. Air outlets and inlets.
 - c. Speakers.
 - d. Sprinklers.
 - e. Access panels.

1.4 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace refrigeration components of water-source heat pumps that fail in materials or workmanship within five years from date of Substantial Completion.

1.5 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Two sets of filters for each unit.

PART II - PRODUCTS

2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, manufacturers specified.
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

2.2 WATER-SOURCE HEAT PUMPS

- A. MANUFACTURERS:
 - 1. Carrier Corporation.
 - 2. ClimateMaster, Inc.
 - 3. FHP Manufacturing, Inc.
 - 4. Trane.
- B. Description: Packaged water-source heat pump with temperature controls; factory assembled, tested, and rated according to ARI-ISO-13256-1.
- C. Cabinet and Chassis: Galvanized-steel casing with the following features:
 - 1. Access panel for access and maintenance of internal components.
 - 2. Knockouts for electrical and piping connections.
 - 3. Flanged duct connections.
 - 4. Cabinet Insulation: Glass-fiber liner, minimum 1/2 inch (13 mm) thick, complying with UL 181.
 - 5. Condensate Drainage: Plastic or stainless-steel drain pan pitched as required in ASHRAE 62 with condensate drain piping projecting through unit cabinet.
 - 6. Sound Attenuation Package:
 - a. Minimum 0.598-inch- (1.5-mm-) thick compressor enclosure and front panel. Minimum 0.0937-inch- (2.38-mm-) thick foam gasket around the compressor and perimeter of end panel.
 - b. Sound Attenuating blanket over compressor.
 - c. Hot-gas muffler.
- D. Fan: Direct driven, centrifugal, with multispeed motor resiliently mounted in fan inlet.

1. General requirements for motors are specified in Division 15 Section "Motors".
 2. Motor: Multispeed, permanently lubricated, motor.
- E. Water Circuit
1. Refrigerant-to-Water Heat Exchangers: Coaxial heat exchangers with cupronickel water tube with enhanced heat-transfer surfaces inside a steel shell; both shell and tube leak tested to 450 psig (3102 kPa) on refrigerant side and 400 psig (2758 kPa) on the water side. Factory mount heat exchanger in unit on resilient rubber vibration isolators.
 2. Motorized Water Valve: Stop water flow through the unit when compressor is off.
- F. Refrigerant-to-Air Coils: Copper tubes with aluminum fins, leak tested to 450 psig (3102 kPa).
- G. Refrigerant Circuit Components::
1. Sealed Refrigerant Circuit: Change with R-410A refrigerant.
 2. Motorized Water Valve: Charging Connections: Service fittings on suction and liquid for charging and testing.
 3. Reversing Valve: Pilot-operated sliding-type valve designed to be fail-safe in heating position with replaceable magnetic coil.
 4. Compressor: Hermetic reciprocating compressor installed on vibration isolators and housed in an acoustically treated enclosure with factory-installed safeties as follows:
 - a. Antirecycle timer.
 - b. High-pressure cutout.
 - c. Low-pressure cutout or loss of charge switch.
 - d. Internal thermal-overload protection.
 - e. Freezestat to stop compressor if water-loop temperature in refrigerant-to-water heat exchanger falls below 35 deg F (2 deg C).
 - f. Condensate overflow switch to stop compressor with high condensate level in condensate drain pan.
 5. Refrigerant Piping Materials: ASTM B 743 copper tube with wrought-copper fittings and brazed joints.
 6. Pipe Insulation: Refrigerant minimum 3/8-inch- (10-mm-) thick, flexible elastomeric insulation on piping on piping exposed to airflow through the unit. Maximum 25/50 flame-spread/smoke-development indexes according to ASTM E 84.
 7. Refrigerant Metering Device: Thermal expansion valve to allow specified operation with entering-water temperatures from 25 to 125 deg F (minus 4 to plus 52 deg C).
 8. Hot-Gas Reheat Valve: Pilot-operated sliding-type valve with replaceable magnetic coil.
- H. Hot-Gas Reheat: Reheat valve diverts refrigerant hot gas to reheat coil when remote humidistat calls for dehumidification.
- I. Filters: Pleated type, 1 inch (25 mm) thick, with adhesive, shall have minimum 80 percent arrestance according to ASHRAE 52.1 and a minimum efficiency reporting valve (MERV) of 5 according to ASHRAE 52.2
- J. Controls:
1. Provide electronic programmable automatic changeover thermostat with remote sensor.

- K. Electrical Connection: Single electrical connection with fused disconnect.

2.3 HOSE KITS

- A. General: Hose kits shall be designed for minimum 400 psig (2758 kPa) working pressure, and operating temperatures from 33 to 211 deg F (.05 to 99 deg C). Tag hose kits to equipment designations.
- B. Hose: Minimum diameter, equal to water-source heat-pump connection size. Length as required.
- C. Isolation Valves: Two-piece bronze-body ball valves with stainless-steel ball and stem and galvanized-steel lever handle. Provide valve for supply and return. If balancing device is combination shutoff type with memory stop, the isolation valve may be omitted on the return.
- D. Strainer: Y-type with blowdown valve in supply connection.
- E. Balancing Devices: Mount in return connection. Include meter ports to allow flow measurement with differential pressure gage.
 - 1. Manual, calibrated-orifice balancing valve.
- F. See Drawing Detail for additional requirements.

PART III - EXECUTION

3.1 INSTALLATION

- A. Concrete Bases: Install floor mounting units on 4-inch- (100-mm-) high concrete bases. See Division 15 Section "Basic Mechanical Materials and Methods" for concrete base materials and fabrication requirements.
- B. Mount water-source heat pumps on concrete base with vibration isolators.
 - 1. Units with Internally Isolated Fans and Compressors: Support on concrete bases using neoprene pads with minimum 0.125-inch (3.17-mm) static deflection. Secure units to anchor bolts installed in concrete bases.
 - 2. Floor-Mounted Units: Support on concrete bases using housed-spring isolators. Secure units to anchor bolts installed in concrete bases.
- C. Install wall-mounting thermostats, humidistats, and switch controls in electrical outlet boxes at heights as directed by the Owner.
- D. Drawings indicate general arrangement of piping, fittings, and specialties. Specific connection requirements are as follows.
 - 1. Connect supply and return hydronic piping to heat pump as shown on Drawings.
 - 2. Connect heat-pump condensate drain pan to indirect waste connection with condensate trap of adequate depth to seal against the pressure of fan. Install cleanouts in piping at changes of direction. Provide overflow drain pan consistent with Mechanical Code.
- E. Duct installation requirements are specified in other Division 15 Sections. Drawings indicate general arrangement of ducts. Specific connection requirements are as follows:
 - 1. Connect supply and return ducts to water-source heat pumps with flexible duct connectors.

- F. Install electrical devices furnished by manufacturer but not specified to be factory mounted.
- G. Install piping adjacent to machine to allow service and maintenance.
- H. Ground equipment according to Division 16 Section "Grounding and Bonding".
- I. Connect wiring according to Division 16 Section "Conductors and Cables".

3.2 FIELD QUALITY CONTROL

- A. Perform the following field tests and inspections and prepare test reports:
 - 1. After installing water-source heat pumps and after electrical circuitry has been energized, test units for compliance with requirements.
 - 2. Inspect for and remove shipping bolts, blocks, and tie-down straps.
 - 3. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
 - 4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- B. Remove and replace malfunctioning units and retest as specified above.

3.3 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
- B. Complete installation and startup checks according to manufacturer's written instructions and do the following:
 - 1. Inspect for visible damage to unit casing.
 - 2. Inspect for visible damage to compressor, coils, and fans.
 - 3. Inspect internal insulation.
 - 4. Verify that labels are clearly visible.
 - 5. Verify that clearances have been provided for servicing.
 - 6. Verify that controls are connected and operable.
 - 7. Verify that filters are installed.
 - 8. Adjust vibration isolators.
 - 9. Inspect operation of barometric dampers.
 - 10. Verify bearing lubrication on fan.
 - 11. Inspect fan-wheel rotation for movement in correct direction without vibration and binding.
 - 12. Adjust fan belts to proper alignment and tension.
 - 13. Start unit according to manufacturer's written instructions.
 - 14. Complete startup sheets and attach copy with Contractor's startup report.
 - 15. Inspect and record performance of interlocks and protective devices; verify sequences.
 - 16. Operate unit for an initial period as recommended or required by manufacturer.
 - 17. Verify thermostat and humidistat calibration.
 - 18. Inspect outdoor-air dampers for proper stroke and interlock with return-air dampers.
 - 19. Inspect controls for correct sequencing of heating, mixing dampers, refrigeration, and normal and emergency shutdown.
 - 20. Start refrigeration system and measure and record the following:
 - a. Coil leaving-air, dry- and wet-bulb temperatures.
 - b. Coil entering-air, dry- and wet-bulb temperatures.
 - c. Outdoor-air, dry-bulb temperature.
 - d. Outdoor-air-coil, discharge-air, dry-bulb temperature.

21. Measure and record the following minimum and maximum airflows. Plot fan volumes on fan curve.
 - a. Supply-air volume.
 - b. Return-air volume.
 - c. Relief-air volume.
 - d. Outdoor-air intake volume.

3.4 ADJUSTING

- A. Adjust initial temperature and humidity set points.
- B. Set field-adjustable switches and circuit-breaker trip ranges as indicated.
- C. Occupancy Adjustments: When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to two visits to Project during other than normal occupancy hours for this purpose.

3.5 CLEANING

- A. Replace filters used during construction prior to air balance or substantial completion.
- B. After completing installation of exposed, factory-finished water-source heat pumps, inspect exposed finishes and repair damaged finishes.

3.6 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain water-source heat pumps. Refer to Division 1 Section "Demonstration and Training".

END OF SECTION 15745

SECTION 15782 –Energy Recovery Ventilator**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to work of this Section.

1.2 DESCRIPTION OF WORK

- A. Extent of Air Conditioning Unit work required by this Section is indicated on Drawings and Schedules and by Requirements of this Section.

1.3 SUBMITTALS

- A. Product Data: Submit manufacturer's technical product data, including rated capacities for each unit indicated, weights (shipping, installed, and operating), furnished specialties and accessories; and rigging, installation, and start-up instructions.
- B. Maintenance Data: Submit Maintenance Data and Parts List for each unit, control, and accessory; including "trouble- shooting" maintenance guide. Include this data and product data in Maintenance Manual in accordance with requirements of Division 1.

1.4 DELIVERY, STORAGE AND HANDLING

- A. Handle unit and components properly to prevent damage, breaking, denting and scoring. Do not install damaged roof top unit or components; replace with new. Comply with manufacturer's rigging and installation instructions for unloading the unit, and transporting the unit to final location.

1.5 WARRANTY

- A. General Warranty: The special warranty specified in this Section shall not deprive the owner of other rights the owner may have under other provisions of the contract documents and shall be in addition to, and run concurrent with, other warranties made by the contractor under requirements of the contract documents.
- B. Special Warranty: A written warranty, executed by the manufacturer and signed by the contractor, agreeing to replace the components that fail in material or workmanship, within the specified warranty period, provided manufacturer's written instructions for installation, operation, and maintenance have been followed.
 - 1. Unit warranty period: Not less than one year after date of start-up, but not to exceed 14 months from date of shipment.
 - 2. Heat Wheel: Non-prorated full parts replacement not less than 5 years from date of shipment.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Micrometal
 - 2. Semco
 - 3. RenewAire

2.2 MANUFACTURED UNITS

Energy Recovery Ventilator

- A. Provide complete unit with heat wheel energy recovery.
- B. Unit shall be self-contained, packaged, factory assembled and pre-wired, consisting of cabinet and frame, supply fan, exhaust fan, heat recovery wheel, controls, air filters.

2.3 FABRICATION

- A. Cabinet: Galvanized steel with baked enamel finish, access doors or removable access panels with quick fasteners [locking door handle type with piano hinges. Structural members shall be minimum 18 gauge (1.20 mm), with access doors or removable panels of minimum 20 gauge (0.90 mm).
- B. Insulation: One inch thick neoprene coated glass fiber on surfaces where conditioned air is handled. Protect edges from erosion.
- C. Heat Exchangers: Aluminized steel of welded construction.
- D. Supply and Exhaust Fan: Forward curved centrifugal type, resiliently mounted with V-belt drive, adjustable variable pitch motor pulley, and rubber isolated hinge mounted motor.
- E. Air Filters: 2 inch thick pleated glass fiber disposable media in metal frames. Provide at total of 4 complete sets.

2.4 ENERGY RECOVERY SECTION

- A. The unit shall have a factory mounted and tested energy recovery wheel. The energy recovery wheel shall be mounted in a rigid frame containing the wheel drive motor, drive belt, wheel seals and bearings.
- B. The energy recovery cassette shall be rated in accordance with ARI Standard 1060 and shall bear the ARI certification symbol.
- C. The energy recovery cassette shall contain a total energy recovery heat wheel constructed of a light-weight polymer material with permanently bonded desiccant coating. The energy recovery wheel media shall be capable of removal from the cassette and replacement without the use of tools. Wheel media shall be cleanable using hot water or light detergent without degrading the efficiency.
- D. The exhaust fan shall be backward inclined type. Fan and motor shall be dynamically balanced. A back draft damper shall be included with the exhaust fan. Outside air filters shall be 4" thick pleated disposable media. Provide a total of 4 sets.
- E. Motors shall be standard efficiency with ball bearings and external lubrication connections.

PART III - EXECUTION

3.1 EXAMINATION

- A. Verify that proper power supply is available.

3.2 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Mount units on field built mounting frame. Install mounting frame level. Mounting frame shall be provided by the HVAC Contractor. Field Coordinate frame and installation

C203304-RA (K-3800)

BEAUFORT COUNTY

required.

- C. See structural drawings for design of mounting frame.

3.3 MANUFACTURER'S FIELD SERVICES

- A. Provide initial start-up and standard maintenance during first year of operation, including routine service and check-out.

END OF SECTION 15782

SECTION 15870 - POWER VENTILATORS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Power Ventilators.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections:
 - 1. Product data for selected models, including specialties, accessories, and the following:
 - a. Motor ratings and electrical characteristics plus motor and fan accessories.
 - b. Materials gauges and finishes.
 - 2. Shop drawings from manufacturer detailing equipment assemblies and indicating dimensions, weights, required clearances, components, and location and size of field connections.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Carnes Company, Inc.
 - 2. Cook (Loren) Co.
 - 3. Greenheck Fan Corp.
 - 4. Penn Ventilator Co., Inc.

2.2 ROOF EXHAUSTERS

- A. Centrifugal Fan Unit: V-belt driven with spun aluminum housing; resilient mounted motor, ½ inch mesh, 16 gauge aluminum bird screen; square base to suit roof curb with continuous curb gaskets; secured with cadmium plated bolts and screws.
- B. Roof Curb: 16 inch high with continuously welded seams and factory installed door nailer strip.
- C. Disconnect Switch: Factory wired, non-fusible, in housing for thermal overload protected motor.
- D. Back Draft Damper: Gravity activated, aluminum multiple blade construction, felt edged with nylon bearings.

- E. Sheaves: Cast iron or steel, dynamically balanced, bored to fit shafts and keyed; variable and adjustable pitch motor sheave selected so required rpm is obtained with sheaves set at mid-position; fan shaft with self-aligning pre-lubricated ball bearings.

2.3 WALL EXHAUSTERS

- A. Centrifugal Fan Unit: V-belt driven with spun aluminum housing; resilient mounted motor, ½ inch mesh, 16 gauge aluminum bird screen; secured with cadmium plated bolts and screws.
- B. Disconnect Switch: Factory wired, non-fusible, in housing for thermal overload protected motor.
- C. Back Draft Damper: Gravity activated, aluminum multiple blade construction, felt edged with nylon bearings.
- D. Sheaves: Cast iron or steel, dynamically balanced, bored to fit shafts and keyed; variable and adjustable pitch motor sheave selected so required rpm is obtained with sheaves set at mid-position; fan shaft with self-aligning pre-lubricated ball bearings.

2.4 CEILING EXHAUST FANS

- A. Centrifugal Fan Unit: V-belt or direct drive with galvanized steel housing lined with ½ inch acoustic insulation, resilient mounted motor, gravity back draft damper in discharge.
- B. Disconnect Switch: Factory wired, non-fusible, in housing for thermal overload protected motor.
- C. Grille: Molded white plastic or aluminum with baked white enamel finish.
- D. Sheaves: Cast iron or steel, dynamically balanced, bored to fit shafts and keyed; variable and adjustable pitch motor sheaves selected so required RPM is obtained with sheaves set at mid-position; fan shaft with self-aligning pre-lubricated ball bearings.

2.5 IN-LINE CABINET EXHAUST FANS

- A. Centrifugal Fan Unit: V-belt or direct driven, with galvanized steel housing lined with ½ inch acoustic insulation, resilient mounted motor, gravity back draft damper in discharge.
- B. Disconnect Switch: Factory wired, non-fusible, in housing for thermal overload protected motor.
- C. Sheaves: Cast iron or steel, dynamically balanced, bored to fit shafts and keyed; variable and adjustable pitch motor sheaves selected so required RPM is obtained with sheaves set at mid-position; fan shaft with self-aligning pre-lubricated ball bearings.

2.6 ROOF SUPPLY FAN

- A. Fan Unit: Direct driven axial type, aluminum hood, bird screen, die formed aluminum propeller blades riveted to steel hub, resilient mounted motor square base to suit roof curb.
- B. Roof Curbs: 16 inch high, continuously welded seams, and factory door nailed strip. Roof curb shall have same manufacturer as fan and be supplied by Mechanical Contractor and installed by the General Contractor.

- C. Disconnect Switch: Factory wired, non-fusible, in housing for thermal overload protected motor.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Secure roof exhausters with lag screws to roof curb.

END OF SECTION 15870

SECTION 15891 - METAL DUCTWORK**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes low pressure ducts and plenums for heating, ventilating, and air conditioning systems

PART II - PRODUCTS**2.1 MATERIALS**

- A. Steel Ducts: ASTM A525 or ASTM A527 galvanized steel sheet, lock-forming quality, having zinc coating of G-90 for each side in conformance with ASTM A90.
- B. Insulated Flexible Ducts: Flexible duct wrapped with flexible glass fiber insulation, enclosed by seamless aluminum pigmented plastic vapor barrier jacket; maximum 0.23 K value at 75 degrees F.
- C. Fasteners: Rivets, bolts, or sheet metal screws
- D. Sealant: Liquid non-hardening, water resistant, fire resistive, compatible with mating materials; liquid used alone or with tape, or heavy mastic.
- E. Hanger Rod: Steel, galvanized; threaded both ends, threaded one end, or continuously threaded.

2.2 LOW PRESSURE DUCTWORK

- A. Fabricate and support in accordance with SMACNA Low Pressure Duct Construction Standards and ASHRAE handbooks, except as indicated. Provide duct material, gages, re-inforcing and sealing for operating pressures indicated.
- B. No variation of duct configuration or sizes permitted except by written permission.
- C. Construct T's, bends, and elbows with radius of not less than 1½ times width of duct on center line. Where not possible and where rectangular elbows are used, provide turning vanes.
- D. Increase duct sizes gradually, not exceeding 15 degrees divergence wherever possible. Divergence upstream of equipment shall not exceed 30 degrees; convergence downstream shall not exceed 45 degrees.
- E. Connect flexible ducts to metal ducts with liquid adhesive.
- F. Use crimp joints with or without bead for joining round duct sizes 8 inch and smaller with crimp in direction of air flow.
- G. Use double nuts and lock washers on threaded rod supports.

2.3 FACTORY FABRICATED DUCTWORK

- A. Duct shall be of standard spiral lock seam or single-rib construction and shall be provided according to the gages given in the following table:

Diameter (inches)	Thickness (inches)
3 - 8	.032
9 - 14	.040
15 - 36	.050

- B. Duct shall be provided in continuous, unjoined lengths wherever possible. Except when interrupted by fittings, round duct sections.
- C. Fittings shall be round and shall have a wall thickness in accordance with the following table:

Fitting Body Diameters (inches)	Minimum Round Fitting Thickness (inches)
3-14	.040
15-26	.050
27-36	.063

- D. Elbows shall be of die-stamped, gored or pleated construction. The bend radius of stamped, gored and pleated elbows shall be 1.5 time the elbow diameter.
- E. All round elbows in diameter of 8 inches or less shall be of die-stamped or pleated construction.
- F. All round elbows in diameter of 9 inches through 14 inches shall be of gored or pleated construction.
- G. All round elbows in diameter greater than 14 inches shall be of gored construction.
- H. Diverging-flow fittings shall be constructed with a radiused entrance to all branch taps and with no excess material projecting from the body into the branch tap entrance.
- I. All take-off or branch entrances shall be by means of factory fabricated fittings.
- J. All fitting ends shall be sized to slip inside mating duct sections. They shall provide a tight fit and have a minimum 2-inch insertion length with a stop bead. No additional coupling shall be required for duct to fitting joints.

PART III - EXECUTION

3.1 INSTALLATION

- A. Factory Fabricated ductwork can be substituted for low-pressure field constructed ductwork.
- B. All factory fabricated spiral duct and fittings shall be installed in accordance with manufacturer's recommendations.
- C. Locate ducts with sufficient space around equipment to allow normal operating and maintenance activities.

- D. Connect diffusers or troffer boots to low pressure ducts with 5 feet maximum length of flexible duct. Hold in place with strap or clamp.
- E. During construction provide temporary closures of metal or taped polyethylene on open ductwork to prevent construction dust from entering ductwork system.

3.2 ADJUSTING AND CLEANING

- A. Clean duct system and force air at high velocity through duct to remove accumulated dust. To obtain sufficient air, clean half the system at a time. Protect equipment that may be harmed by excessive dirt with temporary filters or bypass during cleaning.
- B. Clean duct systems with high power vacuum machines. Protect equipment that may be harmed by excessive dirt with filters, or bypass during cleaning. Provide adequate access into ductwork for cleaning purposes.

END OF SECTION 15891

SECTION 15910 - DUCT ACCESSORIES**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Not used
 - 2. Turning Vanes
 - 3. Duct Mounted Access Doors and Panels
 - 4. Flexible Connectors
 - 5. Flexible Ducts

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data including details for materials, dimensions of individual components, profiles, and finishes.
- C. Shop drawings from manufacturer detailing assemblies: Include dimensions, weights, loadings, required clearances, method of field assembly, components, and location and size of each field connection.

PART II - PRODUCTS**2.1 AIR TURNING DEVICES**

- A. Multi-blade device with blades aligned in short dimension; steel or aluminum construction; with individually adjustable blades, mounting straps.

2.2 FLEXIBLE DUCT CONNECTIONS

- A. Fabricate in accordance with SMACNA Low Pressure Duct Construction Standards, and as indicated.
- B. Provide factory made spin-in starting collars for connections to trunk ducts.

2.3 DUCT ACCESS DOORS

- A. Fabricate in accordance with SMACNA Low Pressure Duct Construction Standards and as indicated.
- B. Review locations prior to fabrication.
- C. Fabricate rigid and close fitting doors of galvanized steel with sealing gaskets and quick fastening locking devices. For insulated ductwork, install minimum one-inch thick insulation with sheet metal cover.
- D. Access doors smaller than 12 inches square may be secured with sash locks.

- E. Provide two hinges and two sash locks for sizes up to 18 inches square, three hinges and two compression latches with outside and inside handles for sizes up to 24 x 48 inches. Provide an additional hinge for larger sizes.
- F. Access doors with sheet metal screw fasteners are not acceptable.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install accessories in accordance with manufacturer's instructions.
- B. Provide balancing dampers at points on low pressure supply systems where branches are taken from larger ducts as required for air balancing. Use splitter dampers only where indicated.
- C. Provide flexible connections immediately adjacent to equipment in ducts associated with fans and motorized equipment.
- D. Provide duct access doors for inspection and cleaning before and after filters, coils, fans, automatic dampers, at fire dampers, and elsewhere as indicated. Provide minimum 8 x 8 inch size for hand access, 18 x 18 inch size for shoulder access, and as indicated.
- E. Provide duct test holes where indicated and required for testing and balancing purposes.

END OF SECTION 15910

SECTION 15932 - AIR OUTLETS AND INLETS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to work of this Section.

1.2 DESCRIPTION OF WORK

- A. Extent of air outlets and inlets work is indicated by Drawings and Schedules and by Requirements of this Section.
- B. Types of outlets and inlets required for this Project include the following:
 - 1. Ceiling Air Diffusers
 - 2. Wall Registers and Grilles
 - 3. Louvers

1.3 SUBMITTALS

- A. Product Data: Submit manufacturer's technical product data for air outlets and inlets including the following:
 - 1. Schedule of air outlets and inlets indicating drawing designation, room location, number furnished, model number, size and accessories furnished.
 - 2. Data sheet for each type of air outlet and inlet, and accessory furnished; indicating construction, finish and mounting details.
 - 3. Performance data for each type of air outlet and inlet furnished, throw and drop; and noise criteria ratings. Indicate selections on data.
- B. Shop Drawings: Submit manufacturer's assembly-type shop drawing for each type of air outlet and inlet, indicating materials and methods of assembly of components.

PART II - PRODUCTS**2.1 ACCEPTABLE MANUFACTURERS**

- A. Diffusers & Grilles
 - 1. Titus, Inc.
 - 2. Metalaire, Inc.
 - 3. Carnes, Inc.
 - 4. E. H. Price
- B. Louvers
 - 1. Arrow United Industries, Inc.
 - 2. Louvers & Dampers, Inc.
 - 3. Penn Ventilator Co., Inc.
 - 4. Ruskin Mfg. Co.
 - 5. Safe-Air Inc.
 - 6. Vent Products Co., Inc.

- 7. NCA
- 8. Cesco Products

2.2 RECTANGULAR CEILING DIFFUSERS

- A. Rectangular, extruded aluminum, multi-core type diffuser to discharge air in 360 degree pattern.
- B. Provide inverted T-bar type frame. In plaster ceilings, provide plaster frame and ceiling frame.
- C. Fabricate of aluminum with baked enamel off-white finish.
- D. Provide opposed blade damper with damper adjustable from diffuser face.

2.3 CEILING GRID CORE EXHAUST AND RETURN REGISTERS/GRILLES

- A. Fixed grilles of 1/2 x 1/2 x 1 inch egg crate.
- B. Provide inverted T-bar type frame. In plaster ceilings, provide plaster frame and ceiling frame.
- C. Fabricate of aluminum with baked enamel off-white finish.
- D. Where not individually connected to exhaust fans, provide integral, gang-operated opposed blade dampers with removable key operator, operable from face.

2.4 WALL SUPPLY REGISTERS/GRILLES

- A. Streamlined and individually adjustable blades, depth of which exceeds 3/4 inch maximum spacing with spring or other device to set blades, horizontal face, double deflection.
- B. Fabricate 1 1/4 inch margin frame with countersunk screw mounting and gasket.
- C. Fabricate of aluminum extrusions with 20 gauge minimum frames and 22 gauge minimum blades, with baked enamel off-white finish.
- D. Provide integral, gang-operated opposed blade dampers with removable key operator, operable from face.

2.6 LOUVERS

- A. Provide 4-inch deep louvers with blades on 45 degree slope with center baffle and return bend, heavy channel frame, bird screen with 1/2 inch square mesh.
- B. Fabricate of 12-gauge extruded aluminum, welded assembly, with factory baked enamel finish. Color selection from manufacturer standard.
- C. Furnish with interior screw holes in jambs for installation.

2.7 ROOF HOODS

- A. Fabricate air inlet or exhaust hoods in accordance with SMACNA Low Pressure Duct Construction Standards.
- B. Fabricate of aluminum, minimum 16 gauge base and 18 gauge hood; suitably reinforced; with removable hood; bird screen with 1/2 inch square mesh and factory prime coat baked enamel finish.

- C. Mount unit on minimum 12-inch high curb base with insulation between duct and curb.
- D. Make hood outlet area minimum of twice throat area.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install items in accordance with manufacturer's instructions.
- B. Check location of outlets and inlets and make necessary adjustments in position to conform with architectural features, symmetry and lighting arrangement.
- C. Install diffusers to ductwork with air-tight connection.
- D. Provide balancing dampers on duct take-off to diffusers, and grilles and registers, regardless of whether dampers are specified as part of the diffuser, or grille and register assembly.
- E. Paint ductwork visible behind air outlets and inlets matte black.

END OF SECTION 15932

SECTION 15990 - TESTING, ADJUSTING AND BALANCING**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to work of this Section.

1.2 SUMMARY

- A. This Section specifies the Requirements and Procedures of Total Mechanical Systems Testing, Adjusting and Balancing. Requirements include measurement and establishment of the fluid quantities of the Mechanical Systems as required to meet Design Specifications and Recording and reporting the results.
- B. Testing and Balancing must be conducted by an independent, Certified Testing and Balancing firm, registered with either the AABC or the NEBB.
- C. The Test and Balance Contractor shall be a subcontractor to the Mechanical Contractor.

1.3 SECTION INCLUDES

- A. Testing, adjustment and balancing of air systems.
- B. Measurement of final operating condition of HVAC Systems.
- C. Sound measurement of equipment operating conditions.
- D. Vibration measurement of equipment operating conditions.

1.4 SUBMITTALS

- A. Submit under provisions of Section 15500.
- B. Submit name of adjusting and balancing agency for approval within 30 days after Award of Contract.
- C. Field Reports: Submit under provisions of Section 15500.
- D. Field Reports: Indicate deficiencies in systems that would prevent proper testing, adjusting, and balancing of systems and equipment to achieve specified performance.
- E. Prior to commencing work, submit report forms or outlines indicating adjusting, balancing, and equipment data required.
- F. Submit draft copies of report for review prior to final acceptance of Project. Provide final copies for Owner and for inclusion in operating and maintenance manuals.
- G. Provide reports in soft cover, letter size, 3-ring binder manuals, complete with index page and indexing tabs, with cover identification at front and side. Report shall reference the Contract Drawings for location of equipment and devices. Where reference to the contract drawings is not satisfactory, include a set of reduced drawings or sketches with equipment and devices identified to correspond with data sheets.
- H. Include detailed procedures, agenda, sample report forms and copy of AABC National Project Performance Guaranty prior to commencing system balance.

- I. Test Reports: Indicate data on AABC National Standards for Total System Balance forms or NEBB forms.

1.5 QUALITY ASSURANCE

- A. Perform total system balance in accordance with AABC National Standards for Field Measurement and Instrumentation, Total System Balance, ASHRAE 111, and NEBB Procedural Standards for Testing, Balancing and Adjusting of Environmental Systems.
- B. Maintain one copy of each document on site.

1.6 SEQUENCING AND SCHEDULING

- A. Sequence work under the provisions of Section 15500.
- B. Sequence work to commence after completion of systems and schedule completion of work before Substantial Completion of Project.
- C. Schedule work under the provisions of Section 15500.
- D. Schedule and provide assistance in final adjustment and test of Smoke Control System with Fire Authority.

PART II - PRODUCTS (Not Used)

PART III - EXECUTION

3.1 EXAMINATION

- A. Verify that systems are complete and operable before commencing work. Ensure the following conditions:
 - 1. Systems are started and operating in a safe and normal condition.
 - 2. Control systems are installed complete and operable.
 - 3. Proper thermal overload protection is in place for electrical equipment.
 - 4. Ductwork Systems:
 - a. Final filters are clean and in place. If required, install temporary media in addition to final filters.
 - b. Duct systems are clean of debris.
 - c. Fans are rotating correctly.
 - d. Dampers are in place and open.
 - e. Air coil fins are cleaned and combed.
 - f. Access doors are closed and duct end caps are in place.
 - g. Air inlets and outlets are installed and connected.
 - h. Duct system leakage is minimized.
- B. Submit Field Reports: Report defects and deficiencies noted during performance of services which prevent system balance.
- C. Beginning of work means acceptance of existing conditions.

3.2 PREPARATION

- A. Provide instruments required for testing, adjusting, and balancing operations. Make instruments available to Owner to facilitate spot checks during testing.
- B. Provide additional balancing devices as required.

3.3 INSTALLATION TOLERANCES

- A. HVAC Systems: Adjust to within plus or minus 5 percent of design for supply and return systems and plus or minus 10 percent of design for exhaust systems.
- B. Air Outlets and Inlets: Adjust outlets and inlets in space to within plus or minus 10 percent of design.

3.4 ADJUSTING

- A. Ensure recorded data represents actual measured or observed conditions.
- B. Permanently mark settings of balancing devices allowing settings to be restored. Set and lock memory stops.
- C. After adjustment, take measurements to verify balance has not been disrupted or that such disruption has been rectified.
- D. Leave systems in proper working order, replacing belt guards, closing access doors, closing doors to electrical switch boxes, and restoring thermostats to specified settings.

3.5 AIR SYSTEM PROCEDURE

- A. Adjust equipment and distribution systems to provide required or design air quantities.
- B. Make air quantity measurements in ducts by Pitot tube traverse of entire cross sectional area of duct.
- C. Measure and record air quantities at air inlets and outlets.
- D. Adjust distribution system to obtain uniform space temperatures free from objectionable drafts and noise.
- E. Use volume control devices to regulate air quantities only to extent that adjustments do not create objectionable air motion or sound levels. Adjust air volume by adjusting duct internal devices such as dampers and splitters. Do not utilize opposed blade dampers at air inlets and outlets.
- F. Vary total system air quantities by adjusting sheave position at each fan. Vary branch air quantities by damper regulation.
- G. Measure and record static air pressure conditions at air supply and exhaust units, including filter and coil pressure drops, and total pressure across the fan. Make allowances for 50 percent loading of filters.
- H. Adjust settings and minimum set points for motorized and back draft dampers to design conditions.
- I. Measure and record inlet and outlet temperatures at each air supply unit at full cooling and heating capacity.

3.6 REPORT FORMS

A. Forms shall include the following:

1. Title Page:
 - a. Name of Testing, Adjusting and Balancing Agency
 - b. Address of Testing, Adjusting and Balancing Agency
 - c. Telephone number of Testing, Adjusting and Balancing Agency
 - d. Project Name
 - e. Project Location
 - f. Project Architect
 - g. Project Engineer
 - h. Project Contractor
 - i. Project Altitude
 - j. Report Date
2. Summary Comments:
 - a. Design versus final performance
 - b. Notable characteristics of system
 - c. Description of systems operation sequence
 - d. Summary of outdoor and exhaust flows to indicate amount of building pressurization
 - e. Nomenclature used throughout report
 - f. Test Conditions
3. Instrument List:
 - a. Instrument
 - b. Manufacturer
 - c. Model Number
 - d. Serial Number
 - e. Range
 - f. Calibration Date
4. Electric Motors:
 - a. Manufacturer
 - b. Model/Frame
 - c. HP/BHP/Efficiency
 - d. Phase, Voltage, Amperage; Nameplate, Actual, No Load
 - e. RPM
 - f. Service Factor
 - g. Starter Size, Rating, Heater Elements
 - h. Sheave Make/Size/Bore
5. V-Belt Drive:
 - a. Identification/Location
 - b. Required Driven RPM
 - c. Driven Sheave, Diameter and RPM
 - d. Belt, Size and Quantity
 - e. Motor Sheave Diameter and RPM
 - f. Center to center distance, maximum, minimum, and actual
6. Equipment Data:
 - a. Identification/number
 - b. Manufacturer
 - c. Model number and Serial number

- d. Capacity
 - e. Service
 - f. Design flow rate, pressure drop, BHP
 - g. Actual flow rate, pressure drop, BHP
 - h. Temperature readings
7. Duct Traverse:
- a. System zone/branch
 - b. Duct size
 - c. Area
 - d. Design velocity
 - e. Design air flow
 - f. Test velocity
 - g. Test air flow
 - h. Duct static pressure
 - i. Air temperature
 - j. Correction factor
8. Air Distribution Test Sheet:
- a. Air terminal number
 - b. Room number/location
 - c. Terminal type
 - d. Terminal size
 - e. Area factor
 - f. Design velocity
 - g. Design air flow
 - h. Test (final) velocity
 - i. Test (final) air flow
 - j. Percent of design air flow

3.7 SOUND AND VIBRATION TESTING

- A. Test and adjust Mechanical Systems for sound and vibration in accordance with the detailed instructions of the referenced Standards.
- B. Sound Level Test and Report:
- 1. Location
 - 2. Octave Bands - equipment off
 - 3. Octave Bands - equipment on
- C. Vibration Test and Report:
- 1. Location of Points:
 - a. Fan bearing: drive end
 - b. Fan bearing: opposite end
 - c. Motor bearing: center (if applicable)
 - d. Motor bearing: drive end
 - e. Motor bearing: opposite end
 - f. Casing: (bottom or top)
 - g. Casing: (side)
 - h. Duct after flexible connection: (discharge)
 - i. Duct after flexible connection: (suction)
 - 2. Test Readings:
 - a. Horizontal, velocity and displacement
 - b. Vertical, velocity and displacement
 - c. Axial, velocity and displacement

3. Normally acceptable readings, velocity and acceleration
4. Unusual conditions at time of test
5. Vibration source (if non-complying)

END OF SECTION 15990

C203304-RA (K-3800)

BEAUFORT COUNTY

DIVISION 15B- COMPENSATION FOR MECHANICAL

COMPENSATION

- A. The work of furnishing materials and constructing the Mechanical System for the Rest Area Building in accordance with the plans and specifications, completed and accepted, will be paid for at the contract lump sum price for the "Mechanical Installation for Rest Area Building". Such price and payment will be full compensation for all work of the Mechanical Installation for Rest Area Building, including but not limited to furnishing all transportation, materials, labor, tools, equipment, fees and incidentals necessary to complete the work. Payment will be made under:

"Mechanical Installation for Rest Area Building"Lump Sum

SECTION 16010 - BASIC ELECTRICAL REQUIREMENTS**PART I - GENERAL****1.1 GENERAL CONDITIONS**

- A. The Stipulations and Conditions stated in this Section, together with all provisions of the "Instructions to Bidders", "General Conditions", "Supplemental General Conditions" and "Special Conditions", hereinbefore set forth, shall apply to this and the other Sections of Division 16.

1.2 GENERAL REQUIREMENTS

- A. The General Requirements hereinafter listed apply to the Electrical Work Division. If there is any conflict between the General Requirements and the General Conditions, the General Conditions shall take precedence.

1.3 ALTERNATES

- A. Carefully examine all alternates at the back of this Specification and on the Drawings to determine if any work described under the Electrical Section will be affected thereby.

1.4 INTENT

- A. The intent of these Drawings and Specifications are to describe the installation of a complete, fully adjusted, and operational system. Therefore, any items shown on Drawings and not specifically called for in the Specifications, or any items specified and not specifically indicated or detailed on the Drawings, or any items neither specified or shown, but which are reasonably incidental to and commonly required to make a complete job, will be furnished and installed by the Electrical Contractor at his own expense.

1.5 DEFINITIONS

- A. The Electrical Contractor shall provide all supervision, labor, material equipment, machinery, plant, and any and all other items necessary to complete the Electrical systems. All items of equipment are specified in the singular; however, the Electrical Contractor shall provide the number of items of equipment as indicated on the drawings, and as required for complete systems.

Where the word "provide" is used, it shall mean "furnish and install complete and ready to use".

1.6 VISIT TO THE SITE

- A. The Electrical Contractor shall visit the site before submitting his bid so as to be thoroughly familiar with the job conditions and/or peculiarities. No extra payment will be allowed for anything which could have been anticipated from a visit to the site.

1.7 REGULATORY REQUIREMENTS

- A. All work under this section shall be accomplished in strict accordance with State codes. Where these plans and specifications conflict with such codes, the codes shall govern.
- B. The Electrical Contractor shall notify the Architect or Engineer of such conflicts in writing prior to receipt of bids.

- C. References to the National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL), and National Fire Protection Association (NFPA) are a minimum installation requirement.

- D. The following regulatory shall be used as minimum standards:

AEIC	American Association of Edison Illuminating Companies
ANSI	American National Standards Institute
ASTM	American Society for Testing and Materials
ICEA	Insulated Cable Engineers Association
IEEE	Institute of Electrical and Electronic Engineers
NCCM	N.C. Construction Manual w/G.S. as listed
NCSBC	N.C. State Building Code
NEC	National Electrical Code
NEMA	National Electrical Manufacturers Association
NESC	National Electrical Safety Code
NFPA	National Fire Protection Association
U/L	Underwriters' Laboratories, Inc.
OSHA	Occupational Safety and Health Standards
ASHRAE/IES	90.1 energy code

1.8 TEST STANDARDS

- A. All material and equipment shall be listed, labeled or certified by a nationally recognized testing laboratory to meet Underwriters Laboratories, Inc., or third party agencies accredited by the North Carolina Building Code Councils latest edition or amendment.

1.9 PERMITS AND FEES

- A. NA

1.10 DRAWINGS AND SPECIFICATIONS

- A. The Electrical Drawings and Specifications are intended to cover all the work enumerated under the respective headings. The Drawings are diagrammatic only. No Contractor shall take advantage of conflict or error between Drawings and Specifications, or between General Drawings and Mechanical, Plumbing and/or Electrical Drawings, but shall request a clarification of such from the Architect/Engineer, should this condition exist. If there is insufficient time to issue an Addendum for this clarification, the Electrical Contractor shall include in his bid the most expensive of the items in conflict.
- B. The Electrical Contractor shall refer to the Architectural and Structural Drawings and Specifications for the general construction of the building, for floors and ceiling heights, for locations of walls, partitions, beams, etc., and shall be guided accordingly for setting of all sleeves, inserts and equipment. No Contractor shall under any circumstances scale drawings for the location of equipment. The Electrical Contractor shall verify the locations of all utility services and electrical equipment.
- C. The Electrical Contractor shall keep at least one set of corrected Shop and Design Drawings at the site. Drawings are to be current, denoting approved modifications and actual installed departure. Submit Drawings to Architect/Engineer before final payment is made.

1.11 SUPERVISION

- A. The Electrical Contractor performing the work specified shall be required to employ a qualified superintendent or foreman to continuously supervise the installation of their work, with authorization to act as agent. He shall be capable of checking layouts,

coordinating and supervising the work, establishing grades and levels and locating chases, openings, hangers, inserts, sleeves, etc.

PART II - PRODUCTS

2.1 STANDARD PRODUCTS

- A. Unless otherwise indicated in writing by the Architect/Engineer, the materials to be provided under this Specification shall be standard products of manufacturers regularly engaged in the production of such equipment and shall be the manufacturer's latest design. All items of the same type or rating shall be identical.

2.2 SUBMITTAL

- A. The Electrical Contractor shall submit, for approval, detailed Shop Drawings on all major equipment and where requested. No materials or equipment may be delivered to the job site or installed until the Electrical Contractor has in his possession the approved Shop Drawing for the particular material or equipment. The Electrical Contractor shall furnish the number of copies required by the General or Special Conditions of the contract, but no case less than six (6) copies.
- B. Submitted material shall be properly labeled indicating specific service for which material or equipment is to be used, Section and Article Number of Specifications governing, Contractor's name and name of job.
- C. Approval of equipment will not relieve the Electrical Contractor of compliance with the Specifications even if such approval is made in writing, unless the attention of the Engineer is called to the non-complying features by letter accompanying the submittal data. Approval of submittal data by the Engineer shall not be construed as a complete check of approval of detailed dimensions, weights, gauges, and similar details with the proposed articles. The conformance with the necessary coordination between the various other Contractors and suppliers shall be solely the responsibility of the Electrical Contractor and with no additional expense to the Owner.

2.3 SUBSTITUTIONS

- A. Manufacturer's lists are to establish a standard of quality and not intended to limit the selection to these manufacturers. All materials and equipment which are essential and have not been specified or shown shall be new and of the highest grade and quality free from defect or other imperfections. It should be understood that where the words "furnished and installed" are used, it is intended that the Electrical Contractor shall purchase and install all materials required, unless otherwise noted.
- B. All materials and equipment proposed as substitutes for these specified shall require a ten (10) day prior approval from the Engineer prior to the bid date. No substitutions will be allowed after the ten (10) day period before the bid date.
- C. All products shall be furnished in compliance with NC General Statute 133-3.

2.4 PRODUCT HANDLING

- A. Equipment and materials shall be properly stored, adequately protected, and carefully handled to prevent damage before and during installation. Equipment and materials shall be handled, stored and protected in accordance with the manufacturer's recommendations and as approved by the Architect/Engineer. Equipment installed with a

factory finish shall be fully protected during construction and shall be maintained free of dust, dirt and foreign matter. Dents and other surface damage shall be repaired or replaced to the satisfaction of the Architect/Engineer at no additional cost to the Owner.

- B. The Electrical Contractor shall clean up and remove from the job site all waste materials, packaging, crating, and refuse resulting from his work on a daily basis.

2.5 MATERIALS AND WORKMANSHIP

- A. The Electrical Contractor shall perform a first class job, both in material and workmanship. None other will be accepted. Deviations from either will be corrected by the Electrical Contractor at the Electrical Contractor's expense.
- B. The material used throughout the work, except when otherwise noted, shall be new and of Specification grade and the best of its kind. No substitutes shall be used unless approved by the Architect/Engineer. All work shall be executed with a maximum speed consistent with safety and good workmanship.
- C. Any equipment furnished by the Mechanical Contractor or any other Contractor that is larger than those indicated on the Drawings and described in these Specifications or have different Electrical characteristics, the increase in cost to the Electrical Contractor for larger wires, conduit, circuit breakers, switches, etc. or for changes in work already installed shall be borne by the instigating Contractor.

PART III - EXECUTION

3.1 EXCAVATION AND BACKFILL

- A. The Electrical Contractor shall preform any and all trench and pit excavation and backfilling required for the installation of his work. Trenches shall be made with the sides vertical and shall be shored where necessary for the protection of men and equipment. All excavation work shall be done in a careful manner to avoid damage to footers and foundations. The backfilling shall be placed in layers not exceeding 4 inches in depth, wetting each layer as it is placed and thoroughly compacting each layer with Mechanical tamper or other approved means. Any damage done during excavation and backfilling operations to roads, sidewalks, curbs, shrubs, sod, footers, foundations, etc. shall be replaced to its original condition prior to construction at no expense to the owner. All work will be approved by the Engineer.

3.2 SCAFFOLDING, RIGGING AND HOISTING

- A. The Electrical Contractor shall furnish all necessary scaffolding, staging, rigging and hoisting required for the completion of his work. All such scaffolding, etc., shall be removed from the premises when its use is no longer required on the job.

3.3 CUTTING AND PATCHING

- A. The Electrical Contractor shall provide all cutting and patching necessary to install the work specified in the 16000 Sections. The patching shall match adjacent surface material and finishes.
- B. No Structural member shall be cut without the approval of the Engineer and all such cutting shall be done in a manner directed by him.
- C. Cutting or Holes:

C203304-RA (K-3800)

BEAUFORT COUNTY

1. Locate holes in advance where they are proposed in the Structural Sections such as ribs or beams. Obtain the approval of the Engineer prior to drilling through Structural Sections.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed.

3.4 WATERPROOFING

- A. At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight. All work subject to approval of the Engineer.

3.5 EQUIPMENT SPACE AND ARRANGEMENT

- A. The equipment shall fit into the space allotted and shall allow adequate clearance for entry, installation, replacement, servicing, and maintenance. The Electrical Contractor shall coordinate the work to ensure that equipment may be moved into place without altering building components or other installations. Access space shall not be less than the equipment manufacturer's requirements. Working clearances shall be not less than N.E.C or other regulatory requirements.
- B. These drawings indicate the extent and general arrangement of equipment. If any departures are deemed necessary by the Electrical Contractor, details of such departures and the reasons therefore shall be submitted to the Architect/Engineer for approval as soon as practicable and within 30 days after Award of the Contract. No departure shall be made without written approval of the Architect/Engineer. Any delay on the Contractor's part to provide such submittal will not constitute an extension of the Contract time.

3.6 DAMAGE TO WORK ALREADY IN PLACE

- A. The Electrical Contractor shall assume full responsibility for any damage done by him, his agents or employees, to any work already in place. Any such damage done shall be repaired at the Contractor's expense by Mechanics skilled at their respective trades, to the approval of the Architect/Engineer.

3.7 JURISDICTION OF WORK

- A. It may become necessary for the Electrical Contractor to furnish labor or materials which are not generally accepted as part of this trade. In cases of this type, he shall contract the work or shall furnish materials and employ workmen of the trade involved in order not to cause any delay or stoppage of work caused by infringement of Trade Agreements as to jurisdiction, alleged or actual.

3.8 COORDINATION WITH OTHER TRADES

- A. All work shall be coordinated with other trades involved in the construction project. All work shall be carefully laid out in advance to coordinate Architectural, Structural, Mechanical, Plumbing and Electrical features of construction. The Contractor shall verify at the site all locations, grades, elevations and utility service connections indicated. Any conflicts due to lack of proper coordination shall be brought to the attention of the Architect/Engineer for resolution. The Electrical Contractor shall make required changes or relocations at no additional cost to the Owner.

- B. Installation, inspection, and testing of work above ceilings shall be completed and approved by the Architect/Engineer prior to installation of the specified finished ceilings. However, a Ceiling Suspension System may be installed as required for coordination.
- C. The Electrical Contractor shall consult with the other trades at the start of the work and periodically thereafter, as required to properly coordinate the various items of work, and to avoid interferences. Should any interferences of any nature develop as the work progresses, such interferences shall be resolved and eliminated as directed. The cost of any work directed shall be borne by the Subcontractor or Contractors directed to do this work.

3.9 DIVISION OF WORK

- A. These paragraphs are intended to show exactly the point of division of work between the Electrical Division and the Mechanical Division or any other division.
- C. All equipment covered in the Mechanical Division or any other Division of the Specifications shall be furnished, mounted, and aligned under the respective Division. All starters, controls and wiring for this equipment, including final connection to the same, shall be furnished and installed under that Division.
- D. Divisions of the Specifications shall be completed under the respective Division.
- E. Under Division 16, the Contractor shall be responsible for providing all line side power wiring, conduit, disconnect switches, and junction boxes as shown on the electrical drawings.

3.10 EQUIPMENT INSTALLATION

- A. Manufacturer's Instructions: Equipment shall be installed as recommended by the manufacturer to conform to the requirements of the particular application, in accordance with these Drawings and Specifications.

3.11 OPERATION AND MAINTENANCE MANUALS

- A. Prepare maintenance manuals in accordance with Division 1 Section "PROJECT CLOSEOUT". In addition to the requirements specified in Division 1, include the following information for equipment items:
 - 1. Description of function, normal operating characteristics and limitations, performance curves, engineering data and tests, and complete nomenclature and commercial numbers of replacement parts.
 - 2. Manufacturer's printed Operating Procedures to include start-up, break-in, and routine and normal Operating Instructions; regulation, control, stopping, shutdown, and emergency instructions and summer and winter operating instructions.
 - 3. Maintenance procedures for routine preventative maintenance and troubleshooting; disassembly, repair, and re-assembly; aligning and adjusting instructions.
 - 4. Servicing Instructions and Lubrication Charts and Schedules.

3.12 RECORD DOCUMENTS

- A. Prepare record documents in accordance with the requirements in Division 1 Section

"PROJECT CLOSEOUT". In addition to the requirements specified in Division 1, indicate installed conditions for:

1. Major raceway systems, size and location, for both exterior and interior; locations of control devices; distribution and branch electrical circuitry; and fuse and circuit breaker size and arrangements.
2. Equipment locations (exposed and concealed) dimensioned from prominent building lines.
3. Approved substitutions, Contract modifications and actual equipment and materials installed.

3.13 GUARANTEE

- A. The Electrical Contractor shall present to the Owner a written guarantee covering his work, including all equipment, material and workmanship. This guarantee shall be against all defects in any of the above work, and shall run for a period of one (1) year from the date of written acceptance of the Contractor's work.
- B. Any defective work, equipment, material and/or workmanship that develops within the Guarantee period, which is not caused by ordinary wear or abuse by other persons, shall be replaced by the Electrical Contractor without cost to the Owner.

3.14 FINAL INSPECTION

- A. When the entire Contract has been completed and the work is ready for final inspection, the Architect/Engineer or his duly authorized representative will make the inspection. At the time of inspection, the Electrical Contractor shall demonstrate to the Architect/Engineer that the various systems and pieces of equipment have been adjusted to operate in accordance with the requirements of the Contract.
- B. **An authorized Inspector from the North Carolina Department of Insurance shall inspect the project during construction and upon completion of the construction phase. It shall be the responsibility of the Electrical Contractor to notify the Inspector as the work progresses. The NCDOL Inspector can be reached at (919) 661-5880.**

3.15 FINAL PAYMENTS

- A. All Final Payments are contingent upon all necessary Certificates and/or Approvals cited above, together with the written Guarantee being presented to the Owner.

3.16 DOCUMENTATION

- A. All tests shall be completely documented indicated time of day, temperature, and all pertinent test information.
- B. All required documentation of readings shall be submitted to the engineer prior to, and as one of the prerequisites for, final acceptance of the project.

END OF SECTION 16010

SECTION 16050 - BASIC ELECTRICAL MATERIALS AND METHODS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes limited Scope, General Construction Materials and Methods for Application with Electrical Installations as follows:
 - 1. Miscellaneous metals for support of electrical materials and equipment.
 - 2. Joint sealers for sealing around electrical materials and equipment; and for sealing penetrations in fire and smoke barriers, floors, and foundation walls.

1.3 DEFINITIONS

- A. The following definitions apply to excavation operations:
 - 1. Additional Excavation: Where excavation has reached required subgrade elevations, if unsuitable bearing materials are encountered, continue excavation until suitable bearing materials are reached. The Contract Sum may be adjusted by an appropriate Contract Modification.
 - 2. Sub-Base: As used in this Section refers to the compacted soil layer used in pavement systems between the subgrade and the pavement base course material.
 - 3. Sub-Grade: As used in this Section refers to the compacted soil immediately below the slab or pavement system.
 - 4. Unauthorized excavation consists of removal of materials beyond indicated sub-grade elevations or dimensions without specific direction from the Architect.

1.4 SEQUENCE AND SCHEDULING

- A. Coordinate the shut-off and disconnection of electrical service with the Owner and the utility company.

PART II - PRODUCTS**2.1 SOIL MATERIALS**

- A. Sub-Base Material: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, crushed slag, or natural or crushed sand.
- B. Drainage Fill: Washed, evenly graded mixture of crushed stone, or crushed or uncrushed gravel, with 100 percent passing a 1½ inch sieve, and not more than 5 percent passing a No. 4 sieve.
- C. Backfill and Fill Materials: Materials complying with ASTM D2487 soil classification groups GW, GP, GM, SM, SW, and SP; free of clay, rock, or gravel larger than 2 inches

in any dimension; debris; waste; frozen materials; and vegetable and other deleterious matter.

2.2 MISCELLANEOUS METALS

- A. Steel plates, shapes, bars, and bar grating: ASTM A 36.
- B. Cold-Formed Steel Tubing: ASTM A 500.
- C. Hot-Rolled Steel Tubing: ASTM A 501.
- D. Steel Pipe: ASTM A 53, Schedule 40, welded.
- E. Fasteners: Zinc-coated, type, grade and class as required.

PART III - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting installation and application of joint sealers. Do not proceed with installation until unsatisfactory conditions have been corrected.

3.2 EXCAVATION

- A. Slope sides of excavations to comply with local codes and ordinances. Shore and brace as required for stability of excavation.
- B. Install sediment and erosion control measures in accordance with local codes and ordinances.
- C. Dewatering: Prevent surface water and subsurface or groundwater from flowing into excavations and from flooding project site and surrounding area.
 - 1. Do not allow water to accumulate in excavations. Remove water to prevent softening of bearing materials.
 - 2. Provide and establish and maintain temporary drainage ditches and other diversions outside excavation limits to convey surface water to collecting or run-off areas. Do not use trench excavations as temporary drainage ditches.
- D. Material Storage: Stockpile satisfactory excavated materials where directed, until required for backfill or fill. Place, grade, and shape stockpiles for proper drainage.
 - 1. Locate and retain soil materials away from edge of excavations. Do not store within drip line of trees indicated to remain.
 - 2. Remove and legally dispose of excess excavated materials and materials not acceptable for use as backfill or fill.
- E. Trenching: Excavate trenches for electrical installations as follows:
 - 1. Excavate trenches to the uniform width, sufficiently wide to provide ample working room and a minimum of 6 to 9 inches clearance on both sides of raceways and equipment.

2. Excavate trenches to depth indicated or required.
 3. Limit the length of open trench to that in which installations can be made and the trench backfilled within the same day.
 4. Where rock is encountered, carry excavation below required elevation and backfill with a layer of crushed stone or gravel prior to installation of raceways and equipment. Provide a minimum of 6 inches of stone or gravel cushion between rock bearing surface and electrical installations.
- F. Cold Weather Protection: Protect excavation bottoms against freezing when atmospheric temperature is less than 35 degrees F (1 degree 2 C).
- G. Backfilling and Filling: Place soil materials in layers to required subgrade elevations for each area classification listed below, using materials specified in Part 2 of this Section.
1. Under walks and pavements, use a combination of sub-base materials and excavated or borrowed materials.
 2. Under building slabs, use drainage fill materials.
 3. Under piping and equipment, use subbase materials where required over rock bearing surface and for correction of unauthorized excavation.
 4. For raceways less than 30 inches below surface of roadways, provide 4-inch thick concrete base slab support. After installation of raceways, provide a 4-inch thick concrete encasement (sides and top) prior to backfilling and placement of roadway sub-base.
 5. Other areas, use excavated or borrowed materials.
- H. Backfill excavations as promptly as work permits, but not until completion of the following:
1. Inspection, testing, approval, and locations of underground utilities have been recorded.
 2. Removal of concrete formwork.
 3. Removal of shoring and bracing and backfilling of voids.
 4. Removal of trash and debris.
- I. Placement and Compaction: Place backfill and fill materials in layers of not more than eight (8) inches in loose depth for material compacted by heavy equipment, and not more than four (4) inches in loose depth for material compacted by hand operated tampers.
- J. Before compaction, moisten or aerate each layer as necessary to provide optimum moisture content. Compact each layer to required percentage of maximum dry density or relative dry density for each area classification specified below. Do not place backfill or fill material on surfaces that are muddy, frozen, or contain frost or ice.
- K. Place backfill and fill materials evenly adjacent to structures, piping, and equipment to required elevations. Prevent displacement of raceways and equipment by carrying material uniformly around them to approximately same elevation in each lift.
- L. Compaction: Control soil compaction during construction, providing minimum percentage of density specified for each area classification indicated below.

1. **Percentage of Maximum Density Requirements:** Compact soil to not less than the following percentages of maximum density for soils which exhibit a well-defined moisture density relationship (cohesive soils), determined in accordance with ASTM D 1557 and not less than the following percentages of relative density, determined in accordance with ASTM D 2049, for soils which will not exhibit a well-defined moisture density relationship (cohesion-less soils).
2. **Areas Under Structures, Building Slabs and Steps, Pavements:** Compact top 12 inches of material, or 95 percent relative density for cohesionless material.
 - a. **Areas Under Walkways:** Compact top 6 inches of subgrade and each layer of backfill or fill material to 90 percent maximum density for cohesive material or 95 percent relative density for cohesionless material.
 - b. **Other Areas:** Compact top 6 inches of subgrade and each layer of backfill or fill material to 85 percent maximum density for cohesive soils, and 90 percent relative density for cohesionless soils.
3. **Moisture Control:** Where subgrade or layer of soil material must be moisture conditioned before compaction, uniformly apply water. Apply water in minimum quantity necessary to achieve required moisture content and to prevent water appearing on surface during, or subsequent to, compaction operations.
4. **Subsidence:** Where subsidence occurs at electrical installation excavations during the period 12 months after Substantial Completion, remove surface treatment (i.e., pavement, lawn, or other finish), add backfill material, compact to specified conditions, and replace surface treatment. Restore appearance, quality, and condition of surface or finish to match adjacent areas.

3.3 ERECTION OF METAL SUPPORTS AND ANCHORAGE

- A. Cut, fit, and place miscellaneous metal fabrications accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
- B. **Field Welding:** Comply with AWS "Structural Welding Code".

END OF SECTION 16050

SECTION 16100 - RACEWAYS, BOXES AND CABINETS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Raceways, Fittings, Boxes, Enclosures and Cabinets for Electrical Wiring.

PART II - PRODUCTS**2.1 METAL CONDUIT AND TUBING**

- A. Rigid Steel Conduit: ANSI C80.1
- B. Intermediate Metal Conduit: ANSI C80.6
- C. Electrical Metallic Tubing and Fittings: ANSI C80.3 with compression-type fittings.
- D. Flexible Metal Conduit: Zinc coated steel
- E. Liquid tight Flexible Metal Conduit: Flexible steel conduit with PVC jacket.
- F. Fittings: NEMA FB 1, compatible with conduit/tubing materials.
- G. Non-Metallic Rigid Conduit: Schedule 40 pvc as where shown on the drawings.
- H. "MC" type cable.

2.2 OUTLET AND DEVICE BOXES

- A. Sheet Metal Boxes: NEMA OS 1
- B. Cast Metal Boxes: NEMA FB 1, type FD, cast alloy box with gasketed cover

2.3 PULL AND JUNCTION BOXES

- A. Small Sheet Metal Boxes: NEMA OS 1.
- B. Cast Metal Boxes: NEMA FB 1, cast aluminum with gasketed cover.
- C. Pull Boxes: Code gauge steel with screw type removable cover. NEMA rated for the condition.

PART III - EXECUTION**3.1 EXAMINATION**

- A. Examine surfaces to receive raceways, boxes, enclosures, and cabinets for compliance with installation tolerances and other conditions affecting performance of the raceway

system. Do not proceed with installation until unsatisfactory conditions have been corrected.

3.2 MINIMUM CONDUIT SIZE: (unless indicated otherwise) on the drawings conduit shall be sized as follows:

- A. Indoors: The minimum conduit size shall be 1/2".
 - 1. Flexible metal conduit may be used for tap connection to recessed lighting fixtures.
- B. Outdoors: Branch circuit conduit installed below grade to exterior equipment shall be one (1) inch minimum unless noted otherwise.

3.3 WIRING METHODS: Unless noted otherwise on the drawings the following materials shall be used:

- A. Outdoors: Use the following wiring methods:
 - 1. Exposed: Rigid or intermediate metal conduit.
 - 2. Underground: Galvanized Rigid Conduit.
 - 3. Connection to Vibrating Equipment (including transformers and hydraulic, pneumatic, or electric solenoid or motor-driven equipment): Liquid tight flexible metal conduit.
 - 4. Boxes and Enclosures: NEMA Type 3R or Type 4.
- B. Indoors: Use the following wiring methods:
 - 1. Connection to Vibrating Equipment (including transformers and hydraulic, pneumatic, or electric solenoid or motor-driven equipment): Flexible metal conduit, except in wet or damp locations use liquid tight flexible metal conduit.
 - 2. Damp or Wet Locations: Rigid steel conduit.
 - 3. Exposed: Electrical metallic tubing above 8 feet and rigid metallic conduit below eight (8) feet.
 - 4. Concealed: Electrical metallic tubing or MC cable.
 - 5. Boxes and Enclosures: NEMA Type 1, except in damp or wet locations use NEMA Type 3R, unless otherwise noted.

3.4 INSTALLATION

- A. Telephone/Data/Cable TV outlet boxes shall be 2 gang with appropriate trim and cover. Coordinate cover plates with Owner.
- B. Provide insulated bushings for all conduit ends.
- C. Conceal rigid conduit and EMT, unless otherwise indicated, within finished walls, ceilings, above attic space and below floors.
- D. Keep raceways at least 6 inches (150 mm) away from parallel runs of flues and steam or hot water pipes. Install horizontal raceway runs above water and steam piping.
- E. Install raceways level and square and at proper elevations. Provide adequate headroom.

- F. Complete raceway installation before starting conductor installation.
- G. Use temporary closures to prevent foreign matter from entering raceway.
- H. Protect stubs from damage where conduits rise through floor slabs. Arrange so curved portion of bends is not visible above the finished slab.
- I. Where non-metallic conduit is shown to be used below the slab provide rigid conduit to turn up into the building space or at all exterior walls, poles or equipment.
- J. Use raceway fittings compatible with raceway and suitable for use and location. For intermediate steel conduit, use threaded rigid steel conduit fittings, except as otherwise indicated.
- K. Run concealed raceways with a minimum of bends in the shortest practical distance considering the type of building construction and obstructions, except as otherwise indicated. Where the number of bends exceed the total number required by the N.E.C., provide pull boxes as required by code.
- L. Install raceways parallel to or at right angles to surfaces or structural members, and follow the surface contours as much as practical.
 - 1. Run parallel or banked raceways together, on common supports where practical.
 - 2. Make bends in parallel or banked runs from same centerline to make bends parallel. Use factory elbows only where they can be installed parallel; otherwise, provide field bends for parallel raceways.
- M. Join raceways with fittings designed and approved for the purpose and make joints tight.
 - 1. Use bonding jumpers where joints cannot be made tight.
 - 2. Use insulating bushings to protect conductors.
 - 3. Provide expansion joint fittings where required for the raceway used.
- N. IMC and GRC shall terminate with either a double locknut/bushing set or in a threaded hub.
- O. Where conduit type "LB" fittings are used all conduits on conduits over 2" in size shall be "MOGAL" type.
- P. "EMT" connectors shall be steel plated hexagonal compression type only. Do not use pot metal, set-screw, or indenter type connectors.
- Q. Where concentric, eccentric, or oversized knockouts are encountered, a grounding-type insulated bushing shall be provided.
- R. Where conduits of any type pass over a building expansion joint, a standard "expansion joint" fitting, compatible with the type raceway, shall be provided.
- S. Terminations: Where raceways are terminated with locknuts and bushings, align the raceway to enter squarely and install the locknuts with dished part against the box. Where terminations cannot be made secure with one locknut, use two locknuts, one inside and one outside the box.
- T. Where terminating in threaded hubs, screw the raceway or fitting tight into the hub so the

- end bears against the wire protection shoulder. Where chase nipples are used, align the raceway so the coupling is square to the box and tighten the chase nipple so no threads are exposed.
- U. Install pull cords in all empty raceways. Use monofilament plastic line having not less than 200-lb (90 kg) tensile strength. Leave not less than 12 inches (300 mm) of slack at each end of the pull cord.
 - V. Telephone and Signal System Raceways 2 Inch Trade Size and Smaller: In addition to the above requirements, install in maximum lengths of 150 feet (45 m) and with a maximum of two 90-degree bends or equivalent. Install pull or junction boxes where necessary to comply with these requirements. Pull boxes shall be a minimum of 10" square x 6" deep with removable cover.
 - W. Install raceway sealing fittings at suitable, approved, accessible locations and fill them with UL-listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points and elsewhere as indicated:
 - 1. Where conduits enter or leave hazardous classified locations.
 - 2. Where conduits pass from warm locations to cold locations, such as exterior spaces and air-conditioned spaces.
 - 3. Where otherwise required by the NEC.
 - X. Stub-Up Connections: Extend conduits through concrete floor a minimum of 6" for connection to freestanding equipment. Extend conductors to equipment with flexible metal conduit. Where equipment connections are not made under this Contract verify the length of the flexible connectors.
 - Y. Flexible Connections: Use maximum of 6 feet (1830 mm) of flexible conduit for recessed and semi-recessed lighting fixtures; for equipment subject to vibration, noise transmission, or movement; and for all motors. Use liquid tight flexible conduit in wet or damp locations. Install separate ground conductor.
 - Z. Provide grounding connections for raceway, boxes and components. Tighten connectors and terminals according to tightening torques specified in UL Standard 486A.
 - AA. All underground raceways shall be identified by "UNDERGROUND LINE MARKING TAPE" located directly above the raceway at 6" below finished grade. Tape shall be permanent, bright-colored, continuous, magnetic strip, printed, plastic tape compounded for direct burial not less than 6" wide and 4 mils thick. Printed legend shall be indicative of the service it is marking. Provide sufficient tape not less than 2/3 of the width of the item marked for the full length of the Raceway.
 - BB. Where underground raceways are required to turn up into cabinets, equipment, etc., and on to poles, the elbow required and the sub-up out of the slab or earth shall be rigid steel.
 - CC. Where shown to be used on the drawings PVC non-metallic conduit used exterior to the building for grouped circuits it shall be encased in a minimum of 3" of 3000 psi rated concrete. Concrete encased non-metallic ducts shall be supported on plastic separators coordinated with duct size and spacing. Separators shall be spaced close enough to prevent sagging and deforming of ducts. Secure separators to the earth and to ducts to prevent floating during placement of concrete. Do not use steel or tie wires in such a way to form conductive or magnetic loops around ducts or duct groups.

- DD. The Raceway System shall not be relied on for grounding continuity. A green grounding conductor, properly sized per NEC Table 250-122, shall be run in all power raceways.
- EE. Where non-metallic conduit is allowed on the drawings all bends and off-sets shall be made by approved mechanical benders per the manufacturers instruction. Any conduit not in compliance will be removed.

3.5 PROTECTION

- A. Provide final protection and maintain conditions, in a manner acceptable to manufacturer and Installer, to ensure that coatings, finishes, and cabinets are without damage or deterioration at Substantial Completion.
 - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
 - 2. Repair damage to paint finishes with matching touch-up coating recommended by the manufacturer.

3.6 CLEANING

- A. Upon completion of installation of system, including outlet fittings and devices, inspect exposed finish. Remove burrs, dirt and construction debris and repair damaged finish, including chips.

END OF SECTION 16100

SECTION 16120 - WIRES AND CABLES**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Building Wires and Cables and Associated Splices, Connectors and Terminations for Wiring Systems rated 600 Volts and Less.

PART II - PRODUCTS**2.1 BUILDING WIRES AND CABLES**

- A. UL-listed building wires and cables with conductor material, insulation type, cable construction, and rating as specified in Part 3 "Applications" Article.
- B. Rubber Insulation: Conform to NEMA WC 3.
- C. Thermoplastic Insulation: Conform to NEMA WC 5.
- D. Cross-Linked Polyethylene Insulation: Conform to NEMA WC 7.
- E. Ethylene Propylene Rubber Insulation: Conform to NEMA WC 8.
- F. Solid conductor for 10 AWG and smaller: Stranded conductor for larger than 10 AWG.

2.2 CONNECTORS AND SPLICES

- A. UL-listed factory fabricated wiring connectors of size, ampacity rating, material, and type and class for application and for service indicated.

PART III - EXECUTION**3.1 EXAMINATION**

- A. Examine raceways and building finishes to receive wires and cables for compliance with installation tolerances and other conditions. Do not proceed with installation until unsatisfactory conditions have been corrected.

3.2 APPLICATIONS

- A. Feeders and Branch Circuits: Type THHN\THWN or XHHW, copper conductor, in raceway.

3.3 INSTALLATION

- A. All conductors shall be copper.
- B. Minimum conductor size for power and lighting circuits shall be #12 AWG. Maximum conductor size shall be 500 KCMIL AWG.

- C. All power and lighting circuits #10 awg and smaller shall be solid copper conductors. Conductor sizes #8 awg and larger shall be Class "B" stranded copper conductors.
- D. Pull conductors into raceway simultaneously where more than one is being installed in same raceway.
 - 1. Use pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation.
 - 2. Use pulling means, including fish tape, cable, rope, and basket weave wire/cable grips that will not damage cables or raceway.
- E. Conductor Splices: Keep to minimum.
- F. Wiring at Outlets: Install with at least 8 inches of slack conductor at each outlet.
- G. Connect outlets and components to wiring and to ground as indicated. Tighten to UL Standard 486A.
- H. **Power and Lighting circuits shall have individual neutral conductors.**
- I. All power circuits noted for computer equipment with isolated grounding shall be individually installed in a separate conduit with separate phase, neutral conductor, grounding conductor, and isolated grounding conductor, unless noted otherwise.
- J. In no case shall any wire installed to a device exceed the U.L. rating of the device.

3.4 SPLICING

- A. Joints in solid conductors shall be using Idea "wire nuts", 3M Company "scotch lock", or "T&B" "PIGGY" connectors in junction boxes, outlet boxes and lighting fixtures.
- B. "Sta-kon" or other permanent type crimp connectors shall not be used for branch circuit connections.
- C. Joints in stranded conductors shall be spliced by approved mechanical connectors. Solderless mechanical connectors similar to "NSI" multi-cable connector blocks for splices and taps, provided with UL approved insulating covers, may be used instead of mechanical connectors plus tape.
- D. Conductors in all cases, shall be continuous from outlet to outlet unless "taps" are required and shall be made only within outlet, junction boxes, troughs and gutters.

3.5 VOLTAGE DROP

- A. Where conductor length from the panel to the first outlet on a 120 volt circuit exceeds 100 feet, the branch circuit conductors from the panel to the first outlet shall be not smaller than #10 awg.

3.6 FIELD QUALITY CONTROL

- A. Testing: Upon installation of wires and cables and before electrical circuitry has been energized, demonstrate product capability and compliance with requirements.
 - 1. Procedures: Perform each Visual and Mechanical Inspection and Electrical Test stated in NETA Standard ATS, Section 7.3.1. Certify compliance with test parameters.

- B. Correct malfunctioning products at site, where possible, and re-test to demonstrate compliance; otherwise, remove and replace with new units and re-test.

3.7 ELECTRICAL TESTING

A. Feeder Insulation Resistance Testing:

1. All current carrying phase conductors and neutrals shall be tested as installed, and before connections are made, for insulation resistance and accidental grounds. This shall be done with a 500-volt megger. The procedures listed below shall be followed:
2. Minimum readings shall be one million (1,000,000) or more ohms for # 6 AWG wire and smaller, 250,000 ohms or more for #4 wire or larger, between conductor and the grounding conductor.
3. After all devices and equipment are installed and all connections completed to each panel, the Contractor shall disconnect the neutral feeder conductor from the neutral bar and take a megger reading between the neutral bar and the grounded enclosure. If this reading is less than 250,000 ohms, the Contractor shall disconnect the branch circuit neutral wires from the neutral bar. Test each neutral conductor separately until the low readings are found. The Contractor shall correct troubles, reconnect and re-test until at least 250,000 ohms from the neutral bar to the grounded panel can be achieved with only the neutral feeder disconnected.
4. The Contractor shall send a letter to the Engineer certifying that the above has been done and tabulating the megger readings for each panel. This shall be done at least four (4) days prior to final inspection.
5. At the final inspection, the Contractor shall furnish a megger and show the Engineers that the panels comply with the above requirements. He shall also furnish a hook-on type ammeter and a voltmeter and take current and voltage readings as directed by the representatives.

END OF SECTION 16120

SECTION 16140 - WIRING DEVICES**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes various types of receptacles, connectors, switches and finish plates.

1.3 SUBMITTALS

- A. Submit the following according to the Conditions of the Contract and Division 1 Specification Sections.
- B. Product data for each product specified.

PART II - PRODUCTS**2.1 WIRING DEVICES**

- A. Comply with NEMA Standard WD 1-101968, "General Purpose Wiring Devices".
- B. Enclosures: NEMA 1 equivalent, except as otherwise indicated.
- C. Color: Selected by Architect.
- D. Duplex receptacles shall be of the grounding type arranged for back and side wiring, with separate single or double grounding terminals. Receptacles shall be straight blade, rated 20 amp, 125 volt and the face configuration shall conform to the NEMA Standard No. WD-1, NEMA WD-6, DSCC W-C-596G & UL 498, and shall be approved third party listed. Self-grounding or automatic type grounding receptacles are not acceptable in lieu of receptacles with separate grounding screw lugs and a direct green insulated conductor connection to the equipment grounding system. Receptacles shall be specification grade mounted vertically.
- E. Receptacles, Straight-Blade, Special Features: Comply with the basic requirements specified above for straight-blade receptacles of the class and type indicated, and with the following additional requirements:
 - 1. Ground Fault Circuit Interrupter (GFCI) Receptacles: UL Standard 943, "Ground Fault Circuit Interrupters" with integral NEMA 5-20R duplex receptacle. Design units for installation in a 2¾ inch (70-mm) deep outlet box without an adapter.
- F. Receptacles, Industrial Heavy-Duty: Conform to NEMA Standard PK 4 "Plugs, Receptacles and Cable Connectors of the Pin and Sleeve type for Industrial Use".
- G. Plug Sets: Match voltage and current ratings and number of conductors to requirements of the equipment being connected.
- H. Single pole and three or four-way toggle type as indicated on the drawings. Switches shall be of the grounding type with hex-head grounding screw rated 20 amp 120/277V

AC only. Lighted handle switches shall have neon lights of the correct voltage rating where indicated on the drawings. All switches shall have quiet operating mechanisms without the use of mercury switches. All switches shall be listed by an approved third-party agency, approved for the voltage and amperage indicated. Color selected by Architect.

- I. Motion Sensor Switches
 - 1. Single Pole-single switching
 - 2. Single Pole-double switching
 - 3. Switches shall be combination ultrasonic and passive infrared.
 - 4. 100 square foot coverage, 180 degree.
 - 5. 120 volt: 800 watt incandescent, 1000 watt fluorescent.
 - 6. 277 volt, 1800 watt fluorescent.
 - 7. 5 year warranty.
- J. Wall Plates: Single and combination types that mate and match with corresponding wiring devices. Features include the following:
 - 1. Material for Finished Spaces: 0.04 inch thick, type 302, satin finished stainless steel, intermediate jumbo size except as otherwise indicated.
 - 2. Material for Unfinished Spaces: Galvanized cast ferrous steel, standard size.
 - 3. Provide a quantity of 2% spare cover plates for each type of device cover used to the Owner.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install devices and assemblies plumb and secure.
- B. Install wall plates when painting is complete.
 - 1. Arrangement of Devices: Except as otherwise indicated, mount flush, with long dimension vertical and grounding terminal of receptacles on top. Group adjacent switches under single, multi-gang wall plates.
- C. Protect devices and assemblies during painting.
- D. Adjust locations at which floor service outlets are installed to suit the indicated arrangement of partitions and furnishings.
- E. Field verify the actual location of all outlet devices above equipment or counter tops before rough-in and installation. Any outlet installed in conflict with equipment or conditions that could have been avoided, will be corrected at the Contractor's expense.
- F. Provide weatherproof cast aluminum cover plates for all devices exterior to the building or in "wet" locations, Hubbell WP26M or equal.

- G. GFCI protection shall be provided for all receptacles exterior to the building, in restrooms or where required by Code.
- H. Locate all receptacles in rated walls with 24" minimum horizontal separation. This includes devices located opposite each other in the walls.

3.2 IDENTIFICATION

- A. Comply with Division 16 Section "Electrical Identification".
 - 1. Switches: Where 3 or more switches are ganged and elsewhere where indicated, identify each switch with approved legend engraved on wall plate.
 - 2. Receptacles: Identify the panelboard and circuit number from which served. Use machine-printed, pressure-sensitive, abrasion-resistant label tape on face of plate and durable wire markers or tags within outlet boxes.

3.3 FIELD QUALITY CONTROL

- A. Testing: Test wiring devices for proper polarity and ground continuity. Operate each operable device at least six (6) times.
- B. Test ground-fault circuit interrupter operation with both local and remote fault simulations according to manufacturer recommendations.
- C. Replace damaged or defective components.

3.4 CLEANING

- A. General: Internally clean devices, device outlet boxes and enclosures. Replace stained or improperly painted wall plates or devices.

END OF SECTION 16140

SECTION 16190 - SUPPORTING DEVICES**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes secure support from the building structure for Electrical items by means of Hangers, Supports, Anchors, Sleeves, Inserts, Seals and Associated Fastenings.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data for each type of product specified.

PART II - PRODUCTS**2.1 COATINGS**

- A. Coating: Supports, support hardware and fasteners shall be protected with zinc coating or with treatment of equivalent corrosion resistance using approved alternative treatment, finish and inherent material characteristic. Products for use outdoors shall be hot-dip galvanized.

2.2 MANUFACTURED SUPPORTING DEVICES

- A. Raceway Supports: Clevis hangers, riser clamps, conduit straps, threaded C clamps with retainers, ceiling trapeze hangers, wall brackets and spring steel clamps.
 - 1. Expansion Anchors: Carbon steel wedge or sleeve type.
 - 2. Toggle Bolts: All steel spring-head type.
- B. Conduit Sealing Bushings: Factory-fabricated watertight conduit sealing bushing assemblies suitable for sealing around conduit or tubing passing through concrete floors and walls. Construct seals with steel sleeve, malleable iron body, neoprene sealing grommets or rings, metal pressure rings, pressure clamps and cap screws.
- C. U-Channel Systems: 16-gage steel channels, with 9/16-inch diameter holes, at a minimum of 8 inches on center, in top surface. Provide fittings and accessories that mate and match with U-channel and are of the same manufacturer.

2.3 FABRICATED SUPPORTING DEVICES

- A. General: Shop or field fabricated supports or manufactured supports assembled from U-Channel components.
- B. Steel Brackets: Fabricated of angles, channels and other standard structural shapes. Connect with welds and machine bolts to form rigid supports.

- C. Pipe Sleeves: Provide pipe sleeves of one of the following:
1. Sheet Metal: Fabricate from galvanized sheet metal; round tube closed with snap-lock joint, welded spiral seams, or welded longitudinal joint. Fabricate sleeves from the following gage metal for sleeve diameter noted:
 - a. 3-inch and smaller: 20-gage
 - b. 4-inch to 6-inch: 16-gage
 2. Steel Pipe: Fabricate from Schedule 40 galvanized steel pipe.
 3. Plastic Pipe: Fabricate from Schedule 80 PVC plastic pipe.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install supporting devices to fasten electrical components securely and permanently in accordance with NEC requirements.
- B. Coordinate with the building structural system and with other electrical installation.
- C. Raceway Supports: Comply with the NEC and the following requirements:
1. Strength of each support shall be adequate to carry present and future load multiplied by a safety factor of at least four. Where this determination results in a safety allowance of less than 200 lbs, provide additional strength until there is a minimum of 200 lbs safety allowance in the strength of each support.
 2. Install individual and multiple (trapeze) raceway hangers and riser clamps as necessary to support raceways. Provide U-bolts, clamps, attachments and other hardware necessary for hanger assembly and for securing hanger rods and conduits.
 3. Support parallel runs of horizontal raceways together on trapeze-type hangers.
 4. Support individual horizontal raceways by separate pipe hangers. Spring steel fasteners may be used in lieu of hangers only for 1 inch and smaller raceways serving lighting and receptacle branch circuits above suspended ceilings only. For hanger rods with spring steel fasteners, use ¼ inch diameter or larger threaded steel. Use spring steel fasteners that are specifically designed for supporting single conduits or tubing.
 5. Space supports for raceway's types not covered by the above in accordance with NEC.
 6. Support exposed and concealed raceway within 1 foot of an unsupported box and access fittings. In horizontal runs, support at the box and access fittings may be omitted where box or access fittings are independently supported and raceway terminals are not made with chase nipples or threadless box connectors.
 7. In vertical runs, arrange support so the load produced by the weight of the raceway and the enclosed conductors is carried entirely by the conduit supports with no weight load on raceway terminals.

8. In interior spaces provide a minimum of ¼ inch space for all conduits installed on the exterior building walls. Approved "clamp-back" or strut devices shall be used.
- D. Miscellaneous Supports: Support miscellaneous electrical components as required to produce the same structural safety factors as specified for raceway supports. Install metal channel racks for mounting cabinets, panelboards, disconnects, control enclosures, pull boxes, junction boxes, transformers and other devices.
- E. In open overhead spaces, cast boxes threaded to raceways need not be supported separately except where used for fixture support; support sheet metal boxes directly from the building structure or by bar hangers. Where bar hangers are used, attach the bar to raceways on opposite sides of the box and support the raceway with an approved type of fastener not more than 24 inches from the box.
- F. Conduit Seals: Install bushing seals for conduit penetrations of slabs on grade and exterior walls below grade. Tighten sleeve seal screws until sealing grommets have expanded to form watertight seal.
- G. Fastening: Unless otherwise indicated, fasten electrical items and their supporting hardware securely to the building structure, including but not limited to conduits, raceways, cables, cable trays, bus ways, cabinets, panelboards, transformers, boxes, disconnect switches and control components in accordance with the following:
 1. Fasten by means of wood screws or screw-type nails on wood, toggle bolts on hollow masonry units, concrete inserts or expansion bolts on concrete or solid masonry and machine screws, welded threaded studs, or spring-tension clamps on steel. Do not weld conduit, pipe straps or items other than threaded studs to steel structures. In partitions of light steel construction, use sheet metal screws.

END OF SECTION 16190

SECTION 16195 - ELECTRICAL IDENTIFICATION**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections apply to this Section.

1.2 SUMMARY

- A. This Section includes Identification of Electrical Materials, Equipment and Installations.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product Data for each type of product specified.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Ideal Industries, Inc.
 - 2. National Band and Tag Co.
 - 3. Panduit Corp.
 - 4. Seton Name Plate Co.
 - 5. Standard Signs, Inc.
 - 6. W.H. Brady, Co.

2.2 ELECTRICAL IDENTIFICATION PRODUCTS

- A. Colored Adhesive Marking Tape for Raceways, Wires, and Cables: Self-adhesive vinyl tape not less than 3 mils thick by 1 inch to 2 inches in width. Colors to match color schemes noted herein.
- B. Underground Line Marking Tape: Permanent, bright colored, continuous printed, metallic strip, plastic tape compounded for direct burial service not less than 6 inches wide by 4 mils thick. Printed legend indicative of general type of underground line below.
- C. Wire/Cable Designation Tape Markers: Vinyl or vinyl cloth, self adhesive, wrap-around, cable/conductor markers with pre-printed numbers and letter.
- D. Furnish and install engraved laminated phenolic nameplates for all safety switches, panelboards, transformers, switchboards, switchboard branch breakers, motor control centers and other electrical equipment. Nameplates shall be securely attached with self-tapping stainless steel screws, if the screw end is protected; otherwise rivets shall be used. Letters shall be approximately $\frac{1}{8}$ " high minimum. Embossed self-adhesive tape is not acceptable for marking equipment.
- E. Cable Ties: Fungus inert, self-extinguishing, one-piece, self-locking nylon cable ties, 0.18-inch minimum width, 50-lb minimum tensile strength, and suitable for a temperature range from minus 50 degrees F to 350 degrees F. Provide ties in specified colors when used for color coding.

PART III - EXECUTION**3.1 INSTALLATION**

- A. Lettering and Graphics: Coordinate names, abbreviations, colors and other designations used in Electrical Identification work with corresponding designations specified or indicated. Install numbers, lettering, and colors as approved in submittals and as required by code.
- B. Sequence of Work: Where identification is to be applied to surfaces that require finish, install identification after completion of finish work.
- C. Identify Junction, Pull, and Connection Boxes: Install on outside of box cover. Label box covers with identity of contained circuits. Use pressure-sensitive plastic labels at exposed locations and similar labels concealed boxes. Color code boxes as indicated below. Method shall be by colored adhesive not less than 4 square inches for 4" boxes and larger boxes. Permanent type "magic" markers are not accepted as a means of identification.

120/208 volt blue

- D. Underground Electrical Line Identification: During trench backfilling, for exterior underground power, signal and communications lines, install continuous underground plastic line marker, located directly above line at 6 inches below finished grade where multiple lines are installed in a common trench or concrete envelope. Provide marker tape to cover 2/3 of the overall width.
- E. Conductor Color Coding: Provide color coding for secondary service, feeder, and branch circuit conductors throughout the project secondary electrical system as follows:

<u>230/120 Volts</u>	<u>Phase</u>
Black	A
Red	B
White	Neutral
Green	Ground

- F. Use conductors with color factory-applied the entire length of the conductors except as follows:
 - 1. The following field-applied color-coding methods may be used in lieu of factory-coded wire for sizes larger than No. 10 AWG.
 - a. Apply colored, pressure-sensitive plastic tape in half-lapped turns for a distance of 6 inches from terminal points and in boxes where splices or taps are made. Apply the last two laps of tape with no tension to prevent possible unwinding. Use 1-inch wide tape in colors as specified. Do not obliterate cable identification markings by taping. Tape locations may be adjusted slightly to prevent such obliteration minimum width 2".
- G. Tag or label conductors as follows:
 - 1. Multiple Circuits: Where multiple branch circuits or control wiring or communications/signal conductors are present in the same box or enclosure (except for three-circuit, four-wire home runs), label each conductor or cable. Provide legend indicating source, voltage, circuit number, and phase for branch circuit wiring. Phase and voltage of branch circuit wiring may be indicated by mean of coded color of conductor insulation. For control and communications/signal wiring, use color coding or wire/cable marking tape at

terminations and at intermediate locations where conductors appear in wiring boxes, troughs, and control cabinets. Use consistent letter/number conductor designations throughout on wire/cable marking tapes.

2. Match identification markings with designations used in panelboards shop drawings, Contract Documents, and similar previously established identification schemes for the facility's electrical installations.
- H. Install equipment/system circuit/device identification as follows:
1. Apply equipment identification labels of engraved plastic-laminate on each major unit of electrical equipment in building, including central or master unit of each electrical system. This includes communication/signal/alarm systems, unless unit is specified with its own self-explanatory identification. Except as otherwise indicated, provide single line of text, with 1/2 inch high lettering on 1½ inch high label (2 inch high where two lines are required), white lettering in blue field for normal power equipment other face colors shall match the equipment served. Text shall match terminology and numbering of the Contract Documents and shop drawings.
 2. All Phenolic labels shall be securely attached to the equipment by self-tapping stainless steel screws.
 3. Name plate colors shall be as follows:

....Blue surface with white core for 120/230 Volt Equipment.
- I. Apply circuit/control/item designation labels of engraved plastic laminate for disconnect switches, breakers, pushbuttons, pilot lights, motor control centers, and similar items for power distribution and control components above, except panelboards and alarm/signal components, where labeling is specified elsewhere. For panelboards, provide framed, typed circuit schedules with explicit description and identification of items controlled by each individual breaker. Pencil in all spare and leave spaces blank.
- J. All outlet boxes, junction boxes and pull boxes shall have their covers and exterior visible surfaces painted with colors to match the surface color scheme specified. This includes covers on boxes above lay-in and other type accessible ceilings.
- K. All empty conduit runs and conduit with conductors for future use shall be identified for use and shall indicate where they terminate. Identification shall be by pressure sensitive label applied to the conduit or outlet; designate "use" and "location served".

END OF SECTION 16195

SECTION 16452 - GROUNDING**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Solid Grounding of Electrical Systems and Equipment. It includes basic requirements for grounding for protection of life, equipment, circuits, and systems. Grounding requirements specified in this Section may be supplemented in other Sections of these Specifications.

1.3 QUALITY ASSURANCE

- A. Listing and Labeling: Provide products specified in this Section that are listed and labeled. The terms "listed" and "labeled" shall be defined as they are in the National Electrical Code, Article 100.

PART II - PRODUCTS**2.1 GROUNDING AND BONDING PRODUCTS**

- A. Products: Of types indicated and of sizes and ratings to comply with NEC. Where types, sizes, ratings, and quantities indicated are in excess of NEC requirements, the more stringent requirements and the greater size, rating, and quantity indications govern.
- B. Conductor Materials: Copper

2.2 WIRE AND CABLE CONDUCTORS

- A. General: Comply with Division 16 Section "Wires and Cables". Conform to NEC Table 8, except as otherwise indicated, for conductor properties, including stranding.
- B. Equipment Grounding Conductor: Green insulated
- C. Grounding Electrode Conductor: Stranded cable
- D. Bare Copper Conductors: Conform to the following:
 - 1. Solid Conductors: ASTM B-3
 - 2. Assembly of Stranded Conductors: ASTM B-8
 - 3. Tinned Conductors: ASTM B-33

2.3 MISCELLANEOUS CONDUCTORS

- A. Ground Bus: Bare annealed copper bars of rectangular cross section, full-size rated.
- B. Braided Bonding Jumpers: Copper tape, braided No. 30 gauge bare copper wire, terminated with copper ferrules.
- C. Bonding Strap Conductor/Connectors: Soft copper, 0.05 inch thick and 2 inches wide, except as indicated.

2.4 CONNECTOR PRODUCTS

- A. General: Listed and labeled as Grounding Connectors for the materials used.
- B. Pressure Connectors: High conductivity-plated units
- C. Bolted Clamps: Heavy-duty units listed for the application

2.5 GROUNDING ELECTRODES

- A. Ground Rods: Copper-clad steel with high strength steel core and electrolytic grade copper outer sheath, molten welded to core.

- 1. Size: 3/4 inch by 10 feet

PART III - EXECUTION**3.1 APPLICATION**

- A. Equipment Grounding Conductor Application: Comply with NEC Article 250 for sizes and quantities of equipment grounding conductors, except where larger sizes or more conductors are indicated.
 - 1. The raceway system shall not be relied on for ground continuity. Install an equipment ground conductor in all power related conduits. Size conductor as required by NEC Table 250-122. Data and Signal conduits do not require a separate grounding conductor unless required by the manufacturer of the equipment to be installed.
- B. Signal and Communications: For telephone, alarm, and communication systems, provide a #6 AWG minimum green insulated copper conductor in raceway from the grounding electrode system to each terminal equipment location. Leave 3' pigtail wiring at termination point where equipment boards are shown. Make direct connection where equipment is provided.

3.2 INSTALLATION

- A. General: Ground electrical systems and equipment in accordance with NEC requirements except where the Drawings or Specifications exceed NEC requirements.
- B. The electrical service shall be grounded by three (3) means:
 - 1. To the cold water main, if metallic and in direct contact with the earth for at least 10 feet as per the NEC Article 250-81.
 - 2. To the steel frame of the building, provided the building frame is effectively grounded.
 - 3. To ground rod(s)
- C. Ground Rods: Locate a minimum of one-rod length from each other and at least the same distance from any other grounding electrode. Interconnect ground rods with bare conductors buried at least 24 inches below grade. Connect bare-cable ground conductors to ground rods by means of exothermic welds except as otherwise indicated. Make these connections without damaging the copper coating or exposing the steel. Use 3/4 inch by 10 ft. ground rods except as otherwise indicated. Drive rods until tops are 6

inches below finished floor or final grade except as otherwise indicated. All ground connections shall be accessible.

- D. **Metallic Water Service Pipe:** Provide insulated copper ground conductors, sized as indicated, in conduit from the building main service equipment, or the ground bus, to main metallic water service entrances to the building. Connect ground conductors to the main metallic water service pipes by means of ground clamps. Where a dielectric main water fitting is installed, connect the ground conductor to the street side of the fitting. Do not install a grounding jumper around dielectric fittings. Bond the ground conductor conduit to the conductor at each end.
- E. Route grounding conductors along the shortest and straightest paths possible without obstructing access or placing conductors where they may be subjected to strain, impact, or damage, except as indicated.

3.3 CONNECTIONS

- A. **General:** Make connections in such a manner as to minimize possibility of galvanic action or electrolysis. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact will be galvanically compatible.
 - 1. Use electroplated or hot tin-coated materials to assure high conductivity and make contact points closer in order of galvanic series.
 - 2. Make connections with clean bare metal at points of contact.
 - 3. Aluminum to steel connections shall be with stainless steel separators and mechanical clamps.
 - 4. Aluminum to galvanized steel connections shall be with tin-plated copper jumpers and mechanical clamps.
 - 5. Coat and seal connections involving dissimilar metals with inert material such as red lead paint to prevent future penetration of moisture to contact surfaces.
- B. Terminate insulated equipment grounding conductors for feeders and branch circuits with pressure-type grounding lugs. Where metallic raceways terminate at metallic housings without mechanical and electrical connection to the housing, terminate each conduit with a grounding bushing. Connect grounding bushings with a bare grounding conductor to the ground bus in the housing. Bond electrically non-continuous conduits at both entrances and exits with grounding bushings and bare grounding conductors.
- C. Tighten grounding and bonding connectors and terminals, including screws and bolts, in accordance with manufacturer's published torque tightening values for connectors and bolts. Where manufacturer's torquing requirements are not indicated, tighten connections to comply with torque tightening values specified in UL 486A and UL 486B.
- D. **Compression-Type Connections:** Use hydraulic compression tools to provide the correct circumferential pressure for compression connectors. Use tools and dies recommended by the manufacturer of the connectors. Provide embossing die code or other standard method to make a visible indication that a connector has been adequately compressed on the ground conductor.

3.4 FIELD QUALITY CONTROL

- A. **Tests:** Subject the completed grounding system to a megger test at each location where a maximum ground resistance level is specified, at service disconnect enclosure ground terminal, and at ground test wells. Measure ground resistance without the soil being

moistened by any means other than natural precipitation or natural drainage or seepage and without chemical treatment or other artificial means of reducing natural ground resistance. Perform tests by the 2 point method in accordance with Section 9.03 of IEEE 81, "Guide for Measuring Earth Resistivity, Ground Impedance and Earth Surface Potentials of a Grounding System".

B. Service Grounding Test

1. After completion of the electrical grounding and bonding systems, test the ground resistance with a ground resistance tester. Where test shown resistance-to-ground is over 25 ohms, provide additional ground rods until the minimum of 25 ohms is achieved.

C. Deficiencies: Where ground resistances exceed specified values, and if directed, modify the grounding system to reduce resistance values. Where measures are detected that exceed those indicated the provisions of the Contract, covering changes will apply.

D. Report: Prepare test reports of the ground resistance at each test location. Include observations of weather and other phenomena that may affect test results. Describe measures taken to improve test results.

3.5 CLEANING AND ADJUSTING

- A. Restore surface features at areas disturbed by excavation and re-establish original grades. Where sod has been removed, replace it as soon as possible after backfilling is completed. Restore areas disturbed by trenching, storing of dirt, cable laying, and other Work to their original condition. Include necessary topsoil, fertilizing, liming, seeding, sodding, sprigging, or mulching.

END OF SECTION 16452

SECTION 16470 – PANEL BOARDS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Lighting and Power Panel Boards and Associated Auxiliary Equipment Rated 600 V or Less

1.3 DEFINITIONS

- A. Panel Boards: A panel board with thermal magnetic circuit-breaker branches, designed for residential and light commercial projects, operating at 600 V and below, available in both single and 3-phase versions, and equipped with combination flush/surface mounting trim.
- B. Over-current Protective Device (OCPD): A device operative on excessive current that causes and maintains the interruption of power in the circuit it protects.

1.4 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data for each type panel board, accessory item, and component specified.
- C. Shop Drawings from manufacturers of panel boards including dimensioned plans, sections, and elevations. Show tabulations of installed devices, major features and voltage rating.
- D. Include the following:
 - 1. Enclosure type with details for types other than NEMA Type 1.
 - 2. Bus configuration and current ratings.
 - 3. Short-circuit current rating of panelboard.
 - 4. Features, characteristics, ratings, and factory settings of individual protective devices and auxiliary components.

1.5 QUALITY ASSURANCE

- A. Listing and Labeling: Provide products specified in this Section that are listed and labeled.
 - 1. The terms "listed" and "labeled" shall be defined as they are in the National Electrical Code, Article 100.
- B. Electrical Component Standard: Components and installation shall comply with NFPA 70, "National Electrical Code".
- C. NEMA Standard: Comply with NEMA PB1, "Panel Boards".
- D. UL Standards: Comply with UL 61, "Panel Boards", and UL 50, "Cabinets and Boxes".

PART II - PRODUCTS**2.1 MANUFACTURERS****A. Acceptable Manufacturers:**

1. Cutler Hammer
2. Square D
3. Siemens

2.2 PANELBOARDS - GENERAL REQUIREMENTS

- A. Over-current Protective Devices (OCPDs): Provide type, rating, and features as indicated on the schedules. Tandem circuit breakers shall not be used. Multiple breakers shall have common trip.
- B. Circuit Breakers shall be bolt-on type.
- C. 100% rated copper Ground and Neutral Bus (unless noted otherwise).
- D. Enclosures: Cabinets, flush or surface mounted as indicated. NEMA Type 1 enclosure.
- E. Front: Secured to box with concealed trim clamps except as indicated. Front for surface-mounted panels shall be same dimensions as box. Fronts for flush panels shall overlap box except as otherwise specified.
- F. Directory Frame: Metal, mounted inside each panel door.
- G. Bus: Hard drawn copper of 98 percent conductivity
- H. Main and Neutral Lugs: Bolt-on type
- I. Equipment Ground Bus: Adequate for feeder and branch-circuit equipment ground conductors.
- K. Provision for Future Devices: Equip with mounting brackets, bus connections, and necessary appurtenances, for the OCPD ampere ratings indicated for future installation of devices.
- L. Feed-through panels are not permitted.
- M. The use of series breakers is not permitted.
- N. Flash protection boundary and the incident energy for the electrical equipment shall be determined in accordance with IEEE 1584 and NFPA 70E requirements.

2.3 IDENTIFICATION

- A. Panel Board Nameplates: Engraved laminated plastic or metal nameplate for each panel board mounted with self-tapping stainless steel screws.

PART III - EXECUTION**3.1 INSTALLATION**

- A. General: Install panel boards and accessory items in accordance with NEMA PB 1.1, "General Instructions for Proper Installation, Operation and Maintenance of Panel Boards Rated 600 Volts or Less" and manufacturers' written installation instructions.

- B. Mounting Heights: Top of trim 6'-2" above finished floor, except as indicated.
- C. Mounting: Plumb and rigid without distortion of box. Mount flush panels uniformly flush with wall finish.
- D. Circuit Directory: Typed and reflective of final circuit changes required to balance panel loads. Obtain approval before installing. Pencil all spares. Spaces shall be left blank.
- E. Install filler plates in unused spaces.
- F. Provision for Future Circuits at Flush Panel Boards: Stub four 1-inch empty conduits from panel into accessible ceiling space or space designated to be ceiling space in future.
- G. Wiring in Panel Gutters: Train conductors neatly in groups, bundle and wrap with wire ties after completion of load balancing.

3.2 GROUNDING

- A. Connections: Make equipment grounding connections for panelboards as indicated.
- B. Provide ground continuity to main electrical ground bus indicated.

3.3 CONNECTIONS

- A. All connections shall be provided per UL 486A and UL 486B.

3.4 FIELD QUALITY CONTROL

- A. Quality Control Program: Conform to the following:
 - 1. Procedures: Field tests and Inspections will be made by the Engineer at time of completion of the work and in accordance these Specifications.
 - 2. Schedule tests with at least one (1) week in advance notification.
- B. Visual and Mechanical Inspection: Include the following inspections and related work:
 - 1. Inspect for defects and physical damage, labeling, and nameplate compliance with requirements of up-to-date Drawings and Panel Board Schedules.
 - 2. Exercise and perform of operational tests of all Mechanical components and other operable devices in accordance with manufacturer's Instruction Manual.
 - 3. Check panel board mounting, area clearances and alignment and fit of components.
 - 4. Check tightness of bolted electrical connections with calibrated torque wrench.

3.5 CLEANING

- A. Upon completion of installation, inspect interior and exterior of panel boards. Remove paint splatters and other spots, dirt, and debris. Touch up scratches and mars of finish to match original finish.

END OF SECTION 16470

SECTION 16476 – DISCONNECTS**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes Equipment and Service disconnects.

1.3 SUBMITTALS

- A. General: Submit the following according to the Conditions of the Contract and Division 1 Specification Sections.
- B. Product Data for Switches and Accessories specified in this Section.

1.4 QUALITY ASSURANCE

- A. Comply with NFPA 70 "National Electrical Code" for components and installation.
- B. Listing and Labeling: Provide products specified in this Section that are listed and labeled.
 - 1. The Terms "Listed" and "Labeled": As defined in the "National Electrical Code", Article 100.

PART II - PRODUCTS**2.1 MANUFACTURERS**

- A. Acceptable Manufacturers:
 - 1. Cutler-Hammer Products; Eaton Corp.
 - 2. Siemens
 - 3. Square D Company

2.2 ENCLOSED SWITCHES

- A. Enclosed Non-Fusible Switch: NEMA KS 1, Type HD, handle lockable with 2 padlocks.
- B. Enclosed Fusible Switch, 800 Amperes and Smaller: NEMA KS 1, Type HD, clips to accommodate specified fuses, enclosure consistent with environment where located, handle lockable with 2 padlocks, and interlocked with cover in CLOSED position.
- C. Enclosure: NEMA KS 1, Type 1, unless specified or required otherwise to meet environmental conditions of installed location.
- D. Outdoor Locations: Type 3R
- E. Other Wet or Damp Indoor Locations: Type 4
- F. All switches shall be "Heavy Duty" rated for the voltage required.
- G. Coordinate all fuse rated switches with the equipment to be furnished. Furnish fuses.

- H. Safety switches shall be third-party listed.
- I. Switches shall have defeatable door interlocks that prevent the door from opening when the operating handle is in the open position.
- J. Switches shall have handles whose positions are easily recognizable in the "on" or "off" position. For safety reasons, padlocks shall be provided for switches located in the public areas.
- K. Switches shall have nontearable, positive, quick make-quick-break mechanisms.
- L. Switches shall be properly labeled. See section 16195, Electrical Identification.

PART III - EXECUTION

3.1 INSTALLATION

- A. Install enclosed switches level and plumb.
- B. Where fuses are required, the fuses shall be matched with the equipment supplier's requirements.
- C. Provide one additional set of fuses for each disconnect switch.

3.2 FIELD QUALITY CONTROL

- A. Testing: After installing enclosed switches and after electrical circuitry has been energized, demonstrate product capability and compliance with requirements.
- B. Correct malfunctioning units at site, where possible, and retest to demonstrate compliance. Otherwise, remove and replace with new units and re-test.

3.3 CLEANING

- A. After completing system installation, including outlet fittings and devices, inspect exposed finish. Remove burrs, dirt, construction debris and repair damaged finish including chips, scratches and abrasions.

END OF SECTION 16476

SECTION 16515 - INTERIOR LIGHTING**PART I - GENERAL****1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes interior lighting fixtures, lamps, ballasts, emergency lighting units, and accessories.

1.3 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of Contract and Division 1 Specification Sections.
- B. Product data describing fixtures, lamps, ballasts, and emergency lighting units. Arrange product data for fixtures in order of fixture designation. Include data on features and accessories and the following information:
 - 1. Outline drawings of fixtures indicating dimensions and principal features.
 - 2. Electrical ratings and photometric data with specified lamps and certified results of independent laboratory tests.
 - 3. Data on batteries and chargers of emergency lighting units.
 - 4. Shop Drawings from manufacturers detailing non-standard fixtures and indicating dimensions, weights, methods of field assembly, components, features and accessories.
 - 5. Non-returnable samples, when requested by Engineer, for verification purposes of specific individual fixtures.

1.4 QUALITY ASSURANCE

- A. Comply with NFPA 70 "National Electrical Code" for components and installation.
- B. Listing and Labeling: Provide fixtures that are listed and labeled for their indicated use on the Project.
- C. Coordination of Fixtures With Ceiling: Coordinate fixtures mounting hardware and trim with the ceiling system. Provide plaster or sheet-rock trims when required on the project whether indicated or not at no additional cost to the Owner. Coordinate with Architectural Plans before ordering fixtures.

1.5 WARRANTY

- A. Minimum warranty period on emergency lights shall be three (3) years from date acceptance. Warranty shall include all parts (less lamps).
- B. All other lighting products shall be warranted for a period of not less than 1 year from date of acceptance. This warranty does not include miscellaneous parts which are external to the product (i.e. lamps) which are considered maintenance item.

PART II - PRODUCTS**2.1 FIXTURES - GENERAL**

- A. Comply with the requirements specified in the Articles below and the Lighting Fixture Schedule on the Drawings.

2.2 FIXTURE COMPONENTS - GENERAL

- A. Metal Parts: Free from burrs and sharp corners and edges.
- B. Sheet Metal Components: Steel, except as indicated. Components are formed and supported to prevent warping and sagging.
- C. Doors, Frames, and Other Internal Access: Smooth operating and free from light leakage under operating conditions. Arrange to permit re-lamping without use of tools. Arrange doors, frames, lenses, diffusers, and other pieces to prevent accidental falling during re-lamping and when secured in the operating position. Light seal strips inside the fixture will not be allowed.
- D. Reflecting Surfaces: Minimum reflectances as follows, except as otherwise indicated:
 - 1. White Surfaces: 85 percent
 - 2. Specular Surfaces: 83 percent
 - 3. Diffusing Specular Surfaces: 75 percent
 - 4. Laminated Silver Metalized Film: 90 percent
- E. Lenses, Diffusers, Covers, and Globes: 100 percent virgin acrylic
 - 1. Plastic: Highly resistance to yellowing and other changes due to aging, exposure to heat and UV radiation.
 - 2. Lens Thickness: 0.125 inches minimum

2.3 SUSPENDED FIXTURE SUPPORT COMPONENTS

- A. Single-Stem Hangers: ½ inch steel tubing with swivel ball fitting and ceiling canopy. Finish same as fixture.
- B. Twin-Stem Hangers: Two, ½ inch steel tubes with single canopy arranged to mount a single fixture. Finish same as fixture.
- C. Rod Hangers: 3/16 inch diameter cadmium plated, threaded steel rod.

2.4 FLUORESCENT FIXTURES

- A. Electronic Ballast:
 - 1. Ballast to be "UL listed, Class P".
 - 2. Ballast to be "Sound Rated A".
 - 3. Ballast enclosure size shall be same as or smaller than, magnetic ballast.

4. Light regulation shall be +/- 10% input voltage variation.
 5. Ballast shall have high power factor (minimum of 90%).
 6. Lamp current crest factor shall be equal to, or less than, 1.7.
 7. Input current third harmonics shall not exceed ANSI recommendations (32% total harmonic distortion, 27.5% of the third triplets).
 8. Flicker shall be 15% or less with any lamp suitable for the ballast.
 9. Ballast design shall withstand line transients per IEEE 587, Category A.
 10. Ballast case temperature shall not exceed 25 degrees C rise over 40 degrees C ambient.
 11. Ballast shall meet FCC Rules and Regulations, Part 18.
 12. Parallel wiring between the ballast and fixture is recommended.
 13. Minimum of five (5) years warranty is required with each electronic ballast.
 14. The manufacturer shall have not less than 5 years of experience in manufacturing electronic ballast.
- B. Provide disconnecting means per NEC 410.130 G.
- C. Low Temperature Ballast Minimum Starting Temperature: Minus 20 degrees C
- D. Where compact fluorescent light fixtures are specified, "High Power Factor" electronic ballast shall be standard.

2.5 FLUORESCENT LAMPS

- A. All fluorescent lamps to be {41} K-rated unless noted otherwise.

2.6 EXIT SIGNS

- A. Conform to UL 924, "Emergency Lighting and Power Equipment".
1. Arrows: Include as indicated.
- B. Emergency Exit Signs shall be of the "LED" style.
- C. Units shall be completely self-contained, provided with maintenance-free battery, automatic charger, and other features. Luminaire must be third-party listed as emergency lighting equipment, and meet or exceed the following standards: NEC, NC Building Code, Volume X Energy code, NFPA-101, and NEMA Standards.
- D. BATTERY-It shall be sealed, maintenance-free type, with minimum of 90 minutes operating endurance. Must have a normal life expectancy of 10 years. Batteries shall be a high temperature type with an operating range of 0 degree C to 60 degrees C and contain a resealable pressure vent, a sintered + positive and – negative terminal.
- E. CHARGER- It shall be fully automatic solid state type, full wave rectifying, with current limiting. Charger shall restore the battery to its full charge within 24 hours after a discharge of 90 minutes under full rated load. The unit shall be activated when the voltage drops below 80%. A low voltage disconnect switch shall be included if LEAD

battery is used to disconnect the battery from the load and prevent damage from a deep discharge during extended power outage.

- F. **ADDITIONAL FEATURES-** Pilot light to indicate the unit is connected to AC power. The battery shall have rate discharge pilot light, unless self-diagnostic type. Test switch to simulate the operation of the unit upon loss of AC power by energizing the lamps from the battery. This simulation must also exercise the transfer relay.
- G. **WARRANTY-**The entire unit shall be warranted for 3 years. The battery must have an additional 2 more years pro-rated warranty. Warranty shall start from the date of project final acceptance. Warranty shall be included in the contract document.
- H. **LED-**The use of LED is required due to their reliable performance, low power consumption, and limited maintenance requirements. Maximum LED failure rate shall be 25% within a seven (7) year period; otherwise, if exceeded, manufacturer shall replace the complete unit at no charge to the owner.

2.7 EMERGENCY LIGHTING UNITS

- A. Conform to UL 924, "Emergency Lighting and Power Equipment" requirements for "Unit Equipment". Provide self-contained units with the following features and additional characteristics as indicated.
- B. Units shall be completely self-contained, provided with maintenance-free battery, automatic charger, and other features. Luminaire must be third-party listed as emergency lighting equipment, and meet or exceed the following standards: NEC, NC Building Code, Volume X Energy code, NFPA-101, and NEMA Standards.
- C. **BATTERY-**It shall be sealed, maintenance-free type, with minimum of 90 minutes operating endurance. Must have a normal life expectancy of 10 years. Batteries shall be a high temperature type with an operating range of 0 degree C to 60 degrees C and contain a resealable pressure vent, a sintered + positive and – negative terminal.
- D. **CHARGER-** It shall be fully automatic solid state type, full wave rectifying, with current limiting. Charger shall restore the battery to its full charge within 24 hours after a discharge of 90 minutes under full rated load. The unit shall be activated when the voltage drops below 80%. A low voltage disconnect switch shall be included if LEAD battery is used to disconnect the battery from the load and prevent damage from a deep discharge during extended power outage.
- E. **ADDITIONAL FEATURES-** Pilot light to indicate the unit is connected to AC power. The battery shall have rate discharge pilot light, unless self-diagnostic type. Test switch to simulate the operation of the unit upon loss of AC power by energizing the lamps from the battery. This simulation must also exercise the transfer relay.
- F. **WARRANTY-**The entire unit shall be warranted for 3 years. The battery must have an additional 2 more years pro-rated warranty. Warranty shall start from the date of project final acceptance. Warranty shall be included in the contract document.

2.8 FINISH

- A. **Steel Parts:** Manufacturer's standard finish applied over corrosion-resistant primer, free of streaks, runs, holidays, stains, blisters, and defects. Remove fixtures showing evidence of corrosion during project warranty period and replace with new fixtures.
- B. **Paint parts** after fabrication.

PART III – EXECUTION**3.1 INSTALLATION**

- A. Setting and Securing: Set units plumb, square, and level with ceiling and walls, and secure according to manufacturer's printed instructions and approved Shop Drawings.
- B. Support For Recessed and Semi-Recessed Fixtures: Units shall be supported independent from suspended ceiling. Install fixture with support wires at 2 diagonal corners to the structure or building steel.
 - 1. Fixtures of Sizes Less Than Ceiling Grid: Center in the acoustical panel. Support fixtures independently with at least two ¾ inch metal channels spanning and secured to the ceiling tees.
 - 2. Install support clips or screws for recessed fixtures, securely fastened to ceiling grid members, at or near each fixture corners.
 - 3. Support wires shall be not less than the support wires for the ceiling system.
- C. Support for Suspended Fixtures: Brace pendants and rods that are 4 feet long or longer to limit swinging. Support stem mounted single unit suspended fluorescent fixtures with twin stem hangers. For continuous rows, use tubing or stem for wiring at one point and tubing or rod for suspension for each unit length of chassis, including one at each end.
- D. Lamping: See Schedule on Drawings, or provide standard lamp for the rating of the fixture.
- E. Where mounting height for fixtures are not scheduled, coordinate with the Engineer before any installation.

3.2 FIELD QUALITY CONTROL

- A. Inspect each installed fixture for damage. Replace damaged fixtures and components.
- B. Emergency Battery Units Test: Verify normal operation of each fixture after fixtures have been installed and circuits have been energized with normal power source. Interrupt electrical energy for a period of not less than 90 minutes to demonstrate proper operation of Emergency Lighting installation. Include the following in tests of emergency lighting equipment.
 - 1. Duration of supply
 - 2. Low battery voltage shut-down
 - 3. Normal transfer to battery source and retransfer to normal
 - 4. Low supply voltage transfer
- C. Replace or repair malfunctioning fixtures and components, then retest. Repeat procedure until all units operate properly.
- D. Contractor shall perform a test on each unit after it is permanently installed and charged for a minimum of 24 hours. Battery shall be tested for 90 minutes. The battery test shall be done 10 days prior to final inspection by the State Construction Office. Any unit which fails the test must be repaired or replaced and tested again. Copy of the test report shall be sent to the State Construction Office.

3.3 ADJUSTING AND CLEANING

- A. Clean fixtures upon completion of installation. Use methods and materials recommended by manufacturer.
- B. Adjust aimable fixtures to provide required light intensities.

END OF SECTION 16515

C203304-RA (K-3800)

BEAUFORT COUNTY

DIVISION 16- COMPENSATION FOR ELECTRICAL

COMPENSATION

- A. The work of furnishing materials and constructing the Electrical installation for the Rest Area Building and the Storage Building in accordance with the plans and specifications, completed and accepted, will be paid for at the contract lump sum price for the "Electrical Installation for Rest Area Building" and "Electrical Installation for Storage Building" . Such price and payment will be full compensation for all work of constructing the Electrical installation for the Rest Area Building and the Storage Building, including but not limited to furnishing all transportation, materials, labor, tools, equipment, fees and incidentals necessary to complete the work. Payment will be made under:

"Electrical Installation for Rest Area Building"Lump Sum

"Electrical Installation for Storage Building"Lump Sum

PROJECT SPECIAL PROVISION

(10-18-95) (Rev. 10-15-13)

Z-1

PERMITS

The Contractor's attention is directed to the following permits, which have been issued to the Department of Transportation by the authority granting the permit.

<u>PERMIT</u>	<u>AUTHORITY GRANTING THE PERMIT</u>
Dredge and Fill and/or Work in Navigable Waters (404)	U. S. Army Corps of Engineers
Water Quality (401)	Division of Environmental Management, DENR State of North Carolina
Buffer Certification	Division of Environmental Management, DENR State of North Carolina
CCPCUA	Division of Water Resources, DENR State of North Carolina

The Contractor shall comply with all applicable permit conditions during construction of this project. Those conditions marked by * are the responsibility of the Department and the Contractor has no responsibility in accomplishing those conditions.

Agents of the permitting authority will periodically inspect the project for adherence to the permits.

The Contractor's attention is also directed to Articles 107-10 and 107-13 of the *2012 Standard Specifications* and the following:

Should the Contractor propose to utilize construction methods (such as temporary structures or fill in waters and/or wetlands for haul roads, work platforms, cofferdams, etc.) not specifically identified in the permit (individual, general, or nationwide) authorizing the project it shall be the Contractor's responsibility to coordinate with the Engineer to determine what, if any, additional permit action is required. The Contractor shall also be responsible for initiating the request for the authorization of such construction method by the permitting agency. The request shall be submitted through the Engineer. The Contractor shall not utilize the construction method until it is approved by the permitting agency. The request normally takes approximately 60 days to process; however, no extensions of time or additional compensation will be granted for delays resulting from the Contractor's request for approval of construction methods not specifically identified in the permit.

Where construction moratoriums are contained in a permit condition which restricts the Contractor's activities to certain times of the year, those moratoriums will apply only to the portions of the work taking place in the waters or wetlands provided that activities outside those areas is done in such a manner as to not affect the waters or wetlands.

**U.S. ARMY CORPS OF ENGINEERS
WILMINGTON DISTRICT**

Action Id. SAW-2013-02202 County: Beaufort U.S.G.S. Quad: NC-HACKNEY

GENERAL PERMIT (REGIONAL AND NATIONWIDE) VERIFICATION

Permittee: NC Department of Transportation

Richard Hancock

Address: 1598 Mail Service Center

Raleigh, NC, 27699-1598

Telephone Number:

Size (acres) 8.5 acres

Nearest Town Chocowinity

Nearest Waterway Chapel Branch

River Basin Pamlico, North Carolina.

USGS HUC 3020104

Coordinates Latitude: 35.4912670451807

Longitude: -77.1061329411386

Location description: Facility located on US 17 North, south of Chocowinity, Beaufort County, NC

Description of projects area and activity: Construct a new rest area on an 8.5 acres parcel adjacent to US 17, near Chocowinity, NC. 269 linear feet of permanent intermittent stream impacts, 60 linear feet of temporary stream impacts and 0.00 acres of wetland impacts are authorized by this verification.

Applicable Law: ☒ Section 404 (Clean Water Act, 33 USC 1344)
☐ Section 10 (Rivers and Harbors Act, 33 USC 403)

Authorization: Regional General Permit Number or Nationwide Permit Number: NWP 23 Approved Categorical Exclusions.

SEE ATTACHED RGP or NWP GENERAL, REGIONAL AND SPECIAL CONDITIONS

Your work is authorized by the above referenced permit provided it is accomplished in strict accordance with the attached conditions and your submitted application and attached information dated 06/19/2013. Any violation of the attached conditions or deviation from your submitted plans may subject the permittee to a stop work order, a restoration order and/or appropriate legal action.

This verification will remain valid until the expiration date identified below unless the nationwide authorization is modified, suspended or revoked. If, prior to the expiration date identified below, the nationwide permit authorization is reissued and/or modified, this verification will remain valid until the expiration date identified below, provided it complies with all requirements of the modified nationwide permit. If the nationwide permit authorization expires or is suspended, revoked, or is modified, such that the activity would no longer comply with the terms and conditions of the nationwide permit, activities which have commenced (i.e., are under construction) or are under contract to commence in reliance upon the nationwide permit, will remain authorized provided the activity is completed within twelve months of the date of the nationwide permit's expiration, modification or revocation, unless discretionary authority has been exercised on a case-by-case basis to modify, suspend or revoke the authorization.

Activities subject to Section 404 (as indicated above) may also require an individual Section 401 Water Quality Certification. You should contact the NC Division of Water Quality (telephone 919-807-6300) to determine Section 401 requirements.

For activities occurring within the twenty coastal counties subject to regulation under the Coastal Area Management Act (CAMA), prior to beginning work you must contact the N.C. Division of Coastal Management in Morehead City, NC, at (252) 808-2808.

This Department of the Army verification does not relieve the permittee of the responsibility to obtain any other required Federal, State or local approvals/permits.

If there are any questions regarding this verification, any of the conditions of the Permit, or the Corps of Engineers regulatory program, please contact Thomas Steffens at 910-251-4615 or Thomas.A.Steffens@usace.army.mil.

STEFFENS.THOMAS.ANCRUM.1284706273

Corps Regulatory Official: 2013.11.13 15:47:18 -05'00'

Date: 11/13/2013

Expiration Date of Verification: 03/18/2017

Determination of Jurisdiction:

- A. ☒ Based on preliminary information, there appear to be waters of the US including wetlands within the above described project area. This preliminary determination is not an appealable action under the Regulatory Program Administrative Appeal Process (Reference 33 CFR Part 331).
- B. ☐ There are Navigable Waters of the United States within the above described project area subject to the permit requirements of Section 10 of the Rivers and Harbors Act and Section 404 of the Clean Water Act. Unless there is a change in the law or our published regulations, this determination may be relied upon for a period not to exceed five years from the date of this notification.
- C. ☐ There are waters of the US and/or wetlands within the above described project area subject to the permit requirements of Section 404 of the Clean Water Act (CWA)(33 USC § 1344). Unless there is a change in the law or our published regulations, this determination may be relied upon for a period not to exceed five years from the date of this notification.
- D. ☐ The jurisdictional areas within the above described project area have been identified under a previous action. Please reference jurisdictional determination issued . Action ID: **SAW-**

Basis For Determination: This waterbody exhibits an Ordinary High Water Mark as indicated by changes in soil character and absence of terrestrial vegetation and is hydrologically connected to Maple Branch, a tributary of the Pamlico River, a TNW.

Remarks:

E. Attention USDA Program Participants

This delineation/determination has been conducted to identify the limits of Corps' Clean Water Act jurisdiction for the particular site identified in this request. The delineation/determination may not be valid for the wetland conservation provisions of the Food Security Act of 1985. If you or your tenant are USDA Program participants, or anticipate participation in USDA programs, you should request a certified wetland determination from the local office of the Natural Resources Conservation Service, prior to starting work.

F. Appeals Information (This information applies only to approved jurisdictional determinations as indicated in B and C above).

This correspondence constitutes an approved jurisdictional determination for the above described site. If you object to this determination, you may request an administrative appeal under Corps regulations at 33 CFR Part 331. Enclosed you will find a Notification of Appeal Process (NAP) fact sheet and request for appeal (RFA) form. If you request to appeal this determination you must submit a completed RFA form to the following address:

US Army Corps of Engineers
South Atlantic Division
Attn: Jason Steele, Review Officer
60 Forsyth Street SW, Room 10M15
Atlanta, Georgia 30303-8801
Phone: (404) 562-5137

In order for an RFA to be accepted by the Corps, the Corps must determine that it is complete, that it meets the criteria for appeal under 33 CFR part 331.5, and that it has been received by the Division Office within 60 days of the date of the NAP. Should you decide to submit an RFA form, it must be received at the above address by

****It is not necessary to submit an RFA form to the Division Office if you do not object to the determination in this correspondence.****
STEFFENS.THOMAS.ANCRUM.1284706273

Corps Regulatory Official: 2013.11.13 15:47:43 -05'00'

Thomas Steffens

Date of JD: **11/13/2013**

Expiration Date of JD:

The Wilmington District is committed to providing the highest level of support to the public. To help us ensure we continue to do so, please complete our customer Satisfaction Survey online at <http://per2.nwp.usace.army.mil/survey.html>.

SAW-2013-02202

SPECIAL CONDITIONS

1. CONSTRUCTION PLANS: All work authorized by this permit must be performed in strict compliance with the attached plans June 19, 2013, which are a part of this permit. Any modification to these plans must be approved by the US Army Corps of Engineers (USACE) prior to implementation.

2. UNAUTHORIZED DREDGE OR FILL: Except as authorized by this permit or any USACE approved modification to this permit, no excavation, fill or mechanized land-clearing activities shall take place at any time in the construction or maintenance of this project, within waters or wetlands. This permit does not authorize temporary placement or double handling of excavated or fill material within waters or wetlands outside the permitted area. This prohibition applies to all borrow and fill activities connected with this project.

3. MAINTAIN CIRCULATION AND FLOW OF WATERS: Except as specified in the plans attached to this permit, no excavation, fill or mechanized land-clearing activities shall take place at any time in the construction or maintenance of this project, in such a manner as to impair normal flows and circulation patterns within waters or wetlands or to reduce the reach of waters or wetlands.

4. DEVIATION FROM PERMITTED PLANS: The permittee shall ensure that the construction design plans for this project do not deviate from the permit plans attached to this authorization. Written verification shall be provided that the final construction drawings comply with the attached permit drawings prior to any active construction in waters of the United States, including wetlands. Any deviation in the construction design plans will be brought to the attention of the Corps of Engineers, Tom Steffens, Washington Regulatory Field Office prior to any active construction in waters or wetlands.

5. PRECONSTRUCTION MEETING: The Permittee shall schedule an onsite preconstruction meeting between its representatives, the contractor's representatives and the appropriate Corps of Engineers Project Manager prior to undertaking any work within jurisdictional waters and wetlands to ensure that there is a mutual understanding of all terms and conditions contained within the Department of the Army permit. The Permittee shall notify the Corps of Engineers Project Manager a minimum of thirty (30) days in advance of the scheduled meeting in order to provide that individual with ample opportunity to schedule and participate in the required meeting.

6. SILT-FENCING: The permittee shall employ all sedimentation and erosion control measures necessary to prevent an increase in sedimentation or turbidity within waters and wetlands outside the permit area. This shall include, but is not limited to, the immediate installation of silt fencing or similar appropriate devices around all areas subject to soil disturbance or the movement of earthen fill, and the immediate stabilization of all disturbed areas. Additionally, the project must remain in full compliance with all aspects of the Sedimentation Pollution Control Act of 1973 (North Carolina General Statutes Chapter 113A Article 4).

7. REPORTING VIOLATIONS OF THE CLEAN WATER ACT AND RIVERS AND HARBORS ACT: Violation of these conditions or violation of Section 404 of the Clean Water Act or Section 10 of the Rivers and Harbors Act must be reported in writing to the Wilmington District U.S. Army Corps of Engineers within 24 hours of the permittee's discovery of the violation.

8. COMPLIANCE INSPECTION: A representative of the Corps of Engineers will periodically and randomly inspect the work for compliance with these conditions. Deviations from these procedures may result in an administrative financial penalty and/or directive to cease work until the problem is resolved to the satisfaction of the Corps.

9. PERMITTEE-RESPONSIBLE MITIGATION:

The Permittee shall fully implement the compensatory mitigation plan, entitled "US 17 Rest Area Onsite Stream and Buffer Mitigation Plan", and dated June 19, 2013. Activities prescribed by this plan shall be initiated prior to, or concurrently with, commencement of any construction activities within jurisdictional areas authorized by this permit.

The mitigation project proposes to restore 815 linear feet of intermittent stream by removing the [stream] degrading factors on the site and preserve an additional 623 feet of intermittent stream downstream from the project as onsite mitigation for impacts associated with the project. In review of the mitigation plan, the Corps finds removing the stream degrading factors without modifying the channel profile and dimension to be enhancement rather than restoration. As such, the proposed work is inappropriate as stream restoration and finds stream enhancement a better description of the proposed mitigation project.

To compensate for the unavoidable impacts to 269 linear feet of intermittent stream associated with this project, the permittee shall enhance 403 linear feet of intermittent stream (1.5:1 ratio). The remaining 412 linear feet of intermittent stream enhancement and 623 linear feet of intermittent stream preservation as mitigation assets may be available, subject to Corps and agency approval.

The permittee will, in accordance with the plan, adhere to the following conditions:

- 1) The permittee, NCDOT, is the party responsible for the implementation, performance and long term management of the compensatory mitigation project.
- 2) Any changes or modifications to your mitigation plan shall be approved by the Corps.
- 3) The permittee shall maintain the entire mitigation site in its natural condition, as altered by the work in the mitigation plan, in perpetuity. Prohibited activities within the mitigation site specifically include, but are not limited to: Filling; grading; excavating; earth movement of any kind; construction of roads, walkways, buildings, signs, or any other structure; any activity that may alter the drainage patterns on the property; the destruction, cutting, removal, mowing, or other alteration of vegetation on the property; disposal or storage of any garbage, trash, debris or other waste material; graze or water animals, or use for any agricultural or horticultural purpose; or any other activity which would result in the property being adversely impacted or destroyed, except as specifically authorized by this permit.
- 4) In accordance with the mitigation plan, the permittee will identify the proposed preservation mechanism to be used to maintain the entire mitigation site in perpetuity, subject to the approval of the Wilmington District. The District considers preservation of property for compensatory mitigation purposes to consist of maintaining the property in its natural condition, or, if restoration, creation, or enhancement work has been performed on the property, in its mitigated condition. The permittee shall not sell or otherwise convey any interest in the mitigation property used to satisfy the mitigation requirements for this permit to any third party, without prior written approval from the Wilmington District Corps of Engineers.
- 5) All mitigation areas shall be monitored for a minimum of 3 years or until deemed successful by the Corps in accordance with the monitoring requirements included in the mitigation plan.
- 6) If the compensatory mitigation fails to meet the performance standards 3 years after completion of the compensatory mitigation objectives, the compensatory mitigation will be deemed unsuccessful. Within 60 days of notification by the Corps that the compensatory mitigation is unsuccessful, the Permittee shall submit to the Corps an alternate compensatory mitigation proposal to fully offset the functional loss that occurred as a result of the project. The alternate compensatory mitigation proposal may be required to include additional mitigation to compensate for the temporal loss of wetland function associated with the unsuccessful compensatory mitigation activities. The Corps reserves the right to fully evaluate, amend, and approve or reject the alternate compensatory mitigation proposal. Within 120 days of Corps approval, the Permittee will complete the alternate compensatory mitigation proposal.

10. INSTALLATION OF CULVERTS: For construction of culverts, measures will be included in the construction that will promote the safe passage of fish and other aquatic organisms. For all culvert construction activities, the dimension, pattern, and profile of the stream, (above and below a pipe or culvert), should not be modified by widening the stream channel or by reducing the depth of the stream. Culvert inverts will be buried at least one foot below the bed of the stream for culverts greater than 48 inches in diameter. For culverts 48 inches in diameter or smaller, culverts must be buried below the bed of the stream to a depth equal to or greater than 20 percent of the diameter of the culvert.

Action ID Number: SAW-2013-02202

County: Beaufort

Permittee: NC Department of Transportation
Richard Hancock

Project Name: NCDOT K-3800 SR 1150 US 17 Rest Stop UT to Maple Branch

Date Verification Issued: 11/13/2013

Project Manager: Thomas Steffens

STEFFENS.THOMAS.ANCRUM.1284706273
2013.11.13 15:48:04 -05'00'

 Upon completion of the activity authorized by this permit and any mitigation required by the permit, sign this certification and return it to the following address:

US ARMY CORPS OF ENGINEERS
WILMINGTON DISTRICT
Attn: Thomas Steffens
Washington Regulatory Field Office
2407 West 5th Street
Washington, North Carolina
27889

Please note that your permitted activity is subject to a compliance inspection by a U. S. Army Corps of Engineers representative. If you fail to comply with this permit you are subject to permit suspension, modification, or revocation.

I hereby certify that the work authorized by the above referenced permit has been completed in accordance with the terms and condition of the said permit, and required mitigation was completed in accordance with the permit conditions.

Signature of Permittee

Date

**NATIONWIDE PERMIT 23
DEPARTMENT OF THE ARMY
CORPS OF ENGINEERS
FINAL NOTICE OF ISSUANCE AND MODIFICATION OF NATIONWIDE PERMITS
FEDERAL REGISTER
AUTHORIZED MARCH 19, 2012**

Approved Categorical Exclusions. Activities undertaken, assisted, authorized, regulated, funded, or financed, in whole or in part, by another Federal agency or department where:

(a) That agency or department has determined, pursuant to the Council on Environmental Quality's implementing regulations for the National Environmental Policy Act (40 CFR part 1500 et seq.), that the activity is categorically excluded from environmental documentation, because it is included within a category of actions which neither individually nor cumulatively have a significant effect on the human environment; and

(b) The Office of the Chief of Engineers (Attn: CECW-CO) has concurred with that agency's or department's determination that the activity is categorically excluded and approved the activity for authorization under NWP 23.

The Office of the Chief of Engineers may require additional conditions, including pre-construction notification, for authorization of an agency's categorical exclusions under this NWP.

* **Notification:** Certain categorical exclusions approved for authorization under this NWP require the permittee to submit a pre-construction notification to the district engineer prior to commencing the activity (see general condition 31). The activities that require pre-construction notification are listed in the appropriate Regulatory Guidance Letters. (Sections 10 and 404)

Note: The agency or department may submit an application for an activity believed to be categorically excluded to the Office of the Chief of Engineers (Attn: CECW-CO). Prior to approval for authorization under this NWP of any agency's activity, the Office of the Chief of Engineers will solicit public comment. As of the date of issuance of this NWP, agencies with approved categorical exclusions are the: Bureau of Reclamation, Federal Highway Administration, and U.S. Coast Guard. Activities approved for authorization under this NWP as of the date of this notice are found in Corps Regulatory Guidance Letter 05-07, which is available at:

<http://www.usace.army.mil/Missions/CivilWorks/RegulatoryProgramandPermits/GuidanceLetters.aspx> . Any future approved categorical exclusions will be announced in Regulatory Guidance Letters and posted on this same web site.

NATIONWIDE PERMIT CONDITIONS

The following General Conditions must be followed in order for any authorization by a NWP to be valid:

1. Navigation. (a) No activity may cause more than a minimal adverse effect on navigation.
(b) Any safety lights and signals prescribed by the U.S. Coast Guard, through regulations or otherwise, must be installed and maintained at the permittee's expense on authorized facilities in navigable waters of the United States.
(c) The permittee understands and agrees that, if future operations by the United States require the removal, relocation, or other alteration, of the structure or work herein authorized, or if, in the opinion of the Secretary of the Army or his authorized representative, said structure or work shall cause unreasonable obstruction to the free navigation of the navigable waters, the permittee will be required, upon due notice from the Corps of Engineers, to remove, relocate, or alter the structural work or obstructions caused thereby, without expense to the United States. No claim shall be made against the United States on account of any such removal or alteration.
2. Aquatic Life Movements. No activity may substantially disrupt the necessary life cycle movements of those species of aquatic life indigenous to the waterbody, including those species that normally migrate through the area, unless the activity's primary purpose is to impound water. All permanent and temporary crossings of waterbodies shall be suitably culverted, bridged, or otherwise designed and constructed to maintain low flows to sustain the movement of those aquatic species.
3. Spawning Areas. Activities in spawning areas during spawning seasons must be avoided to the maximum extent practicable. Activities that result in the physical destruction (e.g., through excavation, fill, or downstream smothering by substantial turbidity) of an important spawning area are not authorized.
4. Migratory Bird Breeding Areas. Activities in waters of the United States that serve as breeding areas for migratory birds must be avoided to the maximum extent practicable.
5. Shellfish Beds. No activity may occur in areas of concentrated shellfish populations, unless the activity is directly related to a shellfish harvesting activity authorized by NWPs 4 and 48, or is a shellfish seeding or habitat restoration activity authorized by NWP 27.
6. Suitable Material. No activity may use unsuitable material (e.g., trash, debris, car bodies, asphalt, etc.). Material used for construction or discharged must be free from toxic pollutants in toxic amounts (see Section 307 of the Clean Water Act).
7. Water Supply Intakes. No activity may occur in the proximity of a public water supply intake, except where the activity is for the repair or improvement of public water supply intake structures or adjacent bank stabilization.

8. Adverse Effects From Impoundments. If the activity creates an impoundment of water, adverse effects to the aquatic system due to accelerating the passage of water, and/or restricting its flow must be minimized to the maximum extent practicable.

9. Management of Water Flows. To the maximum extent practicable, the pre-construction course, condition, capacity, and location of open waters must be maintained for each activity, including stream channelization and storm water management activities, except as provided below. The activity must be constructed to withstand expected high flows. The activity must not restrict or impede the passage of normal or high flows, unless the primary purpose of the activity is to impound water or manage high flows. The activity may alter the pre-construction course, condition, capacity, and location of open waters if it benefits the aquatic environment (e.g., stream restoration or relocation activities).

10. Fills Within 100-Year Floodplains. The activity must comply with applicable FEMA-approved state or local floodplain management requirements.

11. Equipment. Heavy equipment working in wetlands or mudflats must be placed on mats, or other measures must be taken to minimize soil disturbance.

12. Soil Erosion and Sediment Controls. Appropriate soil erosion and sediment controls must be used and maintained in effective operating condition during construction, and all exposed soil and other fills, as well as any work below the ordinary high water mark or high tide line, must be permanently stabilized at the earliest practicable date. Permittees are encouraged to perform work within waters of the United States during periods of low-flow or no-flow.

13. Removal of Temporary Fills. Temporary fills must be removed in their entirety and the affected areas returned to pre-construction elevations. The affected areas must be revegetated, as appropriate.

14. Proper Maintenance. Any authorized structure or fill shall be properly maintained, including maintenance to ensure public safety and compliance with applicable NWP general conditions, as well as any activity-specific conditions added by the district engineer to an NWP authorization.

15. Single and Complete Project. The activity must be a single and complete project. The same NWP cannot be used more than once for the same single and complete project.

16. Wild and Scenic Rivers. No activity may occur in a component of the National Wild and Scenic River System, or in a river officially designated by Congress as a "study river" for possible inclusion in the system while the river is in an official study status, unless the appropriate Federal agency with direct management responsibility for such river, has determined in writing that the proposed activity will not adversely affect the Wild and Scenic River designation or study status. Information on Wild and Scenic Rivers may be obtained from the appropriate Federal land management agency responsible for the designated Wild and Scenic River or study river (e.g., National Park Service, U.S. Forest Service, Bureau of Land Management, U.S. Fish and Wildlife Service).

17. Tribal Rights. No activity or its operation may impair reserved tribal rights, including, but not limited to, reserved water rights and treaty fishing and hunting rights.

18. Endangered Species. (a) No activity is authorized under any NWP which is likely to directly or indirectly jeopardize the continued existence of a threatened or endangered species or a species proposed for such designation, as identified under the Federal Endangered Species Act (ESA), or which will directly or indirectly destroy or adversely modify the critical habitat of such species. No activity is authorized under any NWP which "may affect" a listed species or critical habitat, unless Section 7 consultation addressing the effects of the proposed activity has been completed.

(b) Federal agencies should follow their own procedures for complying with the requirements of the ESA. Federal permittees must provide the district engineer with the appropriate documentation to demonstrate compliance with those requirements. The district engineer will review the documentation and determine whether it is sufficient to address ESA compliance for the NWP activity, or whether additional ESA consultation is necessary.

* (c) Non-federal permittees must submit a pre-construction notification to the district engineer if any listed species or designated critical habitat might be affected or is in the vicinity of the project, or if the project is located in designated critical habitat, and shall not begin work on the activity until notified by the district engineer that the requirements of the ESA have been satisfied and that the activity is authorized. For activities that might affect Federally-listed endangered or threatened species or designated critical habitat, the pre-construction notification must include the name(s) of the endangered or threatened species that might be affected by the proposed work or that utilize the designated critical habitat that might be affected by the proposed work. The district engineer will determine whether the proposed activity "may affect" or will have "no effect" to listed species and designated critical habitat and will notify the non-Federal applicant of the Corps' determination within 45 days of receipt of a complete pre-construction notification. In cases where the non-Federal applicant has identified listed species or critical habitat that might be affected or is in the vicinity of the project, and has so notified the Corps, the applicant shall not begin work until the Corps has provided notification the proposed activities will have "no effect" on listed species or critical habitat, or until Section 7 consultation has been completed. If the non-Federal applicant has not heard back from the Corps within 45 days, the applicant must still wait for notification from the Corps.

(d) As a result of formal or informal consultation with the FWS or NMFS the district engineer may add species-specific regional endangered species conditions to the NWPs.

(e) Authorization of an activity by a NWP does not authorize the "take" of a threatened or endangered species as defined under the ESA. In the absence of separate authorization (e.g., an ESA Section 10 Permit, a Biological Opinion with "incidental take" provisions, etc.) from the U.S. FWS or the NMFS, The Endangered Species Act prohibits any person subject to the jurisdiction of the United States to take a listed species, where "take" means to harass, harm, pursue, hunt, shoot, wound, kill, trap, capture, or collect, or to attempt to engage in any such conduct. The word "harm" in the definition of "take" means an act which actually kills or injures wildlife. Such an act may include significant habitat modification or degradation where it actually kills or injures wildlife by significantly impairing essential behavioral patterns, including breeding, feeding or sheltering.

(f) Information on the location of threatened and endangered species and their critical habitat can be obtained directly from the offices of the U.S. FWS and NMFS or their world wide web pages at <http://www.fws.gov/> or <http://www.fws.gov/ipac> and <http://www.noaa.gov/fisheries.html> respectively.

19. Migratory Birds and Bald and Golden Eagles. The permittee is responsible for obtaining any “take” permits required under the U.S. Fish and Wildlife Service’s regulations governing compliance with the Migratory Bird Treaty Act or the Bald and Golden Eagle Protection Act. The permittee should contact the appropriate local office of the U.S. Fish and Wildlife Service to determine if such “take” permits are required for a particular activity.

20. Historic Properties. (a) In cases where the district engineer determines that the activity may affect properties listed, or eligible for listing, in the National Register of Historic Places, the activity is not authorized, until the requirements of Section 106 of the National Historic Preservation Act (NHPA) have been satisfied.

(b) Federal permittees should follow their own procedures for complying with the requirements of Section 106 of the National Historic Preservation Act. Federal permittees must provide the district engineer with the appropriate documentation to demonstrate compliance with those requirements. The district engineer will review the documentation and determine whether it is sufficient to address section 106 compliance for the NWP activity, or whether additional section 106 consultation is necessary.

* (c) Non-federal permittees must submit a pre-construction notification to the district engineer if the authorized activity may have the potential to cause effects to any historic properties listed on, determined to be eligible for listing on, or potentially eligible for listing on the National Register of Historic Places, including previously unidentified properties. For such activities, the pre-construction notification must state which historic properties may be affected by the proposed work or include a vicinity map indicating the location of the historic properties or the potential for the presence of historic properties. Assistance regarding information on the location of or potential for the presence of historic resources can be sought from the State Historic Preservation Officer or Tribal Historic Preservation Officer, as appropriate, and the National Register of Historic Places (see 33 CFR 330.4(g)). When reviewing pre-construction notifications, district engineers will comply with the current procedures for addressing the requirements of Section 106 of the National Historic Preservation Act. The district engineer shall make a reasonable and good faith effort to carry out appropriate identification efforts, which may include background research, consultation, oral history interviews, sample field investigation, and field survey. Based on the information submitted and these efforts, the district engineer shall determine whether the proposed activity has the potential to cause an effect on the historic properties. Where the non-Federal applicant has identified historic properties on which the activity may have the potential to cause effects and so notified the Corps, the non-Federal applicant shall not begin the activity until notified by the district engineer either that the activity has no potential to cause effects or that consultation under Section 106 of the NHPA has been completed.

(d) The district engineer will notify the prospective permittee within 45 days of receipt of a complete pre-construction notification whether NHPA Section 106 consultation is required. Section 106 consultation is not required when the Corps determines that the activity does not have the potential to cause effects on historic properties (see 36 CFR §800.3(a)). If NHPA

section 106 consultation is required and will occur, the district engineer will notify the non-Federal applicant that he or she cannot begin work until Section 106 consultation is completed. If the non-Federal applicant has not heard back from the Corps within 45 days, the applicant must still wait for notification from the Corps.

(e) Prospective permittees should be aware that section 110k of the NHPA (16 U.S.C. 470h-2(k)) prevents the Corps from granting a permit or other assistance to an applicant who, with intent to avoid the requirements of Section 106 of the NHPA, has intentionally significantly adversely affected a historic property to which the permit would relate, or having legal power to prevent it, allowed such significant adverse effect to occur, unless the Corps, after consultation with the Advisory Council on Historic Preservation (ACHP), determines that circumstances justify granting such assistance despite the adverse effect created or permitted by the applicant. If circumstances justify granting the assistance, the Corps is required to notify the ACHP and provide documentation specifying the circumstances, the degree of damage to the integrity of any historic properties affected, and proposed mitigation. This documentation must include any views obtained from the applicant, SHPO/THPO, appropriate Indian tribes if the undertaking occurs on or affects historic properties on tribal lands or affects properties of interest to those tribes, and other parties known to have a legitimate interest in the impacts to the permitted activity on historic properties.

21. Discovery of Previously Unknown Remains and Artifacts. If you discover any previously unknown historic, cultural or archeological remains and artifacts while accomplishing the activity authorized by this permit, you must immediately notify the district engineer of what you have found, and to the maximum extent practicable, avoid construction activities that may affect the remains and artifacts until the required coordination has been completed. The district engineer will initiate the Federal, Tribal and state coordination required to determine if the items or remains warrant a recovery effort or if the site is eligible for listing in the National Register of Historic Places.

22. Designated Critical Resource Waters. Critical resource waters include, NOAA-managed marine sanctuaries and marine monuments, and National Estuarine Research Reserves. The district engineer may designate, after notice and opportunity for public comment, additional waters officially designated by a state as having particular environmental or ecological significance, such as outstanding national resource waters or state natural heritage sites. The district engineer may also designate additional critical resource waters after notice and opportunity for public comment.

(a) Discharges of dredged or fill material into waters of the United States are not authorized by NWPs 7, 12, 14, 16, 17, 21, 29, 31, 35, 39, 40, 42, 43, 44, 49, 50, 51, and 52 for any activity within, or directly affecting, critical resource waters, including wetlands adjacent to such waters.

(b) For NWPs 3, 8, 10, 13, 15, 18, 19, 22, 23, 25, 27, 28, 30, 33, 34, 36, 37, and 38, notification is required in accordance with general condition 31, for any activity proposed in the designated critical resource waters including wetlands adjacent to those waters. The district engineer may authorize activities under these NWPs only after it is determined that the impacts to the critical resource waters will be no more than minimal.

23. Mitigation. The district engineer will consider the following factors when determining appropriate and practicable mitigation necessary to ensure that adverse effects on the aquatic environment are minimal:

(a) The activity must be designed and constructed to avoid and minimize adverse effects, both temporary and permanent, to waters of the United States to the maximum extent practicable at the project site (i.e., on site).

(b) Mitigation in all its forms (avoiding, minimizing, rectifying, reducing, or compensating for resource losses) will be required to the extent necessary to ensure that the adverse effects to the aquatic environment are minimal.

(c) Compensatory mitigation at a minimum one-for-one ratio will be required for all wetland losses that exceed 1/10-acre and require pre-construction notification, unless the district engineer determines in writing that either some other form of mitigation would be more environmentally appropriate or the adverse effects of the proposed activity are minimal, and provides a project-specific waiver of this requirement. For wetland losses of 1/10-acre or less that require pre-construction notification, the district engineer may determine on a case-by-case basis that compensatory mitigation is required to ensure that the activity results in minimal adverse effects on the aquatic environment. Compensatory mitigation projects provided to offset losses of aquatic resources must comply with the applicable provisions of 33 CFR part 332.

(1) The prospective permittee is responsible for proposing an appropriate compensatory mitigation option if compensatory mitigation is necessary to ensure that the activity results in minimal adverse effects on the aquatic environment.

(2) Since the likelihood of success is greater and the impacts to potentially valuable uplands are reduced, wetland restoration should be the first compensatory mitigation option considered.

(3) If permittee-responsible mitigation is the proposed option, the prospective permittee is responsible for submitting a mitigation plan. A conceptual or detailed mitigation plan may be used by the district engineer to make the decision on the NWP verification request, but a final mitigation plan that addresses the applicable requirements of 33 CFR 332.4(c)(2) – (14) must be approved by the district engineer before the permittee begins work in waters of the United States, unless the district engineer determines that prior approval of the final mitigation plan is not practicable or not necessary to ensure timely completion of the required compensatory mitigation (see 33 CFR 332.3(k)(3)).

(4) If mitigation bank or in-lieu fee program credits are the proposed option, the mitigation plan only needs to address the baseline conditions at the impact site and the number of credits to be provided.

(5) Compensatory mitigation requirements (e.g., resource type and amount to be provided as compensatory mitigation, site protection, ecological performance standards, monitoring requirements) may be addressed through conditions added to the NWP authorization, instead of components of a compensatory mitigation plan.

(d) For losses of streams or other open waters that require pre-construction notification, the district engineer may require compensatory mitigation, such as stream rehabilitation, enhancement, or preservation, to ensure that the activity results in minimal adverse effects on the aquatic environment.

(e) Compensatory mitigation will not be used to increase the acreage losses allowed by the acreage limits of the NWPs. For example, if an NWP has an acreage limit of 1/2-acre, it cannot be used to authorize any project resulting in the loss of greater than 1/2-acre of waters of

the United States, even if compensatory mitigation is provided that replaces or restores some of the lost waters. However, compensatory mitigation can and should be used, as necessary, to ensure that a project already meeting the established acreage limits also satisfies the minimal impact requirement associated with the NWP.

(f) Compensatory mitigation plans for projects in or near streams or other open waters will normally include a requirement for the restoration or establishment, maintenance, and legal protection (e.g., conservation easements) of riparian areas next to open waters. In some cases, riparian areas may be the only compensatory mitigation required. Riparian areas should consist of native species. The width of the required riparian area will address documented water quality or aquatic habitat loss concerns. Normally, the riparian area will be 25 to 50 feet wide on each side of the stream, but the district engineer may require slightly wider riparian areas to address documented water quality or habitat loss concerns. If it is not possible to establish a riparian area on both sides of a stream, or if the waterbody is a lake or coastal waters, then restoring or establishing a riparian area along a single bank or shoreline may be sufficient. Where both wetlands and open waters exist on the project site, the district engineer will determine the appropriate compensatory mitigation (e.g., riparian areas and/or wetlands compensation) based on what is best for the aquatic environment on a watershed basis. In cases where riparian areas are determined to be the most appropriate form of compensatory mitigation, the district engineer may waive or reduce the requirement to provide wetland compensatory mitigation for wetland losses.

(g) Permittees may propose the use of mitigation banks, in-lieu fee programs, or separate permittee-responsible mitigation. For activities resulting in the loss of marine or estuarine resources, permittee-responsible compensatory mitigation may be environmentally preferable if there are no mitigation banks or in-lieu fee programs in the area that have marine or estuarine credits available for sale or transfer to the permittee. For permittee-responsible mitigation, the special conditions of the NWP verification must clearly indicate the party or parties responsible for the implementation and performance of the compensatory mitigation project, and, if required, its long-term management.

(h) Where certain functions and services of waters of the United States are permanently adversely affected, such as the conversion of a forested or scrub-shrub wetland to a herbaceous wetland in a permanently maintained utility line right-of-way, mitigation may be required to reduce the adverse effects of the project to the minimal level.

24. Safety of Impoundment Structures. To ensure that all impoundment structures are safely designed, the district engineer may require non-Federal applicants to demonstrate that the structures comply with established state dam safety criteria or have been designed by qualified persons. The district engineer may also require documentation that the design has been independently reviewed by similarly qualified persons, and appropriate modifications made to ensure safety.

25. Water Quality. Where States and authorized Tribes, or EPA where applicable, have not previously certified compliance of an NWP with CWA Section 401, individual 401 Water Quality Certification must be obtained or waived (see 33 CFR 330.4(c)). The district engineer or State or Tribe may require additional water quality management measures to ensure that the authorized activity does not result in more than minimal degradation of water quality.

26. Coastal Zone Management. In coastal states where an NWP has not previously received a state coastal zone management consistency concurrence, an individual state coastal zone management consistency concurrence must be obtained, or a presumption of concurrence must occur (see 33 CFR 330.4(d)). The district engineer or a State may require additional measures to ensure that the authorized activity is consistent with state coastal zone management requirements.

27. Regional and Case-By-Case Conditions. The activity must comply with any regional conditions that may have been added by the Division Engineer (see 33 CFR 330.4(e)) and with any case specific conditions added by the Corps or by the state, Indian Tribe, or U.S. EPA in its section 401 Water Quality Certification, or by the state in its Coastal Zone Management Act consistency determination.

28. Use of Multiple Nationwide Permits. The use of more than one NWP for a single and complete project is prohibited, except when the acreage loss of waters of the United States authorized by the NWPs does not exceed the acreage limit of the NWP with the highest specified acreage limit. For example, if a road crossing over tidal waters is constructed under NWP 14, with associated bank stabilization authorized by NWP 13, the maximum acreage loss of waters of the United States for the total project cannot exceed 1/3-acre.

29. Transfer of Nationwide Permit Verifications. If the permittee sells the property associated with a nationwide permit verification, the permittee may transfer the nationwide permit verification to the new owner by submitting a letter to the appropriate Corps district office to validate the transfer. A copy of the nationwide permit verification must be attached to the letter, and the letter must contain the following statement and signature:

“When the structures or work authorized by this nationwide permit are still in existence at the time the property is transferred, the terms and conditions of this nationwide permit, including any special conditions, will continue to be binding on the new owner(s) of the property. To validate the transfer of this nationwide permit and the associated liabilities associated with compliance with its terms and conditions, have the transferee sign and date below.”

(Transferee)

(Date)

- * 30. Compliance Certification. Each permittee who receives an NWP verification letter from the Corps must provide a signed certification documenting completion of the authorized activity and any required compensatory mitigation. The success of any required permittee-responsible mitigation, including the achievement of ecological performance standards, will be addressed separately by the district engineer. The Corps will provide the permittee the certification document with the NWP verification letter. The certification document will include:

- (a) A statement that the authorized work was done in accordance with the NWP authorization, including any general, regional, or activity-specific conditions;
- (b) A statement that the implementation of any required compensatory mitigation was completed in accordance with the permit conditions. If credits from a mitigation bank or in-lieu fee program are used to satisfy the compensatory mitigation requirements, the certification must include the documentation required by 33 CFR 332.3(l)(3) to confirm that the permittee secured the appropriate number and resource type of credits; and
- (c) The signature of the permittee certifying the completion of the work and mitigation.

* 31. Pre-Construction Notification. (a) Timing. Where required by the terms of the NWP, the prospective permittee must notify the district engineer by submitting a pre-construction notification (PCN) as early as possible. The district engineer must determine if the PCN is complete within 30 calendar days of the date of receipt and, if the PCN is determined to be incomplete, notify the prospective permittee within that 30 day period to request the additional information necessary to make the PCN complete. The request must specify the information needed to make the PCN complete. As a general rule, district engineers will request additional information necessary to make the PCN complete only once. However, if the prospective permittee does not provide all of the requested information, then the district engineer will notify the prospective permittee that the PCN is still incomplete and the PCN review process will not commence until all of the requested information has been received by the district engineer. The prospective permittee shall not begin the activity until either:

- (1) He or she is notified in writing by the district engineer that the activity may proceed under the NWP with any special conditions imposed by the district or division engineer; or
- (2) 45 calendar days have passed from the district engineer's receipt of the complete PCN and the prospective permittee has not received written notice from the district or division engineer. However, if the permittee was required to notify the Corps pursuant to general condition 18 that listed species or critical habitat might be affected or in the vicinity of the project, or to notify the Corps pursuant to general condition 20 that the activity may have the potential to cause effects to historic properties, the permittee cannot begin the activity until receiving written notification from the Corps that there is "no effect" on listed species or "no potential to cause effects" on historic properties; or that any consultation required under Section 7 of the Endangered Species Act (see 33 CFR 330.4(f)) and/or Section 106 of the National Historic Preservation (see 33 CFR 330.4(g)) has been completed. Also, work cannot begin under NWPs 21, 49, or 50 until the permittee has received written approval from the Corps. If the proposed activity requires a written waiver to exceed specified limits of an NWP, the permittee may not begin the activity until the district engineer issues the waiver. If the district or division engineer notifies the permittee in writing that an individual permit is required within 45 calendar days of receipt of a complete PCN, the permittee cannot begin the activity until an individual permit has been obtained. Subsequently, the permittee's right to proceed under the NWP may be modified, suspended, or revoked only in accordance with the procedure set forth in 33 CFR 330.5(d)(2).

(b) Contents of Pre-Construction Notification: The PCN must be in writing and include the following information:

- (1) Name, address and telephone numbers of the prospective permittee;
- (2) Location of the proposed project;

(3) A description of the proposed project; the project's purpose; direct and indirect adverse environmental effects the project would cause, including the anticipated amount of loss of water of the United States expected to result from the NWP activity, in acres, linear feet, or other appropriate unit of measure; any other NWP(s), regional general permit(s), or individual permit(s) used or intended to be used to authorize any part of the proposed project or any related activity. The description should be sufficiently detailed to allow the district engineer to determine that the adverse effects of the project will be minimal and to determine the need for compensatory mitigation. Sketches should be provided when necessary to show that the activity complies with the terms of the NWP. (Sketches usually clarify the project and when provided results in a quicker decision. Sketches should contain sufficient detail to provide an illustrative description of the proposed activity (e.g., a conceptual plan), but do not need to be detailed engineering plans);

(4) The PCN must include a delineation of wetlands, other special aquatic sites, and other waters, such as lakes and ponds, and perennial, intermittent, and ephemeral streams, on the project site. Wetland delineations must be prepared in accordance with the current method required by the Corps. The permittee may ask the Corps to delineate the special aquatic sites and other waters on the project site, but there may be a delay if the Corps does the delineation, especially if the project site is large or contains many waters of the United States. Furthermore, the 45 day period will not start until the delineation has been submitted to or completed by the Corps, as appropriate;

(5) If the proposed activity will result in the loss of greater than 1/10-acre of wetlands and a PCN is required, the prospective permittee must submit a statement describing how the mitigation requirement will be satisfied, or explaining why the adverse effects are minimal and why compensatory mitigation should not be required. As an alternative, the prospective permittee may submit a conceptual or detailed mitigation plan.

(6) If any listed species or designated critical habitat might be affected or is in the vicinity of the project, or if the project is located in designated critical habitat, for non-Federal applicants the PCN must include the name(s) of those endangered or threatened species that might be affected by the proposed work or utilize the designated critical habitat that may be affected by the proposed work. Federal applicants must provide documentation demonstrating compliance with the Endangered Species Act; and

(7) For an activity that may affect a historic property listed on, determined to be eligible for listing on, or potentially eligible for listing on, the National Register of Historic Places, for non-Federal applicants the PCN must state which historic property may be affected by the proposed work or include a vicinity map indicating the location of the historic property. Federal applicants must provide documentation demonstrating compliance with Section 106 of the National Historic Preservation Act.

(c) Form of Pre-Construction Notification: The standard individual permit application form (Form ENG 4345) may be used, but the completed application form must clearly indicate that it is a PCN and must include all of the information required in paragraphs (b)(1) through (7) of this general condition. A letter containing the required information may also be used.

(d) Agency Coordination: (1) The district engineer will consider any comments from Federal and state agencies concerning the proposed activity's compliance with the terms and conditions of the NWPs and the need for mitigation to reduce the project's adverse environmental effects to a minimal level.

(2) For all NWP activities that require pre-construction notification and result in the loss of greater than 1/2-acre of waters of the United States, for NWP 21, 29, 39, 40, 42, 43, 44, 50, 51, and 52 activities that require pre-construction notification and will result in the loss of greater than 300 linear feet of intermittent and ephemeral stream bed, and for all NWP 48 activities that require pre-construction notification, the district engineer will immediately provide (e.g., via e-mail, facsimile transmission, overnight mail, or other expeditious manner) a copy of the complete PCN to the appropriate Federal or state offices (U.S. FWS, state natural resource or water quality agency, EPA, State Historic Preservation Officer (SHPO) or Tribal Historic Preservation Office (THPO), and, if appropriate, the NMFS). With the exception of NWP 37, these agencies will have 10 calendar days from the date the material is transmitted to telephone or fax the district engineer notice that they intend to provide substantive, site-specific comments. The comments must explain why the agency believes the adverse effects will be more than minimal. If so contacted by an agency, the district engineer will wait an additional 15 calendar days before making a decision on the pre-construction notification. The district engineer will fully consider agency comments received within the specified time frame concerning the proposed activity's compliance with the terms and conditions of the NWPs, including the need for mitigation to ensure the net adverse environmental effects to the aquatic environment of the proposed activity are minimal. The district engineer will provide no response to the resource agency, except as provided below. The district engineer will indicate in the administrative record associated with each pre-construction notification that the resource agencies' concerns were considered. For NWP 37, the emergency watershed protection and rehabilitation activity may proceed immediately in cases where there is an unacceptable hazard to life or a significant loss of property or economic hardship will occur. The district engineer will consider any comments received to decide whether the NWP 37 authorization should be modified, suspended, or revoked in accordance with the procedures at 33 CFR 330.5.

(3) In cases of where the prospective permittee is not a Federal agency, the district engineer will provide a response to NMFS within 30 calendar days of receipt of any Essential Fish Habitat conservation recommendations, as required by Section 305(b)(4)(B) of the Magnuson-Stevens Fishery Conservation and Management Act.

(4) Applicants are encouraged to provide the Corps with either electronic files or multiple copies of pre-construction notifications to expedite agency coordination.

D. District Engineer's Decision

1. In reviewing the PCN for the proposed activity, the district engineer will determine whether the activity authorized by the NWP will result in more than minimal individual or cumulative adverse environmental effects or may be contrary to the public interest. For a linear project, this determination will include an evaluation of the individual crossings to determine whether they individually satisfy the terms and conditions of the NWP(s), as well as the cumulative effects caused by all of the crossings authorized by NWP. If an applicant requests a waiver of the 300 linear foot limit on impacts to intermittent or ephemeral streams or of an otherwise applicable limit, as provided for in NWPs 13, 21, 29, 36, 39, 40, 42, 43, 44, 50, 51 or 52, the district engineer will only grant the waiver upon a written determination that the NWP activity will result in minimal adverse effects. When making minimal effects determinations the district engineer will consider the direct and indirect effects caused by the NWP activity. The district engineer will also consider site specific factors, such as the environmental setting in the

vicinity of the NWP activity, the type of resource that will be affected by the NWP activity, the functions provided by the aquatic resources that will be affected by the NWP activity, the degree or magnitude to which the aquatic resources perform those functions, the extent that aquatic resource functions will be lost as a result of the NWP activity (e.g., partial or complete loss), the duration of the adverse effects (temporary or permanent), the importance of the aquatic resource functions to the region (e.g., watershed or ecoregion), and mitigation required by the district engineer. If an appropriate functional assessment method is available and practicable to use, that assessment method may be used by the district engineer to assist in the minimal adverse effects determination. The district engineer may add case-specific special conditions to the NWP authorization to address site-specific environmental concerns.

2. If the proposed activity requires a PCN and will result in a loss of greater than 1/10-acre of wetlands, the prospective permittee should submit a mitigation proposal with the PCN. Applicants may also propose compensatory mitigation for projects with smaller impacts. The district engineer will consider any proposed compensatory mitigation the applicant has included in the proposal in determining whether the net adverse environmental effects to the aquatic environment of the proposed activity are minimal. The compensatory mitigation proposal may be either conceptual or detailed. If the district engineer determines that the activity complies with the terms and conditions of the NWP and that the adverse effects on the aquatic environment are minimal, after considering mitigation, the district engineer will notify the permittee and include any activity-specific conditions in the NWP verification the district engineer deems necessary. Conditions for compensatory mitigation requirements must comply with the appropriate provisions at 33 CFR 332.3(k). The district engineer must approve the final mitigation plan before the permittee commences work in waters of the United States, unless the district engineer determines that prior approval of the final mitigation plan is not practicable or not necessary to ensure timely completion of the required compensatory mitigation. If the prospective permittee elects to submit a compensatory mitigation plan with the PCN, the district engineer will expeditiously review the proposed compensatory mitigation plan. The district engineer must review the proposed compensatory mitigation plan within 45 calendar days of receiving a complete PCN and determine whether the proposed mitigation would ensure no more than minimal adverse effects on the aquatic environment. If the net adverse effects of the project on the aquatic environment (after consideration of the compensatory mitigation proposal) are determined by the district engineer to be minimal, the district engineer will provide a timely written response to the applicant. The response will state that the project can proceed under the terms and conditions of the NWP, including any activity-specific conditions added to the NWP authorization by the district engineer.

3. If the district engineer determines that the adverse effects of the proposed work are more than minimal, then the district engineer will notify the applicant either: (a) That the project does not qualify for authorization under the NWP and instruct the applicant on the procedures to seek authorization under an individual permit; (b) that the project is authorized under the NWP subject to the applicant's submission of a mitigation plan that would reduce the adverse effects on the aquatic environment to the minimal level; or (c) that the project is authorized under the NWP with specific modifications or conditions. Where the district engineer determines that mitigation is required to ensure no more than minimal adverse effects occur to the aquatic environment, the activity will be authorized within the 45-day PCN period, with activity-specific

conditions that state the mitigation requirements. The authorization will include the necessary conceptual or detailed mitigation or a requirement that the applicant submit a mitigation plan that would reduce the adverse effects on the aquatic environment to the minimal level. When mitigation is required, no work in waters of the United States may occur until the district engineer has approved a specific mitigation plan or has determined that prior approval of a final mitigation plan is not practicable or not necessary to ensure timely completion of the required compensatory mitigation.

FURTHER INFORMATION

1. District Engineers have authority to determine if an activity complies with the terms and conditions of an NWP.
2. NWPs do not obviate the need to obtain other federal, state, or local permits, approvals, or authorizations required by law.
3. NWPs do not grant any property rights or exclusive privileges.
4. NWPs do not authorize any injury to the property or rights of others.
5. NWPs do not authorize interference with any existing or proposed Federal project.

DEFINITIONS

Best management practices (BMPs): Policies, practices, procedures, or structures implemented to mitigate the adverse environmental effects on surface water quality resulting from development. BMPs are categorized as structural or non-structural.

Compensatory mitigation: The restoration (re-establishment or rehabilitation), establishment (creation), enhancement, and/or in certain circumstances preservation of aquatic resources for the purposes of offsetting unavoidable adverse impacts which remain after all appropriate and practicable avoidance and minimization has been achieved.

Currently serviceable: Useable as is or with some maintenance, but not so degraded as to essentially require reconstruction.

Direct effects: Effects that are caused by the activity and occur at the same time and place.

Discharge: The term “discharge” means any discharge of dredged or fill material.

Enhancement: The manipulation of the physical, chemical, or biological characteristics of an aquatic resource to heighten, intensify, or improve a specific aquatic resource function(s). Enhancement results in the gain of selected aquatic resource function(s), but may also lead to a decline in other aquatic resource function(s). Enhancement does not result in a gain in aquatic resource area.

Ephemeral stream: An ephemeral stream has flowing water only during, and for a short duration after, precipitation events in a typical year. Ephemeral stream beds are located above the water table year-round. Groundwater is not a source of water for the stream. Runoff from rainfall is the primary source of water for stream flow.

Establishment (creation): The manipulation of the physical, chemical, or biological characteristics present to develop an aquatic resource that did not previously exist at an upland site. Establishment results in a gain in aquatic resource area.

High Tide Line: The line of intersection of the land with the water’s surface at the maximum height reached by a rising tide. The high tide line may be determined, in the absence

of actual data, by a line of oil or scum along shore objects, a more or less continuous deposit of fine shell or debris on the foreshore or berm, other physical markings or characteristics, vegetation lines, tidal gages, or other suitable means that delineate the general height reached by a rising tide. The line encompasses spring high tides and other high tides that occur with periodic frequency but does not include storm surges in which there is a departure from the normal or predicted reach of the tide due to the piling up of water against a coast by strong winds such as those accompanying a hurricane or other intense storm.

Historic Property: Any prehistoric or historic district, site (including archaeological site), building, structure, or other object included in, or eligible for inclusion in, the National Register of Historic Places maintained by the Secretary of the Interior. This term includes artifacts, records, and remains that are related to and located within such properties. The term includes properties of traditional religious and cultural importance to an Indian tribe or Native Hawaiian organization and that meet the National Register criteria (36 CFR part 60).

Independent utility: A test to determine what constitutes a single and complete non-linear project in the Corps regulatory program. A project is considered to have independent utility if it would be constructed absent the construction of other projects in the project area. Portions of a multi-phase project that depend upon other phases of the project do not have independent utility. Phases of a project that would be constructed even if the other phases were not built can be considered as separate single and complete projects with independent utility.

Indirect effects: Effects that are caused by the activity and are later in time or farther removed in distance, but are still reasonably foreseeable.

Intermittent stream: An intermittent stream has flowing water during certain times of the year, when groundwater provides water for stream flow. During dry periods, intermittent streams may not have flowing water. Runoff from rainfall is a supplemental source of water for stream flow.

Loss of waters of the United States: Waters of the United States that are permanently adversely affected by filling, flooding, excavation, or drainage because of the regulated activity. Permanent adverse effects include permanent discharges of dredged or fill material that change an aquatic area to dry land, increase the bottom elevation of a waterbody, or change the use of a waterbody. The acreage of loss of waters of the United States is a threshold measurement of the impact to jurisdictional waters for determining whether a project may qualify for an NWP; it is not a net threshold that is calculated after considering compensatory mitigation that may be used to offset losses of aquatic functions and services. The loss of stream bed includes the linear feet of stream bed that is filled or excavated. Waters of the United States temporarily filled, flooded, excavated, or drained, but restored to pre-construction contours and elevations after construction, are not included in the measurement of loss of waters of the United States. Impacts resulting from activities eligible for exemptions under Section 404(f) of the Clean Water Act are not considered when calculating the loss of waters of the United States.

Non-tidal wetland: A non-tidal wetland is a wetland that is not subject to the ebb and flow of tidal waters. The definition of a wetland can be found at 33 CFR 328.3(b). Non-tidal wetlands contiguous to tidal waters are located landward of the high tide line (i.e., spring high tide line).

Open water: For purposes of the NWPs, an open water is any area that in a year with normal patterns of precipitation has water flowing or standing above ground to the extent that an ordinary high water mark can be determined. Aquatic vegetation within the area of standing or

flowing water is either non-emergent, sparse, or absent. Vegetated shallows are considered to be open waters. Examples of “open waters” include rivers, streams, lakes, and ponds.

Ordinary High Water Mark: An ordinary high water mark is a line on the shore established by the fluctuations of water and indicated by physical characteristics, or by other appropriate means that consider the characteristics of the surrounding areas (see 33 CFR 328.3(e)).

Perennial stream: A perennial stream has flowing water year-round during a typical year. The water table is located above the stream bed for most of the year. Groundwater is the primary source of water for stream flow. Runoff from rainfall is a supplemental source of water for stream flow.

Practicable: Available and capable of being done after taking into consideration cost, existing technology, and logistics in light of overall project purposes.

Pre-construction notification: A request submitted by the project proponent to the Corps for confirmation that a particular activity is authorized by nationwide permit. The request may be a permit application, letter, or similar document that includes information about the proposed work and its anticipated environmental effects. Pre-construction notification may be required by the terms and conditions of a nationwide permit, or by regional conditions. A pre-construction notification may be voluntarily submitted in cases where pre-construction notification is not required and the project proponent wants confirmation that the activity is authorized by nationwide permit.

Preservation: The removal of a threat to, or preventing the decline of, aquatic resources by an action in or near those aquatic resources. This term includes activities commonly associated with the protection and maintenance of aquatic resources through the implementation of appropriate legal and physical mechanisms. Preservation does not result in a gain of aquatic resource area or functions.

Re-establishment: The manipulation of the physical, chemical, or biological characteristics of a site with the goal of returning natural/historic functions to a former aquatic resource. Re-establishment results in rebuilding a former aquatic resource and results in a gain in aquatic resource area and functions.

Rehabilitation: The manipulation of the physical, chemical, or biological characteristics of a site with the goal of repairing natural/historic functions to a degraded aquatic resource. Rehabilitation results in a gain in aquatic resource function, but does not result in a gain in aquatic resource area.

Restoration: The manipulation of the physical, chemical, or biological characteristics of a site with the goal of returning natural/historic functions to a former or degraded aquatic resource. For the purpose of tracking net gains in aquatic resource area, restoration is divided into two categories: re-establishment and rehabilitation.

Riffle and pool complex: Riffle and pool complexes are special aquatic sites under the 404(b)(1) Guidelines. Riffle and pool complexes sometimes characterize steep gradient sections of streams. Such stream sections are recognizable by their hydraulic characteristics. The rapid movement of water over a coarse substrate in riffles results in a rough flow, a turbulent surface, and high dissolved oxygen levels in the water. Pools are deeper areas associated with riffles. A slower stream velocity, a streaming flow, a smooth surface, and a finer substrate characterize pools.

Riparian areas: Riparian areas are lands adjacent to streams, lakes, and estuarine-marine shorelines. Riparian areas are transitional between terrestrial and aquatic ecosystems, through

which surface and subsurface hydrology connects riverine, lacustrine, estuarine, and marine waters with their adjacent wetlands, non-wetland waters, or uplands. Riparian areas provide a variety of ecological functions and services and help improve or maintain local water quality. (See general condition 23.)

Shellfish seeding: The placement of shellfish seed and/or suitable substrate to increase shellfish production. Shellfish seed consists of immature individual shellfish or individual shellfish attached to shells or shell fragments (i.e., spat on shell). Suitable substrate may consist of shellfish shells, shell fragments, or other appropriate materials placed into waters for shellfish habitat.

Single and complete linear project: A linear project is a project constructed for the purpose of getting people, goods, or services from a point of origin to a terminal point, which often involves multiple crossings of one or more waterbodies at separate and distant locations. The term “single and complete project” is defined as that portion of the total linear project proposed or accomplished by one owner/developer or partnership or other association of owners/developers that includes all crossings of a single water of the United States (i.e., a single waterbody) at a specific location. For linear projects crossing a single or multiple waterbodies several times at separate and distant locations, each crossing is considered a single and complete project for purposes of NWP authorization. However, individual channels in a braided stream or river, or individual arms of a large, irregularly shaped wetland or lake, etc., are not separate waterbodies, and crossings of such features cannot be considered separately.

Single and complete non-linear project: For non-linear projects, the term “single and complete project” is defined at 33 CFR 330.2(i) as the total project proposed or accomplished by one owner/developer or partnership or other association of owners/developers. A single and complete non-linear project must have independent utility (see definition of “independent utility”). Single and complete non-linear projects may not be “piecemealed” to avoid the limits in an NWP authorization.

Stormwater management: Stormwater management is the mechanism for controlling stormwater runoff for the purposes of reducing downstream erosion, water quality degradation, and flooding and mitigating the adverse effects of changes in land use on the aquatic environment.

Stormwater management facilities: Stormwater management facilities are those facilities, including but not limited to, stormwater retention and detention ponds and best management practices, which retain water for a period of time to control runoff and/or improve the quality (i.e., by reducing the concentration of nutrients, sediments, hazardous substances and other pollutants) of stormwater runoff.

Stream bed: The substrate of the stream channel between the ordinary high water marks. The substrate may be bedrock or inorganic particles that range in size from clay to boulders. Wetlands contiguous to the stream bed, but outside of the ordinary high water marks, are not considered part of the stream bed.

Stream channelization: The manipulation of a stream’s course, condition, capacity, or location that causes more than minimal interruption of normal stream processes. A channelized stream remains a water of the United States.

Structure: An object that is arranged in a definite pattern of organization. Examples of structures include, without limitation, any pier, boat dock, boat ramp, wharf, dolphin, weir, boom, breakwater, bulkhead, revetment, riprap, jetty, artificial island, artificial reef, permanent

mooring structure, power transmission line, permanently moored floating vessel, piling, aid to navigation, or any other manmade obstacle or obstruction.

Tidal wetland: A tidal wetland is a wetland (i.e., water of the United States) that is inundated by tidal waters. The definitions of a wetland and tidal waters can be found at 33 CFR 328.3(b) and 33 CFR 328.3(f), respectively. Tidal waters rise and fall in a predictable and measurable rhythm or cycle due to the gravitational pulls of the moon and sun. Tidal waters end where the rise and fall of the water surface can no longer be practically measured in a predictable rhythm due to masking by other waters, wind, or other effects. Tidal wetlands are located channelward of the high tide line, which is defined at 33 CFR 328.3(d).

Vegetated shallows: Vegetated shallows are special aquatic sites under the 404(b)(1) Guidelines. They are areas that are permanently inundated and under normal circumstances have rooted aquatic vegetation, such as seagrasses in marine and estuarine systems and a variety of vascular rooted plants in freshwater systems.

Waterbody: For purposes of the NWP, a waterbody is a jurisdictional water of the United States. If a jurisdictional wetland is adjacent – meaning bordering, contiguous, or neighboring – to a waterbody determined to be a water of the United States under 33 CFR 328.3(a)(1)-(6), that waterbody and its adjacent wetlands are considered together as a single aquatic unit (see 33 CFR 328.4(c)(2)). Examples of “waterbodies” include streams, rivers, lakes, ponds, and wetlands.

Final Regional Conditions 2012

NOTICE ABOUT WEB LINKS IN THIS DOCUMENT:

The web links (both internal to our District and any external links to collaborating agencies) in this document are valid at the time of publication. However, the Wilmington District Regulatory Program web page addresses, as with other agency web sites, may change over the timeframe of the five-year Nationwide Permit renewal cycle, in response to policy mandates or technology advances. While we will make every effort to check on the integrity of our web links and provide re-direct pages whenever possible, we ask that you report any broken links to us so we can keep the page information current and usable. We apologize in advanced for any broken links that you may encounter, and we ask that you navigate from the regulatory home page (wetlands and stream permits) of the Wilmington District Corps of Engineers, to the "Permits" section of our web site to find links for pages that cannot be found by clicking directly on the listed web link in this document.

Final 2012 Regional Conditions for Nationwide Permits (NWP) in the Wilmington District

1.0 Excluded Waters

The Corps has identified waters that will be excluded from the use of all NWP's during certain timeframes. These waters are:

1.1 Anadromous Fish Spawning Areas

Waters of the United States identified by either the North Carolina Division of Marine Fisheries (NCDMF) or the North Carolina Wildlife Resources Commission (NCWRC) as anadromous fish spawning areas are excluded during the period between February 15 and June 30, without prior written approval from NCDMF or NCWRC and the Corps.

1.2 Trout Waters Moratorium

Waters of the United States in the twenty-five designated trout counties of North Carolina are excluded during the period between October 15 and April 15 without prior written approval from the NCWRC. (See Section 2.7 for a list of the twenty-five trout counties).

1.3 Sturgeon Spawning Areas as Designated by the National Marine Fisheries Service (NMFS)

Waters of the United States designated as sturgeon spawning areas are excluded during the period between February 1 and June 30, without prior written approval from the NMFS.

*** 2.0 Waters Requiring Additional Notification**

The Corps has identified waters that will be subject to additional notification requirements for activities authorized by all NWP's. These waters are:

*** 2.1 Western NC Counties that Drain to Designated Critical Habitat**

For proposed activities within Waters of the U.S. that require a Pre-Construction Notification pursuant to General Condition 31 (PCN) and are located in the sixteen counties listed below, applicants must provide a copy of the PCN to the US Fish and Wildlife Service, 160 Zillicoa Street, Asheville, North Carolina 28801. This PCN must be sent concurrently to the US Fish and Wildlife Service and the Corps Asheville Regulatory Field Office. Please see General Condition 18 for specific notification requirements related to Federally Endangered Species and the following website for information on the location of designated critical habitat.

Counties with tributaries that drain to designated critical habitat that require notification to the Asheville US Fish and Wildlife Service: Avery, Cherokee, Forsyth, Graham, Haywood, Henderson, Jackson, Macon Mecklenburg, Mitchell, Stokes, Surry, Swain, Transylvania, Union and Yancey.

Website and office addresses for Endangered Species Act Information:

The Wilmington District has developed the following website for applicants which provides guidelines on how to review linked websites and maps in order to fulfill NWP general condition 18 requirements: <http://www.saw.usace.army.mil/wetlands/ESA>

Applicants who do not have internet access may contact the appropriate US Fish and Wildlife Service offices listed below or the US Army Corps of Engineers at (910) 251- 4633:

US Fish and Wildlife Service
Asheville Field Office
160 Zillicoa Street
Asheville, NC 28801
Telephone: (828) 258-3939

Asheville US Fish and Wildlife Service Office counties: All counties west of and including Anson, Stanly, Davidson, Forsyth and Stokes Counties

US Fish and Wildlife Service
Raleigh Field Office
Post Office Box 33726
Raleigh, NC 27636-3726
Telephone: (919) 856-4520

Raleigh US Fish and Wildlife Service Office counties: all counties east of and including Richmond, Montgomery, Randolph, Guilford, and Rockingham Counties.

*** 2.2 Special Designation Waters**

Prior to the use of any NWP in any of the following identified waters and contiguous wetlands in North Carolina, applicants must comply with Nationwide Permit General Condition 31 (PCN). The North Carolina waters and contiguous wetlands that require additional notification requirements are:

“Outstanding Resource Waters” (ORW) or “High Quality Waters” (HQW) as designated by the North Carolina Environmental Management Commission; “Inland Primary Nursery Areas” (IPNA) as designated by the NCWRC; “Contiguous Wetlands” as defined by the North Carolina Environmental Management Commission; or “Primary Nursery Areas” (PNA) as designated by the North Carolina Marine Fisheries Commission.

2.3 Coastal Area Management Act (CAMA) Areas of Environmental Concern

Non-federal applicants for any NWP in a designated “Area of Environmental Concern” (AEC) in the twenty (20) counties of Eastern North Carolina covered by the North Carolina Coastal Area Management Act (CAMA) must also obtain the required CAMA permit. Development activities for non-federal projects may not commence until a copy of the approved CAMA permit is furnished to the appropriate Wilmington District Regulatory Field Office (Wilmington Field Office – 69 Darlington Avenue, Wilmington, NC 28403 or Washington Field Office – 2407 West 5th Street, Washington, NC 27889).

*** 2.4 Barrier Islands**

Prior to the use of any NWP on a barrier island of North Carolina, applicants must comply with Nationwide Permit General Condition 31 (PCN).

*** 2.5 Mountain or Piedmont Bogs**

Prior to the use of any NWP in a Bog classified by the North Carolina Wetland Assessment Methodology (NCWAM), applicants shall comply with Nationwide Permit General Condition 31 (PCN). The latest version of NCWAM is located on the NC DWQ web site at: <http://portal.ncdenr.org/web/wq/swp/ws/pdu/ncwam> .

*** 2.6 Animal Waste Facilities**

Prior to use of any NWP for construction of animal waste facilities in waters of the US, including wetlands, applicants shall comply with Nationwide Permit General Condition 31 (PCN).

*** 2.7 Trout Waters**

Prior to any discharge of dredge or fill material into streams or waterbodies within the twenty-five (25) designated trout counties of North Carolina, the applicant shall comply with Nationwide Permit General Condition 31 (PCN). The applicant shall also provide a copy of the notification to the appropriate NCWRC office to facilitate the determination of any potential

impacts to designated Trout Waters. Notification to the Corps of Engineers will include a statement with the name of the NCWRC biologist contacted, the date of the notification, the location of work, a delineation of wetlands, a discussion of alternatives to working in the mountain trout waters, why alternatives were not selected, and a plan to provide compensatory mitigation for all unavoidable adverse impacts to mountain trout waters.

NCWRC and NC Trout Counties

Western Piedmont Region Coordinator	Alleghany	Caldwell	Watauga
20830 Great Smoky Mtn. Expressway	Ashe	Mitchell	Wilkes
Waynesville, NC 28786	Avery	Stokes	
Telephone: (828) 452-2546	Burke	Surry	

Mountain Region Coordinator	Buncombe	Henderson	Polk
20830 Great Smoky Mtn. Expressway	Cherokee	Jackson	Rutherford
Waynesville, NC 28786	Clay	Macon	Swain
Telephone: (828) 452-2546	Graham	Madison	Transylvania
Fax: (828) 452-7772	Haywood	McDowell	Yancey

3.0 List of Corps Regional Conditions for All Nationwide Permits

The following conditions apply to all Nationwide Permits in the Wilmington District:

3.1 Limitation of Loss of Perennial Stream Bed

NWPs may not be used for activities that may result in the loss or degradation of greater than 300 total linear feet of perennial, intermittent or ephemeral stream, unless the District Commander has waived the 300 linear foot limit for ephemeral and intermittent streams on a case-by-case basis and he determines that the proposed activity will result in minimal individual and cumulative adverse impacts to the aquatic environment. Loss of stream includes the linear feet of stream bed that is filled, excavated, or flooded by the proposed activity. Waivers for the loss of ephemeral and intermittent streams must be in writing and documented by appropriate/accepted stream quality assessments*. This waiver only applies to the 300 linear feet threshold for NWPs.

*NOTE: Applicants should utilize the most current methodology prescribed by Wilmington District to assess stream function and quality. Information can be found at:

<http://www.saw.usace.army.mil/wetlands/permits/nwp/nwp2012> (see "Quick Links")

3.2 Mitigation for Loss of Stream Bed

For any NWP that results in a loss of more than 150 linear feet of perennial and/or ephemeral/intermittent stream, the applicant shall provide a mitigation proposal to compensate for more than minimal individual and cumulative adverse impacts to the aquatic environment. For stream losses less than 150 linear feet, that require a PCN, the District Commander may determine, on a case-by-case basis that compensatory mitigation is required to ensure that the activity results in minimal adverse effect on the aquatic environment.

3.3 Pre-construction Notification for Loss of Streambed Exceeding 150 Feet.

Prior to use of any NWP for any activity which impacts more than 150 total linear feet of perennial stream or ephemeral/ intermittent stream, the applicant must comply with Nationwide Permit General Condition 31 (PCN). This applies to NWPs that do not have specific notification requirements. If a NWP has specific notification requirements, the requirements of the NWP should be followed.

3.4 Restriction on Use of Live Concrete

For all NWPs which allow the use of concrete as a building material, live or fresh concrete, including bags of uncured concrete, may not come into contact with the water in or entering into waters of the US. Water inside coffer dams or casings that has been in contact with wet concrete shall only be returned to waters of the US when it is no longer poses a threat to aquatic organisms.

3.5 Requirements for Using Riprap for Bank Stabilization

For all NWPs that allow for the use of riprap material for bank stabilization, the following measures shall be applied:

3.5.1. Filter cloth must be placed underneath the riprap as an additional requirement of its use in North Carolina waters.

3.5.2. The placement of riprap shall be limited to the areas depicted on submitted work plan drawings.

3.5.3. The riprap material shall be clean and free from loose dirt or any pollutant except in trace quantities that would not have an adverse environmental effect.

3.5.4. It shall be of a size sufficient to prevent its movement from the authorized alignment by natural forces under normal conditions.


3.5.5. The riprap material shall consist of clean rock or masonry material such as, but not limited to, granite, marl, or broken concrete.

3.5.6. A waiver from the specifications in this Regional Condition may be requested in writing. The waiver will only be issued if it can be demonstrated that the impacts of complying with this Regional condition would result in greater adverse impacts to the aquatic environment.

3.6 Safe Passage Requirements for Culvert Placement

For all NWP's that involve the construction/installation of culverts, measures will be included in the construction/installation that will promote the safe passage of fish and other aquatic organisms. The dimension, pattern, and profile of the stream above and below a pipe or culvert should not be modified by widening the stream channel or by reducing the depth of the stream in connection with the construction activity. The width, height, and gradient of a proposed culvert should be such as to pass the average historical low flow and spring flow without adversely altering flow velocity. Spring flow should be determined from gage data, if available. In the absence of such data, bankfull flow can be used as a comparable level.

In the twenty (20) counties of North Carolina designated as coastal counties by the Coastal Area Management Act (CAMA): All pipes/culverts must be sufficiently sized to allow for the burial of the bottom of the pipe/culvert at least one foot below normal bed elevation when they are placed within the Public Trust Area of Environmental Concern (AEC) and/or the Estuarine Waters AEC as designated by CAMA, and/or all streams appearing as blue lines on United States Geological Survey (USGS) 7.5-minute quadrangle maps.

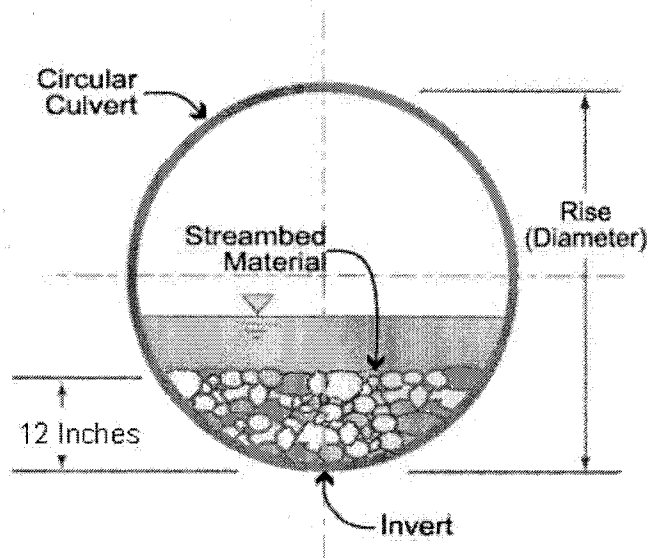

In all other counties: Culverts greater than 48 inches in diameter will be buried at least one foot below the bed of the stream. Culverts 48 inches in diameter or less shall be buried or placed on the stream bed as practicable and appropriate to maintain aquatic passage, and every effort shall be made to maintain the existing channel slope. The bottom of the culvert must be placed at a

depth below the natural stream bottom to provide for passage during drought or low flow conditions.

Culverts are to be designed and constructed in a manner that minimizes destabilization and head cutting. Destabilizing the channel and head cutting upstream should be considered and appropriate actions incorporated in the design and placement of the culvert.

A waiver from the depth specifications in this condition may be requested in writing. The waiver will be issued if it can be demonstrated that the proposal would result in the least impacts to the aquatic environment.

All counties: Culverts placed within riparian and/or riverine wetlands must be installed in a manner that does not restrict the flow and circulation patterns of waters of the United States. Culverts placed across wetland fills purely for the purposes of equalizing surface water do not have to be buried.

3.7 Notification to NCDENR Shellfish Sanitation Section

Applicants shall notify the NCDENR Shellfish Sanitation Section prior to dredging in or removing sediment from an area closed to shell fishing where the effluent may be released to an area open for shell fishing or swimming in order to avoid contamination from the disposal area and cause a temporary shellfish closure to be made. Such notification shall also be provided to the appropriate Corps of Engineers Regulatory Field Office. Any disposal of sand to the ocean beach should occur between November 1 and April 30 when recreational usage is low. Only clean sand should be used and no dredged sand from closed shell fishing areas may be used. If beach disposal were to occur at times other than stated above or if sand from a closed shell fishing area is to be used, a swimming advisory shall be posted, and a press release shall be issued by the permittee.

3.8 Preservation of Submerged Aquatic Vegetation

Adverse impacts to Submerged Aquatic Vegetation (SAV) are not authorized by any NWP within any of the twenty coastal counties defined by North Carolina's Coastal Area Management Act of 1974 (CAMA).

3.9 Sedimentation and Erosion Control Structures and Measures

3.9.1. All PCNs will identify and describe sedimentation and erosion control structures and measures proposed for placement in waters of the US. The structures and measures should be depicted on maps, surveys or drawings showing location and impacts to jurisdictional wetlands and streams.

4.0 NWP #23 – Approved Categorical Exclusions

No development activities authorized by this NWP may begin until the permittee obtains a consistency concurrence or a CAMA permit from the North Carolina Division of Coastal Management, if either is required.



North Carolina Department of Environment and Natural Resources


Division of Water Resources

Water Quality Programs

Thomas A. Reeder

Director

Pat McCrory
Governor

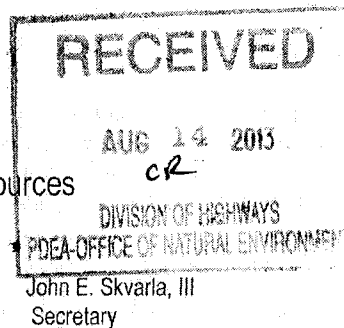

August 9, 2013
Beaufort County
DWR Project No. 20130649
TIP K-3800

APPROVAL of 401 WATER QUALITY CERTIFICATION and TAR-PAMLICO BUFFER AUTHORIZATION with ADDITIONAL CONDITIONS

Dr. Greg Thorpe, PhD., Manager
Project Development and Environmental Analysis
North Carolina Department of Transportation
1598 Mail Service Center
Raleigh, North Carolina, 27699-1598

Dear Dr. Thorpe:

You have our approval, in accordance with the conditions listed below, for the following impacts for the purpose of constructing a new rest area along US 17 near Chocowinity in Beaufort County:

Stream Impacts in the Tar-Pamlico Basin

Site:	Stream Permanent (linear ft)	Stream Temporary (linear ft)	Permanent Surface Water Impacts (ac)	Temporary Surface Water Impacts (ac)	Total Stream Impact (linear ft)	Stream Impacts Requiring Mitigation (linear ft)
1	128	30	<0.01	<0.01	158	128
2	141	30	<0.01	<0.01	171	141
TOTAL:	269	60	0.01	<0.01	329	269

Total Stream Impact: 329 linear feet

Buffer Impacts in the Tar-Pamlico Basin

Site:	Zone 1 Impact (sq ft)	minus Wetlands in Zone 1 (sq ft)	= Zone 1 Buffers (not wetlands) (sq ft)	Zone 1 Buffer Mitigation Required (using 3:1 ratio)	Zone 2 Impact (sq ft)	minus Wetlands in Zone 2 (sq ft)	= Zone 2 Buffers (not wetlands) (sq ft)	Zone 2 Buffer Mitigation Required (using 1.5:1 ratio)
1	5304	0	5304	15,912	3462	0	3462	5,193
2	6717	0	6717	20,151	4304	0	4304	6,456
3	0	0	0	0	981	0	981	1,472
Totals	12,021	0	12,021	36,063	8,747	0	8,747	13,121

Total buffer impacts: 20,768 sq ft. All buffer impacts are on the same stream. Impacts > 1/3 ac = mitigation required.

The project shall be constructed in accordance with your application dated received June 21, 2013. After reviewing your application, we have decided that these impacts are covered by General Water Quality Certification Number 3891. This certification corresponds to the Nationwide Permit 23 issued by the Corps of Engineers. This approval is also valid for the Tar-Pamlico Riparian Buffer Rules (15A NCAC 2B .0259). In addition, you should acquire any other federal, state or local permits before you proceed with your project including (but not limited to) Sediment and Erosion Control, Non-Discharge and Water Supply Watershed regulations. This approval will expire with the accompanying 404 permit.

This approval is valid solely for the purpose and design described in your application (unless modified below). Should your project change, you must notify the DWR and submit a new application. If the property is sold, the new owner must be given a copy of this Certification and approval letter, and is thereby responsible for complying with all the conditions. If total wetland fills for this project (now or in the future) exceed one acre, or of total impacts to streams (now or in the future) exceed 150 linear feet, compensatory mitigation may be required as described in 15A NCAC 2H .0506 (h) (6) and (7). Additionally, impacts to riparian buffers may require mitigation as described in 15A NCAC 2B .0259 (10) For this approval to remain valid, you must adhere to the conditions listed in the attached certification.

Project Specific Conditions

1. It is understood that you wish to perform on-site stream mitigation for the unavoidable impact to 269 linear feet of intermittent stream. The on-site stream mitigation proposal included in your application constitutes Enhancement Level II. Therefore, compensatory mitigation for impacts to 269 linear feet of stream is required at a replacement ratio of 1:1.5 or as directed by the U.S. Army Corps of Engineers per 15A NCAC 2H .0506(h)(1). The onsite stream mitigation shall be constructed in accordance with the design submitted in your June 19, 2013 application. All on-site mitigation sites shall be protected in perpetuity by a conservation easement or through NCDOT fee simple acquisition and recorded in the NCDOT Natural Environment Unit mitigation geodatabase. Please be reminded that as-builts for the completed streams shall be submitted to the North Carolina Division of Water Resources 401 Wetlands Unit with the as-builts for the rest of the project. If the parameters of this condition are not met, then the permittee shall supply additional stream mitigation for the 269 linear feet of impacts. To receive mitigation credit, a 50-foot wide native wooded buffer shall be planted on both sides of the stream unless otherwise authorized by this Certification.
2. Compensatory mitigation for impacts to 12,021 square feet of protected riparian buffers in Zone 1 and 8,747 square feet of protected riparian buffers in Zone 2 shall be required. In accordance with 15A NCAC 02B .0260(9) riparian vegetation reestablishment shall include a minimum of at least 2 native hardwood tree species planted at a density sufficient to provide 320 trees per acre at maturity. The planting plan you submitted with your application dated June 19, 2013 was not sufficient in meeting the required density. Submittal of a buffer restoration plan meeting the requirements of 15A NCAC 02B .0260 (9)(d) for approval by the Division is required prior to construction activities. All on-site mitigation sites shall be protected in perpetuity by a conservation easement or through NCDOT fee simple acquisition and recorded in the NCDOT Natural Environment Unit mitigation geodatabase.
3. The permittee shall monitor the stream and buffer mitigation site. Monitoring shall consist of visual review and viable stem counts. An annual report shall be submitted to NCDWQ for a period of 5 years showing monitoring results including: bank stability, survival rate/ success of tree and vegetation establishment, and that diffuse flow through the riparian buffer has been maintained. The first annual report shall be submitted within one year of final planting. Failure to achieve a buffer density of 320 trees per acre after 5 years will require the annual report to provide appropriate remedial actions to be implemented and a schedule for implementation. Approval of the final annual report, and a formal "close out" of the mitigation site by NCDWQ is required.

General Conditions

1. The issuance of this certification does not exempt the Permittee from complying with any and all statutes, rules, regulations, or ordinances that may be imposed by other government agencies (i.e. local, state, and federal) having jurisdiction, including but not limited to applicable buffer rules, stormwater management rules, soil erosion and sedimentation control requirements, etc.
- * 2. The Permittee shall ensure that the final design drawings adhere to the certification and to the drawings submitted for approval.
3. Unless otherwise approved in this certification, placement of culverts and other structures in open waters and streams shall be placed below the elevation of the streambed by one foot for all culverts with a diameter greater than 48 inches, and 20 percent of the culvert diameter for culverts having a diameter less than 48 inches, to allow low flow passage of water and aquatic life. Design and placement of culverts and other structures including temporary erosion control measures shall not be conducted in a manner that may result in dis-equilibrium of wetlands or streambeds or banks, adjacent to or upstream and downstream of the above structures. The applicant is required to provide evidence that the equilibrium is being maintained if requested in writing by


NCDWR. If this condition is unable to be met due to bedrock or other limiting features encountered during construction, please contact NCDWR for guidance on how to proceed and to determine whether or not a permit modification will be required.

4. If concrete is used during construction, a dry work area shall be maintained to prevent direct contact between curing concrete and stream water. Water that inadvertently contacts uncured concrete shall not be discharged to surface waters due to the potential for elevated pH and possible aquatic life and fish kills.
5. The use of rip-rap above the Normal High Water Mark shall be minimized. Any rip-rap placed for stream stabilization shall be placed in stream channels in such a manner that it does not impede aquatic life passage.
6. All fill slopes located in jurisdictional wetlands shall be placed at slopes no flatter than 3:1, unless otherwise authorized by this certification.
7. The outside buffer, wetland or water boundary located within the construction corridor approved by this certification shall be clearly marked by highly visible fencing prior to any land disturbing activities. Impacts to areas within the fencing are prohibited unless otherwise authorized by this certification.
8. During the construction of the project, no staging of equipment of any kind is permitted in waters of the U.S., or protected riparian buffers.
9. The dimension, pattern and profile of the stream above and below the crossing shall not be modified. Disturbed floodplains and streams shall be restored to natural geomorphic conditions.
10. Heavy equipment shall be operated from the banks rather than in the stream channel in order to minimize sedimentation and reduce the introduction of other pollutants into the stream.
11. All mechanized equipment operated near surface waters must be regularly inspected and maintained to prevent contamination of stream waters from fuels, lubricants, hydraulic fluids, or other toxic materials.
12. Erosion and sediment control practices must be in full compliance with all specifications governing the proper design, installation and operation and maintenance of such Best Management Practices in order to protect surface waters standards:
 - a. The erosion and sediment control measures for the project must be designed, installed, operated, and maintained in accordance with the most recent version of the *North Carolina Sediment and Erosion Control Planning and Design Manual*.
 - b. The design, installation, operation, and maintenance of the sediment and erosion control measures must be such that they equal, or exceed, the requirements specified in the most recent version of the *North Carolina Sediment and Erosion Control Manual*. The devices shall be maintained on all construction sites, borrow sites, and waste pile (spoil) projects, including contractor-owned or leased borrow pits associated with the project.
 - c. For borrow pit sites, the erosion and sediment control measures must be designed, installed, operated, and maintained in accordance with the most recent version of the *North Carolina Surface Mining Manual*.
 - d. The reclamation measures and implementation must comply with the reclamation in accordance with the requirements of the Sedimentation Pollution Control Act.
13. Sediment and erosion control measures shall not be placed in wetlands or waters unless otherwise approved by this Certification.
14. No rock, sand or other materials shall be dredged from the stream channel except where authorized by this certification.
15. Discharging hydroseed mixtures and washing out hydroseeders and other equipment in or adjacent to surface waters is prohibited.
16. Native riparian vegetation (ex: list trees and shrubs native to your geographic region) must be reestablished within the construction limits of the project by the end of the growing season following completion of construction.
17. There shall be no excavation from, or waste disposal into, jurisdictional wetlands or waters associated with this certification without appropriate modification. Should waste or borrow sites, or access roads to waste or borrow sites, be located in wetlands or streams, compensatory mitigation will be required since that is a direct impact from road construction activities.
18. All stormwater runoff shall be directed as sheetflow through stream buffers at nonerosive velocities, unless otherwise approved by this certification.

19. Pursuant to 15A NCAC 2B .0259(6), sediment and erosion control devices shall not be placed in Zone 1 of any Tar-Pamlico Buffer without prior approval by NCDWR. At this time, NCDWR has approved no sediment and erosion control devices in Zone 1, outside of the approved project impacts, anywhere on this project. Moreover, sediment and erosion control devices shall be allowed in Zone 2 of the buffers provided that Zone 1 is not compromised and that discharge is released as diffuse flow.
20. New roadside ditches must be in compliance with the nitrogen control and diffuse flow requirements outlined in 15A NCAC 2B .0259.
21. All riparian buffers impacted by the placement of temporary fill or clearing activities shall be restored to the preconstruction contours and revegetated. Maintained buffers shall be permanently revegetated with non-woody species by the end of the growing season following completion of construction. For the purpose of this condition, maintained buffer areas are defined as areas within the transportation corridor that will be subject to regular NCDOT maintenance activities including mowing. The area with non-maintained buffers shall be permanently revegetated with native woody species before the next growing season following completion of construction.
22. The permittee and its authorized agents shall conduct its activities in a manner consistent with State water quality standards (including any requirements resulting from compliance with §303(d) of the Clean Water Act) and any other appropriate requirements of State and Federal law. If DWR determines that such standards or laws are not being met (including the failure to sustain a designated or achieved use) or that State or federal law is being violated, or that further conditions are necessary to assure compliance, DWR may reevaluate and modify this certification.
23. The Permittee shall report any violations of this certification to the Division of Water Resources within 24 hours of discovery.
- *24. Upon completion of the project (including any impacts at associated borrow or waste site), the NCDOT Division Engineer shall complete and return the enclosed "Certification of Completion Form" to notify DWR when all work included in the 401 Certification has been completed.
25. A copy of this Water Quality Certification shall be maintained on site at the construction site at all times. In addition, the Water Quality Certification and all subsequent modifications, if any, shall be maintained with the Division Engineer and the on-site project manager.

If you do not accept any of the conditions of this certification, you may ask for an adjudicatory hearing. You must act within 60 days of the date that you receive this letter. To ask for a hearing, send a written petition that conforms to Chapter 150B of the North Carolina General Statutes to the Office of Administrative Hearings, 6714 Mail Service Center, Raleigh, N.C. 27699. This certification and its conditions are final and binding unless you ask for a hearing. This letter completes the review of the Division of Water Resources under Section 401 of the Clean Water Act. If you have any questions, please contact Garcy Ward at (252) 948-3922.

Sincerely,


for Thomas A. Reeder

Attachments (General Certification and Certificate of Completion form)

cc: Tom Steffens, US Army Corps of Engineers, Washington Field Office
Jay Johnson, NC DOT, Division 2
Sonia Carrillo, DWQ, Transportation Permitting Unit
File Copy

Water Quality Certification No. 3891

**GENERAL CERTIFICATION FOR PROJECTS ELIGIBLE FOR U.S. ARMY CORPS OF
ENGINEERS NATIONWIDE PERMIT NUMBER 23 (APPROVED CATEGORICAL
EXCLUSIONS) AND RIPARIAN AREA PROTECTION RULES (BUFFER RULES)**

Water Quality Certification Number 3891 is issued in conformity with the requirements of Section 401, Public Laws 92-500 and 95-217 of the United States and subject to the North Carolina Division of Water Quality Regulations in 15A NCAC 02H .0500 and 15A NCAC 02B .0200 for the discharge of fill material to waters and wetland areas as described in 33 CFR 330 Appendix A (B) (23) and for the Riparian Area Protection Rules (Buffer Rules) in 15A NCAC 02B .0200.

The category of activities shall include only Federally-approved Categorical Exclusion projects.

The State of North Carolina certifies that the specified category of activity will not violate applicable portions of Sections 301, 302, 303, 306 and 307 of the Public Laws 92-500 and 95-217 if conducted in accordance with the conditions hereinafter set forth.

Activities meeting any one (1) of the following thresholds or circumstances require *written approval* for a 401 Water Quality Certification from the Division of Water Quality (the "Division"):

- a) Stream impacts (temporary or permanent) equal or greater than 40 linear feet; or
 - b) Any stream relocation; or
 - c) Impacts equal to or greater than one-tenth (1/10) acre of wetlands or open waters; or
 - d) Any impacts to wetlands adjacent to waters designated as: ORW, SA, WS-I, WS-II, or Trout, or wetlands contiguous to waters designated as a North Carolina or National Wild and Scenic River.
 - e) Any impacts to coastal wetlands [15A NCAC 7H .0205], or Unique Wetlands (UWL) [15A NCAC 2H .0506].
 - f) Any impact associated with a Notice of Violation or an enforcement action for violation(s) of DWQ Wetland Rules (15A NCAC 02H .0500), Isolated Wetland Rules (15A NCAC 02H .1300), DWQ Surface Water or Wetland Standards, or Riparian Buffer Rules (15A NCAC 02B .0200); or
 - * g) Any impacts to streams and/or buffers in the Neuse, Tar-Pamlico, or Catawba River Basins or in the Randleman, Jordan or Goose Creek Watersheds (or any other basin or watershed with Riparian Area Protection Rules [Buffer Rules] in effect at the time of application) *unless* the activities are listed as "EXEMPT" from these rules or a Buffer Authorization Certificate is issued through N.C. Division of Coastal Management (DCM) delegation for "ALLOWABLE" activities.
- * In accordance with North Carolina General Statute 143-215.3D(e), written approval for a 401 Water Quality General Certification must include the appropriate fee. If a project also requires a CAMA Permit, then one payment to both agencies shall be submitted and will be the higher of the two fees.

Activities included in this General Certification that do not meet one of the thresholds listed above do not require written approval from the Division as long as they comply with the Conditions of Certification listed below. If any of these Conditions cannot be met, then written approval from the Division is required.

Conditions of Certification:

1. No Impacts Beyond those Authorized in the Written Approval or Beyond the Threshold of Use of this Certification

No waste, spoil, solids, or fill of any kind shall occur in wetlands, waters, or riparian areas beyond the footprint of the impacts depicted in the Pre-Construction Notification, as

Water Quality Certification No. 3891

authorized in the written approval from the Division or beyond the thresholds established for use of this Certification without written authorization, including incidental impacts. All construction activities, including the design, installation, operation, and maintenance of sediment and erosion control Best Management Practices shall be performed so that no violations of state water quality standards, statutes, or rules occur. Approved plans and specifications for this project are incorporated by reference and are enforceable parts of this permit.

2. Standard Erosion and Sediment Control Practices

Erosion and sediment control practices must be in full compliance with all specifications governing the proper design, installation and operation and maintenance of such Best Management Practices and if applicable, comply with the specific conditions and requirements of the NPDES Construction Stormwater Permit issued to the site:

- a. Design, installation, operation, and maintenance of the sediment and erosion control measures must be such that they equal or exceed the requirements specified in the most recent version of the *North Carolina Sediment and Erosion Control Manual*. The devices shall be maintained on all construction sites, borrow sites, and waste pile (spoil) projects, including contractor-owned or leased borrow pits associated with the project.
- b. For borrow pit sites, the erosion and sediment control measures must be designed, installed, operated, and maintained in accordance with the most recent version of the *North Carolina Surface Mining Manual*.
- c. Reclamation measures and implementation must comply with the reclamation in accordance with the requirements of the Sedimentation Pollution Control Act and the Mining Act of 1971.
- d. Sufficient materials required for stabilization and/or repair of erosion control measures and stormwater routing and treatment shall be on site at all times.
- e. If the project occurs in waters or watersheds classified as Primary Nursery Areas (PNAs), SA, WS-I, WS-II, High Quality (HQW), or Outstanding Resource (ORW) waters, then the sedimentation and erosion control designs must comply with the requirements set forth in 15A NCAC 04B .0124, *Design Standards in Sensitive Watersheds*.

3. No Sediment and Erosion Control Measures in Wetlands or Waters

Sediment and erosion control measures shall not be placed in wetlands or waters. Exceptions to this condition require application submittal to and written approval by the Division. If placement of sediment and erosion control devices in wetlands and waters is unavoidable, then design and placement of temporary erosion control measures shall not be conducted in a manner that may result in dis-equilibrium of wetlands, stream beds, or banks, adjacent to or upstream and downstream of the above structures. All sediment and erosion control devices shall be removed and the natural grade restored within two (2) months of the date that the Division of Land Resources (DLR) or locally delegated program has released the specific area within the project.

4. Construction Stormwater Permit NCG010000

Water Quality Certification No. 3891

An NPDES Construction Stormwater Permit is required for construction projects that disturb one (1) or more acres of land. This Permit allows stormwater to be discharged during land disturbing construction activities as stipulated in the conditions of the permit. If your project is covered by this permit, full compliance with permit conditions including the erosion & sedimentation control plan, inspections and maintenance, self-monitoring, record keeping and reporting requirements is required. A copy of the general permit (NCG010000), inspection log sheets, and other information may be found at <http://portal.ncdenr.org/web/wq/ws/su/npdessw#tab-w>.

The North Carolina Department of Transportation (NCDOT) shall be required to be in full compliance with the conditions related to construction activities within the most recent version of their individual NPDES (NCS000250) stormwater permit.

5. Construction Moratoriums and Coordination

If activities must occur during periods of high biological activity (i.e. sea turtle nesting, fish spawning, or bird nesting), then biological monitoring may be required at the request of other state or federal agencies and coordinated with these activities.

All moratoriums on construction activities established by the NC Wildlife Resources Commission (WRC), US Fish and Wildlife Service (USFWS), NC Division of Marine Fisheries (DMF), or National Marine Fisheries Service (NMFS) to lessen impacts on trout, anadromous fish, larval/post-larval fishes and crustaceans, or other aquatic species of concern shall be implemented. Exceptions to this condition require written approval by the resource agency responsible for the given moratorium.

Work within the twenty-five (25) designated trout counties or identified state or federal endangered or threatened species habitat shall be coordinated with the appropriate WRC, USFWS, NMFS, and/or DMF personnel.

6. Work in the Dry

All work in or adjacent to stream waters shall be conducted so that the flowing stream does not come in contact with the disturbed area. Approved best management practices from the most current version of the NC Sediment and Erosion Control Manual, or the NC DOT Construction and Maintenance Activities Manual, such as sandbags, rock berms, cofferdams, and other diversion structures shall be used to minimize excavation in flowing water. Exceptions to this condition require application submittal to and written approval by the Division.

7. Riparian Area Protection (Buffer) Rules

Activities located in the protected riparian areas (whether jurisdictional wetlands or not), within the Neuse, Tar-Pamlico, or Catawba River Basins or in the Randleman, Jordan, or Goose Creek Watersheds (or any other basin or watershed with buffer rules) shall be limited to "uses" identified within and constructed in accordance with 15A NCAC 02B .0233, .0259, .0243, .0250, .0267 and .0605, and shall be located, designed, constructed, and maintained to have minimal disturbance to protect water quality to the maximum extent practicable through the use of best management practices. All buffer rule requirements, including diffuse flow requirements, must be met.

8. If concrete is used during the construction, then all necessary measures shall be taken to prevent direct contact between uncured or curing concrete and waters of the state. Water that inadvertently contacts uncured concrete shall not be discharged to waters of the state due to the potential for elevated pH and possible aquatic life/ fish kills.

Water Quality Certification No. 3891

9. Bridge deck drains shall not discharge directly into the stream. Stormwater shall be directed across the bridge and pre-treated through site-appropriate means (grassed swales, pre-formed scour holes, vegetated buffers, etc.) before entering the stream. Please refer to the most current version of *Stormwater Best Management Practices*. Exceptions to this condition require written approval by the Division.
10. Relocated stream designs should include the same dimensions, patterns, and profiles as the existing channel (or a stable reference reach if the existing channel is unstable), to the maximum extent practical. The new channel should be constructed in the dry and water shall not be turned into the new channel until the banks are stabilized. Vegetation used for bank stabilization shall be limited to native woody species, and should include establishment of a 30-foot wide wooded and an adjacent 20-foot wide vegetated buffer on both sides of the relocated channel to the maximum extent practical. A transitional phase incorporating appropriate erosion control matting materials and seedling establishment is allowable, however matting that incorporates plastic mesh and/or plastic twine shall not be used in wetlands, riparian buffers or floodplains as recommended by the North Carolina Sediment and Erosion Control Manual. Rip-rap, A-Jacks, concrete, gabions or other hard structures may be allowed if it is necessary to maintain the physical integrity of the stream; however, the applicant must provide written justification and any calculations used to determine the extent of rip-rap coverage. Please note that if the stream relocation is conducted as a stream restoration as defined in the US Army Corps of Engineers Wilmington District, April 2003 *Stream Mitigation Guidelines* (or its subsequent updates), the restored length may be used as compensatory mitigation for the impacts resulting from the relocation.

11. Placement of Culverts and Other Structures in Waters and Wetlands

Culverts required for this project shall be designed and installed in such a manner that the original stream profiles are not altered and allow for aquatic life movement during low flows. Existing stream dimensions (including the cross section dimensions, pattern, and longitudinal profile) must be maintained above and below locations of each culvert.

Placement of culverts and other structures in waters and streams must be below the elevation of the streambed by one foot for all culverts with a diameter greater than 48 inches, and 20 percent of the culvert diameter for culverts having a diameter less than or equal to 48 inches, to allow low flow passage of water and aquatic life.

When topographic constraints indicate culvert slopes of greater than 5%, culvert burial is not required, provided that all alternative options for flattening the slope have been investigated and aquatic life movement/ connectivity has been provided when possible (rock ladders, crossvanes, etc). Notification to the Division including supporting documentation to include a location map of the culvert, culvert profile drawings, and slope calculations shall be provided to the Division 60 days prior to the installation of the culvert.

When bedrock is present in culvert locations, culvert burial is not required provided that there is sufficient documentation of the presence of bedrock. Notification to the Division including supporting documentation such as, but not limited to, a location map of the culvert, geotechnical reports, photographs, etc shall be provided to the Division a minimum of 60 days prior to the installation of the culvert. If bedrock is discovered during construction, then the Division shall be notified by phone or email within 24 hours of discovery.

If other site-specific topographic constraints preclude the ability to bury the culverts as described above and/or it can be demonstrated that burying the culvert would result in destabilization of the channel, then exceptions to this condition require application submittal to, and written approval by, the Division of Water Quality, regardless of the total impacts to streams or wetlands from the project.

Water Quality Certification No. 3891

Installation of culverts in wetlands must ensure continuity of water movement and be designed to adequately accommodate high water or flood conditions. Additionally, when roadways, causeways, or other fill projects are constructed across FEMA-designated floodways or wetlands, openings such as culverts or bridges must be provided to maintain the natural hydrology of the system as well as prevent constriction of the floodway that may result in destabilization of streams or wetlands.

The establishment of native, woody vegetation and other soft stream bank stabilization techniques must be used where practicable instead of riprap or other bank hardening methods.

* 12. Compensatory Mitigation

In accordance with 15A NCAC 02H .0506 (h), compensatory mitigation may be required for losses of equal to or greater than 150 linear feet of streams (intermittent and perennial) and/or equal to or greater than one (1) acre of wetlands. For linear public transportation projects, impacts equal to or exceeding 150 linear feet per stream shall require mitigation.

Buffer mitigation may be required for any project with Buffer Rules in effect at the time of application for activities classified as "Allowable with Mitigation" or "Prohibited" within the Table of Uses.

A determination of buffer, wetland, and stream mitigation requirements shall be made for any General Water Quality Certification for this Nationwide and/or Regional General Permit. Design and monitoring protocols shall follow the US Army Corps of Engineers Wilmington District *Stream Mitigation Guidelines* (April 2003) or its subsequent updates. Compensatory mitigation plans shall be submitted to the Division for written approval as required in those protocols. The mitigation plan must be implemented and/or constructed before any impacts occur on site. Alternatively, the Division will accept payment into an in-lieu fee program or a mitigation bank. In these cases, proof of payment shall be provided to the Division before any impacts occur on site.

- * 13. If an environmental document is required under the National or State Environmental Policy Act (NEPA or SEPA), then this General Certification is not valid until a Finding of No Significant Impact (FONSI) or Record of Decision (ROD) is issued by the State Clearinghouse.
- 14. In the twenty (20) coastal counties, the appropriate DWQ Regional Office must be contacted to determine if Coastal Stormwater Regulations will be required.
- 15. This General Certification does not relieve the applicant of the responsibility to obtain all other required Federal, State, or Local approvals.
- 16. The applicant/permittee and their authorized agents shall conduct all activities in a manner consistent with State water quality standards (including any requirements resulting from compliance with §303(d) of the Clean Water Act), and any other appropriate requirements of State and Federal Law. If the Division determines that such standards or laws are not being met, including failure to sustain a designated or achieved use, or that State or Federal law is being violated, or that further conditions are necessary to assure compliance, then the Division may reevaluate and modify this General Water Quality Certification.

Water Quality Certification No. 3891

- * 17. When written authorization is required for use of this certification, upon completion of all permitted impacts included within the approval and any subsequent modifications, the applicant shall be required to return the certificate of completion attached to the approval. One copy of the certificate shall be sent to the DWQ Central Office in Raleigh at 1650 Mail Service Center, Raleigh, NC, 27699-1650.
18. Additional site-specific conditions, including monitoring and/or modeling requirements, may be added to the written approval letter for projects proposed under this Water Quality Certification in order to ensure compliance with all applicable water quality and effluent standards.
19. This certification grants permission to the director, an authorized representative of the Director, or DENR staff, upon the presentation of proper credentials, to enter the property during normal business hours.

This General Certification shall expire on the same day as the expiration date of the corresponding Nationwide and/or Regional General Permit. The conditions in effect on the date of issuance of Certification for a specific project shall remain in effect for the life of the project, regardless of the expiration date of this Certification.

Non-compliance with or violation of the conditions herein set forth by a specific project may result in revocation of this General Certification for the project and may also result in criminal and/or civil penalties.

The Director of the North Carolina Division of Water Quality may require submission of a formal application for Individual Certification for any project in this category of activity if it is determined that the project is likely to have a significant adverse effect upon water quality, including state or federally listed endangered or threatened aquatic species, or degrade the waters so that existing uses of the wetland or downstream waters are precluded.

Public hearings may be held for specific applications or group of applications prior to a Certification decision if deemed in the public's best interest by the Director of the North Carolina Division of Water Quality.

Effective date: March 19, 2012

DIVISION OF WATER QUALITY

By



Charles Wakild, P.E.

Director

History Note: Water Quality Certification (WQC) Number 3891 issued March 19, 2012 replaces WQC 3701 issued November 1, 2007; WQC Number 3632 issued March 2007; WQC Number 3403 issued March 2003; WQC Number 3361 issued March 18, 2002; WQC Number 3107 issued February 11, 1997; WQC Number 2734 issued May 1 1993; and WQC Number 2670 issued on January 21, 1992. This General Certification is rescinded when the Corps of Engineers reauthorizes any of the corresponding Nationwide and/or Regional General Permits or when deemed appropriate by the Director of the Division of Water Quality.




North Carolina Department of Environment and Natural Resources

Division of Water Resources

Thomas A. Reeder

Director

Pat McCrory
Governor

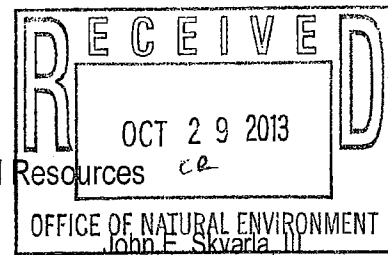

Secretary

October 22, 2013

Mr. Bob Holman
NCDOT
1598 MSC
Raleigh, NC 27699-1598

CERTIFIED MAIL
RETURN RECEIPT REQUESTED
7011 1570 0000 6989 3717

Subject: CCPCUA Permit No. CU4031
NCDOT – K-3800
Beaufort County

Dear Mr. Holman:

In accordance with your application dated September 9, 2013 and associated documentation, we are forwarding Permit No. CU4031 for water use in the Central Coastal Plain Capacity Use Area in Beaufort County. This permit allow for the withdrawal of water for the purpose of mine dewatering.

Enclosed with this package are forms DWR CCPCUA-4 and DWR CCPCUA-6. Form DWR CCPCUA-4 is for reporting water withdrawals, in accordance with Sections I. C. and IV. A. of your permit. Form DWR CCPCUA-6 is for reporting ground water levels, in accordance with Sections II. B. and IV. B. of your permit.

If you are not already doing so, DWR requests you submit your monthly water withdrawal and water level information using our online system. By doing so you will not need to mail the Division a signed hard copy. The CCPCUA online permit renewal application, water withdrawal and levels reporting forms are at:

<http://www.ncwater.org/CCPCUAreportonline>

If you do not have internet access then please make as many copies as necessary and send forms on a monthly basis to the address on the top of the forms.

This permit is effective from the date of issuance until October 31, 2018, and is subject to the conditions and/or limitations contained therein. In order for this permit to continue uninterrupted, please apply for permit renewal at least three (3) months before the expiration date.

Sincerely,


Nathaniel C. Wilson, Chief
Ground Water Management Branch

**North Carolina
Environmental Management Commission
Department of Environment and Natural Resources**

**Permit For The Withdrawal And Use Of Water
In The Central Coastal Plain Capacity Use Area**

In accordance with the provisions of Part 2, Article 21 of Chapter 143, General Statutes of North Carolina as amended, and any other applicable Laws, Rules and Regulations,

Permission Is Hereby Granted To

NC Department of Transportation

Project No. K-3800
US 17 Rest Area

FOR THE

Withdrawal and Use of Water in Beaufort County, North Carolina in accordance with the grantee's application dated September 9, 2013, and any supporting data submitted with the application, all of which are filed with the Department of Environment and Natural Resources and are considered part of this Permit.

This Permit shall be effective from the date of its issuance until October 31, 2018, and shall be subject to the specified conditions and/or limitations contained in Sections I - X of this Permit.

Permit issued this the 22nd day of October, 2013 .

NORTH CAROLINA ENVIRONMENTAL MANAGEMENT COMMISSION

BY



**Thomas A. Reeder
Director, Division of Water Resources**

By Authority of the Secretary of the Department of Environment and Natural Resources

PERMIT #CU4031

I. WITHDRAWALS

A. USE

This Permit allows the withdrawal of water for the purpose of dewatering borrow pits to extract material for road construction.

B. RATES OF WITHDRAWALS

The maximum quantity of water that may be withdrawn shall not exceed what is established in the Reclamation Plan as specified in NCDOT's CCPCUA Special Provisions document.

C. SOURCE(s) OF WITHDRAWALS

Ground Water Source(s): Withdrawals shall be made from sumps in borrow pits in the surficial aquifer.

D. MONITORING OF WITHDRAWALS

Withdrawals from each source, whether well or sump, shall be measured by an approved metering device equipped with a totalizing indicator, and having an accuracy within plus or minus five percent.

II. WATER LEVELS

A. MAXIMUM DRAWDOWN LEVELS

1. Pump intakes for the well(s) shall not be set below the depth specified in the permit application or associated documentation without prior approval of the Division of Water Resources.
2. In the event that data from the permitted wells or other wells within the zone influenced by pumping of the permitted wells indicates a deterioration of quality or quantity in surrounding aquifers or the source aquifer, an alternate maximum pumping level may be established by the Division of Water Resources.

B. MONITORING OF WATER LEVELS

1. The pumping water level in each supply well shall be measured once a month:
 - a. by a steel or electric tape from a fixed reference point, or by using the air-line method
 - b. within accuracy limits of plus or minus one percent,
 - c. just prior to shutting off the pump, or after sufficient time of pumping, so that a maximum drawdown may be obtained, and
 - d. during the last planned pumping day of the month, or within the last five days of the month.

2. The static water level in each supply well shall be measured once a month:
 - a. by a steel or electric tape from a fixed reference point, or by using the air-line method
 - b. within accuracy limits of plus or minus one percent,
 - c. after the pump is shut off for approximately 12 hours, and
 - d. within the last five days of the month.
3. Unused supply wells or other suitable wells that may be available shall be monitored when such monitoring is specified by the Division of Water Resources and when pertinent to observation or evaluation of the effects of withdrawals made under this permit.

III. OTHER PROVISIONS

A. WELL CONSTRUCTION APPROVAL

A Well Construction Permit shall be required prior to the construction of any well that will be used to withdraw any portion of the water regulated under this Permit. Application for these permits must be submitted to the Washington Regional Office, Division of Water Quality, P.O. Box 2188, Washington, NC 27889.

B. ACCESS TO FACILITIES

The Environmental Management Commission and employees of the Department of Environment and Natural Resources shall have reasonable access to areas owned and under control of the permittee for observation and inspection of water use and related facilities pertinent to the provisions of this permit and other regulations.

IV. REPORTS REQUIRED

A. WITHDRAWALS

Monthly reports of daily withdrawal totals from each well or sump shall be furnished to the Division on a quarterly basis, within 30 days after the end of March, June, September and December.

B. WATER LEVELS

Water level measurements for each supply well shall be measured in accordance with Condition II. B. 1. of this permit and submitted to the Division not later than 30 days after the end of the calendar month in which the measurement was taken.

V. MODIFICATION OR REVOCATION

A. MODIFICATION

1. The Permittee must notify the Director of any proposed major changes in usage and apply for a modification of the permit for such changes or for any revisions of the terms of this permit.
2. The Director may modify the terms of the permit, after 60 days written notice to the permittee, if he finds that the terms of the permit and/or the resulting water use are found to be contrary to the purposes of the Water Use Act of 1967 or contrary to public interest or having an unreasonably adverse effect upon other water uses in the capacity use area. Modifications may include, but are not limited to, requirements for alternate pumping levels or the collection, analysis, and reporting of ground or surface water quality samples.

B. REVOCATION

The Director may revoke the permit if he finds that:

1. the Permittee has violated the terms of the permit; or
2. the terms of the Permit and/or the resulting water use are contrary to the purpose of the Water Use Act of 1967 or contrary to the public interest or having an unreasonably adverse effect upon other water uses in the capacity use area and cannot be cured by modification; or
3. the Permittee made false or fraudulent statements in the application for the water use permit; or
4. water withdrawn under the terms of the permit is used for purposes other than those set forth in the permit.

VI. CONSTRUCTION OF PERMIT

- A. The terms and conditions shall not be construed to relieve the Permittee of any legal obligation or liability, which it owes or may incur to third parties as the result of the conduct of its operations in conformity with this Permit.
- B. When under the terms hereof, any provision of this Permit requires approval of the Department or becomes effective at the discretion of the Department, the notice of approval or the exercise of such discretion shall be evidenced by written instrument issued by the Department.
- C. The terms and conditions of this Permit shall not be construed as a limitation of the powers, duties, and authority vested in the Environmental Management Commission or any other State, Federal, or local agency, or any applicable laws hereafter enacted.

VII. ADDITIONAL CONDITIONS

- A. This Permit shall be subject to any limitations or conditions in other State permits, including but not limited to permits required pursuant to North Carolina General Statutes §143-215.1.
- B. Issuance of this Permit shall have no bearing on subsequent State decision(s) regarding any other water use or other permit application(s) submitted or which may be submitted by the Permittee, its successors or assigns.
- C. Compliance with the terms and conditions in this permit does not relieve the permittee of compliance with any provision, now in force or hereafter enacted or promulgated, of the Water Use Act of 1967, the regulations promulgated thereunder, or any other provision of State law.

VIII. PENALTIES

Violations of the terms and conditions of this Permit are subject to penalties as set forth in North Carolina General Statutes §143-215.17.

IX. PERMIT NONTRANSFERABLE

Water Use Permits shall not be transferred except with approval of the Environmental Management Commission.

X. RENEWAL OF PERMIT

The Permittee, at least three (3) months prior to the expiration of this permit, shall request its extension. Upon receipt of the request, the Commission will review the adequacy of the facilities described therein, and if warranted, will extend the permit for such period of time and under such conditions and limitations as it may deem appropriate.

**Report of
Water Withdrawals**
from Each Source

North Carolina Department of Environment and Natural Resources

Mail To: Division of Water Resources - NC DENR
1611 Mail Service Center
Raleigh, North Carolina 27699-1611
Attention : Capacity Use Administration

Check Box If No Use This Month ☐

For month of: _____ Year: _____ Facility: **NCDOT (K-3800)** Permit #: **CU4031** Sheet _____ of _____

Well/Sump ID	meter readings	gallons per day	meter readings	gallons per day	meter readings	gallons per day	Total Withdrawn
Previous Month's Last Day reading							
Day 1							
Day 2							
Day 3							
Day 4							
Day 5							
Day 6							
Day 7							
Day 8							
Day 9							
Day 10							
Day 11							
Day 12							
Day 13							
Day 14							
Day 15							
Day 16							
Day 17							
Day 18							
Day 19							
Day 20							
Day 21							
Day 22							
Day 23							
Day 24							
Day 25							
Day 26							
Day 27							
Day 28							
Day 29							
Day 30							
Day 31							

DWR CCPCUA-4

Name: _____

Signature: _____

Date: _____

North Carolina Department Of Environmental and Natural Resources

Report of Weekly or Monthly Water Levels Pumping (P) and (S)

Mail to: Division of Water Resources- NC DENR
1611 Mail Service Center
Raleigh, NC 27699-1611
Attention: Capacity Use Administration

Name: _____

Signature: _____

Date: _____

Month _____ Year _____ Facility Name: NCDOT (K-3800) Permit #: CU4031 Sheet # _____ of _____

Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____			
Date	Time	Feet Below Land Surface	P or S	Date	Time	Feet Below Land Surface	P or S

Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____			
Date	Time	Feet Below Land Surface	P or S	Date	Time	Feet Below Land Surface	P or S

Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____		Well ID _____ Land Surface Elev. (ft) _____			
Date	Time	Feet Below Land Surface	P or S	Date	Time	Feet Below Land Surface	P or S

DWR CCPCUA-6

State land surface elevations and depths below land surface to the nearest 0.1 feet.

US 17 Rest Area Onsite Stream and Buffer Mitigation Plan
Beaufort County
K-3800
WBS 38748.1.1

The proposed roadway project, K-3800, is to construct a new rest area along US 17 in Beaufort County. The project is located on the east side of US 17 at the intersection with Harding Road, south of Chocowinity. NCDOT proposes to provide onsite mitigation by restoring an estimated 815 feet of intermittent stream, preserving 623 feet of stream, and restoring 81,457.2 sq. feet of buffer on site. Mitigation is required for 269 feet of intermittent stream impact (1:1 ratio) and 961 sq. feet of Zone 2 buffer impact (1.5:1 ratio). This will leave approximately 546 feet of intermittent stream restoration, 623 feet of stream preservation, and 80,015.7 sq. feet of buffer mitigation assets available subject to agency approval.

Existing Conditions

The project site is approximately 20 acres and consists mainly of agricultural fields. The intermittent channel enters the southern end of the site through a culvert under Harding Road, flowing generally northward through the agricultural field for 1000 feet. The channel flows for 600 feet in a small wooded area before exiting the northern end of the site. A ditch carrying flow from US 17 enters the site from the west and flows directly into the channel 650 feet downstream of Harding Road.

The channel was determined to be jurisdictional approximately 50 feet downstream of the culvert under Harding Road. The channel is 1 – 2 feet wide at the base and highly incised. The channel has been straightened, dredged, and regularly mowed in the past for agricultural purposes.

The primary degrading factors of the channel are direct runoff from the agricultural field, mowing of the buffer, and dredging of the channel. Even though the channel is incised, the banks are not experiencing major erosion, most likely due to the heavy herbaceous growth, lack of flow in the channel and lack of direct impacts to the bank.

Proposed Conditions

NCDOT proposes to restore the intermittent channel to more natural conditions by removing the degrading factors on the site.

The proposed design removes the agricultural inputs into the channel and redirects flow away from the channel through a fore bay and stormwater retention system. The flow will exit the stormwater system over a berm and sheetflow through a vegetated buffer before entering the channel. The ditch carrying flow from US 17 will also be redirected into a 250 feet grassed swale before entering the channel.


Localized spots of erosion along the channel banks will be stabilized during construction. The banks will be planted on 4 foot centers with a mix of silky dogwood and buttonbush livestakes. The buffer areas on both sides of the channel will be planted on 20 foot centers with 3 to 5 gallon containerized trees from a mix of cherrybark oak, sycamore, green ash, and willow oak.

Monitoring and Success Criteria


NCDOT shall monitor the site by visual observation and photo points for survival and aerial cover of vegetation. NCDOT shall monitor the site for a minimum of three years or until the site is deemed successful. Monitoring will be initiated upon completion of the site planting.

Long term Management

The site will be removed from agricultural use and protected in perpetuity in its restored state. The site will be held by NCDOT and placed on the NES mitigation geodatabase. Once monitoring is completed and the site is closed out, it will be managed according to NCDOT's Stewardship process for long term maintenance and protection.

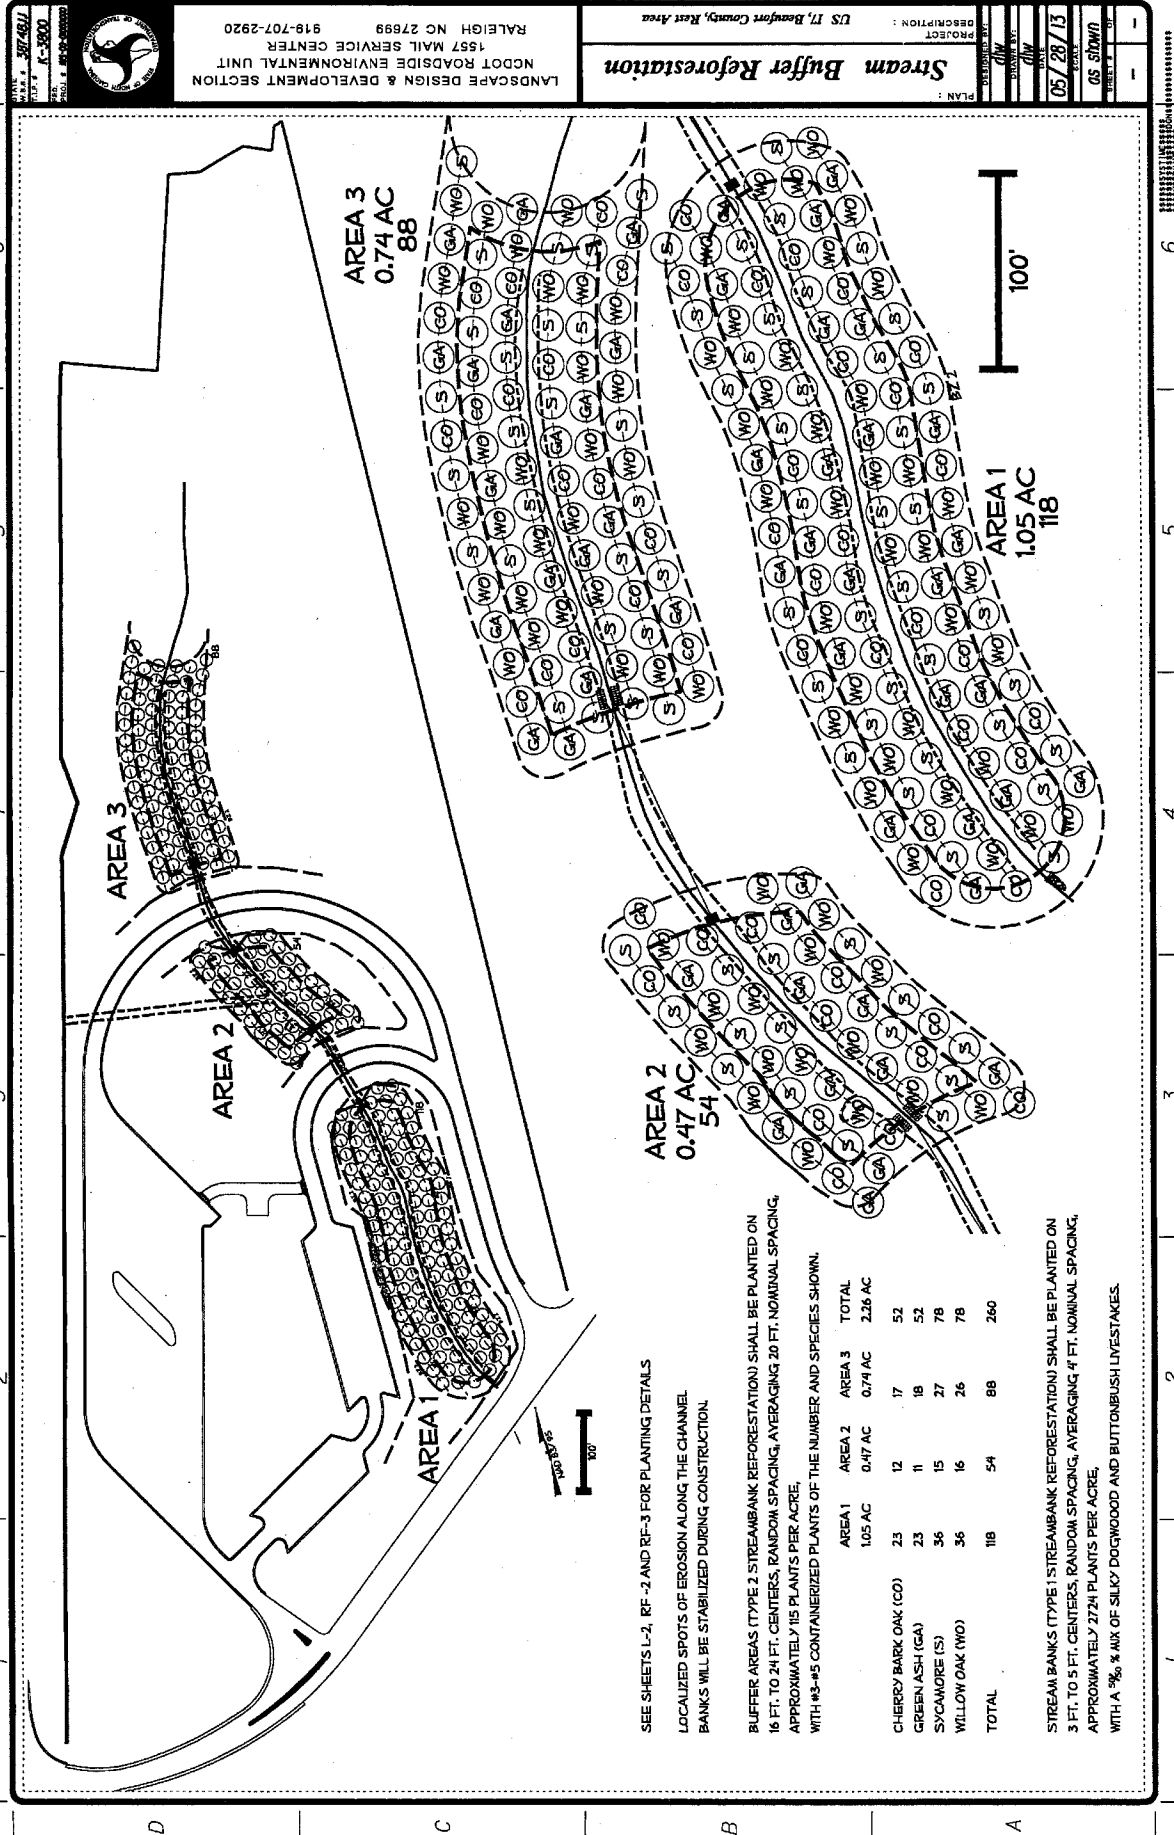

PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

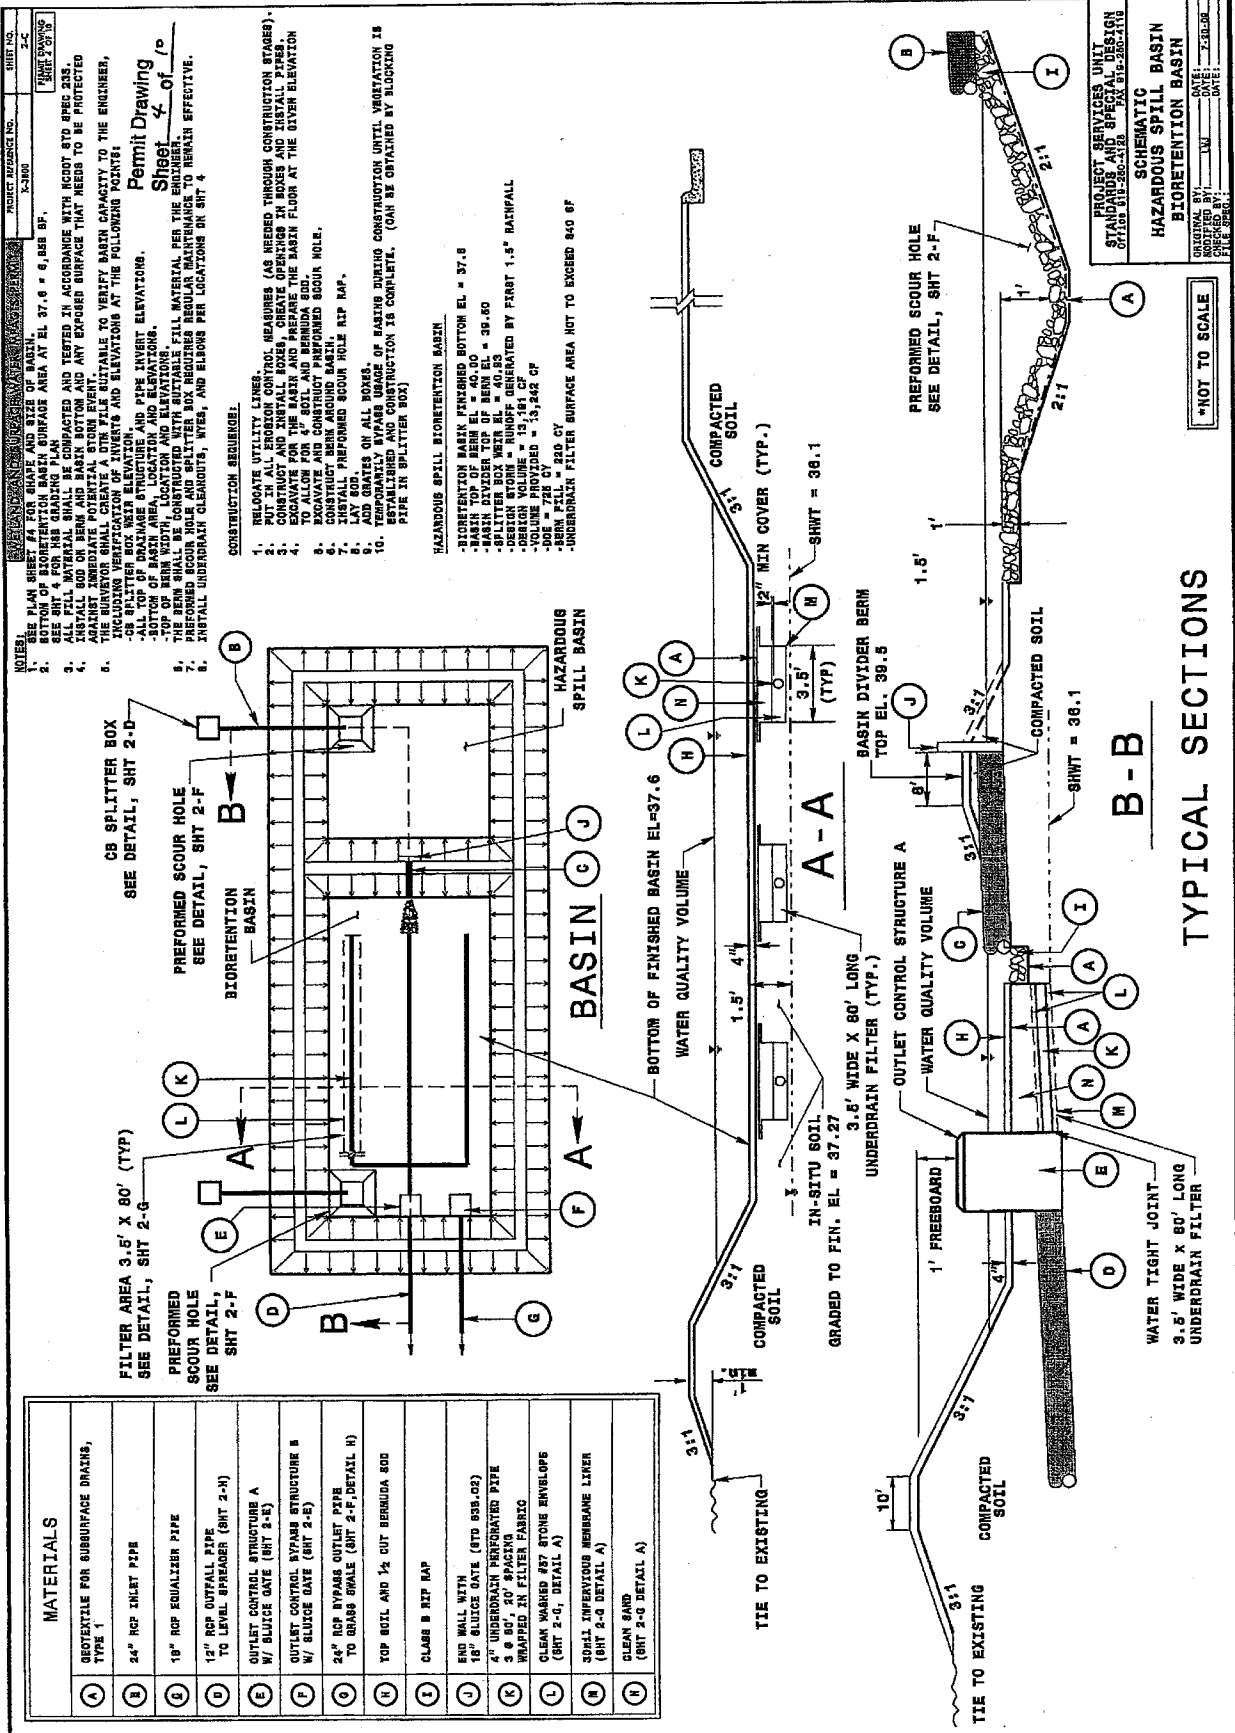

[illegible]

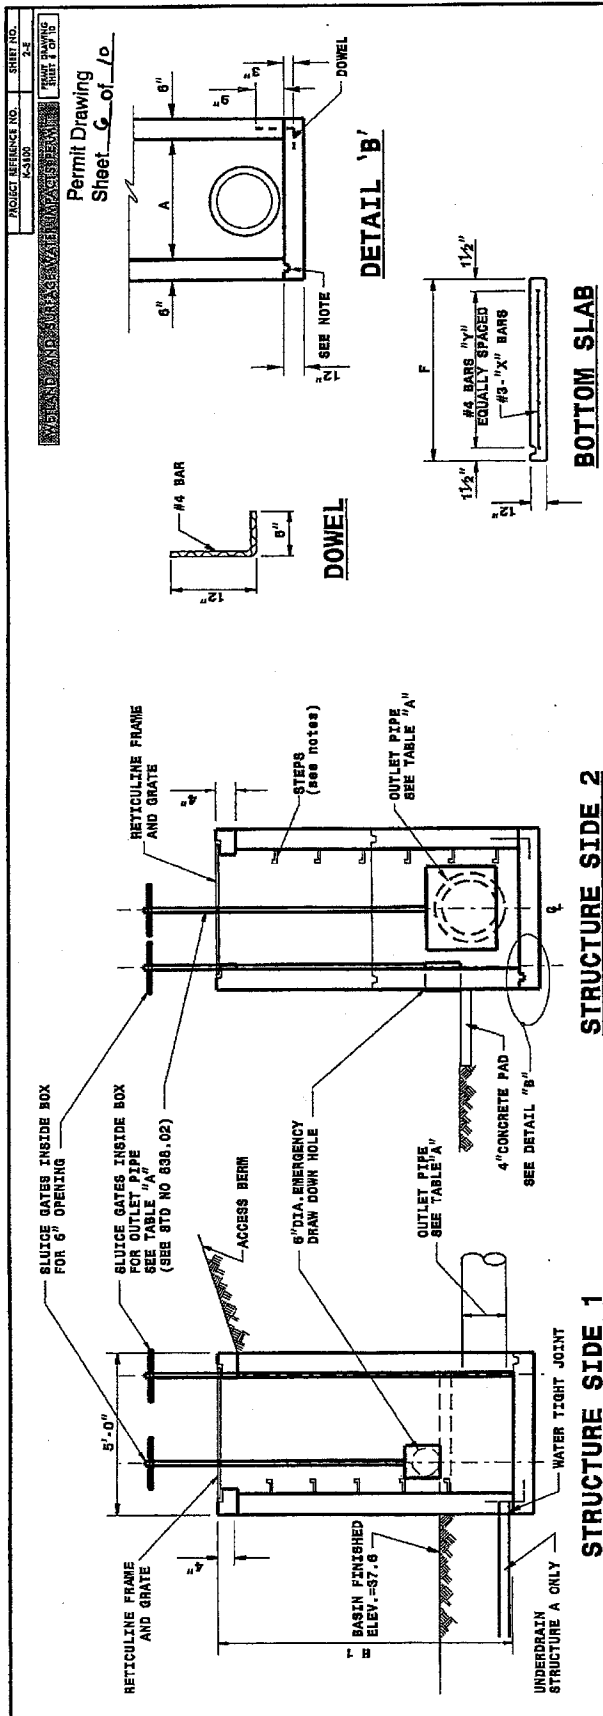


TABLE "A"

MINIMUM DIMENSIONS FOR OUTLET CONTROL STRUCTURE									
CONTROL STRUCT.	PIPE D	PIPE INVERT	BOX HEIGHT	TOP OF GRATE ELEV.	UNDER DRAIN INVERT	UNDERDRAIN PIPE D	POOL BASIN ELEV.	OUTLET PIPE SLUICE GATE	
A	12"	36.25	2.92	39.0	36.25	4"	37.6	12"	
B	24"	34.25	4.50	38.50	N/A	N/A	37.6	24"	
TOTAL CONCRETE QUANTITIES									
STRUCT.									
A									
2.0 CU. YDS.									
B									
2.5 CU. YDS.									

- GENERAL NOTES:**
- * CHANGES IN ELEVATIONS MUST BE APPROVED BY THE ENGINEER.
 - * CLASS "B" CONCRETE TO BE USED THROUGHOUT. PRECAST CONCRETE STRUCTURES TO BE SUBMITTED FOR APPROVAL. USE STD 840.43.
 - * OPTIONAL CONSTRUCTION - MONOLITHIC POUR, 2 INCH KEYWAY, OR #4 BAR DOWELS AT 12 INCH CENTERS, AS DIRECTED BY THE ENGINEER.
 - * FORMS ARE TO BE USED FOR THE CONSTRUCTION OF THE BOTTOM SLAB.
 - * IF REINFORCED CONCRETE PIPE IS SET IN BASE SLAB OF BOX, ADD TO BASE AS SHOWN ON STANDARD 840.00.
 - * ALL DRAWDOWN STRUCTURES OVER 3 FEET IN DEPTH TO BE PROVIDED WITH STEPS 12 INCH ON CENTERS. STEPS SHALL BE INSTALLED IN ACCORDANCE WITH STANDARD 840.00.
 - * FOR 8'-0" IN HEIGHT OR LESS USE 8 INCH WALLS AND BOTTOM SLAB OVER 8'-0" IN HEIGHT USE 12" WALLS TO 6'-0" FROM TOP OF WALL AND USE 8 INCH THICK WALLS FOR THE REMAINING 8'-0". ADJUST QUANTITIES ACCORDINGLY.
 - * RETICULINE FRAME AND GRATE TO BE APPROVED BY THE ENGINEER.













PROJECT SERVICES UNIT
 STANDARDS AND SPECIFICATIONS
 OFFICE: 317-250-1181 FAX: 317-250-1108

DETAIL OF OUTLET
 CONTROL STRUCTURES A AND B

ORIGINAL BY: LNL DATE: 7-20-08
 MODIFIED BY: LNL DATE: 7-20-08
 CHECKED BY: KREB/08/11/2008 DATE: 08/11/2008
 FILE: 0808

PROJECT NUMBER NO.	1-350	SHEET NO.	2-7
MANDATORY DESIGN	HYDRAULICS	PERMIT DRAWING	7 of 10
PRELIMINARY PLANS DO NOT USE FOR CONSTRUCTION			
PERMIT DRAWING SHEET 7 OF 10			


STANDARD SURFACE WATER PROFILES EXHIBIT

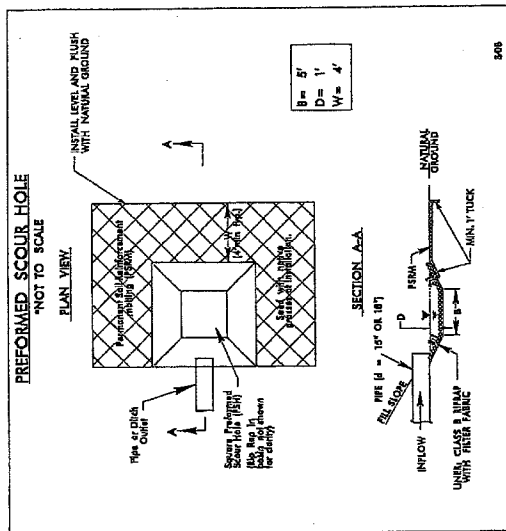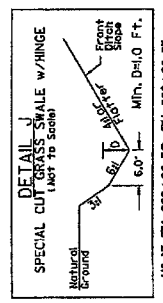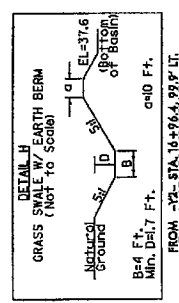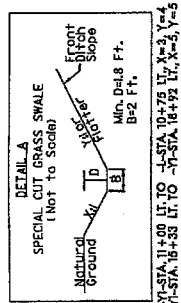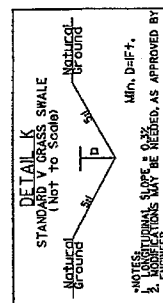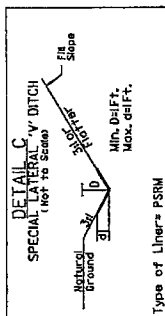


-L- STA. 19+00 RT. -L- STA. 22+50 LT. -L- STA. 23+84.84 LT.,
-Y- STA. 16+27.7 RT.

BIORETENTION/HAZARDOUS SPILL BASIN


PROJECT NUMBER: K-3500	SHEET NO. 2-5
PROJECT NAME: BIORETENTION/HAZARDOUS SPILL BASIN	PERMIT NO. 8 of 10
PRELIMINARY PLANS NO FOR USE AND CONSTRUCTION	

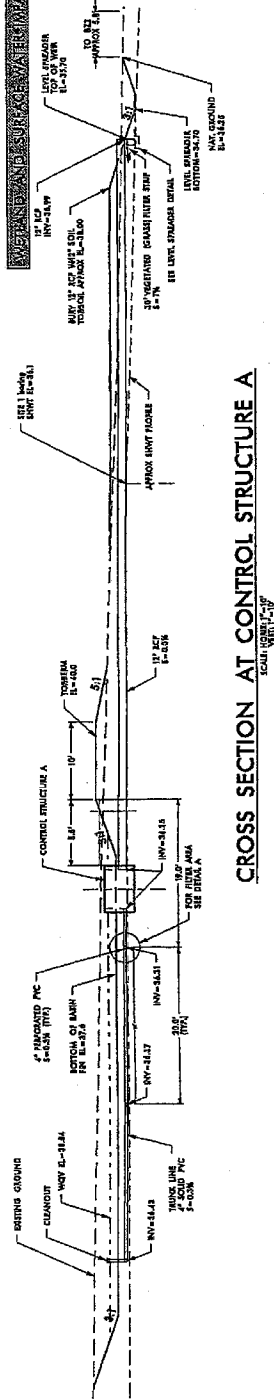


CROSS SECTION AT CONTROL STRUCTURE A
SCALE: HORIZ. 1"=20'
VERT. 1"=2'

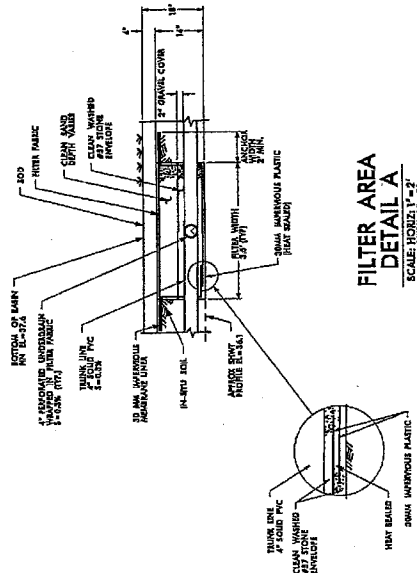

NOTE:
1. 4" PERFORATED PIPE MINIMUM INLET AREA = 4.0 SQ. IN.
2. EDGE OF PLASTIC LINING SHOULD BE REINFORCED WITH A MINIMUM OF 2.0\"/>

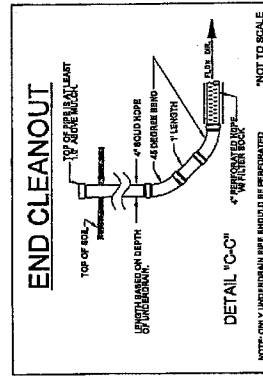

NOTE: ONLY UNDERDRAIN PIPE SHOULD BE PERFORATED
NOT TO SCALE

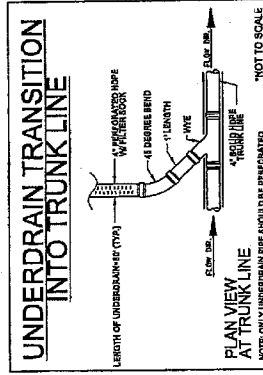


NOTE: ONLY UNDERDRAIN PIPE SHOULD BE PERFORATED
NOT TO SCALE

SAND SPECIFICATIONS


WASHED ASTM C-33 OR ASTM C-335 FINE AGGREGATE CONCRETE SAND. OF ALL SIZES SPECIFICATIONS SAND MUST MEET ALL THE FOLLOWING CONDITIONS:
1. SAND MUST BE SILICA BASED. NO LUMESTONE BASED PRODUCTS MAY BE USED. IF THE MATERIAL IS WHITE OR GRAY IN COLOR, IT IS PROBABLY NOT ACCEPTABLE.
2. SAND, IF AVAILABLE, NATURAL UNWASHED SAND PRODUCTS MAY NOT BE USED. LUMESTONE SAND THAT HAS BECOME CONTAMINATED BY IMPROPER STORAGE OR CONTAMINATION OF THE SAND SHALL BE REJECTED IN ALL CIRCUMSTANCES.
3. SAND, IF AVAILABLE, ON STONE DUST IS NOT ACCEPTABLE UNDER ANY CIRCUMSTANCES.

FILTER AREA DETAIL A SCALE: HORIZ. 1"=2' VERT. 1"=2'


[illegible]

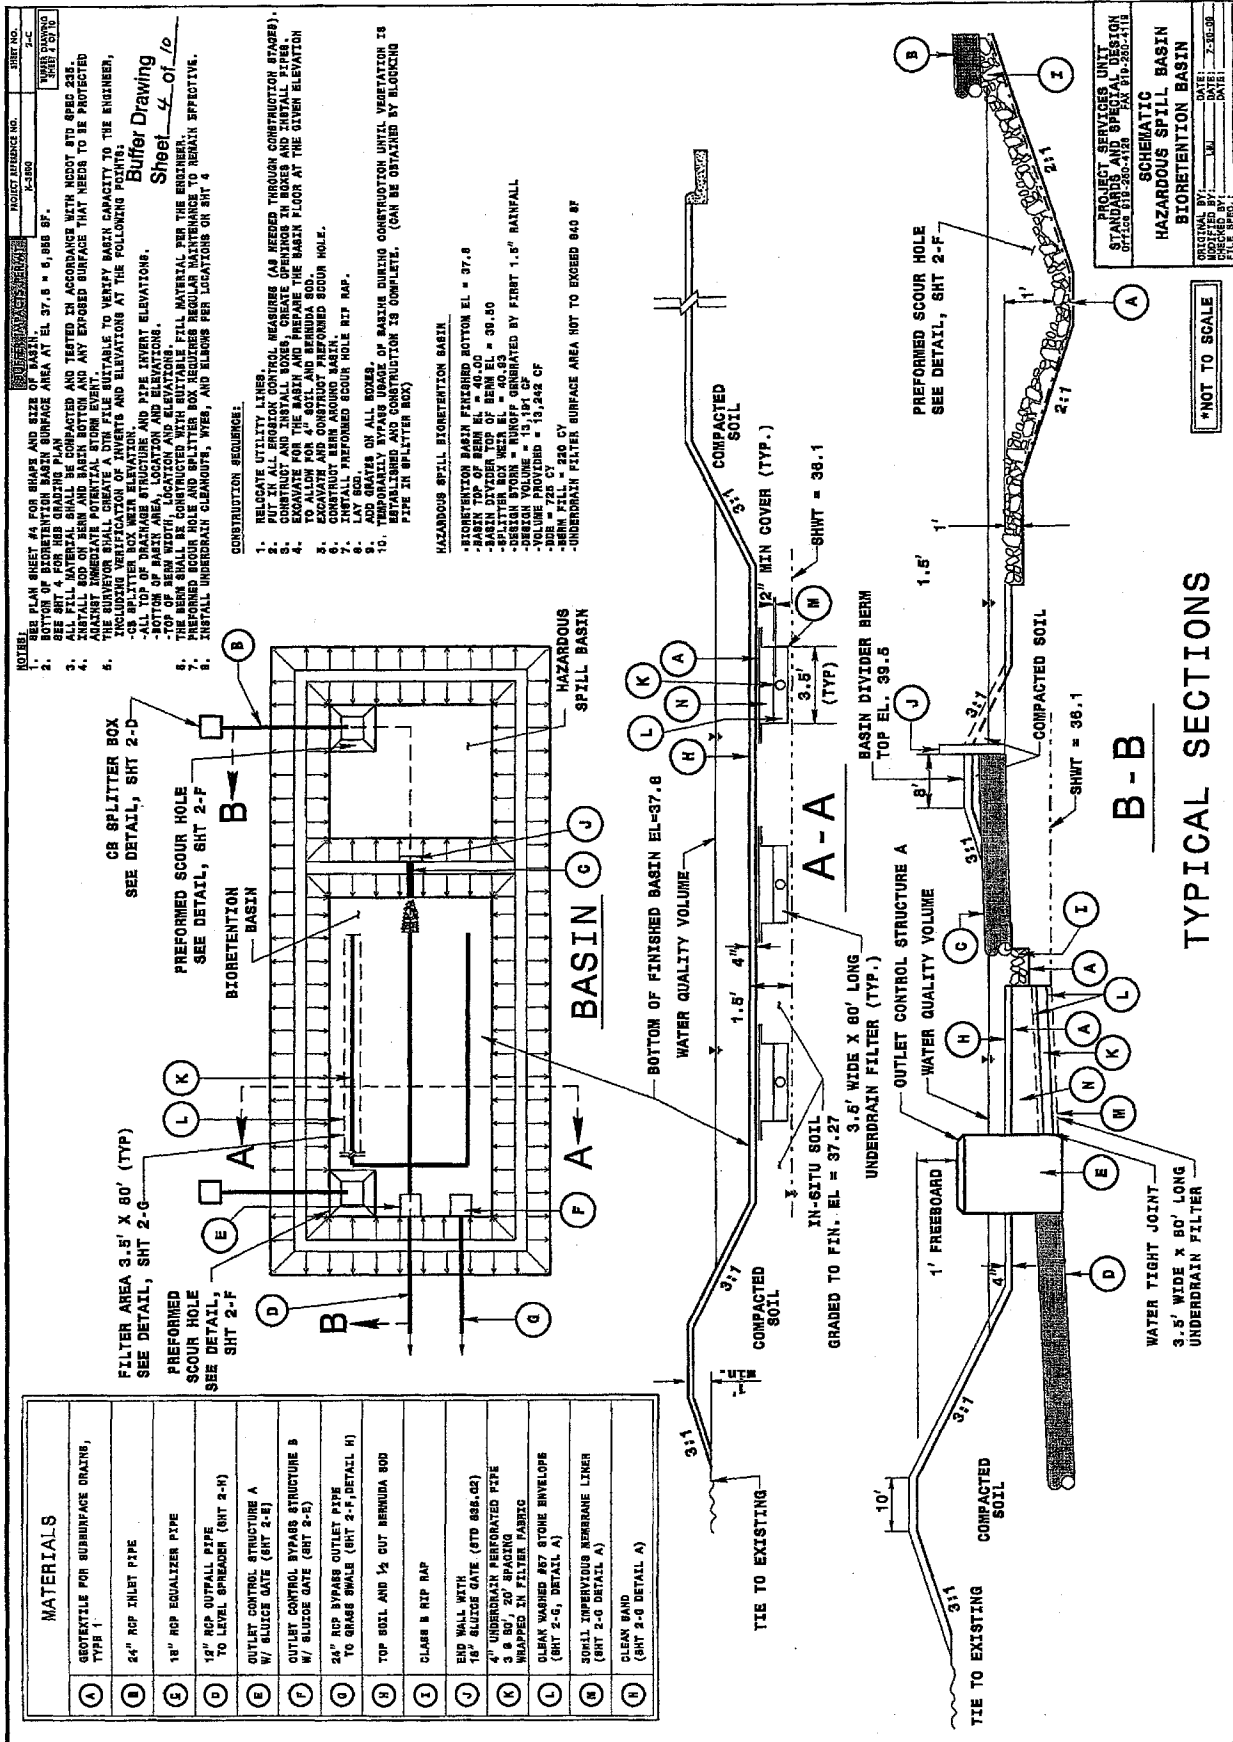

PROJECT REFERENCE NO. 8-400
 SHEET NO. 5 OF 10
 BUFFER DRAWING
 SHEET 5 OF 10

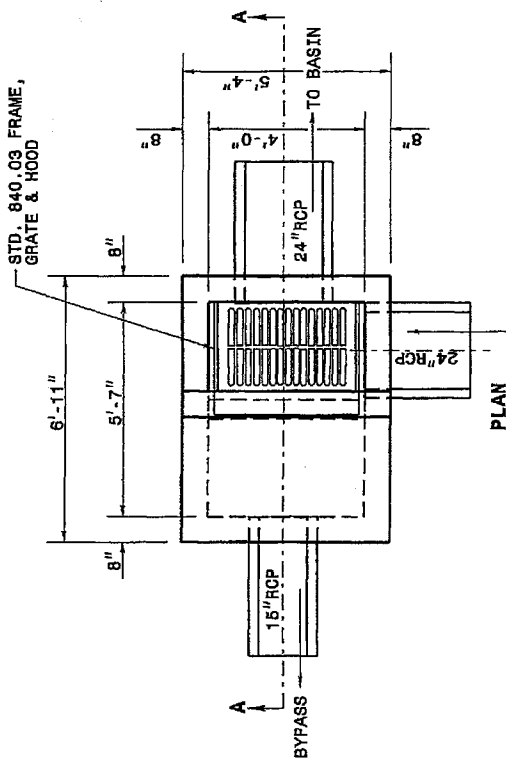

PLAN

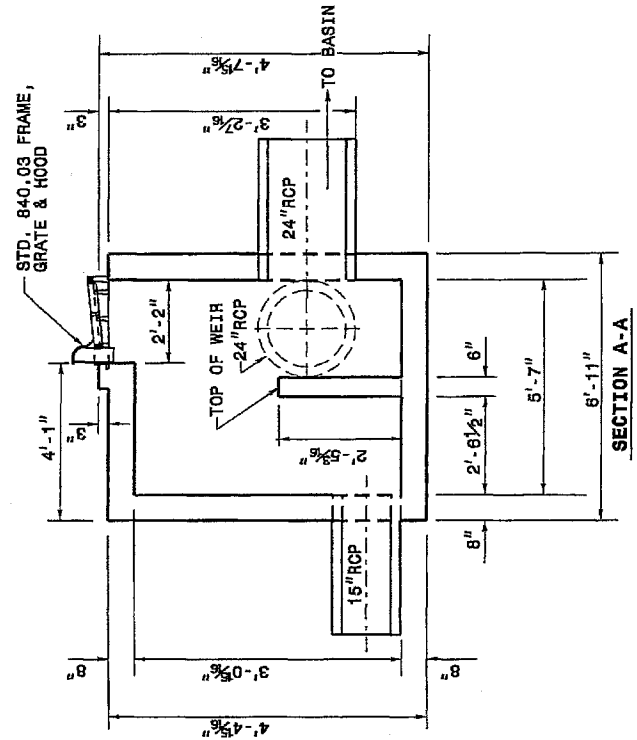

SECTION A-A

PROJECT SERVICES UNIT
 STANDARDS AND SPECIAL DESIGN
 818-280-1126 FAX 818-280-1113
 CATCH BASIN
 SPLITTER BOX
 DESIGNED BY: DATE: 11/14/99
 CHECKED BY: DATE: 11/14/99
 FILE NO.: 818-280-1126-1113-280-1113

PROJECT REFERENCE NO. 1-580 SHEET NO. 2-4
 BUFFER DRAWING
 Sheet 6 of 10


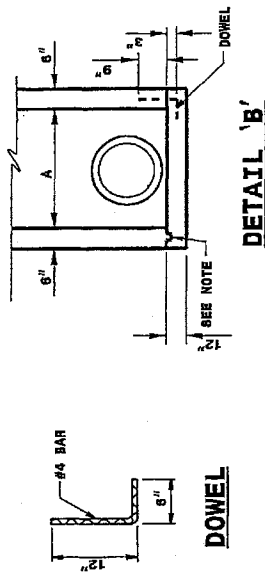
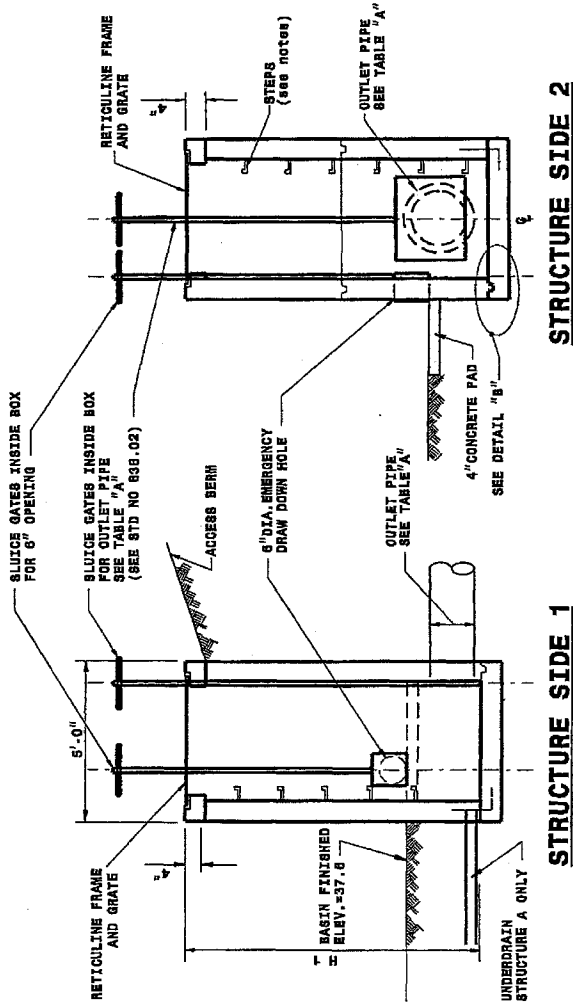


TABLE "A"

MINIMUM DIMENSIONS FOR OUTLET CONTROL STRUCTURE

CONTROL STRUCT.	PIPE D	BOX HEIGHT H1	OUTLET PIPE INVERT	TOP OF GRATE ELEV.	UNDER DRAIN INVERT	UNDER DRAIN PIPE D	POOL BASIN ELEV. @ ORIFICE PAD	OUTLET PIPE SLUICE GATE
A	12"	2.92	36.25	39.0	36.25	4"	37.6	12"
B	24"	4.50	34.25	38.50	N/A	N/A	37.6	24"


CONTROL STRUCT.	PIPE D	"A"		"B"		"C"		"D"		"E"		"F"	
		QTY.	LENGTH	QTY.	LENGTH	QTY.	LENGTH	QTY.	LENGTH	QTY.	LENGTH	QTY.	LENGTH
A	12"	8	4'-0"	8	4'-9"	6	4'-9"	6	4'-9"	5'-0"	5'-0"	2.0	CU YDS.
B	24"	8	4'-0"	8	4'-9"	6	4'-9"	6	4'-9"	5'-0"	5'-0"	2.6	CU YDS.

- GENERAL NOTES:
- CHANGES IN ELEVATIONS MUST BE APPROVED BY THE ENGINEER.
 - CLASS "B" CONCRETE TO BE USED THROUGHOUT. PRECAST CONCRETE STRUCTURES TO BE SUBMITTED FOR APPROVAL. USE STD 840.45.
 - OPTIONAL CONSTRUCTION - MONOLITHIC POUR, 2 INCH KEYWAY, OR #4 BAR DOWELS AT 12 INCH CENTERS, AS DIRECTED BY THE ENGINEER.
 - FORMS ARE TO BE USED FOR THE CONSTRUCTION OF THE BOTTOM SLAB.
 - IF REINFORCED CONCRETE PIPE IS SET IN BASE SLAB OF BOX, ADD TO BASE AS SHOWN ON STANDARD 840.00.
 - ALL DRAINAGE STRUCTURES OVER 3 FEET IN DEPTH TO BE PROVIDED WITH STEPS 12 INCH ON CENTERS. STEPS SHALL BE INSTALLED IN ACCORDANCE WITH STANDARD 840.05.
 - FOR 8'-0" IN HEIGHT OR LESS USE 4 INCH WALLS AND BOTTOM SLAB. OVER 8'-0" IN HEIGHT USE 12" WALLS TO 6'-0" FROM TOP OF WALL AND USE 6 INCH THICK WALLS FOR THE REMAINING 8'-0". ADJUST QUANTITIES ACCORDINGLY.
 - RETIKULINE FRAME AND GRATE TO BE APPROVED BY THE ENGINEER.

PROJECT SERVICES UNIT
 STANDARDS AND SPECIAL DESIGN
 OFFICE 110-555-1115 FAX 110-555-1113


DETAIL OF OUTLET
 CONTROL STRUCTURES A AND B

ORIGINAL BY: LEM
 MODIFIED BY: LEM
 CHECKED BY: LEM
 DATE: 7-30-08
 DATE: 7-30-08
 DATE: 7-30-08

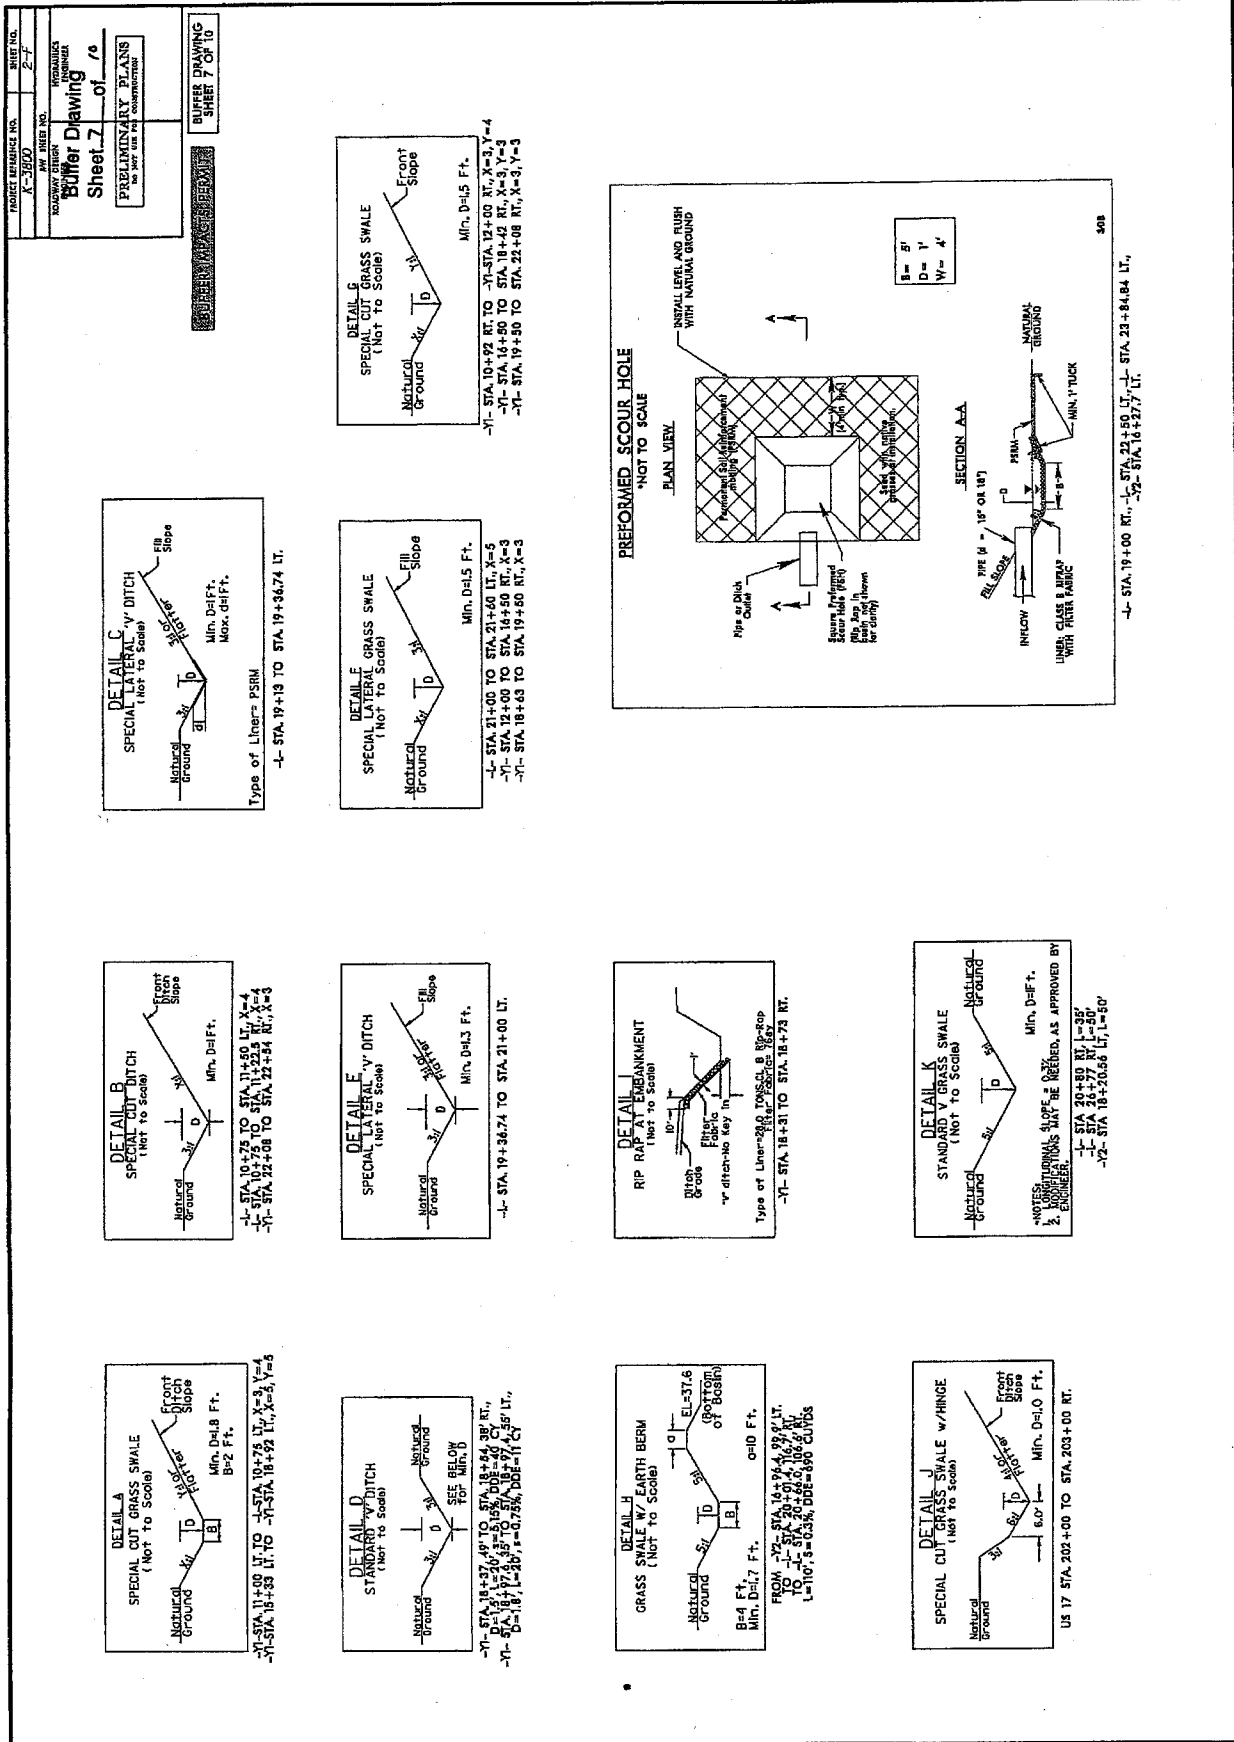


BIORETENTION/HAZARDOUS SPILL BASIN


PROJECT NUMBER NO.	K-2000	SHEET NO.	2-6
DESIGNER	ROADWAY DESIGN	ENGINEER	HYDRAULICS ENGINEER
Buffer Drawing Sheet 2 of 6 PRELIMINARY PLANS DO NOT USE FOR CONSTRUCTION			
BUFFER DRAWING SHEET 8 OF 10			

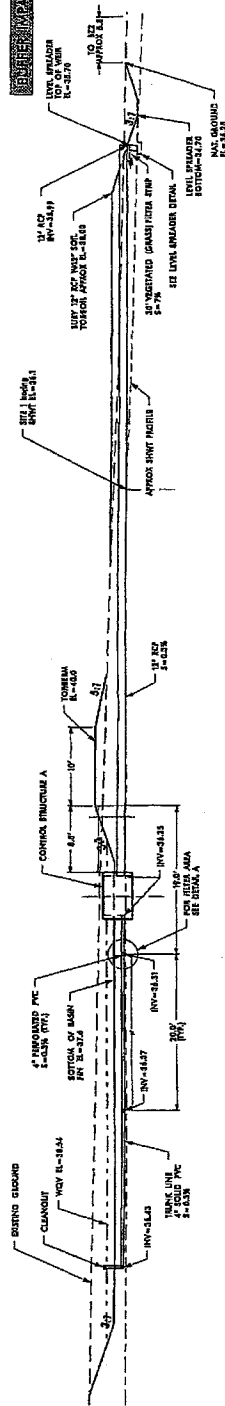

CROSS SECTION A-A AT CONTROL STRUCTURE A
SCALE: VERT. 1"=2'

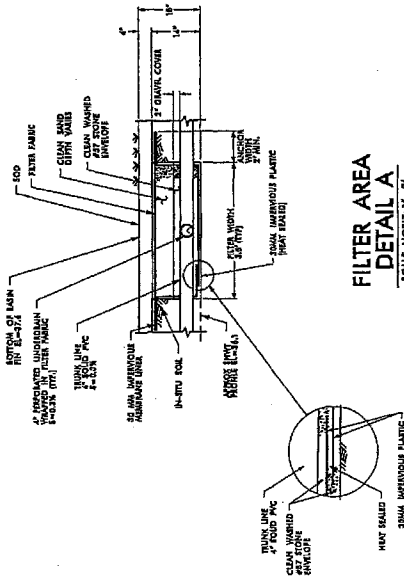


- NOTES:
1. 4" PERFORATED PIPE MINIMUM INLET AREA = 4.0sq. ft.
 2. EDGE OF PLASTIC LINING SHOULD BE ANCHORED IN TO THE GROUND A MINIMUM OF 2.0'
 3. IF A JOINT IN THE PLASTIC LINING IS REQUIRED, IT SHOULD BE HEAT SEALED TO PREVENT LEAKAGE.

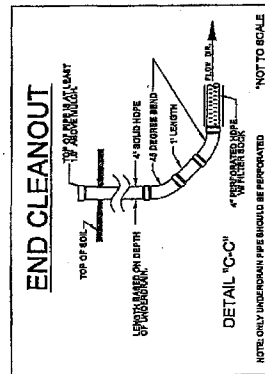

SAND SPECIFICATIONS

WASHED ATTA C31 OR LARSCO H-4.5 MIN AGGREGATE CONCRETE SAND. IN ADDITION TO THESE SPECIFICATIONS, SAND MUST MEET ALL THE FOLLOWING CONDITIONS:


1. SAND MUST BE SILICA BASED, NO LIMESTONE BASED PRODUCTS MAY BE USED.
2. SAND MUST BE CLEAN, NATURAL UNWASHED SAND. DEPOSITS MAY NOT BE USED.
3. STORAGE ON INSTALLATION PACKAGES SHALL BE REJECTED. MANUFACTURED SAND OR STONE DUST IS NOT ACCEPTABLE UNDER ANY CIRCUMSTANCES.

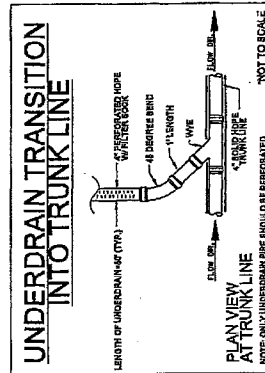


PROJECT: WINDMILL INC.	SHEET NO. 2-77
DATE: 10/20/00	
DESIGNER: J. B. BROWN	
CHECKER: J. B. BROWN	
INCHES: 1/8" = 1'-0"	
Butler Drawing Sheet 7 of 10 PRELIMINARY PLANS FOR THE WINDMILL INC.	

 BUFFER DRAWING
 SHEET 9 OF 10

WALL LEVEL SPREADER DETAIL

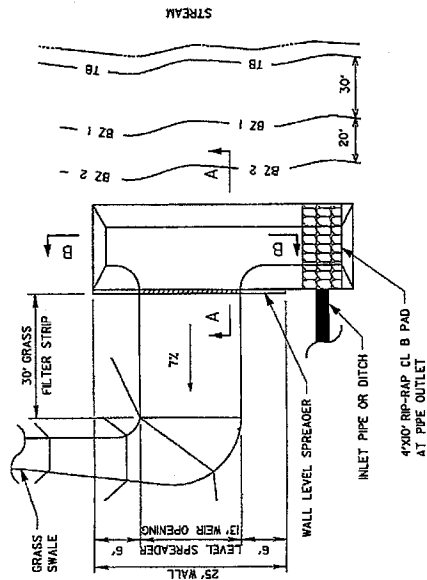
 (NOT TO SCALE)
 FROM -12' STA. 1741 TO STA. 1746 LT.


PLAN

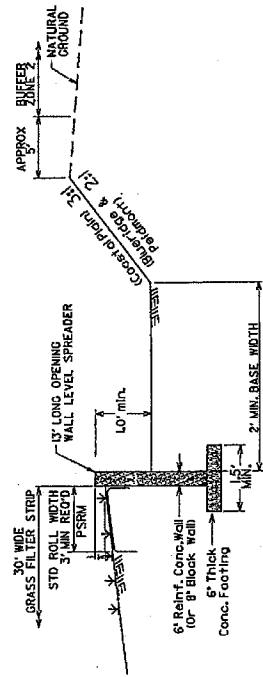

DDE=220 CY

SECTION-AA



SECTION-BB

- NOTES:
1. THE REINFORCING SHALL BE #4 BARS AT 12" CENTERS ALONG THE LENGTH OF THE WALL STEM AND #4 BARS AT 18" CENTERS FOR THE HEIGHT OF THE WALL.
 2. THE BENT REBAR AT THE ENDS OF THE #4 BARS AT 18" CENTERS SHALL BE PLACED IN AN ALTERNATING PATTERN.
 3. AT THE CORNERS OF THE CONNECTING WALL STEMS, THE #4 AT 12" CENTER REBARS ALONG THE LENGTH OF THE WALL SHALL BE BENT AND EXTENDED INTO THE WALLS BY 6'-4" TYPICAL.
 4. FOR THE FOOTING ITSELF, THE REINFORCING SHALL BE #5 BARS AT 12" CENTERS EACH WAY.
 5. SEE NCDDOT STANDARD REBAR FOR USE IN CONSTRUCTING CONCRETE TROUGH.

[illegible]

**N.C. DEPT. OF TRANSPORTATION
DIVISION OF HIGHWAYS**

BEAUFORT COUNTY
PROJECT: 38748.1.1 (K-3800)

3/28/2013
SHEET 10 OF 10

Rev. May 2006

Buffer Drawing
Sheet 10 of 10

STANDARD SPECIAL PROVISION
AVAILABILITY OF FUNDS – TERMINATION OF CONTRACTS

(5-20-08)

Z-2

General Statute 143C-6-11. (h) Highway Appropriation is hereby incorporated verbatim in this contract as follows:

(h) Amounts Encumbered. – Transportation project appropriations may be encumbered in the amount of allotments made to the Department of Transportation by the Director for the estimated payments for transportation project contract work to be performed in the appropriation fiscal year. The allotments shall be multiyear allotments and shall be based on estimated revenues and shall be subject to the maximum contract authority contained in *General Statute 143C-6-11(c)*. Payment for transportation project work performed pursuant to contract in any fiscal year other than the current fiscal year is subject to appropriations by the General Assembly. Transportation project contracts shall contain a schedule of estimated completion progress, and any acceleration of this progress shall be subject to the approval of the Department of Transportation provided funds are available. The State reserves the right to terminate or suspend any transportation project contract, and any transportation project contract shall be so terminated or suspended if funds will not be available for payment of the work to be performed during that fiscal year pursuant to the contract. In the event of termination of any contract, the contractor shall be given a written notice of termination at least 60 days before completion of scheduled work for which funds are available. In the event of termination, the contractor shall be paid for the work already performed in accordance with the contract specifications.

Payment will be made on any contract terminated pursuant to the special provision in accordance with Subarticle 108-13(E) of the *2012 Standard Specifications*.

STANDARD SPECIAL PROVISION
NCDOT GENERAL SEED SPECIFICATION FOR SEED QUALITY

(5-17-11)

Z-3

Seed shall be sampled and tested by the North Carolina Department of Agriculture and Consumer Services, Seed Testing Laboratory. When said samples are collected, the vendor shall supply an independent laboratory report for each lot to be tested. Results from seed so sampled shall be final. Seed not meeting the specifications shall be rejected by the Department of Transportation and shall not be delivered to North Carolina Department of Transportation warehouses. If seed has been delivered it shall be available for pickup and replacement at the supplier's expense.

Any re-labeling required by the North Carolina Department of Agriculture and Consumer Services, Seed Testing Laboratory, that would cause the label to reflect as otherwise specified herein shall be rejected by the North Carolina Department of Transportation.

Seed shall be free from seeds of the noxious weeds Johnsongrass, Balloonvine, Jimsonweed, Witchweed, Itchgrass, Serrated Tussock, Showy Crotalaria, Smooth Crotalaria, Sicklepod, Sandbur, Wild Onion, and Wild Garlic. Seed shall not be labeled with the above weed species on the seed analysis label. Tolerances as applied by the Association of Official Seed Analysts will NOT be allowed for the above noxious weeds except for Wild Onion and Wild Garlic.

Tolerances established by the Association of Official Seed Analysts will generally be recognized. However, for the purpose of figuring pure live seed, the found pure seed and found germination percentages as reported by the North Carolina Department of Agriculture and Consumer Services, Seed Testing Laboratory will be used. Allowances, as established by the NCDOT, will be recognized for minimum pure live seed as listed on the following pages.

The specifications for restricted noxious weed seed refers to the number per pound as follows:

<u>Restricted Noxious Weed</u>	<u>Limitations per Lb. Of Seed</u>	<u>Restricted Noxious Weed</u>	<u>Limitations per Lb. of Seed</u>
Blessed Thistle	4 seeds	Cornflower (Ragged Robin)	27 seeds
Cocklebur	4 seeds	Texas Panicum	27 seeds
Spurred Anoda	4 seeds	Bracted Plantain	54 seeds
Velvetleaf	4 seeds	Buckhorn Plantain	54 seeds
Morning-glory	8 seeds	Broadleaf Dock	54 seeds
Corn Cockle	10 seeds	Curly Dock	54 seeds
Wild Radish	12 seeds	Dodder	54 seeds
Purple Nutsedge	27 seeds	Giant Foxtail	54 seeds
Yellow Nutsedge	27 seeds	Horsenettle	54 seeds
Canada Thistle	27 seeds	Quackgrass	54 seeds
Field Bindweed	27 seeds	Wild Mustard	54 seeds
Hedge Bindweed	27 seeds		

Seed of Pensacola Bahiagrass shall not contain more than 7% inert matter, Kentucky Bluegrass, Centipede and Fine or Hard Fescue shall not contain more than 5% inert matter whereas a maximum of 2% inert matter will be allowed on all other kinds of seed. In addition, all seed shall not contain more than 2% other crop seed nor more than 1% total weed seed. The germination rate as tested by the North Carolina Department of Agriculture shall not fall below 70%, which includes both dormant and hard seed. Seed shall be labeled with not more than 7%, 5% or 2% inert matter (according to above specifications), 2% other crop seed and 1% total weed seed.

Exceptions may be made for minimum pure live seed allowances when cases of seed variety shortages are verified. Pure live seed percentages will be applied in a verified shortage situation. Those purchase orders of deficient seed lots will be credited with the percentage that the seed is deficient.

FURTHER SPECIFICATIONS FOR EACH SEED GROUP ARE GIVEN BELOW:

Minimum 85% pure live seed; maximum 1% total weed seed; maximum 2% total other crop seed; maximum 144 restricted noxious weed seed per pound. Seed less than 83% pure live seed will not be approved.

Sericea Lespedeza
Oats (seeds)

Minimum 80% pure live seed; maximum 1% total weed seed; maximum 2% total other crop; maximum 144 restricted noxious weed seed per pound. Seed less than 78% pure live seed will not be approved.

Tall Fescue (all approved varieties)
Kobe Lespedeza
Korean Lespedeza
Weeping Lovegrass
Carpetgrass

Bermudagrass
Browntop Millet
German Millet – Strain R
Clover – Red/White/Crimson

Minimum 78% pure live seed; maximum 1% total weed seed; maximum 2% total other crop seed; maximum 144 restricted noxious weed seed per pound. Seed less than 76% pure live seed will not be approved.

Common or Sweet Sundangrass

Minimum 76% pure live seed; maximum 1% total weed seed; maximum 2% total other crop seed; maximum 144 restricted noxious weed seed per pound. Seed less than 74% pure live seed will not be approved.

Rye (grain; all varieties)
Kentucky Bluegrass (all approved varieties)
Hard Fescue (all approved varieties)
Shrub (bicolor) Lespedeza

Minimum 70% pure live seed; maximum 1% total weed seed; maximum 2% total other crop seed; maximum 144 noxious weed seed per pound. Seed less than 70% pure live seed will not be approved.

Centipedegrass
Crownvetch
Pensacola Bahiagrass
Creeping Red Fescue

Japanese Millet
Reed Canary Grass
Zoysia

Minimum 70% pure live seed; maximum 1% total weed seed; maximum 2% total other crop seed; maximum 5% inert matter; maximum 144 restricted noxious weed seed per pound.

Barnyard Grass
Big Bluestem
Little Bluestem
Bristly Locust
Birdsfoot Trefoil
Indiangrass
Orchardgrass
Switchgrass
Yellow Blossom Sweet Clover

STANDARD SPECIAL PROVISION**ERRATA**

(1-17-12) (Rev. 1-21-14)

Z-4

Revise the *2012 Standard Specifications* as follows:

Division 2

Page 2-7, line 31, Article 215-2 Construction Methods, replace “Article 107-26” with “Article 107-25”.

Page 2-17, Article 226-3, Measurement and Payment, line 2, delete “pipe culverts,”.

Page 2-20, Subarticle 230-4(B), Contractor Furnished Sources, change references as follows: **Line 1,** replace “(4) Buffer Zone” with “(c) Buffer Zone”; **Line 12,** replace “(5) Evaluation for Potential Wetlands and Endangered Species” with “(d) Evaluation for Potential Wetlands and Endangered Species”; and **Line 33,** replace “(6) Approval” with “(4) Approval”.

Division 3

Page 3-1, after line 15, Article 300-2 Materials, replace “1032-9(F)” with “1032-6(F)”.

Division 4

Page 4-77, line 27, Subarticle 452-3(C) Concrete Coping, replace “sheet pile” with “reinforcement”.

Division 6

Page 6-7, line 31, Article 609-3 Field Verification of Mixture and Job Mix Formula Adjustments, replace “30” with “45”.

Page 6-10, line 42, Subarticle 609-6(C)(2), replace “Subarticle 609-6(E)” with “Subarticle 609-6(D)”.

Page 6-11, Table 609-1 Control Limits, replace “Max. Spec. Limit” for the Target Source of $P_{0.075}/P_{be}$ Ratio with “1.0”.

Page 6-40, Article 650-2 Materials, replace “Subarticle 1012-1(F)” with “Subarticle 1012-1(E)”

Division 8

Page 8-23, line 10, Article 838-2 Materials, replace “Portland Cement Concrete, Class B” with “Portland Cement Concrete, Class A”.

Division 12

Page 12-7, Table 1205-3, add “FOR THERMOPLASTIC” to the end of the title.

Page 12-8, Subarticle 1205-5(B), line 13, replace “Table 1205-2” with “Table 1205-4”.

Page 12-8, Table 1205-4 and 1205-5, replace “THERMOPLASTIC” in the title of these tables with “POLYUREA”.

Page 12-9, Subarticle 1205-6(B), line 21, replace “Table 1205-4” with “Table 1205-6”.

Page 12-11, Subarticle 1205-8(C), line 25, replace “Table 1205-5” with “Table 1205-7”.

Division 15

Page 15-4, Subarticle 1505-3(F) Backfilling, line 26, replace “Subarticle 235-4(C)” with “Subarticle 235-3(C)”.

Page 15-6, Subarticle 1510-3(B), after line 21, replace the allowable leakage formula with the following: $W = LD\sqrt{P} \div 148,000$

Page 15-6, Subarticle 1510-3(B), line 32, delete “may be performed concurrently or” and replace with “shall be performed”.

Page 15-17, Subarticle 1540-3(E), line 27, delete “Type 1”.

Division 17

Page 17-26, line 42, Subarticle 1731-3(D) Termination and Splicing within Interconnect Center, delete this subarticle.

Revise the *2012 Roadway Standard Drawings* as follows:

1633.01 Sheet 1 of 1, English Standard Drawing for Matting Installation, replace “1633.01” with “1631.01”.

STANDARD SPECIAL PROVISION**PLANT AND PEST QUARANTINES****(Imported Fire Ant, Gypsy Moth, Witchweed, And Other Noxious Weeds)**

(3-18-03) (Rev. 10-15-13)

Z-04a

Within Quarantined Area

This project may be within a county regulated for plant and/or pests. If the project or any part of the Contractor's operations is located within a quarantined area, thoroughly clean all equipment prior to moving out of the quarantined area. Comply with federal/state regulations by obtaining a certificate or limited permit for any regulated article moving from the quarantined area.

Originating in a Quarantined County

Obtain a certificate or limited permit issued by the N.C. Department of Agriculture/United States Department of Agriculture. Have the certificate or limited permit accompany the article when it arrives at the project site.

Contact

Contact the N.C. Department of Agriculture/United States Department of Agriculture at 1-800-206-9333, 919-733-6932, or <http://www.ncagr.gov/plantind/> to determine those specific project sites located in the quarantined area or for any regulated article used on this project originating in a quarantined county.

Regulated Articles Include

1. Soil, sand, gravel, compost, peat, humus, muck, and decomposed manure, separately or with other articles. This includes movement of articles listed above that may be associated with cut/waste, ditch pulling, and shoulder cutting.
2. Plants with roots including grass sod.
3. Plant crowns and roots.
4. Bulbs, corms, rhizomes, and tubers of ornamental plants.
5. Hay, straw, fodder, and plant litter of any kind.
6. Clearing and grubbing debris.
7. Used agricultural cultivating and harvesting equipment.
8. Used earth-moving equipment.
9. Any other products, articles, or means of conveyance, of any character, if determined by an inspector to present a hazard of spreading imported fire ant, gypsy moth, witchweed or other noxious weeds.

STANDARD SPECIAL PROVISION**AWARD OF CONTRACT**

(6-28-77)

Z-6

“The North Carolina Department of Transportation, in accordance with the provisions of *Title VI of the Civil Rights Act of 1964* (78 Stat. 252) and the Regulations of the Department of Transportation (*49 C.F.R., Part 21*), issued pursuant to such act, hereby notifies all bidders that it will affirmatively insure that the contract entered into pursuant to this advertisement will be awarded to the lowest responsible bidder without discrimination on the ground of race, color, or national origin”.

STANDARD SPECIAL PROVISION**MINORITY AND FEMALE EMPLOYMENT REQUIREMENTS**

Z-7

NOTICE OF REQUIREMENTS FOR AFFIRMATIVE ACTION TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY (*EXECUTIVE NUMBER 11246*)

1. The goals and timetables for minority and female participation, expressed in percentage terms for the Contractor's aggregate workforce in each trade on all construction work in the covered area, see as shown on the attached sheet entitled "Employment Goals for Minority and Female participation".

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally assisted) performed in the covered area. If the Contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the Contractor also is subject to the goals for both its federally involved and nonfederally involved construction.

The Contractor's compliance with the Executive Order and the regulations in *41 CFR Part 60-4* shall be based on its implementation of the Equal Opportunity Clause, specific affirmative action obligations required by the specifications set forth in *41 CFR 60-4.3(a)*, and its effort to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade and the Contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project or the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the executive Order and the regulations in *41 CFR Part 60-4*. Compliance with the goals will be measured against the total work hours performed.

2. As used in this Notice and in the contract resulting from this solicitation, the "covered area" is the county or counties shown on the cover sheet of the proposal form and contract.

**EMPLOYMENT GOALS FOR MINORITY
AND FEMALE PARTICIPATION**

Economic Areas

Area 023 29.7%

Bertie County
Camden County
Chowan County
Gates County
Hertford County
Pasquotank County
Perquimans County

Area 024 31.7%

Beaufort County
Carteret County
Craven County
Dare County
Edgecombe County
Green County
Halifax County
Hyde County
Jones County
Lenoir County
Martin County
Nash County
Northampton County
Pamlico County
Pitt County
Tyrrell County
Washington County
Wayne County
Wilson County

Area 025 23.5%

Columbus County
Duplin County
Onslow County
Pender County

Area 026 33.5%

Bladen County
Hoke County
Richmond County
Robeson County
Sampson County
Scotland County

Area 027 24.7%

Chatham County
Franklin County
Granville County
Harnett County
Johnston County
Lee County
Person County
Vance County
Warren County

Area 028 15.5%

Alleghany County
Ashe County
Caswell County
Davie County
Montgomery County
Moore County
Rockingham County
Surry County
Watauga County
Wilkes County

Area 029 15.7%

Alexander County
Anson County
Burke County
Cabarrus County
Caldwell County
Catawba County
Cleveland County
Iredell County
Lincoln County
Polk County
Rowan County
Rutherford County
Stanly County

Area 0480 8.5%

Buncombe County
Madison County

Area 030 6.3%

Avery County
Cherokee County
Clay County
Graham County
Haywood County
Henderson County
Jackson County
McDowell County
Macon County
Mitchell County
Swain County
Transylvania County
Yancey County

SMSA AreasArea 5720 26.6%

Currituck County

Area 9200 20.7%

Brunswick County

New Hanover County

Area 2560 24.2%

Cumberland County

Area 6640 22.8%

Durham County

Orange County

Wake County

Area 1300 16.2%

Alamance County

Area 3120 16.4%

Davidson County

Forsyth County

Guilford County

Randolph County

Stokes County

Yadkin County

Area 1520 18.3%

Gaston County

Mecklenburg County

Union County

Goals for FemaleParticipation in Each Trade

(Statewide) 6.9%

STANDARD SPECIAL PROVISION**REQUIRED CONTRACT PROVISIONS FEDERAL - AID CONSTRUCTION CONTRACTS**

FHWA - 1273 Electronic Version - May 1, 2012

Z-8

- I. General
- II. Nondiscrimination
- III. Nonsegregated Facilities
- IV. Davis-Bacon and Related Act Provisions
- V. Contract Work Hours and Safety Standards Act Provisions
- VI. Subletting or Assigning the Contract
- VII. Safety: Accident Prevention
- VIII. False Statements Concerning Highway Projects
- IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
- X. Compliance with Governmentwide Suspension and Debarment Requirements
- XI. Certification Regarding Use of Contract Funds for Lobbying

ATTACHMENTS

- A. Employment and Materials Preference for Appalachian Development Highway System or Appalachian Local Access Road Contracts (included in Appalachian contracts only)

I. GENERAL

- 1. Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

- 2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.
- 3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.
- 4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding \$10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

- 1. **Equal Employment Opportunity:** Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are

incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

- a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.
- b. The contractor will accept as its operating policy the following statement:
"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."
2. **EEO Officer:** The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.
3. **Dissemination of Policy:** All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:
 - a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.
 - b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.
 - c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.
 - d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.
 - e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.
4. **Recruitment:** When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.
 - a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.
 - b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.
 - c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.
5. **Personnel Actions:** Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:
 - a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.
 - b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.
 - c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.
 - d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.
6. **Training and Promotion:**
 - a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.
 - b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).
 - c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.
 - d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.

7. **Unions:** If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:
 - a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.
 - b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.
 - c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.
 - d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.
8. **Reasonable Accommodation for Applicants / Employees with Disabilities:** The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.
9. **Selection of Subcontractors, Procurement of Materials and Leasing of Equipment:** The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.
 - a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.
 - b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.
10. **Assurance Required by 49 CFR 26.13(b):**
 - a. The requirements of 49 CFR Part 26 and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.
 - b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.
11. **Records and Reports:** The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.
 - a. The records kept by the contractor shall document the following:
 - (1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;
 - (2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and
 - (3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;
 - b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of \$10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding \$2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 "Contract provisions and related matters" with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages

- a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the

Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH-1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

- b. (1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:
 - (i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and
 - (ii) The classification is utilized in the area by the construction industry; and
 - (iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.
 - (2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
 - (3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.
 - (4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.
 - c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.
 - d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program. Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.
2. **Withholding.** The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.
 3. **Payrolls and basic records**
 - a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.
 - b. (1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the

payrolls shall only need to include an individually identifying number for each employee (e.g. , the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH-347 is available for this purpose from the Wage and Hour Division Web site at <http://www.dol.gov/esa/whd/forms/wh347instr.htm> or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency.

- (2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:
 - (i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;
 - (ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;
 - (iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.
 - (3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.
 - (4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.
- c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.
- 4. Apprentices and trainees**
- a. Apprentices (programs of the USDOL). Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.
- The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.
- Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.
- In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.
- b. Trainees (programs of the USDOL). Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.
- The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.
- Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

- In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.
- c. **Equal employment opportunity.** The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.
 - d. **Apprentices and Trainees (programs of the U.S. DOT).** Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.
 5. **Compliance with Copeland Act requirements.** The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.
 6. **Subcontracts.** The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.
 7. **Contract termination: debarment.** A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.
 8. **Compliance with Davis-Bacon and Related Act requirements.** All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.
 9. **Disputes concerning labor standards.** Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.
 10. **Certification of eligibility.**
 - a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
 - b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).
 - c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of \$100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. **Overtime requirements.** No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.
2. **Violation; liability for unpaid wages; liquidated damages.** In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.
3. **Withholding for unpaid wages and liquidated damages.** The FHWA or the contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.
4. **Subcontracts.** The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).
 - a. The term "perform work with its own organization" refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees

from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:

- (1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
 - (2) the prime contractor remains responsible for the quality of the work of the leased employees;
 - (3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and
 - (4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.
- b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.
2. The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.
 3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.
 4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.
 5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.
2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).
3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.
2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost \$25,000 or more – as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

- a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.
- b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.
- c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.
- d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contractor). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).
- f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.
- g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.
- i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

- a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:
 - (1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;
 - (2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;
 - (3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and
 - (4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost \$25,000 or more - 2 CFR Parts 180 and 1200)

- a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.
- b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

- c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.
- d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contractor). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).
- e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.
- f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the \$25,000 threshold.
- g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (<https://www.epls.gov/>), which is compiled by the General Services Administration.
- h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

- 1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency.
- 2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed \$100,000 (49 CFR 20).

- 1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:
 - a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.
 - b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.
- 2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.
- 3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed \$100,000 and that all such recipients shall certify and disclose accordingly.

STANDARD SPECIAL PROVISION**ON-THE-JOB TRAINING**

(10-16-07) (Rev. 5-21-13)

Z-10

Description

The North Carolina Department of Transportation will administer a custom version of the Federal On-the-Job Training (OJT) Program, commonly referred to as the Alternate OJT Program. All contractors (existing and newcomers) will be automatically placed in the Alternate Program. Standard OJT requirements typically associated with individual projects will no longer be applied at the project level. Instead, these requirements will be applicable on an annual basis for each contractor administered by the OJT Program Manager.

On the Job Training shall meet the requirements of 23 CFR 230.107 (b), 23 USC – Section 140, this provision and the On-the-Job Training Program Manual.

The Alternate OJT Program will allow a contractor to train employees on Federal, State and privately funded projects located in North Carolina. However, priority shall be given to training employees on NCDOT Federal-Aid funded projects.

Minorities and Women

Developing, training and upgrading of minorities and women toward journeyman level status is a primary objective of this special training provision. Accordingly, the Contractor shall make every effort to enroll minority and women as trainees to the extent that such persons are available within a reasonable area of recruitment. This training commitment is not intended, and shall not be used, to discriminate against any applicant for training, whether a member of a minority group or not.

Assigning Training Goals

The Department, through the OJT Program Manager, will assign training goals for a calendar year based on the contractors' past three years' activity and the contractors' anticipated upcoming year's activity with the Department. At the beginning of each year, all contractors eligible will be contacted by the Department to determine the number of trainees that will be assigned for the upcoming calendar year. At that time the Contractor shall enter into an agreement with the Department to provide a self-imposed on-the-job training program for the calendar year. This agreement will include a specific number of annual training goals agreed to by both parties. The number of training assignments may range from 1 to 15 per contractor per calendar year. The Contractor shall sign an agreement to fulfill their annual goal for the year. A sample agreement is available at www.ncbowd.com/section/on-the-job-training.

Training Classifications

The Contractor shall provide on-the-job training aimed at developing full journeyman level workers in the construction craft/operator positions. Preference shall be given to providing training in the following skilled work classifications:

Equipment Operators	Office Engineers
Truck Drivers	Estimators
Carpenters	Iron / Reinforcing Steel Workers
Concrete Finishers	Mechanics
Pipe Layers	Welders

The Department has established common training classifications and their respective training requirements that may be used by the contractors. However, the classifications established are not all-inclusive. Where the training is oriented toward construction applications, training will be allowed in lower-level management positions such as office engineers and estimators. Contractors shall submit new classifications for specific job functions that their employees are performing. The Department will review and recommend for acceptance to FHWA the new classifications proposed by contractors, if applicable. New classifications shall meet the following requirements:

Proposed training classifications are reasonable and realistic based on the job skill classification needs, and

The number of training hours specified in the training classification is consistent with common practices and provides enough time for the trainee to obtain journeyman level status.

The Contractor may allow trainees to be trained by a subcontractor provided that the Contractor retains primary responsibility for meeting the training and this provision is made applicable to the subcontract. However, only the Contractor will receive credit towards the annual goal for the trainee.

Where feasible, 25 percent of apprentices or trainees in each occupation shall be in their first year of apprenticeship or training. The number of trainees shall be distributed among the work classifications on the basis of the contractor's needs and the availability of journeymen in the various classifications within a reasonable area of recruitment.

No employee shall be employed as a trainee in any classification in which they have successfully completed a training course leading to journeyman level status or in which they have been employed as a journeyman.

Records and Reports

The Contractor shall maintain enrollment, monthly and completion reports documenting company compliance under these contract documents. These documents and any other information as requested shall be submitted to the OJT Program Manager.

Upon completion and graduation of the program, the Contractor shall provide each trainee with a certification Certificate showing the type and length of training satisfactorily completed.

Trainee Interviews

All trainees enrolled in the program will receive an initial and Trainee/Post graduate interview conducted by the OJT program staff.

Trainee Wages

Contractors shall compensate trainees on a graduating pay scale based upon a percentage of the prevailing minimum journeyman wages (Davis-Bacon Act). Minimum pay shall be as follows:

60 percent	of the journeyman wage for the first half of the training period
75 percent	of the journeyman wage for the third quarter of the training period
90 percent	of the journeyman wage for the last quarter of the training period

In no instance shall a trainee be paid less than the local minimum wage. The Contractor shall adhere to the minimum hourly wage rate that will satisfy both the NC Department of Labor (NCDOL) and the Department.

Achieving or Failing to Meet Training Goals

The Contractor will be credited for each trainee employed by him on the contract work who is currently enrolled or becomes enrolled in an approved program and who receives training for at least 50 percent of the specific program requirement. Trainees will be allowed to be transferred between projects if required by the Contractor's scheduled workload to meet training goals.

If a contractor fails to attain their training assignments for the calendar year, they may be taken off the NCDOT's Bidders List.

Measurement and Payment

No compensation will be made for providing required training in accordance with these contract documents.

STANDARD SPECIAL PROVISION
MINIMUM WAGES
GENERAL DECISION NC130086 01/04/2013 NC86

Z-86

Date: January 4, 2013

General Decision Number: NC130086 01/04/2013 NC86

Superseded General Decision Numbers: NC20120086

State: North Carolina

Construction Type: HIGHWAY

COUNTIES:

Beaufort	Dare	Pamlico
Bertie	Gates	Pasquotank
Camden	Hertford	Perquimans
Carteret	Hyde	Tyrrell
Chowan	Jones	Washington
Craven	Martin	

HIGHWAY CONSTRUCTION PROJECTS (excluding tunnels, building structures in rest area projects, railroad construction, bascule, suspension and spandrel arch bridges designed for commercial navigation, bridges involving marine construction, and other major bridges).

Modification Number
0

Publication Date
01/04/2013

SUNC2011-067 09/15/2011

	Rates	Fringes
CARPENTER (Form Work Only)		
Beaufort County	16.53	
Remaining Counties	15.65	
CEMENT MASON/CONCRETE FINISHER	13.64	
IRONWORKER (Reinforcing)	13.90	
LABORER		
Asphalt, Asphalt Distributor, Raker, and Spreader	12.94	
Common or General		
Beaufort County	10.23	
Craven County	10.39	
Jones County	8.95	
Pamlico County	8.76	
Remaining Counties	9.87	
Concrete Saw	11.14	
Landscape	9.68	
Luteman	12.78	
Mason Tender (Cement/Concrete)	10.53	
Pipelayer	11.13	
Traffic Control (Flagger)	10.31	
POWER EQUIPMENT OPERATOR		
Backhoe/Excavator/Trackhoe		
Beaufort County	15.89	
Remaining Counties	14.71	
Broom/Sweeper	12.29	
Bulldozer		
Beaufort County	14.42	
Remaining Counties	14.56	
Crane	19.89	
Grader/Blade	18.75	
Loader	14.08	
Mechanic	19.04	
Milling Machine	14.09	
Oiler	14.19	
Paver	14.45	
Roller	12.97	
Scraper	12.29	
Screed	14.53	
Tractor	12.72	
TRUCK DRIVER		
Dump Truck		
Beaufort County	11.39	
Pamlico County	13.02	
Remaining Counties	12.31	
Lowboy Truck	15.69	
Single Axle Truck		
Dare, Martin, Pasquotank, and Washington Counties	11.78	
Remaining Counties	11.70	
Water Truck	13.82	

Welders – Receive rate prescribed for craft performing operation to which welding is incidental.

Unlisted classifications needed for work not included within the scope of the classifications listed may be added after award only as provided in the labor standards contract clauses (29 CFR 5.5(a)(1)(ii)).

The body of each wage determination lists the classification and wage rates that have been found to be prevailing for the cited type(s) of construction in the area covered by the wage determination. The classifications are listed in alphabetical order of "identifiers" that indicate whether the particular rate is union or non-union.

Union Identifiers

An identifier enclosed in dotted lines beginning with characters other than "SU" denotes that the union classification and rate have found to be prevailing for that classification. Example: PLUM0198-005 07/01/2011. The first four letters, PLUM, indicate the international union and the four-digit number, 0198, that follows indicates the local union number or district council number where applicable, i.e., Plumbers Local 0198. The next number, 005 in the example, is an internal number used in processing the wage determination. The date, 07/01/2011, following these characters is the effective date of the most current negotiated rate/collective bargaining agreement which would be July 1, 2011 in the above example.

Union prevailing wage rates will be updated to reflect any changes in the collective bargaining agreements governing the rates.

0000/9999: weighted union wage rates will be published annually each January.

Non-Union Identifiers

Classifications listed under an "SU" identifier were derived from survey data by computing average rates and are not union rates; however, the data used in computing these rates may include both union and non-union data. Example: SULA2004-007 5/13/2010. SU indicates the rates are not union rates, LA indicates the State of Louisiana; 2004 is the year of the survey; and 007 is an internal number used in producing the wage determination. A 1993 or later date, 5/13/2010, indicates the classifications and rates under that identifier were issued as a General Wage Determination on that date.

Survey wage rates will remain in effect and will not change until a new survey is conducted.

WAGE DETERMINATION APPEALS PROCESS

1.) Has there been an initial decision in the matter? This can be:

- * an existing published wage determination
- * a survey underlying a wage determination
- * a Wage and Hour Division letter setting forth a position on a wage determination matter
- * a conformance (additional classification and rate) ruling

On survey related matters, initial contact, including requests for summaries of surveys, should be with the Wage and Hour Regional Office for the area in which the survey was conducted because those Regional Offices have responsibility for the Davis-Bacon survey program. If the response from this initial contact is not satisfactory, then the process described in 2.) and 3.) should be followed.

With regard to any other matter not yet ripe for the formal process described here, initial contact should be with the Branch of Construction Wage Determinations. Write to:

Branch of Construction Wage Determinations
Wage and Hour Division
U. S. Department of Labor
200 Constitution Avenue, N.W.
Washington, D.C. 20210

2.) If the answer to the question in 1.) is yes, then an interested party (those affected by the action) can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Write to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, D.C. 20210

The request should be accompanied by a full statement of the interested party's position and by any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3.) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, D.C. 20210

4.) All decisions by the Administrative Review Board are final.

END OF GENERAL DECISION

General Decision Number: NC130062 08/23/2013 NC62

Superseded General Decision Number: NC20120062

State: North Carolina

Construction Type: Building

Counties: Beaufort, Bertie, Camden, Carteret, Hertford, Hyde, Pamlico and Tyrrell Counties in North Carolina.

BUILDING CONSTRUCTION PROJECTS (does not include single family homes or apartments up to and including 4 stories).

Modification Number Publication Date

0 01/04/2013

1 08/23/2013

* PLUM0421-004 07/01/2013

	Rates	Fringes
PIPEFITTER (Excluding HVAC System Installation).....	\$ 24.85	9.65

* SUNC2011-043 08/26/2011

	Rates	Fringes
BRICKLAYER.....	\$ 19.38	8.73
CARPENTER (Drywall Hanging Only)....	\$ 18.13	1.31
CARPENTER (Form Work Only).....	\$ 14.21	0.41
CARPENTER, Excludes Drywall Hanging, and Form Work.....	\$ 14.64	2.39
CEMENT MASON/CONCRETE FINISHER...	\$ 14.02	0.00
ELECTRICIAN.....	\$ 17.10	1.47
HVAC MECHANIC (HVAC Duct Installation Only).....	\$ 15.58	1.53
IRONWORKER, STRUCTURAL.....	\$ 18.75	5.62
LABORER: Common or General.....	\$ 10.57	0.67
LABORER: Landscape & Irrigation.....	\$ 10.29	1.82
LABORER: Mason Tender-Brick/Cement/Concrete...	\$ 10.00	0.00

OPERATOR:

Backhoe/Excavator/Trackhoe.....	\$ 14.71	2.33
OPERATOR: Crane.....	\$ 19.25	2.37
OPERATOR: Grader/Blade.....	\$ 15.71	1.49
PAINTER: Brush, Roller and Spray.....	\$ 14.36	1.97
PLUMBER (HVAC Unit Installation).....	\$ 16.96	3.17
PLUMBER, Excludes HVAC Unit Installation.....	\$ 17.34	2.09
ROOFER.....	\$ 13.55	0.80
SHEET METAL WORKER, Excludes HVAC Duct and Unit Installation.....	\$ 13.09	1.28
TRUCK DRIVER: Dump Truck.....	\$ 12.50	1.21

WELDERS - Receive rate prescribed for craft performing operation to which welding is incidental.

Unlisted classifications needed for work not included within the scope of the classifications listed may be added after award only as provided in the labor standards contract clauses (29CFR 5.5 (a) (1) (ii)).

The body of each wage determination lists the classification and wage rates that have been found to be prevailing for the cited type(s) of construction in the area covered by the wage determination. The classifications are listed in alphabetical order of "identifiers" that indicate whether the particular rate is union or non-union.

Union Identifiers

An identifier enclosed in dotted lines beginning with characters other than "SU" denotes that the union classification and rate have found to be prevailing for that classification. Example: PLUM0198-005 07/01/2011. The first four letters , PLUM, indicate the international union and the four-digit number, 0198, that follows indicates the local union number or district council number where applicable , i.e., Plumbers Local 0198. The next number, 005 in the example, is an internal number used in processing the wage determination. The date, 07/01/2011, following these characters is the effective date of the most current negotiated rate/collective bargaining agreement which would be July 1, 2011 in the above example.

Union prevailing wage rates will be updated to reflect any changes in the collective bargaining agreements governing the rates.

0000/9999: weighted union wage rates will be published annually each January.

Non-Union Identifiers

Classifications listed under an "SU" identifier were derived from survey data by computing average rates and are not union rates; however, the data used in computing these rates may include both union and non-union data. Example: SULA2004-007 5/13/2010. SU indicates the rates are not union majority rates, LA indicates the State of Louisiana; 2004 is the year of the survey; and 007 is an internal number used in producing the wage determination. A 1993 or

later date, 5/13/2010, indicates the classifications and rates under that identifier were issued as a General Wage Determination on that date.

Survey wage rates will remain in effect and will not change until a new survey is conducted.

WAGE DETERMINATION APPEALS PROCESS

1.) Has there been an initial decision in the matter? This can be:

- * an existing published wage determination
- * a survey underlying a wage determination
- * a Wage and Hour Division letter setting forth a position on a wage determination matter
- * a conformance (additional classification and rate) ruling

On survey related matters, initial contact, including requests for summaries of surveys, should be with the Wage and Hour Regional Office for the area in which the survey was conducted because those Regional Offices have responsibility for the Davis-Bacon survey program. If the response from this initial contact is not satisfactory, then the process described in 2.) and 3.) should be followed.

With regard to any other matter not yet ripe for the formal process described here, initial contact should be with the Branch of Construction Wage Determinations. Write to:

Branch of Construction Wage Determinations
Wage and Hour Division
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

2.) If the answer to the question in 1.) is yes, then an interested party (those affected by the action) can request review and reconsideration from the Wage and Hour Administrator (See 29 CFR Part 1.8 and 29 CFR Part 7). Write to:

Wage and Hour Administrator
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

The request should be accompanied by a full statement of the interested party's position and by any information (wage payment data, project description, area practice material, etc.) that the requestor considers relevant to the issue.

3.) If the decision of the Administrator is not favorable, an interested party may appeal directly to the Administrative Review Board (formerly the Wage Appeals Board). Write to:

Administrative Review Board
U.S. Department of Labor
200 Constitution Avenue, N.W.
Washington, DC 20210

4.) All decisions by the Administrative Review Board are final.

=====

END OF GENERAL DECISION

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
ROADWAY ITEMS						
0001	0000100000-N	800	MOBILIZATION	Lump Sum	L.S.	
0002	0000400000-N	801	CONSTRUCTION SURVEYING	Lump Sum	L.S.	
0003	0036000000-E	225	UNDERCUT EXCAVATION	14,315 CY		
0004	0043000000-N	226	GRADING	Lump Sum	L.S.	
0005	0050000000-E	226	SUPPLEMENTARY CLEARING & GRUB- BING	1 ACR		
0006	0134000000-E	240	DRAINAGE DITCH EXCAVATION	776 CY		
0007	0195000000-E	265	SELECT GRANULAR MATERIAL	27,700 CY		
0008	0196000000-E	270	GEOTEXTILE FOR SOIL STABILIZA- TION	27,700 SY		
0009	0262000000-N	SP	GENERIC GRADING ITEM HAZARDOUS SPILL BASIN/ BIORETENTION BASIN	1 EA		
0010	0318000000-E	300	FOUNDATION CONDITIONING MATE- RIAL, MINOR STRUCTURES	540 TON		
0011	0320000000-E	300	FOUNDATION CONDITIONING GEO- TEXTILE	1,690 SY		
0012	0335200000-E	305	15" DRAINAGE PIPE	738 LF		
0013	0354000000-E	310	****" RC PIPE CULVERTS, CLASS ***** (15", V)	540 LF		
0014	0354000000-E	310	****" RC PIPE CULVERTS, CLASS ***** (18", V)	60 LF		
0015	0354000000-E	310	****" RC PIPE CULVERTS, CLASS ***** (24", V)	200 LF		
0016	0354000000-E	310	****" RC PIPE CULVERTS, CLASS ***** (30", V)	92 LF		
0017	0366000000-E	310	15" RC PIPE CULVERTS, CLASS III	56 LF		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0018	0372000000-E	310	18" RC PIPE CULVERTS, CLASS III	116 LF		
0019	0414000000-E	310	60" RC PIPE CULVERTS, CLASS III	232 LF		
0020	0546000000-E	310	*** CAA PIPE CULVERTS, ***** THICK (18", 0.064")	4 LF		
0021	0546000000-E	310	*** CAA PIPE CULVERTS, ***** THICK (54", 0.109")	28 LF		
0022	0995000000-E	340	PIPE REMOVAL	181 LF		
0023	1121000000-E	520	AGGREGATE BASE COURSE	6,000 TON		
0024	1220000000-E	545	INCIDENTAL STONE BASE	100 TON		
0025	1275000000-E	600	PRIME COAT	135 GAL		
0026	1489000000-E	610	ASPHALT CONC BASE COURSE, TYPE B25.0B	2,800 TON		
0027	1491000000-E	610	ASPHALT CONC BASE COURSE, TYPE B25.0C	110 TON		
0028	1498000000-E	610	ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0B	4,590 TON		
0029	1503000000-E	610	ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0C	55 TON		
0030	1519000000-E	610	ASPHALT CONC SURFACE COURSE, TYPE S9.5B	3,430 TON		
0031	1523000000-E	610	ASPHALT CONC SURFACE COURSE, TYPE S9.5C	50 TON		
0032	1575000000-E	620	ASPHALT BINDER FOR PLANT MIX	560 TON		
0033	1693000000-E	654	ASPHALT PLANT MIX, PAVEMENT REPAIR	20 TON		
0034	2022000000-E	815	SUBDRAIN EXCAVATION	22.4 CY		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0035	2026000000-E	815	GEOTEXTILE FOR SUBSURFACE DRAINS	100 SY		
0036	2036000000-E	815	SUBDRAIN COARSE AGGREGATE	16.8 CY		
0037	2044000000-E	815	6" PERFORATED SUBDRAIN PIPE	100 LF		
0038	2070000000-N	815	SUBDRAIN PIPE OUTLET	1 EA		
0039	2077000000-E	815	6" OUTLET PIPE	6 LF		
0040	2220000000-E	838	REINFORCED ENDWALLS	16.4 CY		
0041	2253000000-E	840	PIPE COLLARS	6.05 CY		
0042	2286000000-N	840	MASONRY DRAINAGE STRUCTURES	28 EA		
0043	2364000000-N	840	FRAME WITH TWO GRATES, STD 840.16	10 EA		
0044	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (E)	4 EA		
0045	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (F)	4 EA		
0046	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (G)	10 EA		
0047	2549000000-E	846	2'-6" CONCRETE CURB & GUTTER	5,400 LF		
0048	2591000000-E	848	4" CONCRETE SIDEWALK	2,050 SY		
0049	2605000000-N	848	CONCRETE CURB RAMP	5 EA		
0050	2612000000-E	848	6" CONCRETE DRIVEWAY	30 SY		
0051	2647000000-E	852	5" MONOLITHIC CONCRETE ISLANDS (SURFACE MOUNTED)	170 SY		
0052	3503000000-E	866	WOVEN WIRE FENCE, 47" FABRIC	1,010 LF		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0053	3509000000-E	866	4" TIMBER FENCE POSTS, 7'-6" LONG	61 EA		
0054	3515000000-E	866	5" TIMBER FENCE POSTS, 8'-0" LONG	20 EA		
0055	3539000000-E	866	METAL LINE POSTS FOR *** CHAIN LINK FENCE (72")	60 EA		
0056	3545000000-E	866	METAL TERMINAL POSTS FOR *** CHAIN LINK FENCE (72")	3 EA		
0057	3575000000-E	SP	GENERIC FENCING ITEM 72" CHAIN LINK FENCE WITH SLATS	718 LF		
0058	3628000000-E	876	RIP RAP, CLASS I	105 TON		
0059	3649000000-E	876	RIP RAP, CLASS B	58 TON		
0060	3656000000-E	876	GEOTEXTILE FOR DRAINAGE	1,031 SY		
0061	3659000000-N	SP	PREFORMED SCOUR HOLES WITH LEVEL SPREADER APRON	2 EA		
0062	4048000000-E	902	REINFORCED CONCRETE SIGN FOUNDATIONS	4 CY		
0063	4054000000-E	902	PLAIN CONCRETE SIGN FOUNDATIONS	2 CY		
0064	4060000000-E	903	SUPPORTS, BREAKAWAY STEEL BEAM	3,556 LB		
0065	4082000000-E	903	SUPPORTS, WOOD	140 LF		
0066	4102000000-N	904	SIGN ERECTION, TYPE E	8 EA		
0067	4110000000-N	904	SIGN ERECTION, TYPE *** (GROUND MOUNTED) (A)	5 EA		
0068	4110000000-N	904	SIGN ERECTION, TYPE *** (GROUND MOUNTED) (B)	4 EA		
0069	4400000000-E	1110	WORK ZONE SIGNS (STATIONARY)	407 SF		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0070	4405000000-E	1110	WORK ZONE SIGNS (PORTABLE)	234 SF		
0071	4410000000-E	1110	WORK ZONE SIGNS (BARRICADE MOUNTED)	73 SF		
0072	4415000000-N	1115	FLASHING ARROW BOARD	1 EA		
0073	4420000000-N	1120	PORTABLE CHANGEABLE MESSAGE SIGN	1 EA		
0074	4430000000-N	1130	DRUMS	90 EA		
0075	4435000000-N	1135	CONES	40 EA		
0076	4445000000-E	1145	BARRICADES (TYPE III)	80 LF		
0077	4450000000-N	1150	FLAGGER	1,440 HR		
0078	4480000000-N	1165	TMA	1 EA		
0079	4685000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (4", 90 MILS)	2,640 LF		
0080	4686000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (4", 120 MILS)	3,410 LF		
0081	4695000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (8", 90 MILS)	600 LF		
0082	4710000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (24", 120 MILS)	370 LF		
0083	4725000000-E	1205	THERMOPLASTIC PAVEMENT MARKING SYMBOL (90 MILS)	24 EA		
0084	4810000000-E	1205	PAINT PAVEMENT MARKING LINES (4")	4,110 LF		
0085	4820000000-E	1205	PAINT PAVEMENT MARKING LINES (8")	35 LF		
0086	4900000000-N	1251	PERMANENT RAISED PAVEMENT MARKERS	20 EA		
0087	5070000000-N	1405	STANDARD FOUNDATION ***** (TYPE R1)	36 EA		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0088	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (2")	60 LF		
0089	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (3")	92 LF		
0090	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (4")	37 LF		
0091	5170000000-E	1410	** #8 W/G FEEDER CIRCUIT (2)	65 LF		
0092	5180000000-E	1410	** #4 W/G FEEDER CIRCUIT (2)	65 LF		
0093	5205000000-E	1410	** #8 W/G FEEDER CIRCUIT IN *****" CONDUIT (2, 1.5")	4,477 LF		
0094	5210000000-E	1410	** #6 W/G FEEDER CIRCUIT IN *****" CONDUIT (2, 1.5")	1,880 LF		
0095	5215000000-E	1410	** #4 W/G FEEDER CIRCUIT IN *****" CONDUIT (2, 1.5")	225 LF		
0096	5270000000-N	SP	GENERIC LIGHTING ITEM BOLLARD LGT STD	8 EA		
0097	5270000000-N	SP	GENERIC LIGHTING ITEM DAVIT STYLE LGT STD, MH 35', SA 6'	36 EA		
0098	5270000000-N	SP	GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PC18	13 EA		
0099	5270000000-N	SP	GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PG36	1 EA		
0100	5270000000-N	SP	GENERIC LIGHTING ITEM LIGHT CONTROL EQUIPMENT, TYPE RA 120/240V	1 EA		
0101	5270000000-N	SP	GENERIC LIGHTING ITEM POST TOP LIGHT STANDARD	14 EA		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0102	5270000000-N	SP	GENERIC LIGHTING ITEM PT LUMINAIRES, LED, TYPE V	14 EA		
0103	5270000000-N	SP	GENERIC LIGHTING ITEM RDW LUMINAIRES, LED, TYPE III	36 EA		
0104	5270000000-N	SP	GENERIC LIGHTING ITEM STD FOUNDATION, TYPE B1	8 EA		
0105	5270000000-N	SP	GENERIC LIGHTING ITEM STD FOUNDATION, TYPE R1S	14 EA		
0106	5319000000-E	1505	CLASS B CONCRETE FOR ENCASING UTILITY LINES	1.5 CY		
0107	5325000000-E	1510	*** WATER LINE (1")	1,318 LF		
0108	5325200000-E	1510	2" WATER LINE	25 LF		
0109	5325300000-E	1510	3" WATER LINE	233 LF		
0110	5325600000-E	1510	6" WATER LINE	1,315 LF		
0111	5534000000-E	1515	*** VALVE (1")	2 EA		
0112	5534000000-E	1515	*** VALVE (2")	1 EA		
0113	5540000000-E	1515	6" VALVE	3 EA		
0114	5643200000-E	1515	2" WATER METER	1 EA		
0115	5656200000-E	1515	2" RPZ BACKFLOW PREVENTION ASSEMBLY	1 EA		
0116	5666000000-E	1515	FIRE HYDRANT	1 EA		
0117	5691200000-E	1520	6" SANITARY GRAVITY SEWER	750 LF		
0118	5768000000-N	1520	SANITARY SEWER CLEAN-OUT	9 EA		
0119	5775000000-E	1525	4' DIA UTILITY MANHOLE	2 EA		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0120	5882000000-N	SP	GENERIC UTILITY ITEM YARD HYDRANT	1 EA		
0121	6000000000-E	1605	TEMPORARY SILT FENCE	9,400 LF		
0122	6006000000-E	1610	STONE FOR EROSION CONTROL, CLASS A	300 TON		
0123	6009000000-E	1610	STONE FOR EROSION CONTROL, CLASS B	1,000 TON		
0124	6012000000-E	1610	SEDIMENT CONTROL STONE	2,000 TON		
0125	6015000000-E	1615	TEMPORARY MULCHING	10 ACR		
0126	6018000000-E	1620	SEED FOR TEMPORARY SEEDING	300 LB		
0127	6021000000-E	1620	FERTILIZER FOR TEMPORARY SEED- ING	1.75 TON		
0128	6024000000-E	1622	TEMPORARY SLOPE DRAINS	600 LF		
0129	6029000000-E	SP	SAFETY FENCE	1,800 LF		
0130	6030000000-E	1630	SILT EXCAVATION	2,000 CY		
0131	6036000000-E	1631	MATting FOR EROSION CONTROL	10,500 SY		
0132	6037000000-E	SP	COIR FIBER MAT	100 SY		
0133	6038000000-E	SP	PERMANENT SOIL REINFORCEMENT MAT	36 SY		
0134	6042000000-E	1632	1/4" HARDWARE CLOTH	700 LF		
0135	6043000000-E	SP	LOW PERMEABILITY GEOTEXTILE	25 SY		
0136	6046000000-E	1636	TEMPORARY PIPE FOR STREAM CROSSING	25 LF		
0137	6070000000-N	1639	SPECIAL STILLING BASINS	4 EA		
0138	6071012000-E	SP	COIR FIBER WATTLE	900 LF		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0139	6071020000-E	SP	POLYACRYLAMIDE (PAM)	140 LB		
0140	6071030000-E	1640	COIR FIBER BAFFLE	840 LF		
0141	6071050000-E	SP	*** SKIMMER (1-1/2")	1 EA		
0142	6071050000-E	SP	*** SKIMMER (2")	1 EA		
0143	6084000000-E	1660	SEEDING & MULCHING	9 ACR		
0144	6087000000-E	1660	MOWING	9 ACR		
0145	6090000000-E	1661	SEED FOR REPAIR SEEDING	100 LB		
0146	6093000000-E	1661	FERTILIZER FOR REPAIR SEEDING	0.25 TON		
0147	6096000000-E	1662	SEED FOR SUPPLEMENTAL SEEDING	300 LB		
0148	6108000000-E	1665	FERTILIZER TOPDRESSING	8.5 TON		
0149	6111000000-E	SP	IMPERVIOUS DIKE	50 LF		
0150	6114500000-N	1667	SPECIALIZED HAND MOWING	20 MHR		
0151	6117000000-N	SP	RESPONSE FOR EROSION CONTROL	75 EA		
0152	6135000000-E	SP	GENERIC EROSION CONTROL ITEM SEEDING & MULCHING; CENTIPEDE TURF SEEDING, 1 LB/1000SF	4.3 ACR		
0153	6640000000-N	1670	GENERIC PLANTING ITEM ABELIA X KALEIDOSCOPE; KALEI- DOSCOPE ABELIA, 12-15", #3 CONTAINER	18 EA		
0154	6640000000-N	1670	GENERIC PLANTING ITEM CORNUS FLORIDA; FLOWERING DOGWOOD 7-8', 1 1/2" CAL., B&B	21 EA		
0155	6640000000-N	1670	GENERIC PLANTING ITEM GLEDITSIA TRIACANTHOS INERMIS; THORNLESS HONEYLOCUST, 12-14', 3" CAL	7 EA		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0156	6640000000-N	1670	GENERIC PLANTING ITEM HEMEROCALLIS 'BUTTERED POP-CORN' BUTTERED POPCORN DAYLILY, #1 CONTAINER	87 EA		
0157	6640000000-N	1670	GENERIC PLANTING ITEM ILEX CORNUTA 'CARISSA'; CARISSA HOLLY 18-24", #3 CONTAINER	29 EA		
0158	6640000000-N	1670	GENERIC PLANTING ITEM LAGERSTROEMIA 'ARAPAHO'; ARAPAHO CRAPE MYRTLE, 6-7', B&B	6 EA		
0159	6640000000-N	1670	GENERIC PLANTING ITEM LIRIOPE MUSCARI 'BIG BLUE'; BIG BLUE LIRIOPE, #1 CONTAINER	85 EA		
0160	6640000000-N	1670	GENERIC PLANTING ITEM MAGNOLIA GRANDIFLORA 'LITTLE GEM'; LITTLE GEM MAGNOLIA, 8-10', B&B	21 EA		
0161	6640000000-N	1670	GENERIC PLANTING ITEM MYRICA CERIFICA; WAX MYRTLE, 4", #15 CONTAINER	31 EA		
0162	6640000000-N	1670	GENERIC PLANTING ITEM QUERCUS VIRGINIANA; LIVE OAK, 8-10', 2 1/2" CALIPER, #30 CONTAINER	13 EA		
0163	6640000000-N	1670	GENERIC PLANTING ITEM ROSA 'RADTKO'; RED DOUBLE KNOCKOUT ROSE, 18-24", #3 CONTAINER	4 EA		
0164	6640000000-N	1670	GENERIC PLANTING ITEM SCHIZACHYRIUM SCOPARIUM; LITTLE BLUESTEM, #1 CONTAINER	43 EA		
0165	6640000000-N	1670	GENERIC PLANTING ITEM SPIRAEA JAPONICA 'GOLDMOUND'; GOLDMOUND SPIRAEA, 12-15", #3 CONTAINER	11 EA		
0166	6640000000-N	1670	GENERIC PLANTING ITEM TAXODIUM DISTICHUM; BALD CYPRESS, 6-8', 2" CALIPER, #15 CONTAINER	29 EA		
0167	6650000000-E	1670	MULCH FOR PLANTING	170 CY		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0168	6655000000-E	1670	WATER FOR PLANTING	9 M/G		
0169	6665000000-E	1670	POSTEMERGENT HERBICIDAL TREATMENT FOR PLANT BEDS	1,545 SY		
0170	6670000000-E	1670	PREEMERGENT HERBICIDAL TREATMENT FOR PLANT BEDS	1,545 SY		
0171	6674000000-N	SP	GENERIC PLANTING ITEM (LS) STREAMBANK BUFFER REFORESTATION PLANTING	Lump Sum	L.S.	
0172	6675000000-E	SP	GENERIC PLANTING ITEM SODDING	2,600 SY		
0173	6677000000-E	SP	GENERIC PLANTING ITEM RIVER STONE	4 TON		
0174	6690000000-E	SP	GENERIC PLANTING ITEM LANDSCAPE METAL EDGING	184 LF		
0175	6900000000-E	SP	TOPSOIL	600 CY		
0176	6905000000-N	SP	PICNIC TABLE, TERRAZZO & STEEL	4 EA		
0177	6910000000-N	SP	PICNIC SHELTER, SINGLE PICNIC TABLE	3 EA		
0178	6970000000-N	SP	GENERIC REST AREA ITEM BICYCLE PARKING BOLLARD	2 EA		
0179	6970000000-N	SP	GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 28' X 6'	1 EA		
0180	6970000000-N	SP	GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 60' X 8'	1 EA		
0181	6970000000-N	SP	GENERIC REST AREA ITEM PLACEMENT OF BOULDERS	8 EA		
0182	6970000000-N	SP	GENERIC REST AREA ITEM RECYCLING CONTAINER	10 EA		
0183	6970000000-N	SP	GENERIC REST AREA ITEM TAPERED ALUMINUM FLAG POLE	1 EA		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0184	6970000000-N	SP	GENERIC REST AREA ITEM WASTE CONTAINER	10 EA		
0185	6970000000-N	SP	GENERIC REST AREA ITEM WHEEL STOPS @ H/C PARKING	4 EA		
0186	6975000000-N	SP	GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR REST AREA BUILDING	Lump Sum	L.S.	
0187	6975000000-N	SP	GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR STORAGE BUILDING	Lump Sum	L.S.	
0188	6975000000-N	SP	GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF REST AREA BUILDING	Lump Sum	L.S.	
0189	6975000000-N	SP	GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF STORAGE BUILDING	Lump Sum	L.S.	
0190	6975000000-N	SP	GENERIC REST AREA ITEM IRRIGATION SYSTEM	Lump Sum	L.S.	
0191	6975000000-N	SP	GENERIC REST AREA ITEM LANDSCAPE GRADING	Lump Sum	L.S.	
0192	6975000000-N	SP	GENERIC REST AREA ITEM MECHANICAL INSTALLATION FOR REST AREA BUILDING	Lump Sum	L.S.	
0193	6975000000-N	SP	GENERIC REST AREA ITEM PLUMBING INSTALLATION OF REST AREA BUILDING	Lump Sum	L.S.	
0194	6975000000-N	SP	GENERIC REST AREA ITEM RAINWATER COLLECTION SYSTEM	Lump Sum	L.S.	
0195	6975000000-N	SP	GENERIC REST AREA ITEM REST AREA SOLAR WATER HEATING SYSTEM	Lump Sum	L.S.	
0196	6980000000-E	SP	GENERIC REST AREA ITEM 3" PVC UTILITY SLEEVE	140 LF		
0197	6980000000-E	SP	GENERIC REST AREA ITEM 6' WOOD FENCE	18 LF		

County : Beaufort

Line #	Item Number	Sec #	Description	Quantity	Unit Cost	Amount
0198	6982000000-E	SP	GENERIC REST AREA ITEM COMPOSITE DECKING	864 SF		

1410/Dec09/Q171309.95/D900515062000/E198

Total Amount Of Bid For Entire Project :

Vendor 1 of 4: BARNHILL CONTRACTING COMPANY (3516)
Call Order 004 (Proposal: C203304)

Bid Information

County: BEAUFORT
Address: PO Box 1529
Tarboro , NC , 27886
Signature Check: Allen_Barnhill_3516
Time Bid Received: January 21, 2014 01:47 PM
Amendment Count: 0

Bid Checksum: E1C0F4E6
Bid Total: \$4,339,114.45
Items Total: \$4,339,114.45 ✓
Time Total: \$0.00

Bidding Errors:
None.

DBE Goal Set 10.0
DBE Goal Met 10.0

Vendor 1 of 4: BARNHILL CONTRACTING COMPANY (3516)
Call Order 004 (Proposal: C203304)

Bid Bond Information

Projects:

Counties:

Bond ID: SNC14757460

Paid by Check: No

Bond Percent: 5%

Bond Maximum:

State of Incorporation:

Agency Execution Date: 1/14/2014 1

Surety Name: surety2000

Bond Agency Name: Travelers Casualty and Surety
Company of America

Vendor 3516's Bid Information for Call 004, Letting L140121, 01/21/14

Barnhill Contracting Company (3516)
Call Order 004 (Proposal ID C203304)

LIST OF DBE PARTICIPANTS

VENDOR NUMBER	DBE NAME ADDRESS	WORK CODE TYPE OF WORK	CERT TYPE AMOUNT
4247	WB SEAL BROTHERS CONTRACTING LLC 131 W. CLEVE STREET , MOUNT AIRY, NC 27030		Sub 21,800.00 Committed
11705	BOTHERN TRUCKING LLC WB1991 ARCHIE MOBLEY ROAD , WILLIAMSTON, NC 27982		Sub 58,521.00 Committed
4260	MB JORGE AGUILA CARRILLO DBA AGUIL PO BOX 837 , SILER CITY, NC 27344		Sub 29,400.00 Committed
11852	SADLER LANDSCAPING, LLC WB 953 BLACK ROCK ROAD , MERRY HILL, NC 27957		Sub 120,201.75 Committed
7466	WB BEAR & CO SIGNS & LIGHTING, INC 2201 WEST LEE STREET , GREENSBORO, NC 27403		Sub 25,129.40 Committed
5291	WB ATCO TRANSPORT INC 129 KNOBBS CREEK RD , ELIZABETH CITY, NC 27909		Sub 7,000.00 Committed
11705	BOTHERN TRUCKING LLC WB1991 ARCHIE MOBLEY ROAD , WILLIAMSTON, NC 27982		Sub 177,100.00 Committed
TOTAL:			\$439,152.15 10.12%

Vendor 3516's Bid Information for Call 004, Letting L140121, 01/21/14

Barnhill Contracting Company (3516)
Call Order 004 (Proposal ID C203304)

Miscellaneous Data Info - Contractor Responses:

NON-COLLUSION AND DEBARMENT CERTIFICATION

Explanation of the prospective bidder that is unable to certify to any of the statements in this certification:

Explanation:
NOT ANSWERED
NOT ANSWERED
NOT ANSWERED
NOT ANSWERED

AWARD LIMITS ON MULTIPLE PROJECTS

By answering YES to this statement, the bidder acknowledges that they are using the award limits on multiple projects. No

It is the desire of the Bidder to be awarded contracts, the value of which will not exceed a total of NOT ANSWERED for those projects indicated herein, for which bids will be opened on (MM/DD/YY)

The Award Limits shall apply to the following projects:

Contract Number	County
NOT ANSWERED	
NOT ANSWERED	

NOT ANSWERED
NOT ANSWERED
NOT ANSWERED
NOT ANSWERED

Bid Bond Data Info - Contractor Responses:

=====

BondID: SNC14757460
Surety Registry Agency: surety2000
Verified?: Yes
Surety Agency: Travelers Casualty and Surety Company of America
Bond Execution Date: 1/14/2014 1
Bond Amount: \$216,955.72 (Five Percent of Bid)

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
Section 0001 ROADWAY ITEMS				
Alt Group				
0001	0000100000-N MOBILIZATION	LUMP	LUMP	217,000.00
0002	0000400000-N CONSTRUCTION SURVEYING	LUMP	LUMP	50,000.00
0003	0036000000-E UNDERCUT EXCAVATION	14,315.000 CY	15.00000	214,725.00
0004	0043000000-N GRADING	LUMP	LUMP	520,000.00
0005	0050000000-E SUPPLEMENTARY CLEARING & GRUB-BING	1.000 ACR	100.00000	100.00
0006	0134000000-E DRAINAGE DITCH EXCAVATION	776.000 CY	2.00000	1,552.00
0007	0195000000-E SELECT GRANULAR MATERIAL	27,700.000 CY	0.10000	2,770.00
0008	0196000000-E GEOTEXTILE FOR SOIL STABILIZATION	27,700.000 SY	1.20000	33,240.00
0009	0262000000-N GENERIC GRADING ITEM HAZARDOUS SPILL BASIN/ BIORETENTION BASIN	1.000 EA	67,000.00000	67,000.00
0010	0318000000-E FOUNDATION CONDITIONING MATERIAL, MINOR STRUCTURES	540.000 TON	20.00000	10,800.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0011	0320000000-E FOUNDATION CONDITIONING GEO- TEXTILE	1,690.000 SY	0.80000	1,352.00
0012	0335200000-E 15" DRAINAGE PIPE	738.000 LF	26.50000	19,557.00
0013	0354000000-E **** RC PIPE CULVERTS, CLASS ***** (15", V)	540.000 LF	29.70000	16,038.00
0014	0354000000-E **** RC PIPE CULVERTS, CLASS ***** (18", V)	60.000 LF	34.65000	2,079.00
0015	0354000000-E **** RC PIPE CULVERTS, CLASS ***** (24", V)	200.000 LF	45.35000	9,070.00
0016	0354000000-E **** RC PIPE CULVERTS, CLASS ***** (30", V)	92.000 LF	64.50000	5,934.00
0017	0366000000-E 15" RC PIPE CULVERTS, CLASS III	56.000 LF	28.60000	1,601.60
0018	0372000000-E 18" RC PIPE CULVERTS, CLASS III	116.000 LF	28.90000	3,352.40
0019	0414000000-E 60" RC PIPE CULVERTS, CLASS III	232.000 LF	186.00000	43,152.00
0020	0546000000-E *** CAA PIPE CULVERTS, ***** THICK (18", 0.064")	4.000 LF	132.00000	528.00
0021	0546000000-E *** CAA PIPE CULVERTS, ***** THICK (54", 0.109")	28.000 LF	216.00000	6,048.00
0022	0995000000-E PIPE REMOVAL	181.000 LF	13.75000	2,488.75

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0023	1121000000-E AGGREGATE BASE COURSE	6,000.000 TON	22.10000	132,600.00
0024	1220000000-E INCIDENTAL STONE BASE	100.000 TON	22.10000	2,210.00
0025	1275000000-E PRIME COAT	135.000 GAL	6.30000	850.50
0026	1489000000-E ASPHALT CONC BASE COURSE, TYPE B25.0B	2,800.000 TON	50.25000	140,700.00
0027	1491000000-E ASPHALT CONC BASE COURSE, TYPE B25.0C	110.000 TON	57.35000	6,308.50
0028	1498000000-E ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0B	4,590.000 TON	48.40000	222,156.00
0029	1503000000-E ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0C	55.000 TON	57.00000	3,135.00
0030	1519000000-E ASPHALT CONC SURFACE COURSE, TYPE S9.5B	3,430.000 TON	48.10000	164,983.00
0031	1523000000-E ASPHALT CONC SURFACE COURSE, TYPE S9.5C	50.000 TON	60.00000	3,000.00
0032	1575000000-E ASPHALT BINDER FOR PLANT MIX	560.000 TON	600.00000	336,000.00
0033	1693000000-E ASPHALT PLANT MIX, PAVEMENT REPAIR	20.000 TON	100.00000	2,000.00
0034	2022000000-E SUBDRAIN EXCAVATION	22.400 CY	3.50000	78.40

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Cts
0035	2026000000-E GEOTEXTILE FOR SUBSURFACE DRAINS	100.000 SY	0.60000		60.00	
0036	2036000000-E SUBDRAIN COARSE AGGREGATE	16.800 CY	50.00000		840.00	
0037	2044000000-E 6" PERFORATED SUBDRAIN PIPE	100.000 LF	9.50000		950.00	
0038	2070000000-N SUBDRAIN PIPE OUTLET	1.000 EA	195.00000		195.00	
0039	2077000000-E 6" OUTLET PIPE	6.000 LF	42.00000		252.00	
0040	2220000000-E REINFORCED ENDWALLS	16.400 CY	1,122.00000		18,400.80	
0041	2253000000-E PIPE COLLARS	6.050 CY	1,095.00000		6,624.75	
0042	2286000000-N MASONRY DRAINAGE STRUCTURES	28.000 EA	875.00000		24,500.00	
0043	2364000000-N FRAME WITH TWO GRATES, STD 840.16	10.000 EA	490.00000		4,900.00	
0044	2374000000-N FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (E)	4.000 EA	430.00000		1,720.00	
0045	2374000000-N FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (F)	4.000 EA	490.00000		1,960.00	
0046	2374000000-N FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (G)	10.000 EA	520.00000		5,200.00	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304

Project(s): NHS-17(32)

Letting Date: 01-21-14 Call Order: 004

Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Cts
0047	2549000000-E 2'-6" CONCRETE CURB & GUTTER	5,400.000 LF	14.95000		80,730.00	
0048	2591000000-E 4" CONCRETE SIDEWALK	2,050.000 SY	25.00000		51,250.00	
0049	2605000000-N CONCRETE CURB RAMP	5.000 EA	925.00000		4,625.00	
0050	2612000000-E 6" CONCRETE DRIVEWAY	30.000 SY	38.60000		1,158.00	
0051	2647000000-E 5" MONOLITHIC CONCRETE ISLANDS (SURFACE MOUNTED)	170.000 SY	43.50000		7,395.00	
0052	3503000000-E WOVEN WIRE FENCE, 47" FABRIC	1,010.000 LF	3.00000		3,030.00	
0053	3509000000-E 4" TIMBER FENCE POSTS, 7'-6" LONG	61.000 EA	25.00000		1,525.00	
0054	3515000000-E 5" TIMBER FENCE POSTS, 8'-0" LONG	20.000 EA	55.00000		1,100.00	
0055	3539000000-E METAL LINE POSTS FOR *** CHAINLINK FENCE (72")	60.000 EA	47.00000		2,820.00	
0056	3545000000-E METAL TERMINAL POSTS FOR *** CHAIN LINK FENCE (72")	3.000 EA	118.00000		354.00	
0057	3575000000-E GENERIC FENCING ITEM 72" CHAIN LINK FENCE WITH SLATS	718.000 LF	15.50000		11,129.00	
0058	3628000000-E RIP RAP, CLASS I	105.000 TON	57.00000		5,985.00	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0059	3649000000-E RIP RAP, CLASS B	58.000 TON	57.00000	3,306.00
0060	3656000000-E GEOTEXTILE FOR DRAINAGE	1,031.000 SY	1.90000	1,958.90
0061	3659000000-N PREFORMED SCOUR HOLES WITH LEVEL SPREADER APRON	2.000 EA	1,235.00000	2,470.00
0062	4048000000-E REINFORCED CONCRETE SIGN FOUN-DATIONS	4.000 CY	950.00000	3,800.00
0063	4054000000-E PLAIN CONCRETE SIGN FOUNDA- TIONS	2.000 CY	450.00000	900.00
0064	4060000000-E SUPPORTS, BREAKAWAY STEEL BEAM	3,556.000 LB	3.90000	13,868.40
0065	4082000000-E SUPPORTS, WOOD	140.000 LF	4.90000	686.00
0066	4102000000-N SIGN ERECTION, TYPE E	8.000 EA	75.00000	600.00
0067	4110000000-N SIGN ERECTION, TYPE *** (GROUND MOUNTED) (A)	5.000 EA	675.00000	3,375.00
0068	4110000000-N SIGN ERECTION, TYPE *** (GROUND MOUNTED) (B)	4.000 EA	475.00000	1,900.00
0069	4400000000-E WORK ZONE SIGNS (STATIONARY)	407.000 SF	7.50000	3,052.50
0070	4405000000-E WORK ZONE SIGNS (PORTABLE)	234.000 SF	17.80000	4,165.20

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0071	4410000000-E WORK ZONE SIGNS (BARRICADE MOUNTED)	73.000 SF	13.50000	985.50
0072	4415000000-N FLASHING ARROW BOARD	1.000 EA	895.00000	895.00
0073	4420000000-N PORTABLE CHANGEABLE MESSAGE SIGN	1.000 EA	3,500.00000	3,500.00
0074	4430000000-N DRUMS	90.000 EA	40.00000	3,600.00
0075	4435000000-N CONES	40.000 EA	15.00000	600.00
0076	4445000000-E BARRICADES (TYPE III)	80.000 LF	34.00000	2,720.00
0077	4450000000-N FLAGGER	1,440.000 HR	12.00000	17,280.00
0078	4480000000-N TMA	1.000 EA	2,200.00000	2,200.00
0079	4685000000-E THERMOPLAST IC PAVEMENT MARKING LINES (4", 90 MILS)	2,640.000 LF	0.65000	1,716.00
0080	4686000000-E THERMOPLAST IC PAVEMENT MARKING LINES (4", 120 MILS)	3,410.000 LF	0.75000	2,557.50
0081	4695000000-E THERMOPLAST IC PAVEMENT MARKING LINES (8", 90 MILS)	600.000 LF	2.85000	1,710.00
0082	4710000000-E THERMOPLAST IC PAVEMENT MARKING LINES (24", 120 MILS)	370.000 LF	5.90000	2,183.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0083	4725000000-E THERMOPLAST IC PAVEMENT MARKINGSYMBOL (90 MILS)	24.000 EA	115.00000	2,760.00
0084	4810000000-E PAINT PAVEMENT MARKING LINES (4")	4,110.000 LF	0.50000	2,055.00
0085	4820000000-E PAINT PAVEMENT MARKING LINES (8")	35.000 LF	1.00000	35.00
0086	4900000000-N PERMANENT RAISED PAVEMENT MARKERS	20.000 EA	10.00000	200.00
0087	5070000000-N STANDARD FOUNDATION ***** (TYPE R1)	36.000 EA	1,000.00000	36,000.00
0088	5155000000-E ELECTRICAL DUCT, TYPE BD, SIZE ***** (2")	60.000 LF	6.09000	365.40
0089	5155000000-E ELECTRICAL DUCT, TYPE BD, SIZE ***** (3")	92.000 LF	6.74000	620.08
0090	5155000000-E ELECTRICAL DUCT, TYPE BD, SIZE ***** (4")	37.000 LF	7.25000	268.25
0091	5170000000-E ** #8 W/G FEEDER CIRCUIT (2)	65.000 LF	4.24000	275.60
0092	5180000000-E ** #4 W/G FEEDER CIRCUIT (2)	65.000 LF	6.49000	421.85
0093	5205000000-E ** #8 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5")	4,477.000 LF	10.26000	45,934.02
0094	5210000000-E ** #6 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5")	1,880.000 LF	11.14000	20,943.20

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
0095	5215000000-E ** #4 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5") LF	225.000	12.51000		2,814.75	
0096	5270000000-N GENERIC LIGHTING ITEM BOLLARD LGT STD EA	8.000	1,000.00000		8,000.00	
0097	5270000000-N GENERIC LIGHTING ITEM DAVIT STYLE LGT STD, MH 35', SA 6' EA	36.000	1,900.00000		68,400.00	
0098	5270000000-N GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PC18 EA	13.000	432.00000		5,616.00	
0099	5270000000-N GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PG36 EA	1.000	1,133.00000		1,133.00	
0100	5270000000-N GENERIC LIGHTING ITEM LIGHT CONTROL EQUIPMENT, TYPE RA 120/240V EA	1.000	4,500.00000		4,500.00	
0101	5270000000-N GENERIC LIGHTING ITEM POST TOP LIGHT STANDARD EA	14.000	731.00000		10,234.00	
0102	5270000000-N GENERIC LIGHTING ITEM PT LUMINAIRES, LED, TYPE V EA	14.000	1,629.00000		22,806.00	
0103	5270000000-N GENERIC LIGHTING ITEM RDW LUMINAIRES, LED, TYPE III EA	36.000	750.00000		27,000.00	
0104	5270000000-N GENERIC LIGHTING ITEM STD FOUNDATION, TYPE B1 EA	8.000	250.00000		2,000.00	
0105	5270000000-N GENERIC LIGHTING ITEM STD FOUNDATION, TYPE R1S EA	14.000	650.00000		9,100.00	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0106	5319000000-E CLASS B CONCRETE FOR ENCASING UTILITY LINES	1.500 CY	670.00000	1,005.00
0107	5325000000-E *** WATER LINE (1")	1,318.000 LF	7.00000	9,226.00
0108	5325200000-E 2" WATER LINE	25.000 LF	24.00000	600.00
0109	5325300000-E 3" WATER LINE	233.000 LF	12.00000	2,796.00
0110	5325600000-E 6" WATER LINE	1,315.000 LF	18.00000	23,670.00
0111	5534000000-E *** VALVE (1")	2.000 EA	640.00000	1,280.00
0112	5534000000-E *** VALVE (2")	1.000 EA	935.00000	935.00
0113	5540000000-E 6" VALVE	3.000 EA	1,100.00000	3,300.00
0114	5643200000-E 2" WATER METER	1.000 EA	6,825.00000	6,825.00
0115	5656200000-E 2" RPZ BACKFLOW PREVENTION ASSEMBLY	1.000 EA	3,675.00000	3,675.00
0116	5666000000-E FIRE HYDRANT	1.000 EA	2,555.00000	2,555.00
0117	5691200000-E 6" SANITARY GRAVITY SEWER	750.000 LF	29.00000	21,750.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
0118	5768000000-N SANITARY SEWER CLEAN-OUT	9.000 EA	330.00000		2,970.00	
0119	5775000000-E 4' DIA UTILITY MANHOLE	2.000 EA	1,950.00000		3,900.00	
0120	5882000000-N GENERIC UTILITY ITEM YARD HYDRANT	1.000 EA	495.00000		495.00	
0121	6000000000-E TEMPORARY SILT FENCE	9,400.000 LF	1.60000		15,040.00	
0122	6006000000-E STONE FOR EROSION CONTROL, CLASS A	300.000 TON	45.00000		13,500.00	
0123	6009000000-E STONE FOR EROSION CONTROL, CLASS B	1,000.000 TON	45.00000		45,000.00	
0124	6012000000-E SEDIMENT CONTROL STONE	2,000.000 TON	22.00000		44,000.00	
0125	6015000000-E TEMPORARY MULCHING	10.000 ACR	650.00000		6,500.00	
0126	6018000000-E SEED FOR TEMPORARY SEEDING	300.000 LB	5.00000		1,500.00	
0127	6021000000-E FERTILIZER FOR TEMPORARY SEED-ING	1.750 TON	625.00000		1,093.75	
0128	6024000000-E TEMPORARY SLOPE DRAINS	600.000 LF	10.00000		6,000.00	
0129	6029000000-E SAFETY FENCE	1,800.000 LF	1.50000		2,700.00	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
0130	6030000000-E SILT EXCAVATION	2,000.000 CY	0.10000		200.00	
0131	6036000000-E MATTING FOR EROSION CONTROL	10,500.000 SY	1.15000		12,075.00	
0132	6037000000-E COIR FIBER MAT	100.000 SY	2.45000		245.00	
0133	6038000000-E PERMANENT SOIL REINFORCEMENT MAT	36.000 SY	6.50000		234.00	
0134	6042000000-E 1/4" HARDWARE CLOTH	700.000 LF	3.25000		2,275.00	
0135	6043000000-E LOW PERMEABILITY GEOTEXTILE	25.000 SY	12.10000		302.50	
0136	6046000000-E TEMPORARY PIPE FOR STREAM CROSSING	25.000 LF	133.00000		3,325.00	
0137	6070000000-N SPECIAL STILLING BASINS	4.000 EA	320.00000		1,280.00	
0138	6071012000-E COIR FIBER WATTLE	900.000 LF	7.50000		6,750.00	
0139	6071020000-E POLYACRYLAM IDE (PAM)	140.000 LB	9.25000		1,295.00	
0140	6071030000-E COIR FIBER BAFFLE	840.000 LF	10.00000		8,400.00	
0141	6071050000-E *** SKIMMER (1-1/2")	1.000 EA	885.00000		885.00	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0142	6071050000-E *** SKIMMER (2")	1.000 EA	1,000.00000	1,000.00
0143	6084000000-E SEEDING & MULCHING	9.000 ACR	1,675.00000	15,075.00
0144	6087000000-E MOWING	9.000 ACR	75.00000	675.00
0145	6090000000-E SEED FOR REPAIR SEEDING	100.000 LB	11.00000	1,100.00
0146	6093000000-E FERTILIZER FOR REPAIR SEEDING	0.250 TON	700.00000	175.00
0147	6096000000-E SEED FOR SUPPLEMENTAL SEEDING	300.000 LB	4.00000	1,200.00
0148	6108000000-E FERTILIZER TOPDRESSING	8.500 TON	600.00000	5,100.00
0149	6111000000-E IMPERVIOUS DIKE	50.000 LF	120.00000	6,000.00
0150	6114500000-N SPECIALIZED HAND MOWING	20.000 MHR	50.00000	1,000.00
0151	6117000000-N RESPONSE FOR EROSION CONTROL	75.000 EA	10.00000	750.00
0152	6135000000-E GENERIC EROSION CONTROL ITEM SEEDING & MULCHING; CENTIPEDE TURF SEEDING, 1 LB/1000SF	4.300 ACR	2,625.00000	11,287.50

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
0153	6640000000-N GENERIC PLANTING ITEM ABELIA X KALEIDOSCOPE; KALEI- DOSCOPE ABELIA, 12-15", #3 CONTAINER	18.000 EA	40.00000		720.00	
0154	6640000000-N GENERIC PLANTING ITEM CORNUS FLORIDA; FLOWERING DOGWOOD 7-8', 1 1/2" CAL., B&B	21.000 EA	212.50000		4,462.50	
0155	6640000000-N GENERIC PLANTING ITEM GLEDITSIA TRIACANTHOS INERMIS; THORNLESS HONEYLOCUST, 12-14', 3" CAL	7.000 EA	247.00000		1,729.00	
0156	6640000000-N GENERIC PLANTING ITEM HEMEROCALLIS 'BUTTERED POP- CORN' BUTTERED POPCORN DAYLILY, #1 CONTAINER	87.000 EA	6.00000		522.00	
0157	6640000000-N GENERIC PLANTING ITEM ILEX CORNUTA 'CARISSA'; CARISSA HOLLY 18-24", #3 CONT-AINER	29.000 EA	18.00000		522.00	
0158	6640000000-N GENERIC PLANTING ITEM LAGERSTROEMIA 'ARAPAHO'; ARAPAHO CRAPE MYRTLE, 6-7', B&B	6.000 EA	187.50000		1,125.00	
0159	6640000000-N GENERIC PLANTING ITEM LIRIOPE MUSCARI 'BIG BLUE'; BIG BLUE LIRIOPE, #1 CONTAINER	85.000 EA	4.50000		382.50	

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0160	6640000000-N GENERIC PLANTING ITEM MAGNOLIA GRANDIFLORA 'LITTLE GEM '; LITTLE GEM MAGNOLIA, 8-10', B&B	21.000 EA	250.00000	5,250.00
0161	6640000000-N GENERIC PLANTING ITEM MYRICA CERIFICA; WAX MYRTLE, 4", #15 CONTAINER	31.000 EA	96.00000	2,976.00
0162	6640000000-N GENERIC PLANTING ITEM QUERCUS VIRGINIANA; LIVE OAK, 8-10', 2 1/2" CALIPER, #30 CONTAINER	13.000 EA	286.00000	3,718.00
0163	6640000000-N GENERIC PLANTING ITEM ROSA 'RADTKO'; RED DOUBLE KNOCKOUT ROSE, 18-24", #3 CONTAINER	4.000 EA	23.00000	92.00
0164	6640000000-N GENERIC PLANTING ITEM SCHIZACHYRIUM SCOPARIUM; LITTLE BLUESTEM, #1 CONTAINER	43.000 EA	26.00000	1,118.00
0165	6640000000-N GENERIC PLANTING ITEM SPIRAEA JAPONICA 'GOLDMOUND'; GOLDMOUND SPIRAEA, 12-15", #3 CONTAINER	11.000 EA	16.00000	176.00
0166	6640000000-N GENERIC PLANTING ITEM TAXODIUM DISTICHUM; BALD CYPRESS, 6-8', 2" CALIPER, #15CONTAINER	29.000 EA	108.00000	3,132.00
0167	6650000000-E MULCH FOR PLANTING	170.000 CY	26.00000	4,420.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0168	6655000000-E WATER FOR PLANTING	9.000 M/G	125.00000	1,125.00
0169	6665000000-E POSTEMERGEN T HERBICIDAL TREAT-MENT FOR PLANT BEDS	1,545.000 SY	0.25000	386.25
0170	6670000000-E PREEMERGENT HERBICIDAL TREAT- MENT FOR PLANT BEDS	1,545.000 SY	0.25000	386.25
0171	6674000000-N GENERIC PLANTING ITEM (LS) STREAMBANK BUFFER REFOREST- ATION PLANTING	LUMP	LUMP	8,000.00
0172	6675000000-E GENERIC PLANTING ITEM SODDING	2,600.000 SY	4.50000	11,700.00
0173	6677000000-E GENERIC PLANTING ITEM RIVER STONE	4.000 TON	275.00000	1,100.00
0174	6690000000-E GENERIC PLANTING ITEM LANDSCAPE METAL EDGING	184.000 LF	6.00000	1,104.00
0175	6900000000-E TOPSOIL	600.000 CY	21.00000	12,600.00
0176	6905000000-N PICNIC TABLE, TERRAZZO & STEEL	4.000 EA	4,218.00000	16,872.00
0177	6910000000-N PICNIC SHELTER, SINGLE PICNIC TABLE	3.000 EA	15,173.00000	45,519.00
0178	6970000000-N GENERIC REST AREA ITEM BICYCLE PARKING BOLLARD	2.000 EA	832.50000	1,665.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price Dollars Cts	Bid Amount Dollars Ct
0179	6970000000-N GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 28' X 6'	1.000 EA	1,420.00000	1,420.00
0180	6970000000-N GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 60' X 8'	1.000 EA	3,145.00000	3,145.00
0181	6970000000-N GENERIC REST AREA ITEM PLACEMENT OF BOULDERS	8.000 EA	230.00000	1,840.00
0182	6970000000-N GENERIC REST AREA ITEM RECYCLING CONTAINER	10.000 EA	888.00000	8,880.00
0183	6970000000-N GENERIC REST AREA ITEM TAPERED ALUMINUM FLAG POLE	1.000 EA	2,836.05000	2,836.05
0184	6970000000-N GENERIC REST AREA ITEM WASTE CONTAINER	10.000 EA	888.00000	8,880.00
0185	6970000000-N GENERIC REST AREA ITEM WHEEL STOPS @ H/C PARKING	4.000 EA	61.00000	244.00
0186	6975000000-N GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR REST AREA BUILDING	LUMP	LUMP	101,926.00
0187	6975000000-N GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR STORAGE BUILDING	LUMP	LUMP	4,995.00
0188	6975000000-N GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF REST AREA BUILDING	LUMP	LUMP	541,504.00

State of NC
Dept of Transportation

Date: 12-20-13
Revised:

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
0189	6975000000-N GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF STORAGE BUILDING	LUMP	LUMP		53,245.00	
0190	6975000000-N GENERIC REST AREA ITEM IRRIGATION SYSTEM	LUMP	LUMP		59,415.93	
0191	6975000000-N GENERIC REST AREA ITEM LANDSCAPE GRADING	LUMP	LUMP		2,341.71	
0192	6975000000-N GENERIC REST AREA ITEM MECHANICAL INSTALLATION FOR REST AREA BUILDING	LUMP	LUMP		123,543.00	
0193	6975000000-N GENERIC REST AREA ITEM PLUMBING INSTALLATION OF REST AREA BUILDING	LUMP	LUMP		99,678.00	
0194	6975000000-N GENERIC REST AREA ITEM RAINWATER COLLECTION SYSTEM	LUMP	LUMP		33,260.22	
0195	6975000000-N GENERIC REST AREA ITEM REST AREA SOLAR WATER HEATING SYSTEM	LUMP	LUMP		16,100.00	
0196	6980000000-E GENERIC REST AREA ITEM 3" PVC UTILITY SLEEVE	140.000 LF	12.00000		1,680.00	
0197	6980000000-E GENERIC REST AREA ITEM 6' WOOD FENCE	18.000 LF	70.00000		1,260.00	
0198	6982000000-E GENERIC REST AREA ITEM COMPOSITE DECKING	864.000 SF	12.21000		10,549.44	
	Section 0001 Total				4,339,114.45	

Contract ID: C203304 Project(s): NHS-17(32)
Letting Date: 01-21-14 Call Order: 004
Bidder: 3516 - Barnhill Contracting Company

Line No.	Item Description	Approx. Quantity and Units	Unit Price		Bid Amount	
			Dollars	Cts	Dollars	Ct
	Bid Total				4,339,114.45	

NON-COLLUSION AND DEBARMENT CERTIFICATION

The bidder certifies that neither he, nor any official, agent or employee of the bidder has entered into any agreement, participated in any collusion, or otherwise taken any action which is in restraint of free competitive bidding in connection with this bid, and that the bidder intends to do the work with its own bonafide employees or subcontractors and is not bidding for the benefit of another contractor. In addition, submitting this electronic bid constitutes the bidder's certification of Status under penalty of perjury under the laws of the United States and in accordance with the Debarment Certification on file with the Department.

By submitting this bid, the bidder certifies to the best of his knowledge and belief that he and his principals:

- a. Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
- b. Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records; making false statements; or receiving stolen property;
- c. Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph b. of this certification; and
- d. Have not within a three-year period preceding this proposal had one or more public transactions (Federal, State or local) terminated for cause or default.

Where the prospective bidder is unable to certify to any of the statements in this certification, the bidder shall submit an explanation in the blanks provided herein. The explanation will not necessarily result in denial of participation in a contract.

Explanation:

NOT ANSWERED

NOT ANSWERED

NOT ANSWERED

NOT ANSWERED

If the prequalified bidder's status changes, he shall immediately submit a new fully executed non-collusion affidavit and debarment certification with an explanation of the change to the Contract Office prior to submitting the bid.

Failure to furnish a certification or an explanation will be grounds for rejection of a bid

AWARD LIMITS ON MULTIPLE PROJECTS

By answering YES to this statement, the bidder acknowledges that they are using the award limits on multiple projects. No

A bidder who desires to bid on more than one project on which bids are to be opened on the same date, and who also desires to avoid receiving an award of more projects than he is equipped to handle, may bid on any number of projects but may limit the total amount of work awarded to him on selected projects by completing the AWARD LIMITS ON MULTIPLE PROJECTS.

The Award Limits on Multiple Projects must be filled in on each project bid for which the Bidder desires protection.

It is the desire of the Bidder to be awarded contracts, the value of which will not exceed a total of NOT ANSWERED for those projects indicated herein, for which bids will be opened on (MM/DD/YY)

The Award Limits shall apply to the following projects:

Contract Number	County
NOT ANSWERED	
NOT ANSWERED	
NOT ANSWERED	
NOT ANSWERED	
NOT ANSWERED	
NOT ANSWERED	

It is agreed that if I am (we are) the low Bidder(s) on indicated projects, the total value of which is more than the above stipulated award limits, the Board of Transportation will award me (us) projects from among those indicated that have a total value not to exceed the award limit and will result in the lowest total bids to the Department of Transportation.

NORTH CAROLINA STATE DEPARTMENT OF TRANSPORTATION
DBE COMMITMENT ITEMS

DATE:12-20-13
PAGE: 22

PROPOSAL: C203304
LETTING: L140121 CALL: 004
VENDOR: 3516 Barnhill Contracting Company

LINE NO.	ITEM NO.	ITEM DESC.	UNIT TYPE	SUBCONTRACTOR QUANTITY	SUBCONTRACTOR UNIT PRICE	EXTENDED AMOUNT
----------	----------	------------	-----------	------------------------	--------------------------	-----------------

DBE SUBCONTRACTOR: 4247 SEAL BROTHERS CONTRACTING LLC
Will Use Quote: Yes

0121	6000000000-E	TEMPORARY SI LF		9400.000	1.60000	15040.00
0129	6029000000-E	SAFETY FENCE LF		1800.000	1.50000	2700.00
0134	6042000000-E	1/4" HARDWAR LF		700.000	3.25000	2275.00
0140	6071030000-E	COIR FIBER B LF		420.000	4.25000	1785.00

Partial

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

21,800.00 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

21,800.

DBE SUBCONTRACTOR: 11705 BOTHERN TRUCKING LLC
Will Use Quote: Yes

0010	0318000000-E	FND CONDIT M TON		540.000	7.00000	3780.00
		Haul Only				
0024	1220000000-E	INCIDENTAL S TON		100.000	5.00000	500.00
		Haul Only				
0058	3628000000-E	RIP RAP, CLA TON		105.000	7.00000	735.00
		Haul Only				
0059	3649000000-E	RIP RAP, CLA TON		58.000	7.00000	406.00
		Haul Only				
0122	6006000000-E	EROS CONTRL TON		300.000	7.00000	2100.00
		Haul Only				
0123	6009000000-E	EROS CONTRL TON		1000.000	7.00000	7000.00
		Haul Only				
0124	6012000000-E	SEDIMENT CON TON		2000.000	7.00000	14000.00
		Haul Only				
0023	1121000000-E	AGGREGATE BA TON		6000.000	5.00000	30000.00
		haul Only				

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

58,521.00 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

58,521.

DBE SUBCONTRACTOR: 4260 JORGE AGUILA CARRILLO DBA AGUILA'S MASONRY SERVICE
Will Use Quote: Yes

0042	2286000000-N	MASNRY DRAIN EA		28.000	875.00000	24500.00
0043	2364000000-N	FRAME W/2GRT EA		10.000	490.00000	4900.00

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

29,400.00 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

29,400.

DBE SUBCONTRACTOR: 11852 SADLER LANDSCAPING, LLC
Will Use Quote: Yes

NORTH CAROLINA STATE DEPARTMENT OF TRANSPORTATION
DBE COMMITMENT ITEMS

DATE:12-20-13
PAGE: 23

LINE NO.	ITEM NO.	ITEM DESC.	UNIT TYPE	SUBCONTRACTOR QUANTITY	SUBCONTRACTOR UNIT PRICE	EXTENDED AMOUNT
0125	6015000000-E	TEMPORARY MU	ACR	10.000	650.00000	6500.00
0126	6018000000-E	SEED FOR TEM	LB	300.000	5.00000	1500.00
0127	6021000000-E	FERT FOR TEM	TON	1.750	625.00000	1093.75
0131	6036000000-E	MATTING FOR	SY	10500.000	1.15000	12075.00
0132	6037000000-E	COIR FIBER M	SY	100.000	2.45000	245.00
0133	6038000000-E	PERM SOIL RE	SY	36.000	6.50000	234.00
0138	6071012000-E	COIR FIBER W	LF	900.000	7.50000	6750.00
0139	6071020000-E	POLYACRYLAMI	LB	140.000	9.25000	1295.00
0143	6084000000-E	SEEDING AND	ACR	9.000	1675.00000	15075.00
0144	6087000000-E	MOWING	ACR	9.000	75.00000	675.00
0145	6090000000-E	SEED FOR REP	LB	100.000	11.00000	1100.00
0146	6093000000-E	FERT FOR REP	TON	0.250	700.00000	175.00
0147	6096000000-E	SEED FOR SUP	LB	300.000	4.00000	1200.00
0148	6108000000-E	FERTILIZER T	TON	8.500	600.00000	5100.00
0150	6114500000-N	SPECIALIZED	MHR	20.000	50.00000	1000.00
0151	6117000000-N	RESPONSE FOR	EA	75.000	10.00000	750.00
0152	6135000000-E	GENERIC EROS	ACR	4.300	2625.00000	11287.50
0153	6640000000-N	GENERIC PLAN	EA	18.000	40.00000	720.00
0154	6640000000-N	GENERIC PLAN	EA	21.000	212.50000	4462.50
0155	6640000000-N	GENERIC PLAN	EA	7.000	247.00000	1729.00
0156	6640000000-N	GENERIC PLAN	EA	87.000	6.00000	522.00
0157	6640000000-N	GENERIC PLAN	EA	29.000	18.00000	522.00
0158	6640000000-N	GENERIC PLAN	EA	6.000	187.50000	1125.00
0159	6640000000-N	GENERIC PLAN	EA	85.000	4.50000	382.50
0160	6640000000-N	GENERIC PLAN	EA	21.000	250.00000	5250.00
0161	6640000000-N	GENERIC PLAN	EA	31.000	96.00000	2976.00
0162	6640000000-N	GENERIC PLAN	EA	13.000	286.00000	3718.00
0163	6640000000-N	GENERIC PLAN	EA	4.000	23.00000	92.00
0164	6640000000-N	GENERIC PLAN	EA	43.000	26.00000	1118.00
0165	6640000000-N	GENERIC PLAN	EA	11.000	16.00000	176.00
0166	6640000000-N	GENERIC PLAN	EA	29.000	108.00000	3132.00
0167	6650000000-E	MULCH FOR PL	CY	170.000	26.00000	4420.00
0168	6655000000-E	WATER FOR PL	M/G	9.000	125.00000	1125.00
0169	6665000000-E	POSTEMERGENT	SY	1545.000	0.25000	386.25
0170	6670000000-E	PREEMERGENT	SY	1545.000	0.25000	386.25
0171	6674000000-N	GENERIC PLAN	LS	1.000	8000.00000	8000.00
0172	6675000000-E	GENERIC PLAN	SY	2600.000	4.50000	11700.00
0173	6677000000-E	GENERIC PLAN	TON	4.000	275.00000	1100.00
0174	6690000000-E	GENERIC PLAN	LF	184.000	6.00000	1104.00

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

120,201.75 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

120,201

DBE SUBCONTRACTOR: 7466 BEAR & CO SIGNS & LIGHTING, INC.

Will Use Quote: Yes

0062	4048000000-E	REINF CONC F	CY	4.000	950.00000	3800.00
0063	4054000000-E	PLN CONC FOU	CY	2.000	450.00000	900.00
0064	4060000000-E	SUPPORT, BRE	LB	3556.000	3.90000	13868.40
0065	4082000000-E	SUPPORT, WOO	LF	140.000	4.90000	686.00
0066	4102000000-N	SIGN ERECTIO	EA	8.000	75.00000	600.00

NORTH CAROLINA STATE DEPARTMENT OF TRANSPORTATION
DBE COMMITMENT ITEMS

DATE:12-20-13
PAGE: 24

LINE NO.	ITEM NO.	ITEM DESC.	UNIT TYPE	SUBCONTRACTOR QUANTITY	SUBCONTRACTOR UNIT PRICE	EXTENDED AMOUNT
0067	4110000000-N	SIGN ERECTIO	EA	5.000	675.00000	3375.00
0068	4110000000-N	SIGN ERECTIO	EA	4.000	475.00000	1900.00

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

25,129.40 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

25,129.

DBE SUBCONTRACTOR: 5291 ATCO TRANSPORT INC

Will Use Quote: Yes

0032	1575000000-E	ASP FOR PLAN	TON	560.000	12.50000	7000.00
		Haul Only				

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

7,000.00 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

7,000.0

DBE SUBCONTRACTOR: 11705 BOTHERN TRUCKING LLC

Will Use Quote: Yes

0003	0036000000-E	UNDERCUT EXC	CY	10000.000	3.50000	35000.00
		Haul Only				
0004	0043000000-N	GRADING	LS	1.000	105000.00000	105000.00
		Haul Only				
0026	1489000000-E	ASP CONC BAS	TON	1500.000	7.00000	10500.00
		Stone Haul Only				
0028	1498000000-E	ASP CONC INT	TON	2400.000	7.00000	16800.00
		Stone Haul Only				
0030	1519000000-E	ASP CONC SUR	TON	1400.000	7.00000	9800.00
		Stone Haul only				

DBE COMMITMENT TOTAL FOR SUBCONTRACTOR:

177,100.00 Committed

DBE COMMITMENT TOTAL FOR VENDOR (SubContractor)

177,100

TOTAL DBE COMMITMENT FOR VENDOR:

Entered: 10.12% or 439152.15

Required: 10.00% or 433911.45

<GOAL MET>

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
ROADWAY ITEMS						
0001	0000100000-N	800	MOBILIZATION	Lump Sum LS	217,000.00	217,000.00
0002	0000400000-N	801	CONSTRUCTION SURVEYING	Lump Sum LS	50,000.00	50,000.00
0003	0036000000-E	225	UNDERCUT EXCAVATION	14,315 CY	15.00	214,725.00
0004	0043000000-N	226	GRADING	Lump Sum LS	520,000.00	520,000.00
0005	0050000000-E	226	SUPPLEMENTARY CLEARING & GRUB- BING	1 ACR	100.00	100.00
0006	0134000000-E	240	DRAINAGE DITCH EXCAVATION	776 CY	2.00	1,552.00
0007	0195000000-E	265	SELECT GRANULAR MATERIAL	27,700 CY	0.10	2,770.00
0008	0196000000-E	270	GEOTEXTILE FOR SOIL STABILIZA- TION	27,700 SY	1.20	33,240.00
0009	0262000000-N	SP	GENERIC GRADING ITEM HAZARDOUS SPILL BASIN/ BIORETENTION BASIN	1 EA	67,000.00	67,000.00
0010	0318000000-E	300	FOUNDATION CONDITIONING MATE- RIAL, MINOR STRUCTURES	540 TON	20.00	10,800.00
0011	0320000000-E	300	FOUNDATION CONDITIONING GEO- TEXTILE	1,690 SY	0.80	1,352.00
0012	0335200000-E	305	15" DRAINAGE PIPE	738 LF	26.50	19,557.00
0013	0354000000-E	310	**** RC PIPE CULVERTS, CLASS ***** (15", V)	540 LF	29.70	16,038.00
0014	0354000000-E	310	**** RC PIPE CULVERTS, CLASS ***** (18", V)	60 LF	34.65	2,079.00
0015	0354000000-E	310	**** RC PIPE CULVERTS, CLASS ***** (24", V)	200 LF	45.35	9,070.00
0016	0354000000-E	310	**** RC PIPE CULVERTS, CLASS ***** (30", V)	92 LF	64.50	5,934.00
0017	0366000000-E	310	15" RC PIPE CULVERTS, CLASS III	56 LF	28.60	1,601.60

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0018	0372000000-E	310	18" RC PIPE CULVERTS, CLASS III	116 LF	28.90	3,352.40
0019	0414000000-E	310	60" RC PIPE CULVERTS, CLASS III	232 LF	186.00	43,152.00
0020	0546000000-E	310	*** CAA PIPE CULVERTS, ***** THICK (18", 0.064")	4 LF	132.00	528.00
0021	0546000000-E	310	*** CAA PIPE CULVERTS, ***** THICK (54", 0.109")	28 LF	216.00	6,048.00
0022	0995000000-E	340	PIPE REMOVAL	181 LF	13.75	2,488.75
0023	1121000000-E	520	AGGREGATE BASE COURSE	6,000 TON	22.10	132,600.00
0024	1220000000-E	545	INCIDENTAL STONE BASE	100 TON	22.10	2,210.00
0025	1275000000-E	600	PRIME COAT	135 GAL	6.30	850.50
0026	1489000000-E	610	ASPHALT CONC BASE COURSE, TYPE B25.0B	2,800 TON	50.25	140,700.00
0027	1491000000-E	610	ASPHALT CONC BASE COURSE, TYPE B25.0C	110 TON	57.35	6,308.50
0028	1498000000-E	610	ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0B	4,590 TON	48.40	222,156.00
0029	1503000000-E	610	ASPHALT CONC INTERMEDIATE COURSE, TYPE I19.0C	55 TON	57.00	3,135.00
0030	1519000000-E	610	ASPHALT CONC SURFACE COURSE, TYPE S9.5B	3,430 TON	48.10	164,983.00
0031	1523000000-E	610	ASPHALT CONC SURFACE COURSE, TYPE S9.5C	50 TON	60.00	3,000.00
0032	1575000000-E	620	ASPHALT BINDER FOR PLANT MIX	560 TON	600.00	336,000.00
0033	1693000000-E	654	ASPHALT PLANT MIX, PAVEMENT REPAIR	20 TON	100.00	2,000.00
0034	2022000000-E	815	SUBDRAIN EXCAVATION	22.4 CY	3.50	78.40

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0035	2026000000-E	815	GEOTEXTILE FOR SUBSURFACE DRAINS	100 SY	0.60	60.00
0036	2036000000-E	815	SUBDRAIN COARSE AGGREGATE	16.8 CY	50.00	840.00
0037	2044000000-E	815	6" PERFORATED SUBDRAIN PIPE	100 LF	9.50	950.00
0038	2070000000-N	815	SUBDRAIN PIPE OUTLET	1 EA	195.00	195.00
0039	2077000000-E	815	6" OUTLET PIPE	6 LF	42.00	252.00
0040	2220000000-E	838	REINFORCED ENDWALLS	16.4 CY	1,122.00	18,400.80
0041	2253000000-E	840	PIPE COLLARS	6.05 CY	1,095.00	6,624.75
0042	2286000000-N	840	MASONRY DRAINAGE STRUCTURES	28 EA	875.00	24,500.00
0043	2364000000-N	840	FRAME WITH TWO GRATES, STD 840.16	10 EA	490.00	4,900.00
0044	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (E)	4 EA	430.00	1,720.00
0045	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (F)	4 EA	490.00	1,960.00
0046	2374000000-N	840	FRAME WITH GRATE & HOOD, STD 840.03, TYPE ** (G)	10 EA	520.00	5,200.00
0047	2549000000-E	846	2'-6" CONCRETE CURB & GUTTER	5,400 LF	14.95	80,730.00
0048	2591000000-E	848	4" CONCRETE SIDEWALK	2,050 SY	25.00	51,250.00
0049	2605000000-N	848	CONCRETE CURB RAMP	5 EA	925.00	4,625.00
0050	2612000000-E	848	6" CONCRETE DRIVEWAY	30 SY	38.60	1,158.00
0051	2647000000-E	852	5" MONOLITHIC CONCRETE ISLANDS (SURFACE MOUNTED)	170 SY	43.50	7,395.00
0052	3503000000-E	866	WOVEN WIRE FENCE, 47" FABRIC	1,010 LF	3.00	3,030.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0053	3509000000-E	866	4" TIMBER FENCE POSTS, 7'-6" LONG	61 EA	25.00	1,525.00
0054	3515000000-E	866	5" TIMBER FENCE POSTS, 8'-0" LONG	20 EA	55.00	1,100.00
0055	3539000000-E	866	METAL LINE POSTS FOR *** CHAIN LINK FENCE (72")	60 EA	47.00	2,820.00
0056	3545000000-E	866	METAL TERMINAL POSTS FOR *** CHAIN LINK FENCE (72")	3 EA	118.00	354.00
0057	3575000000-E	SP	GENERIC FENCING ITEM 72" CHAIN LINK FENCE WITH SLATS	718 LF	15.50	11,129.00
0058	3628000000-E	876	RIP RAP, CLASS I	105 TON	57.00	5,985.00
0059	3649000000-E	876	RIP RAP, CLASS B	58 TON	57.00	3,306.00
0060	3656000000-E	876	GEOTEXTILE FOR DRAINAGE	1,031 SY	1.90	1,958.90
0061	3659000000-N	SP	PREFORMED SCOUR HOLES WITH LEVEL SPREADER APRON	2 EA	1,235.00	2,470.00
0062	4048000000-E	902	REINFORCED CONCRETE SIGN FOUNDATIONS	4 CY	950.00	3,800.00
0063	4054000000-E	902	PLAIN CONCRETE SIGN FOUNDATIONS	2 CY	450.00	900.00
0064	4060000000-E	903	SUPPORTS, BREAKAWAY STEEL BEAM	3,556 LB	3.90	13,868.40
0065	4082000000-E	903	SUPPORTS, WOOD	140 LF	4.90	686.00
0066	4102000000-N	904	SIGN ERECTION, TYPE E	8 EA	75.00	600.00
0067	4110000000-N	904	SIGN ERECTION, TYPE *** (GROUND MOUNTED) (A)	5 EA	675.00	3,375.00
0068	4110000000-N	904	SIGN ERECTION, TYPE *** (GROUND MOUNTED) (B)	4 EA	475.00	1,900.00
0069	4400000000-E	1110	WORK ZONE SIGNS (STATIONARY)	407 SF	7.50	3,052.50

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0070	4405000000-E	1110	WORK ZONE SIGNS (PORTABLE)	234 SF	17.80	4,165.20
0071	4410000000-E	1110	WORK ZONE SIGNS (BARRICADE MOUNTED)	73 SF	13.50	985.50
0072	4415000000-N	1115	FLASHING ARROW BOARD	1 EA	895.00	895.00
0073	4420000000-N	1120	PORTABLE CHANGEABLE MESSAGE SIGN	1 EA	3,500.00	3,500.00
0074	4430000000-N	1130	DRUMS	90 EA	40.00	3,600.00
0075	4435000000-N	1135	CONES	40 EA	15.00	600.00
0076	4445000000-E	1145	BARRICADES (TYPE III)	80 LF	34.00	2,720.00
0077	4450000000-N	1150	FLAGGER	1,440 HR	12.00	17,280.00
0078	4480000000-N	1165	TMA	1 EA	2,200.00	2,200.00
0079	4685000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (4", 90 MILS)	2,640 LF	0.65	1,716.00
0080	4686000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (4", 120 MILS)	3,410 LF	0.75	2,557.50
0081	4695000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (8", 90 MILS)	600 LF	2.85	1,710.00
0082	4710000000-E	1205	THERMOPLASTIC PAVEMENT MARKING LINES (24", 120 MILS)	370 LF	5.90	2,183.00
0083	4725000000-E	1205	THERMOPLASTIC PAVEMENT MARKING SYMBOL (90 MILS)	24 EA	115.00	2,760.00
0084	4810000000-E	1205	PAINT PAVEMENT MARKING LINES (4")	4,110 LF	0.50	2,055.00
0085	4820000000-E	1205	PAINT PAVEMENT MARKING LINES (8")	35 LF	1.00	35.00
0086	4900000000-N	1251	PERMANENT RAISED PAVEMENT MARKERS	20 EA	10.00	200.00
0087	5070000000-N	1405	STANDARD FOUNDATION ***** (TYPE R1)	36 EA	1,000.00	36,000.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0088	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (2")	60 LF	6.09	365.40
0089	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (3")	92 LF	6.74	620.08
0090	5155000000-E	1409	ELECTRICAL DUCT, TYPE BD, SIZE ***** (4")	37 LF	7.25	268.25
0091	5170000000-E	1410	** #8 W/G FEEDER CIRCUIT (2)	65 LF	4.24	275.60
0092	5180000000-E	1410	** #4 W/G FEEDER CIRCUIT (2)	65 LF	6.49	421.85
0093	5205000000-E	1410	** #8 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5")	4,477 LF	10.26	45,934.02
0094	5210000000-E	1410	** #6 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5")	1,880 LF	11.14	20,943.20
0095	5215000000-E	1410	** #4 W/G FEEDER CIRCUIT IN ***** CONDUIT (2, 1.5")	225 LF	12.51	2,814.75
0096	5270000000-N	SP	GENERIC LIGHTING ITEM BOLLARD LGT STD	8 EA	1,000.00	8,000.00
0097	5270000000-N	SP	GENERIC LIGHTING ITEM DAVIT STYLE LGT STD, MH 35', SA 6'	36 EA	1,900.00	68,400.00
0098	5270000000-N	SP	GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PC18	13 EA	432.00	5,616.00
0099	5270000000-N	SP	GENERIC LIGHTING ITEM ELECTRICAL JUNCTION BOXES, PG36	1 EA	1,133.00	1,133.00
0100	5270000000-N	SP	GENERIC LIGHTING ITEM LIGHT CONTROL EQUIPMENT, TYPE RA 120/240V	1 EA	4,500.00	4,500.00
0101	5270000000-N	SP	GENERIC LIGHTING ITEM POST TOP LIGHT STANDARD	14 EA	731.00	10,234.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0102	5270000000-N	SP	GENERIC LIGHTING ITEM PT LUMINAIRES, LED, TYPE V	14 EA	1,629.00	22,806.00
0103	5270000000-N	SP	GENERIC LIGHTING ITEM RDW LUMINAIRES, LED, TYPE III	36 EA	750.00	27,000.00
0104	5270000000-N	SP	GENERIC LIGHTING ITEM STD FOUNDATION, TYPE B1	8 EA	250.00	2,000.00
0105	5270000000-N	SP	GENERIC LIGHTING ITEM STD FOUNDATION, TYPE R1S	14 EA	650.00	9,100.00
0106	5319000000-E	1505	CLASS B CONCRETE FOR ENCASING UTILITY LINES	1.5 CY	670.00	1,005.00
0107	5325000000-E	1510	*** WATER LINE (1")	1,318 LF	7.00	9,226.00
0108	5325200000-E	1510	2" WATER LINE	25 LF	24.00	600.00
0109	5325300000-E	1510	3" WATER LINE	233 LF	12.00	2,796.00
0110	5325600000-E	1510	6" WATER LINE	1,315 LF	18.00	23,670.00
0111	5534000000-E	1515	*** VALVE (1")	2 EA	640.00	1,280.00
0112	5534000000-E	1515	*** VALVE (2")	1 EA	935.00	935.00
0113	5540000000-E	1515	6" VALVE	3 EA	1,100.00	3,300.00
0114	5643200000-E	1515	2" WATER METER	1 EA	6,825.00	6,825.00
0115	5656200000-E	1515	2" RPZ BACKFLOW PREVENTION ASSEMBLY	1 EA	3,675.00	3,675.00
0116	5666000000-E	1515	FIRE HYDRANT	1 EA	2,555.00	2,555.00
0117	5691200000-E	1520	6" SANITARY GRAVITY SEWER	750 LF	29.00	21,750.00
0118	5768000000-N	1520	SANITARY SEWER CLEAN-OUT	9 EA	330.00	2,970.00
0119	5775000000-E	1525	4' DIA UTILITY MANHOLE	2 EA	1,950.00	3,900.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0120	5882000000-N	SP	GENERIC UTILITY ITEM YARD HYDRANT	1 EA	495.00	495.00
0121	6000000000-E	1605	TEMPORARY SILT FENCE	9,400 LF	1.60	15,040.00
0122	6006000000-E	1610	STONE FOR EROSION CONTROL, CLASS A	300 TON	45.00	13,500.00
0123	6009000000-E	1610	STONE FOR EROSION CONTROL, CLASS B	1,000 TON	45.00	45,000.00
0124	6012000000-E	1610	SEDIMENT CONTROL STONE	2,000 TON	22.00	44,000.00
0125	6015000000-E	1615	TEMPORARY MULCHING	10 ACR	650.00	6,500.00
0126	6018000000-E	1620	SEED FOR TEMPORARY SEEDING	300 LB	5.00	1,500.00
0127	6021000000-E	1620	FERTILIZER FOR TEMPORARY SEED- ING	1.75 TON	625.00	1,093.75
0128	6024000000-E	1622	TEMPORARY SLOPE DRAINS	600 LF	10.00	6,000.00
0129	6029000000-E	SP	SAFETY FENCE	1,800 LF	1.50	2,700.00
0130	6030000000-E	1630	SILT EXCAVATION	2,000 CY	0.10	200.00
0131	6036000000-E	1631	MATTING FOR EROSION CONTROL	10,500 SY	1.15	12,075.00
0132	6037000000-E	SP	COIR FIBER MAT	100 SY	2.45	245.00
0133	6038000000-E	SP	PERMANENT SOIL REINFORCEMENT MAT	36 SY	6.50	234.00
0134	6042000000-E	1632	1/4" HARDWARE CLOTH	700 LF	3.25	2,275.00
0135	6043000000-E	SP	LOW PERMEABILITY GEOTEXTILE	25 SY	12.10	302.50
0136	6046000000-E	1636	TEMPORARY PIPE FOR STREAM CROSSING	25 LF	133.00	3,325.00
0137	6070000000-N	1639	SPECIAL STILLING BASINS	4 EA	320.00	1,280.00
0138	6071012000-E	SP	COIR FIBER WATTLE	900 LF	7.50	6,750.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0139	6071020000-E	SP	POLYACRYLAMIDE (PAM)	140 LB	9.25	1,295.00
0140	6071030000-E	1640	COIR FIBER BAFFLE	840 LF	10.00	8,400.00
0141	6071050000-E	SP	*** SKIMMER (1-1/2")	1 EA	885.00	885.00
0142	6071050000-E	SP	*** SKIMMER (2")	1 EA	1,000.00	1,000.00
0143	6084000000-E	1660	SEEDING & MULCHING	9 ACR	1,675.00	15,075.00
0144	6087000000-E	1660	MOWING	9 ACR	75.00	675.00
0145	6090000000-E	1661	SEED FOR REPAIR SEEDING	100 LB	11.00	1,100.00
0146	6093000000-E	1661	FERTILIZER FOR REPAIR SEEDING	0.25 TON	700.00	175.00
0147	6096000000-E	1662	SEED FOR SUPPLEMENTAL SEEDING	300 LB	4.00	1,200.00
0148	6108000000-E	1665	FERTILIZER TOPDRESSING	8.5 TON	600.00	5,100.00
0149	6111000000-E	SP	IMPERVIOUS DIKE	50 LF	120.00	6,000.00
0150	6114500000-N	1667	SPECIALIZED HAND MOWING	20 MHR	50.00	1,000.00
0151	6117000000-N	SP	RESPONSE FOR EROSION CONTROL	75 EA	10.00	750.00
0152	6135000000-E	SP	GENERIC EROSION CONTROL ITEM SEEDING & MULCHING; CENTIPEDE TURF SEEDING, 1 LB/1000SF	4.3 ACR	2,625.00	11,287.50
0153	6640000000-N	1670	GENERIC PLANTING ITEM ABELIA X KALEIDOSCOPE; KALEIDOSCOPE ABELIA, 12-15", #3 CONTAINER	18 EA	40.00	720.00
0154	6640000000-N	1670	GENERIC PLANTING ITEM CORNUS FLORIDA; FLOWERING DOGWOOD 7-8', 1 1/2" CAL., B&B	21 EA	212.50	4,462.50
0155	6640000000-N	1670	GENERIC PLANTING ITEM GLEDITSIA TRIACANTHOS INERMIS; THORNLESS HONEYLOCUST, 12-14', 3" CAL	7 EA	247.00	1,729.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0156	6640000000-N	1670	GENERIC PLANTING ITEM HEMEROCALLIS 'BUTTERED POP-CORN' BUTTERED POPCORN DAYLILY, #1 CONTAINER	87 EA	6.00	522.00
0157	6640000000-N	1670	GENERIC PLANTING ITEM ILEX CORNUTA 'CARISSA'; CARISSA HOLLY 18-24", #3 CONT- AINER	29 EA	18.00	522.00
0158	6640000000-N	1670	GENERIC PLANTING ITEM LAGERSTROEMIA 'ARAPAHO'; ARAPAHO CRAPE MYRTLE, 6-7', B&B	6 EA	187.50	1,125.00
0159	6640000000-N	1670	GENERIC PLANTING ITEM LIRIOPE MUSCARI 'BIG BLUE'; BIG BLUE LIRIOPE, #1 CONTAINER	85 EA	4.50	382.50
0160	6640000000-N	1670	GENERIC PLANTING ITEM MAGNOLIA GRANDIFLORA 'LITTLE GEM'; LITTLE GEM MAGNOLIA, 8-10', B&B	21 EA	250.00	5,250.00
0161	6640000000-N	1670	GENERIC PLANTING ITEM MYRICA CERIFICA; WAX MYRTLE, 4", #15 CONTAINER	31 EA	96.00	2,976.00
0162	6640000000-N	1670	GENERIC PLANTING ITEM QUERCUS VIRGINIANA; LIVE OAK, 8-10', 2 1/2" CALIPER, #30 CONTAINER	13 EA	286.00	3,718.00
0163	6640000000-N	1670	GENERIC PLANTING ITEM ROSA 'RADTKO'; RED DOUBLE KNOCKOUT ROSE, 18-24", #3 CONTAINER	4 EA	23.00	92.00
0164	6640000000-N	1670	GENERIC PLANTING ITEM SCHIZACHYRIUM SCOPARIUM; LITTLE BLUESTEM, #1 CONTAINER	43 EA	26.00	1,118.00
0165	6640000000-N	1670	GENERIC PLANTING ITEM SPIRAEA JAPONICA 'GOLDMOUND'; GOLDMOUND SPIRAEA, 12-15", #3 CONTAINER	11 EA	16.00	176.00
0166	6640000000-N	1670	GENERIC PLANTING ITEM TAXODIUM DISTICHUM; BALD CYPRESS, 6-8', 2" CALIPER, #15 CONTAINER	29 EA	108.00	3,132.00
0167	6650000000-E	1670	MULCH FOR PLANTING	170 CY	26.00	4,420.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0168	6655000000-E	1670	WATER FOR PLANTING	9 M/G	125.00	1,125.00
0169	6665000000-E	1670	POSTEMERGENT HERBICIDAL TREATMENT FOR PLANT BEDS	1,545 SY	0.25	386.25
0170	6670000000-E	1670	PREEMERGENT HERBICIDAL TREATMENT FOR PLANT BEDS	1,545 SY	0.25	386.25
0171	6674000000-N	SP	GENERIC PLANTING ITEM (LS) STREAMBANK BUFFER REFORESTATION PLANTING	Lump Sum LS	8,000.00	8,000.00
0172	6675000000-E	SP	GENERIC PLANTING ITEM SODDING	2,600 SY	4.50	11,700.00
0173	6677000000-E	SP	GENERIC PLANTING ITEM RIVER STONE	4 TON	275.00	1,100.00
0174	6690000000-E	SP	GENERIC PLANTING ITEM LANDSCAPE METAL EDGING	184 LF	6.00	1,104.00
0175	6900000000-E	SP	TOPSOIL	600 CY	21.00	12,600.00
0176	6905000000-N	SP	PICNIC TABLE, TERRAZZO & STEEL	4 EA	4,218.00	16,872.00
0177	6910000000-N	SP	PICNIC SHELTER, SINGLE PICNIC TABLE	3 EA	15,173.00	45,519.00
0178	6970000000-N	SP	GENERIC REST AREA ITEM BICYCLE PARKING BOLLARD	2 EA	832.50	1,665.00
0179	6970000000-N	SP	GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 28' X 6'	1 EA	1,420.00	1,420.00
0180	6970000000-N	SP	GENERIC REST AREA ITEM DEPRESSED CURB HANDICAP ACCESS, 60' X 8'	1 EA	3,145.00	3,145.00
0181	6970000000-N	SP	GENERIC REST AREA ITEM PLACEMENT OF BOULDERS	8 EA	230.00	1,840.00
0182	6970000000-N	SP	GENERIC REST AREA ITEM RECYCLING CONTAINER	10 EA	888.00	8,880.00
0183	6970000000-N	SP	GENERIC REST AREA ITEM TAPERED ALUMINUM FLAG POLE	1 EA	2,836.05	2,836.05

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0184	6970000000-N	SP	GENERIC REST AREA ITEM WASTE CONTAINER	10 EA	888.00	8,880.00
0185	6970000000-N	SP	GENERIC REST AREA ITEM WHEEL STOPS @ H/C PARKING	4 EA	61.00	244.00
0186	6975000000-N	SP	GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR REST AREA BUILDING	Lump Sum LS	101,926.00	101,926.00
0187	6975000000-N	SP	GENERIC REST AREA ITEM ELECTRICAL INSTALLATION FOR STORAGE BUILDING	Lump Sum LS	4,995.00	4,995.00
0188	6975000000-N	SP	GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF REST AREA BUILDING	Lump Sum LS	541,504.00	541,504.00
0189	6975000000-N	SP	GENERIC REST AREA ITEM GENERAL CONSTRUCTION OF STORAGE BUILDING	Lump Sum LS	53,245.00	53,245.00
0190	6975000000-N	SP	GENERIC REST AREA ITEM IRRIGATION SYSTEM	Lump Sum LS	59,415.93	59,415.93
0191	6975000000-N	SP	GENERIC REST AREA ITEM LANDSCAPE GRADING	Lump Sum LS	2,341.71	2,341.71
0192	6975000000-N	SP	GENERIC REST AREA ITEM MECHANICAL INSTALLATION FOR REST AREA BUILDING	Lump Sum LS	123,543.00	123,543.00
0193	6975000000-N	SP	GENERIC REST AREA ITEM PLUMBING INSTALLATION OF REST AREA BUILDING	Lump Sum LS	99,678.00	99,678.00
0194	6975000000-N	SP	GENERIC REST AREA ITEM RAINWATER COLLECTION SYSTEM	Lump Sum LS	33,260.22	33,260.22
0195	6975000000-N	SP	GENERIC REST AREA ITEM REST AREA SOLAR WATER HEATING SYSTEM	Lump Sum LS	16,100.00	16,100.00
0196	6980000000-E	SP	GENERIC REST AREA ITEM 3" PVC UTILITY SLEEVE	140 LF	12.00	1,680.00
0197	6980000000-E	SP	GENERIC REST AREA ITEM 6' WOOD FENCE	18 LF	70.00	1,260.00

Contract Item Sheets For C203304

Line #	ItemNumber	Sec #	Description	Quantity Unit	Unit Bid Price	Amount Bid
0198	6982000000-E	SP	GENERIC REST AREA ITEM COMPOSITE DECKING	864 SF	12.21	10,549.44

TOTAL AMOUNT OF BID FOR ENTIRE PROJECT

\$4,339,114.45

1511/Feb04/Q171309.95/D900515062000/E198

Contract No. C203304

Rev. 5-19-11

County Beaufort

**EXECUTION OF CONTRACT
NON-COLLUSION AFFIDAVIT, DEBARMENT CERTIFICATION AND GIFT BAN CERTIFICATION**

CORPORATION

The Contractor being duly sworn, solemnly swears (or affirms) that neither he, nor any official, agent or employee has entered into any agreement, participated in any collusion, or otherwise taken any action which is in restraint of free competitive bidding in connection with this Contract, that the Contractor has not been convicted of violating *N.C.G.S. § 133-24* within the last three years, and that the Contractor intends to do the work with its own bonafide employees or subcontractors and did not bid for the benefit of another contractor.

By submitting this Execution of Contract, Non-Collusion Affidavit and Debarment Certification, the Contractor is certifying his status under penalty of perjury under the laws of the United States in accordance with the Debarment Certification attached, provided that the Debarment Certification also includes any required statements concerning exceptions that are applicable.

N.C.G.S. § 133-32 and Executive Order 24 prohibit the offer to, or acceptance by, any State Employee of any gift from anyone with a contract with the State, or from any person seeking to do business with the State. By execution of any response in this procurement, you attest, for your entire organization and its employees or agents, that you are not aware that any such gift has been offered, accepted, or promised by any employees of your organization.

SIGNATURE OF CONTRACTOR

Barnhill Contracting Company

Full name of Corporation

P.O.Box 1529, Tarboro, N.C. 27886

Address as Prequalified

Attest

Helen W. Spain
Secretary/Assistant Secretary
Select appropriate title

By

Allen Barnhill
President/Vice President/Assistant Vice President
Regional Select appropriate title

Helen W. Spain

Print or type Signer's name

Allen Barnhill

Print or type Signer's name

CORPORATE SEAL

AFFIDAVIT MUST BE NOTARIZED

Subscribed and sworn to before me this the

6th day of February 20 14

Judith Sessoms
Signature of Notary Public
(Judith Sessoms)

of Edgecombe County

State of North Carolina

My Commission Expires: 8/9/2015

NOTARY SEAL

DEBARMENT CERTIFICATION

Conditions for certification:

1. The prequalified bidder shall provide immediate written notice to the Department if at any time the bidder learns that his certification was erroneous when he submitted his debarment certification or explanation filed with the Department, or has become erroneous because of changed circumstances.
2. The terms *covered transaction, debarred, suspended, ineligible, lower tier covered transaction, participant, person, primary covered transaction, principal, proposal, and voluntarily excluded*, as used in this provision, have the meanings set out in the Definitions and Coverage sections of the rules implementing Executive Order 12549. A copy of the Federal Rules requiring this certification and detailing the definitions and coverages may be obtained from the Contract Officer of the Department.
3. The prequalified bidder agrees by submitting this form, that he will not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in NCDOT contracts, unless authorized by the Department.
4. For Federal Aid projects, the prequalified bidder further agrees that by submitting this form he will include the Federal-Aid Provision titled *Required Contract Provisions Federal-Aid Construction Contract (Form FHWA PR 1273)* provided by the Department, without subsequent modification, in all lower tier covered transactions.
5. The prequalified bidder may rely upon a certification of a participant in a lower tier covered transaction that he is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless he knows that the certification is erroneous. The bidder may decide the method and frequency by which he will determine the eligibility of his subcontractors.
6. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this provision. The knowledge and information of a participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
7. Except as authorized in paragraph 6 herein, the Department may terminate any contract if the bidder knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available by the Federal Government.

DEBARMENT CERTIFICATION

The prequalified bidder certifies to the best of his knowledge and belief, that he and his principals:

- a. Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal department or agency;
- b. Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records; making false statements; or receiving stolen property;
- c. Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph b. of this certification; and
- d. Have not within a three-year period preceding this proposal had one or more public transactions (Federal, State or local) terminated for cause or default.
- e. Will submit a revised Debarment Certification immediately if his status changes and will show in his bid proposal an explanation for the change in status.

If the prequalified bidder cannot certify that he is not debarred, he shall provide an explanation with this submittal. An explanation will not necessarily result in denial of participation in a contract.

Failure to submit a non-collusion affidavit and debarment certification will result in the prequalified bidder's bid being considered non-responsive.

☐

Check here if an explanation is attached to this certification.


Contract No. **C203304**

County (ies): **Beaufort**

ACCEPTED BY THE
DEPARTMENT OF TRANSPORTATION




Contract Officer



Date

Execution of Contract and Bonds
Approved as to Form:

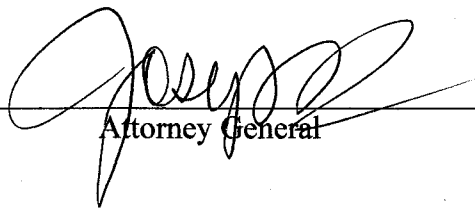

Attorney General

Contract No.
County**C203304**
Beaufort County

Rev 2-1-10

CONTRACT PAYMENT BOND

Date of Payment Bond Execution 2/4/2014

Name of Principal Contractor Barnhill Contracting Company

Name of Surety: Travelers Casualty and Surety Company of America

Name of Contracting Body: North Carolina Department of Transportation
Raleigh, North Carolina

Amount of Bond: Four Million Three Hundred Thirty-Nine Thousand One Hundred Fourteen And 45/100THS

Contract ID No.: C203304

County Name: Beaufort County

KNOW ALL MEN BY THESE PRESENTS, That we, the PRINCIPAL CONTRACTOR (hereafter, PRINCIPAL) and SURETY above named, are held and firmly bound unto the above named Contracting Body, hereinafter called the Contracting Body, in the penal sum of the amount stated above for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that whereas the principal entered into a certain contract with the Contracting Body, numbered as shown above and hereto attached:

NOW THEREFORE, if the principal shall promptly make payment to all persons supplying labor and material in the prosecution of the work provided for in said contract, and any and all duly authorized modifications of said contract that may hereafter be made, notice of which modifications to the surety being hereby waived, then this obligation to be void; otherwise to remain in full force and virtue.

IN WITNESS WHEREOF, the above-bound parties have executed this instrument under their several seals on the date indicated above, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

Contract No.
County

C203304
Beaufort County

Rev 2-1-10


CONTRACT PAYMENT BOND

Affix Seal of Surety Company

Travelers Casualty and Surety Company of America
Print or type Surety Company Name

By **H. Thomas Dawkins**

Print, stamp or type name of Attorney-in-Fact

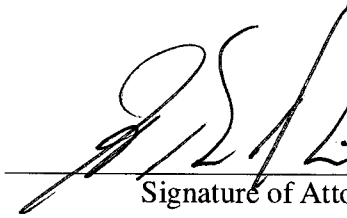

Signature of Attorney-in-Fact



Signature of Witness

Jenny Peterson

Print or type Signer's name

2820 Selwyn Avenue, Suite 375
Charlotte, NC 28209

Address of Attorney-in-Fact

Contract No.
CountyC203304
Beaufort County

Rev 2-1-10

CONTRACT PAYMENT BOND**CORPORATION**

SIGNATURE OF CONTRACTOR (Principal)


Barnhill Contracting Company

Full name of Corporation

P.O. Box 1529, Tarboro, NC 27886


Address as prequalified

By

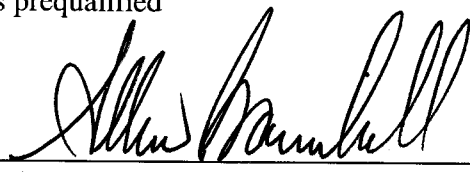
Signature of President, ~~Vice President~~, Assistant Vice President
Regional Select appropriate titleAllen Barnhill
Print or type Signer's name

Affix Corporate Seal

Attest

Signature of Secretary, Assistant Secretary
Select appropriate titleHelen W. Spain

Print or type Signer's name

Contract No.
County

C203304
Beaufort County

Rev 2-1-10

CONTRACT PERFORMANCE BOND

Date of Performance Bond Execution: 2/4/2014

Name of Principal Contractor: Barnhill Contracting Company

Name of Surety: Travelers Casualty and Surety Company of America

Name of Contracting Body: North Carolina Department of Transportation
Raleigh, North Carolina

Amount of Bond: Four Million Three Hundred Thirty-Nine Thousand One Hundred Fourteen And 45/100THS

Contract ID No.: C203304

County Name: Beaufort County

KNOW ALL MEN BY THESE PRESENTS, That we, the PRINCIPAL CONTRACTOR (hereafter, PRINCIPAL) and SURETY above named, are held and firmly bound unto the above named Contracting Body, hereinafter called the Contracting Body, in the penal sum of the amount stated above for the payment of which sum well and truly to be made, we bind ourselves, our heirs, executors, administrators, and successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION IS SUCH, that whereas the principal entered into a certain contract with the Contracting Body, numbered as shown above and hereto attached:

NOW THEREFORE, if the principal shall well and truly perform and fulfill all the undertakings, covenants, terms, conditions, and agreements of said contract during the original term of said contract and any extensions thereof that may be granted by the Contracting Body, with or without notice to the Surety, and during the life of any guaranty required under the contract, and shall also well and truly perform and fulfill all the undertakings, covenants, terms, conditions, and agreements of any and all duly authorized modifications of said contract that may hereafter be made, notice of which modifications to the surety being hereby waived, then this obligation to be void; otherwise to remain in full force and virtue.

IN WITNESS WHEREOF, the above-bound parties have executed this instrument under their several seals on the date indicated above, the name and corporate seal of each corporate party being hereto affixed and these presents duly signed by its undersigned representative, pursuant to authority of its governing body.

Contract No.
County

C203304
Beaufort County

Rev 2-1-10


CONTRACT PERFORMANCE BOND

Affix Seal of Surety Company

Travelers Casualty and Surety Company of America
Print or type Surety Company Name

By **H. Thomas Dawkins**

Print, stamp or type name of Attorney-in-Fact

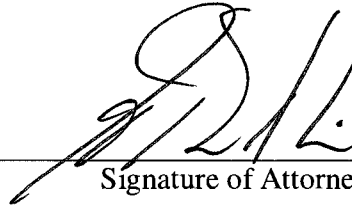

Signature of Attorney-in-Fact



Signature of Witness

Jenny Peterson

Print or type Signer's name

2820 Selwyn Avenue, Suite 375
Charlotte, NC 28209

Address of Attorney-in-Fact

Contract No.
County

C203304
Beaufort County

Rev 2-1-10

CONTRACT PERFORMANCE BOND**CORPORATION**

SIGNATURE OF CONTRACTOR (Principal)


Barnhill Contracting Company

Full name of Corporation

P.O. Box 1529, Tarboro, NC 27886

Address as prequalified

By

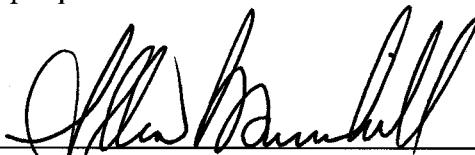

Signature of President, Vice President, Assistant Vice President
Regional Select appropriate title

Allen Barnhill

Print or type Signer's name

Affix Corporate Seal

Attest



Signature of Secretary, Assistant Secretary
Select appropriate title

Helen W. Spain

Print or type Signer's name



POWER OF ATTORNEY

Farmington Casualty Company
 Fidelity and Guaranty Insurance Company
 Fidelity and Guaranty Insurance Underwriters, Inc.
 St. Paul Fire and Marine Insurance Company
 St. Paul Guardian Insurance Company

St. Paul Mercury Insurance Company
 Travelers Casualty and Surety Company
 Travelers Casualty and Surety Company of America
 United States Fidelity and Guaranty Company

Attorney-In Fact No. 223862

Certificate No. 005680749

KNOW ALL MEN BY THESE PRESENTS: That Farmington Casualty Company, St. Paul Fire and Marine Insurance Company, St. Paul Guardian Insurance Company, St. Paul Mercury Insurance Company, Travelers Casualty and Surety Company, Travelers Casualty and Surety Company of America, and United States Fidelity and Guaranty Company are corporations duly organized under the laws of the State of Connecticut, that Fidelity and Guaranty Insurance Company is a corporation duly organized under the laws of the State of Iowa, and that Fidelity and Guaranty Insurance Underwriters, Inc., is a corporation duly organized under the laws of the State of Wisconsin (herein collectively called the "Companies"), and that the Companies do hereby make, constitute and appoint

H. Thomas Dawkins, and Hunter T. Dawkins

of the City of Charlotte, State of North Carolina, their true and lawful Attorney(s)-in-Fact, each in their separate capacity if more than one is named above, to sign, execute, seal and acknowledge any and all bonds, recognizances, conditional undertakings and other writings obligatory in the nature thereof on behalf of the Companies in their business of guaranteeing the fidelity of persons, guaranteeing the performance of contracts and executing or guaranteeing bonds and undertakings required or permitted in any actions or proceedings allowed by law.

IN WITNESS WHEREOF, the Companies have caused this instrument to be signed and their corporate seals to be hereto affixed, this 24th day of October, 2013.

Farmington Casualty Company
 Fidelity and Guaranty Insurance Company
 Fidelity and Guaranty Insurance Underwriters, Inc.
 St. Paul Fire and Marine Insurance Company
 St. Paul Guardian Insurance Company

St. Paul Mercury Insurance Company
 Travelers Casualty and Surety Company
 Travelers Casualty and Surety Company of America
 United States Fidelity and Guaranty Company



State of Connecticut
 City of Hartford ss.

By:

Robert L. Raney, Senior Vice President

On this the 24th day of October, 2013, before me personally appeared Robert L. Raney, who acknowledged himself to be the Senior Vice President of Farmington Casualty Company, Fidelity and Guaranty Insurance Company, Fidelity and Guaranty Insurance Underwriters, Inc., St. Paul Fire and Marine Insurance Company, St. Paul Guardian Insurance Company, St. Paul Mercury Insurance Company, Travelers Casualty and Surety Company, Travelers Casualty and Surety Company of America, and United States Fidelity and Guaranty Company, and that he, as such, being authorized so to do, executed the foregoing instrument for the purposes therein contained by signing on behalf of the corporations by himself as a duly authorized officer.

In Witness Whereof, I hereunto set my hand and official seal.
 My Commission expires the 30th day of June, 2016.



Marie C. Tetreault, Notary Public

This Power of Attorney is granted under and by the authority of the following resolutions adopted by the Boards of Directors of Farmington Casualty Company, Fidelity and Guaranty Insurance Company, Fidelity and Guaranty Insurance Underwriters, Inc., St. Paul Fire and Marine Insurance Company, St. Paul Guardian Insurance Company, St. Paul Mercury Insurance Company, Travelers Casualty and Surety Company, Travelers Casualty and Surety Company of America, and United States Fidelity and Guaranty Company, which resolutions are now in full force and effect, reading as follows:

RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President, any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary may appoint Attorneys-in-Fact and Agents to act for and on behalf of the Company and may give such appointee such authority as his or her certificate of authority may prescribe to sign with the Company's name and seal with the Company's seal bonds, recognizances, contracts of indemnity, and other writings obligatory in the nature of a bond, recognizance, or conditional undertaking, and any of said officers or the Board of Directors at any time may remove any such appointee and revoke the power given him or her; and it is

FURTHER RESOLVED, that the Chairman, the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President may delegate all or any part of the foregoing authority to one or more officers or employees of this Company, provided that each such delegation is in writing and a copy thereof is filed in the office of the Secretary; and it is

FURTHER RESOLVED, that any bond, recognizance, contract of indemnity, or writing obligatory in the nature of a bond, recognizance, or conditional undertaking shall be valid and binding upon the Company when (a) signed by the President, any Vice Chairman, any Executive Vice President, any Senior Vice President or any Vice President, any Second Vice President, the Treasurer, any Assistant Treasurer, the Corporate Secretary or any Assistant Secretary and duly attested and sealed with the Company's seal by a Secretary or Assistant Secretary; or (b) duly executed (under seal, if required) by one or more Attorneys-in-Fact and Agents pursuant to the power prescribed in his or her certificate or their certificates of authority or by one or more Company officers pursuant to a written delegation of authority; and it is

FURTHER RESOLVED, that the signature of each of the following officers: President, any Executive Vice President, any Senior Vice President, any Vice President, any Assistant Vice President, any Secretary, any Assistant Secretary, and the seal of the Company may be affixed by facsimile to any Power of Attorney or to any certificate relating thereto appointing Resident Vice Presidents, Resident Assistant Secretaries or Attorneys-in-Fact for purposes only of executing and attesting bonds and undertakings and other writings obligatory in the nature thereof, and any such Power of Attorney or certificate bearing such facsimile signature or facsimile seal shall be valid and binding upon the Company and any such power so executed and certified by such facsimile signature and facsimile seal shall be valid and binding on the Company in the future with respect to any bond or understanding to which it is attached.

I, Kevin E. Hughes, the undersigned, Assistant Secretary, of Farmington Casualty Company, Fidelity and Guaranty Insurance Company, Fidelity and Guaranty Insurance Underwriters, Inc., St. Paul Fire and Marine Insurance Company, St. Paul Guardian Insurance Company, St. Paul Mercury Insurance Company, Travelers Casualty and Surety Company, Travelers Casualty and Surety Company of America, and United States Fidelity and Guaranty Company do hereby certify that the above and foregoing is a true and correct copy of the Power of Attorney executed by said Companies, which is in full force and effect and has not been revoked.

IN TESTIMONY WHEREOF, I have hereunto set my hand and affixed the seals of said Companies this 4th day of February, 20 14

WARNING: THIS POWER OF ATTORNEY IS INVALID WITHOUT THE RED BORDER

Kevin E. Hughes
Kevin E. Hughes, Assistant Secretary



To verify the authenticity of this Power of Attorney, call 1-800-421-3880 or contact us at www.travelersbond.com. Please refer to the Attorney-In-Fact number, the above-named individuals and the details of the bond to which the power is attached.