






UTILITY PEDESTAL BROKEN LIGHT FIXTURE

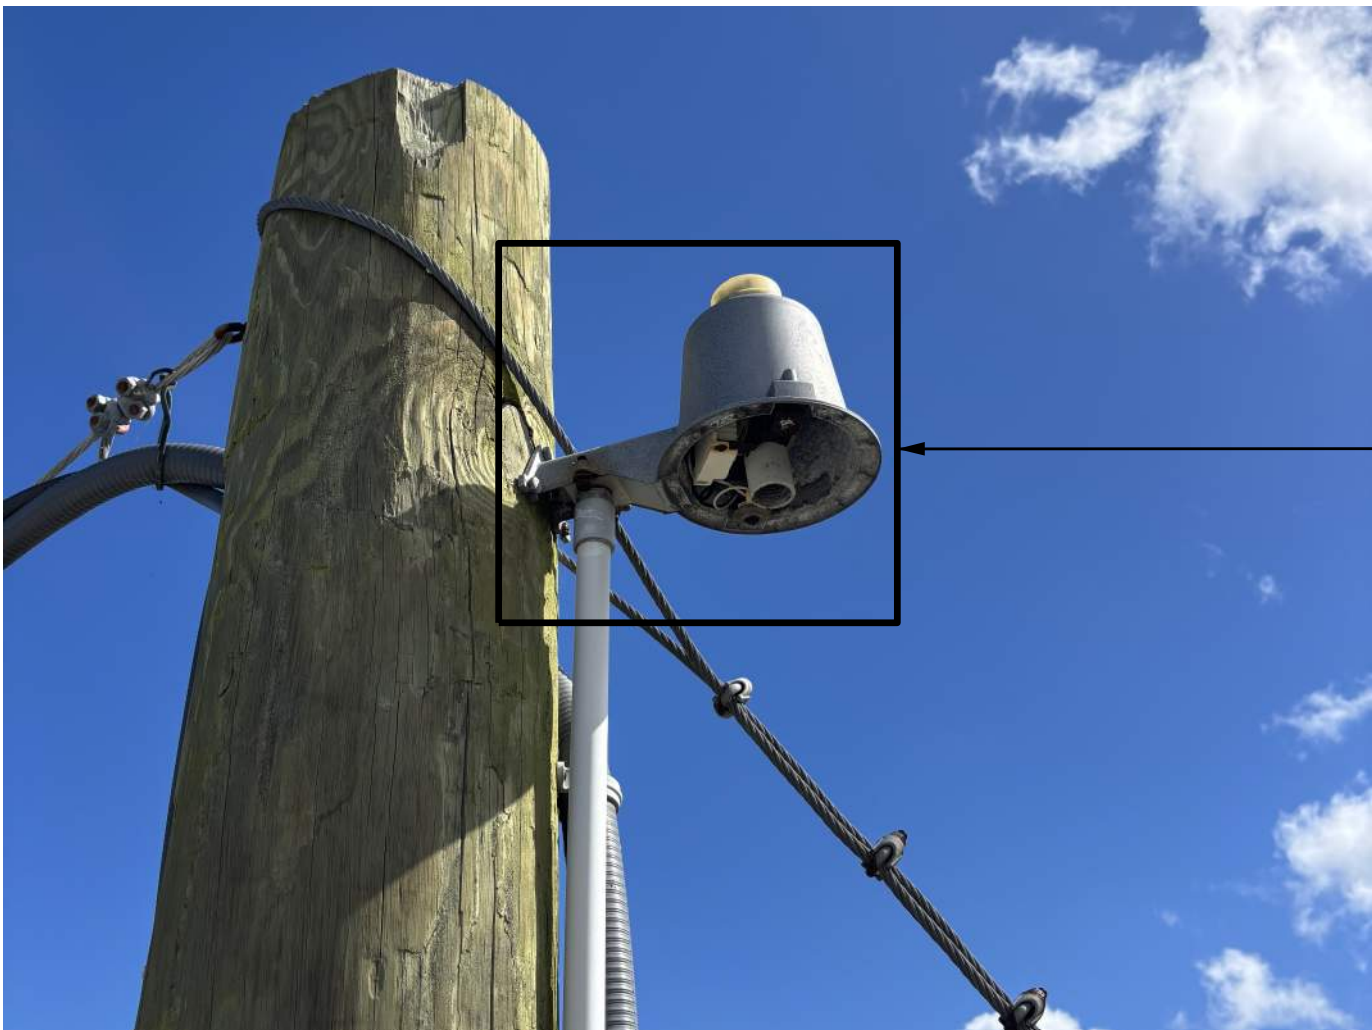

MESSENGER CABLE SUPPORT/LIGHT POLE
BROKEN LIGHTING FIXTURE

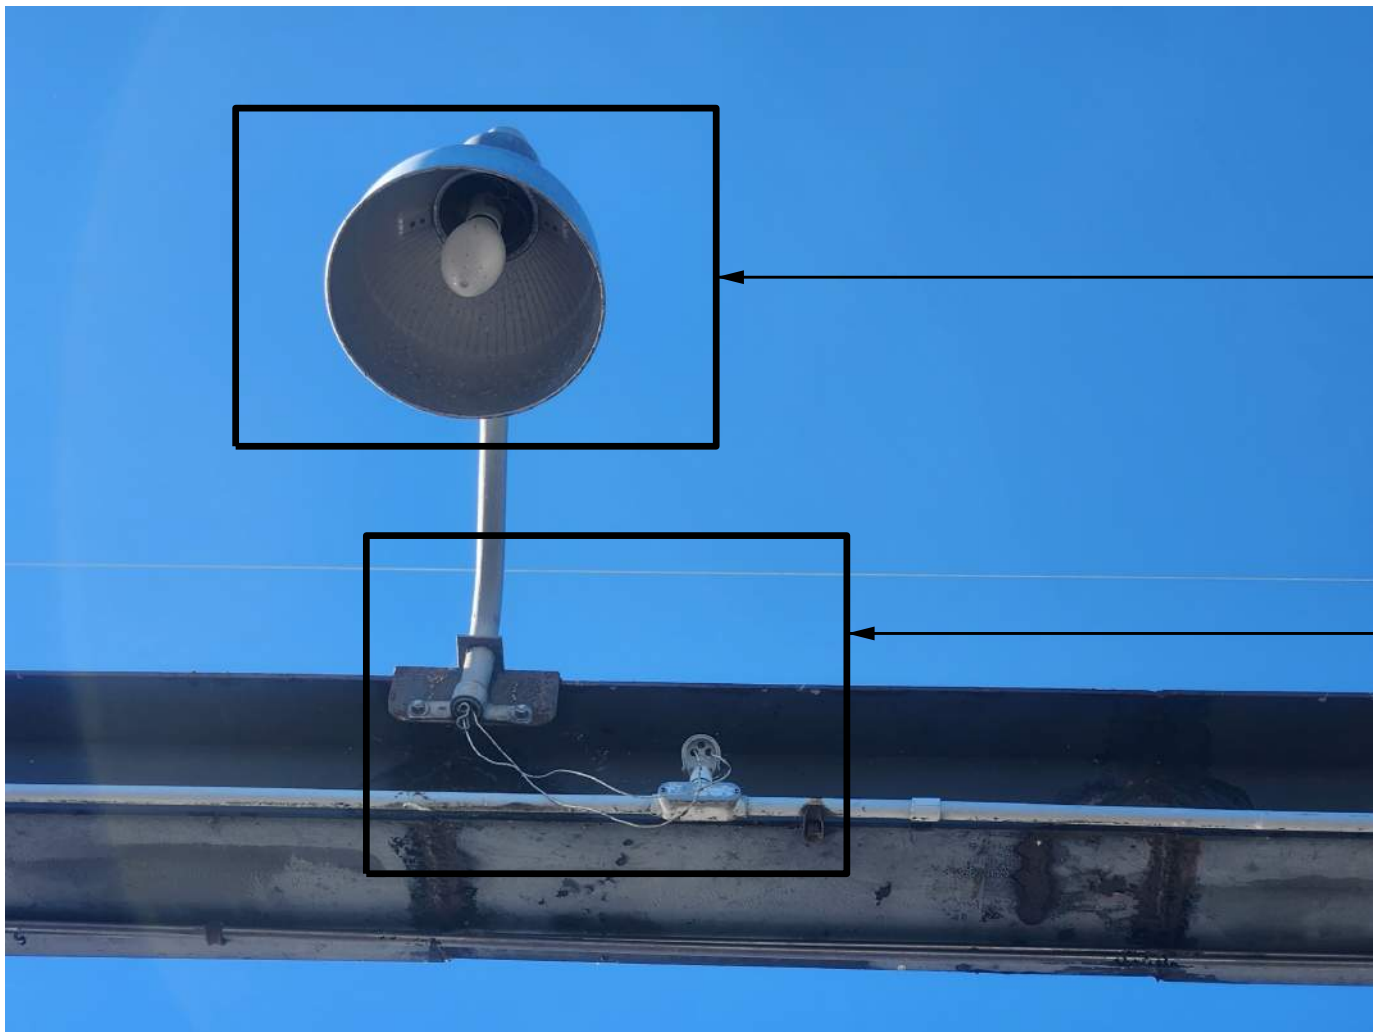

LIGHT ELECTRICAL WIRES NOT IN CONDUIT

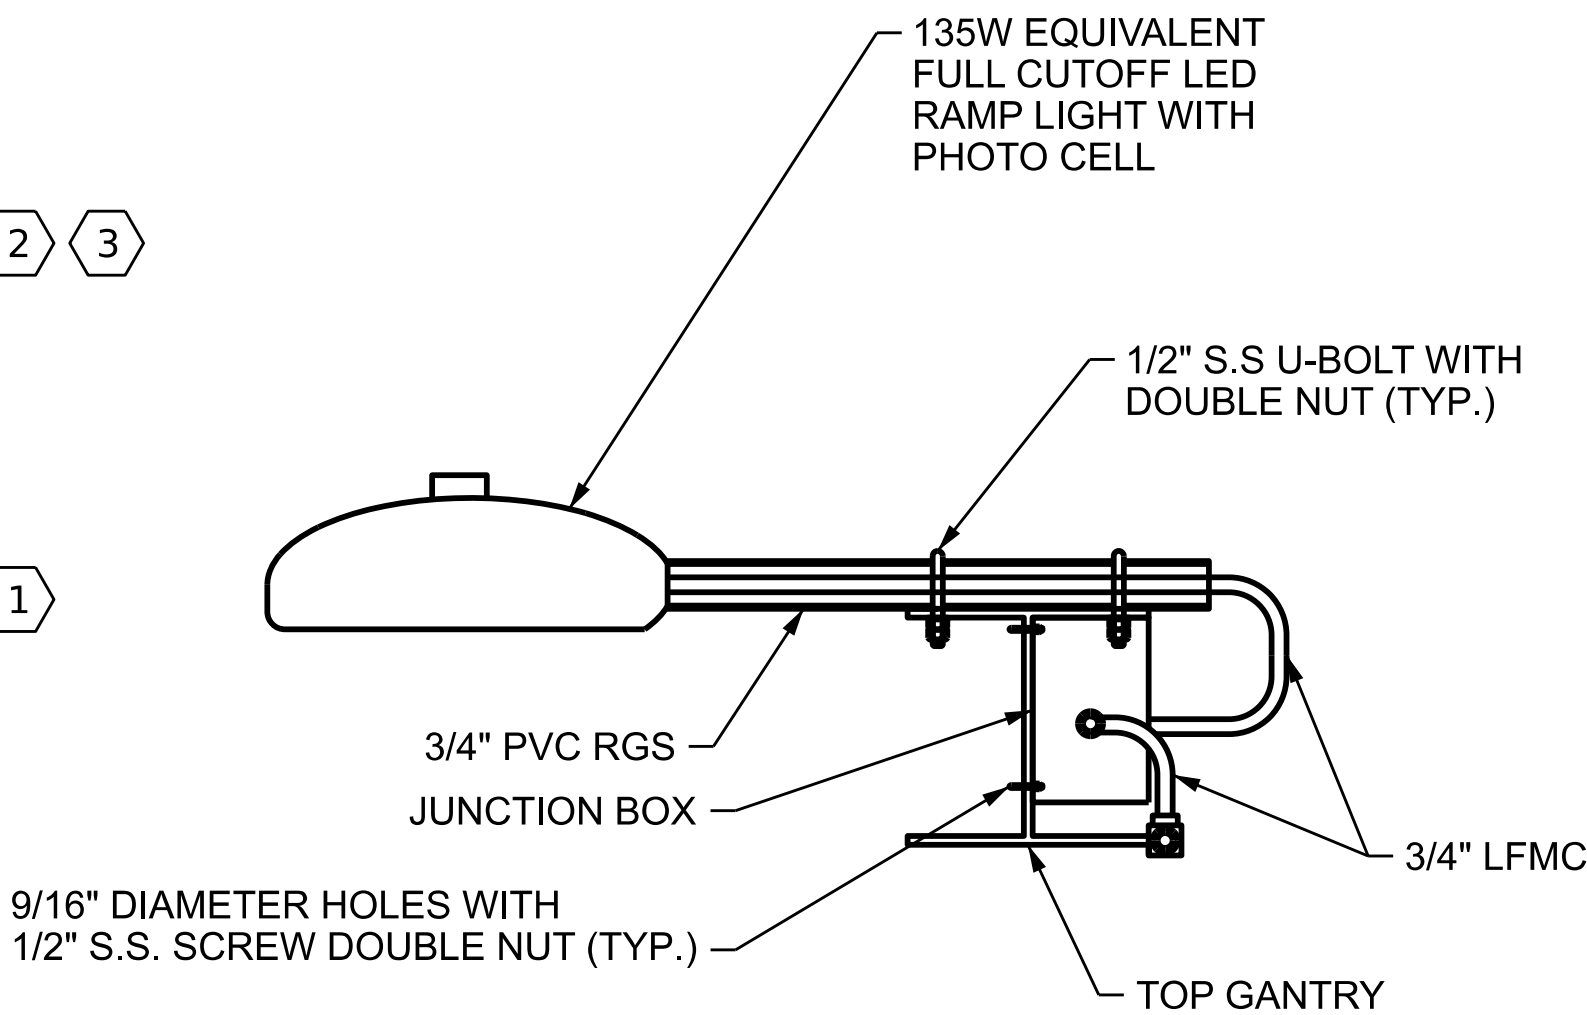

LED RAMP LIGHT DETAIL

KEY NOTES

- 1
- THE CONTRACTOR SHALL REMOVE THE EXISTING WEATHER HEAD AND INSTALL A NEW NEMA 4X STAINLESS STEEL JUNCTION BOX TO CONNECT TO THE EXISTING CONDUIT. LFMC CONDUIT OR APPROVED EQUAL SHALL BE USED TO CONNECT JUNCTION BOX TO LUMINAIRE.
- 2
- THE CONTRACTOR SHALL DISCONNECT, DEMOLISH, AND REMOVE THE EXISTING LIGHTING FIXTURE. THE CONTRACTOR SHALL INSTALL NEW LED FLOOD LIGHT MODEL 53XH22 FROM AMERICAN ELECTRIC OR APPROVED EQUAL.
- 3
- REPLACEMENT LIGHTING TO PROVIDE A MINIMUM OF 15 FC ON THE FERRY RAMP. THE CONTRACTOR IS RESPONSIBLE TO ORIENT THE FIXTURE AS REQUIRED.

PROJECT NO. **15BPR.164**
BEAUFORT COUNTY
TERMINAL: **AURORA**

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

AREA LIGHTING
REPAIR DETAILS

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	E1-02
1	--	--	3	--	--	TOTAL SHEETS 34
2	--	--	4	--	--	



Drake Cole

7/16/2026

DES BY: M. TORRES	DATE : 11/2025	DWG BY: B. PETERSON	DATE : 11/2025
DES CHK: D. COLE	DATE : 11/2025	CHK BY: D. COLE	DATE : 11/2025

HDR Engineering, Inc. of the Carolinas

555 Fayetteville St., Suite 900 Raleigh, N.C. 27601

N.C.B.E.L.S. License Number: F-0116

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED