




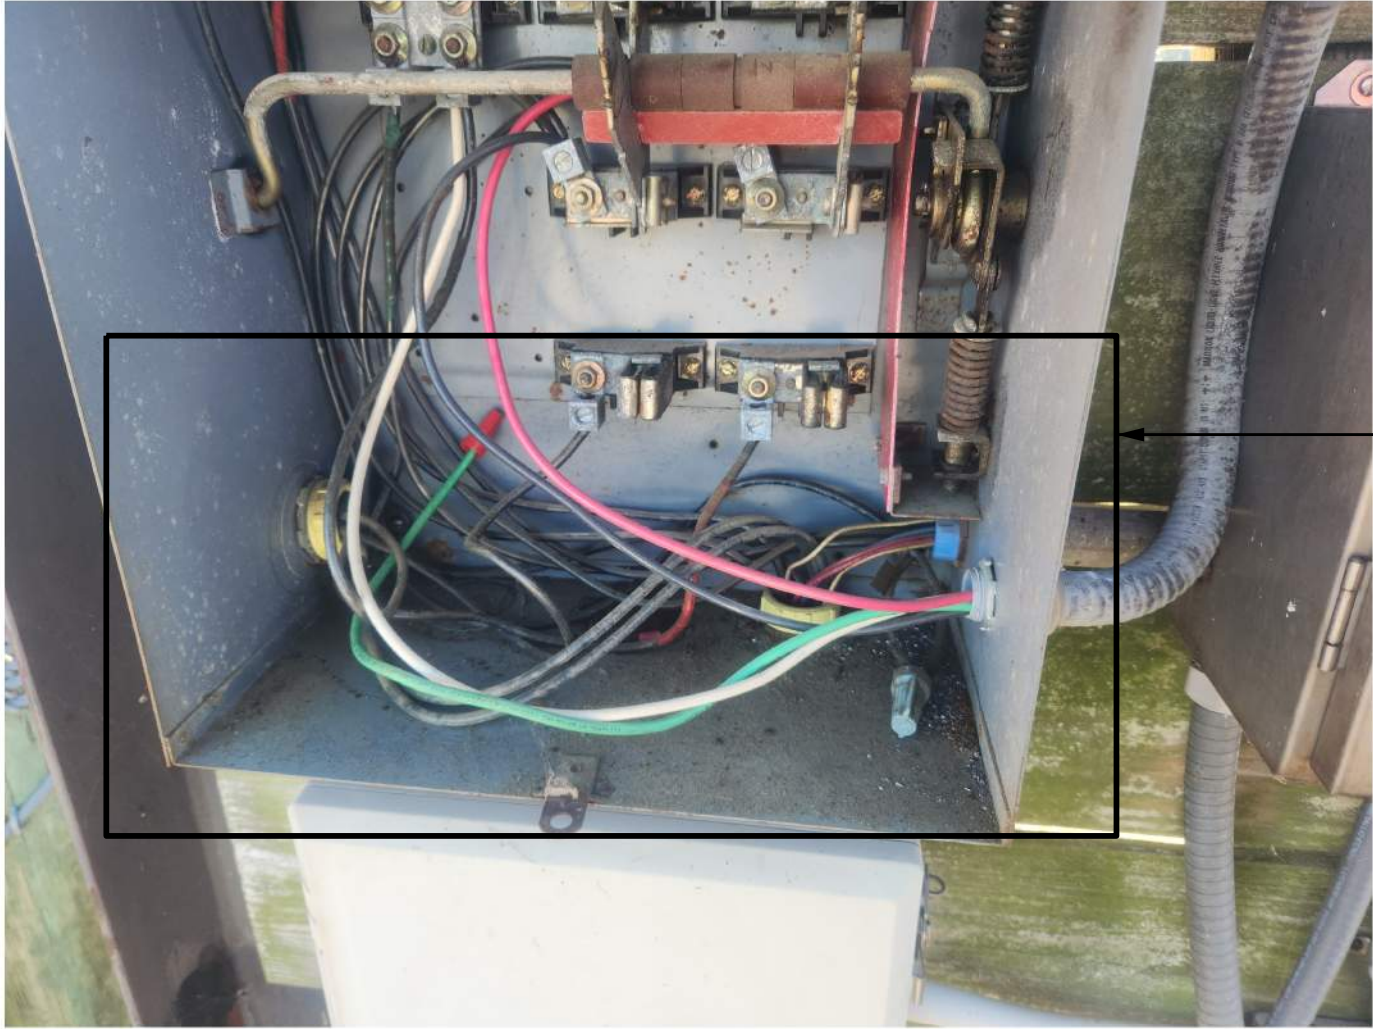


DEBRIS IN MTS CABINET

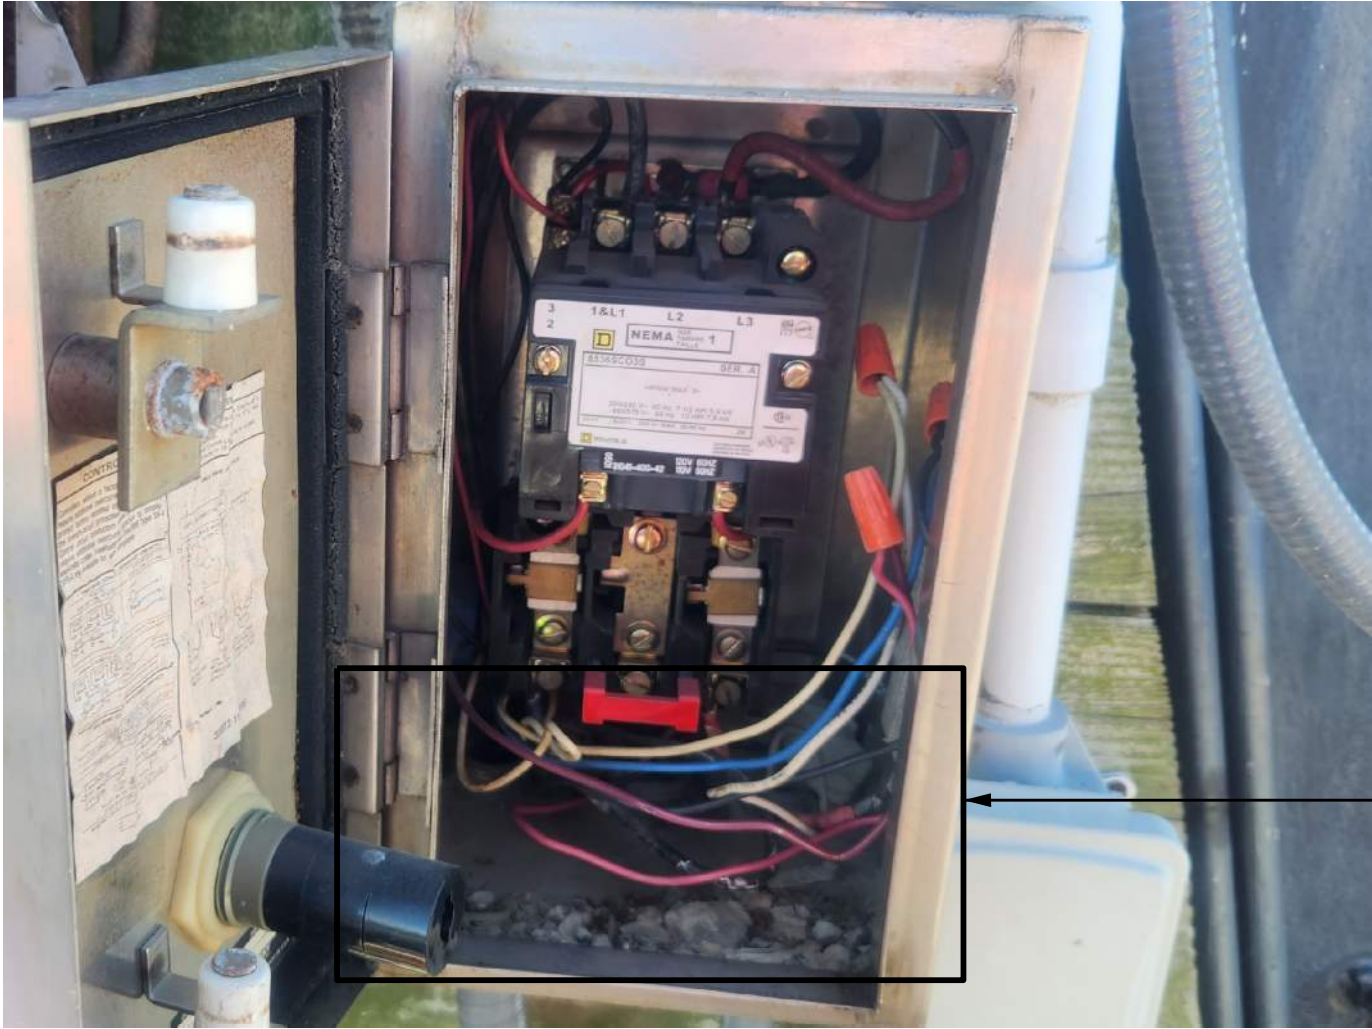


DEBRIS IN HPU MOTOR STARTER JUNCTION BOX

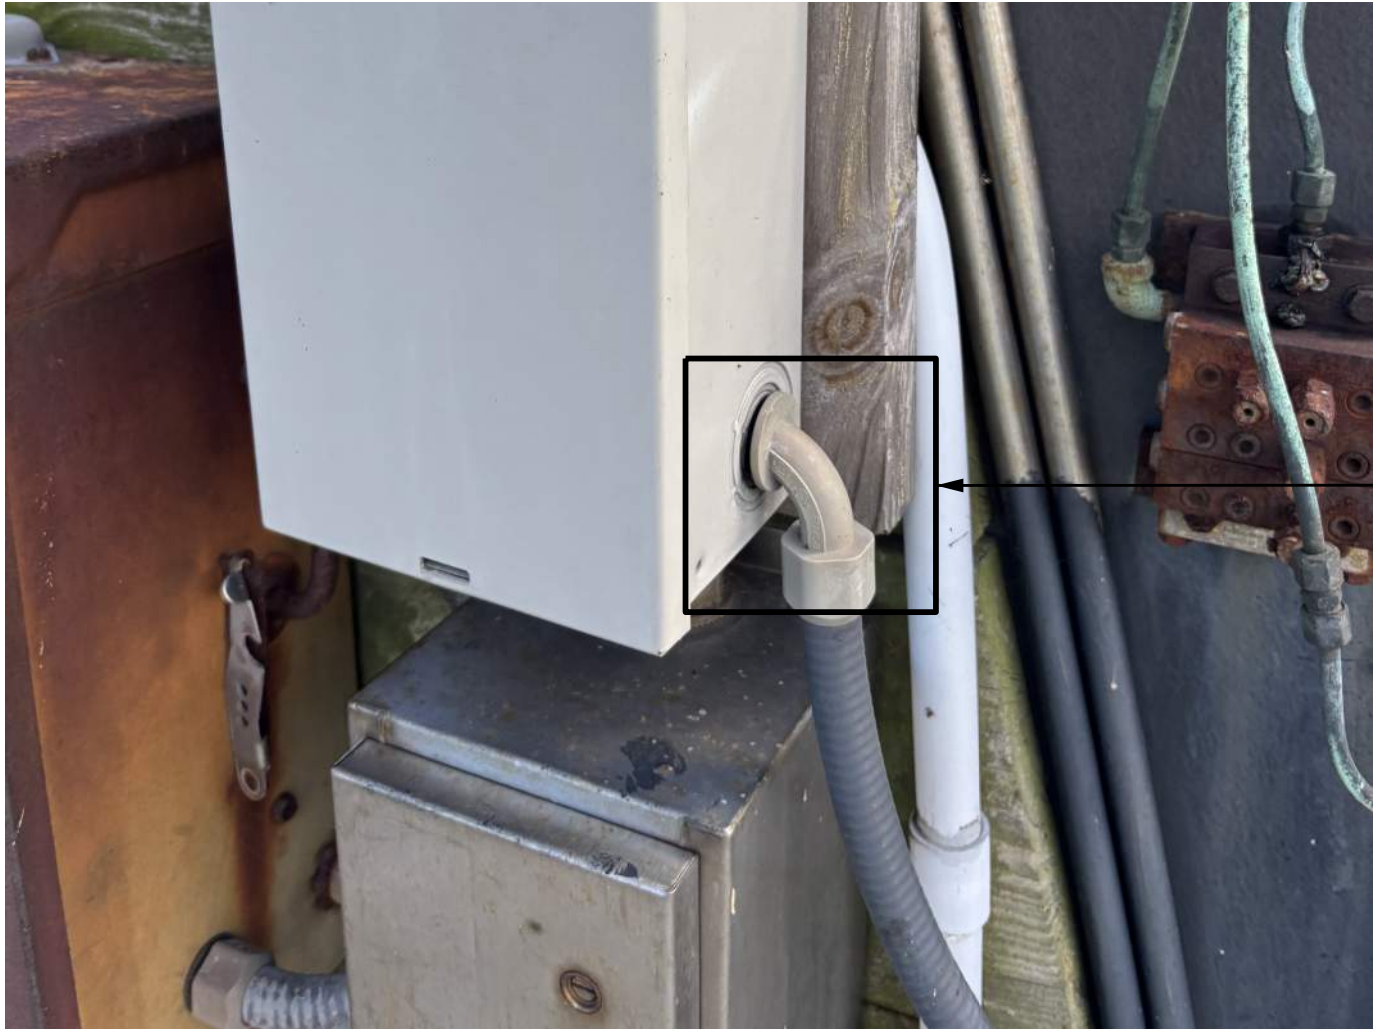

UNLABELED JUNCTION BOX LOCATED ON ELECTRICAL PEDESTAL

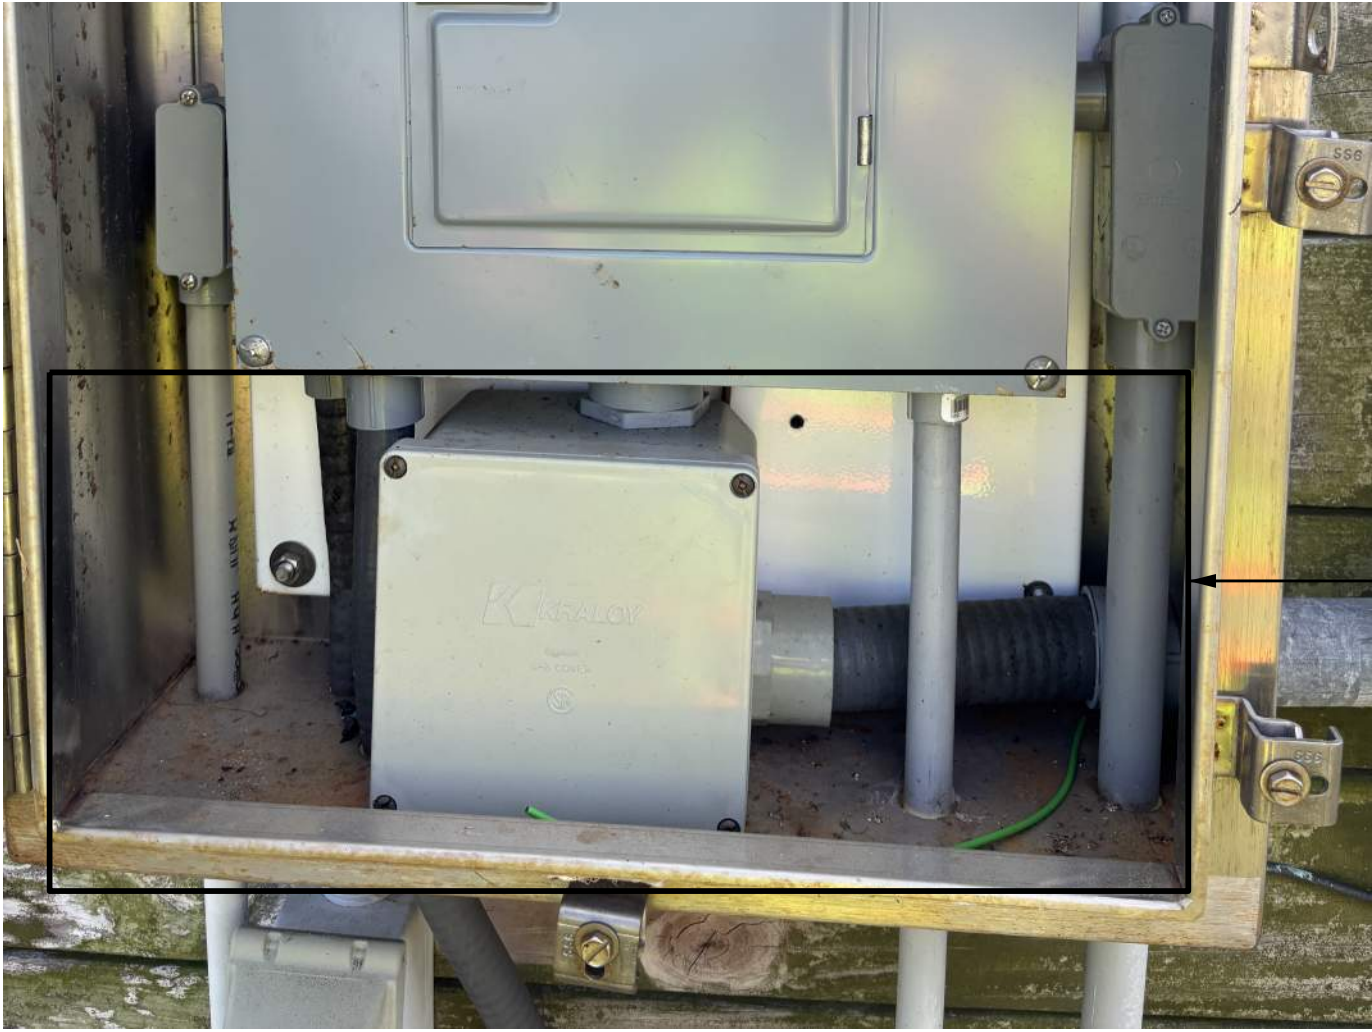

UNTERMINATED GROUND WIRE LOCATED INSIDE
PANELBOARD CABINET

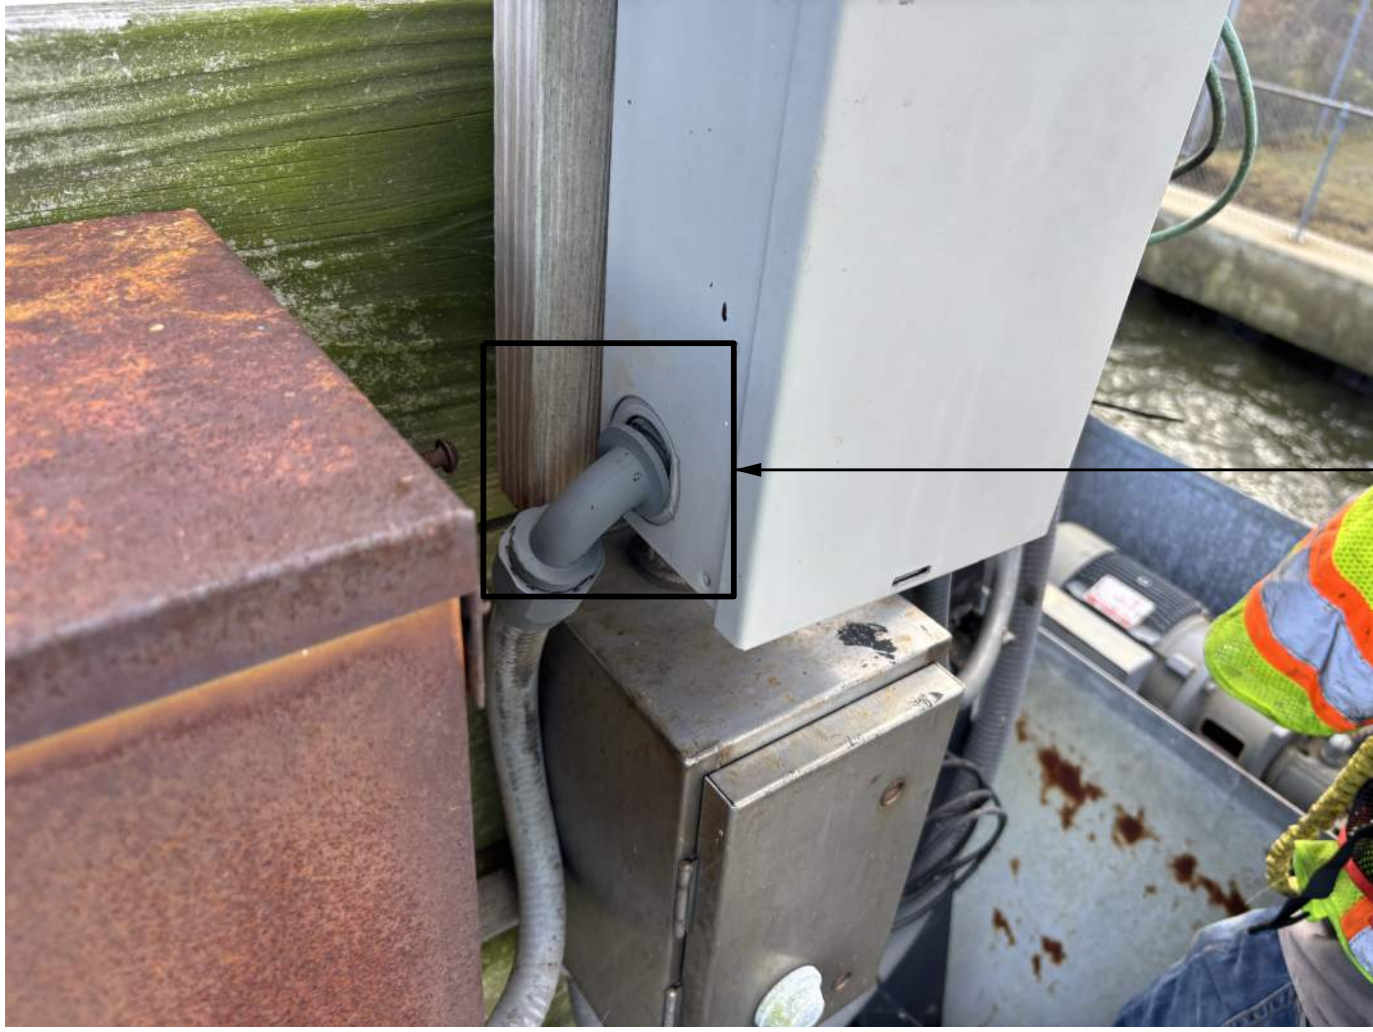

UNLABELED JUNCTION BOX LOCATED ON ELECTRICAL PEDESTAL

KEY NOTES

- 1 THE CONTRACTOR SHALL CLEAN AND REMOVE DEBRIS FROM THE INTERIOR OF BOXES/ENCLOSURES/CABINETS.
- 2 THE CONTRACTOR SHALL INSTALL A GROUND TERMINAL BLOCK TO TERMINATE GROUND CONDUCTORS.
- 3 THE CONTRACTOR SHALL ENSURE CONDUIT FITTING IS SECURELY INSTALLED IN JUNCTION BOX AND SHALL BE REPAIRED OR REPLACED AS REQUIRED.

PROJECT NO. **15BPR.164**
BEAUFORT COUNTY
TERMINAL: **AURORA**

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

JUNCTION BOX
REPAIR DETAILS



Drake J. Cole

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO. E1-04
NO.	BY:	DATE:	NO.	BY:	DATE:	
1	--	--	3	--	--	TOTAL SHEETS 34
2	--	--	4	--	--	

DES BY: M. TORRES	DATE : 11/2025	DWG BY: B. PETERSON	DATE : 11/2025
DES CHK: D. COLE	DATE : 11/2025	CHK BY: D. COLE	DATE : 11/2025