



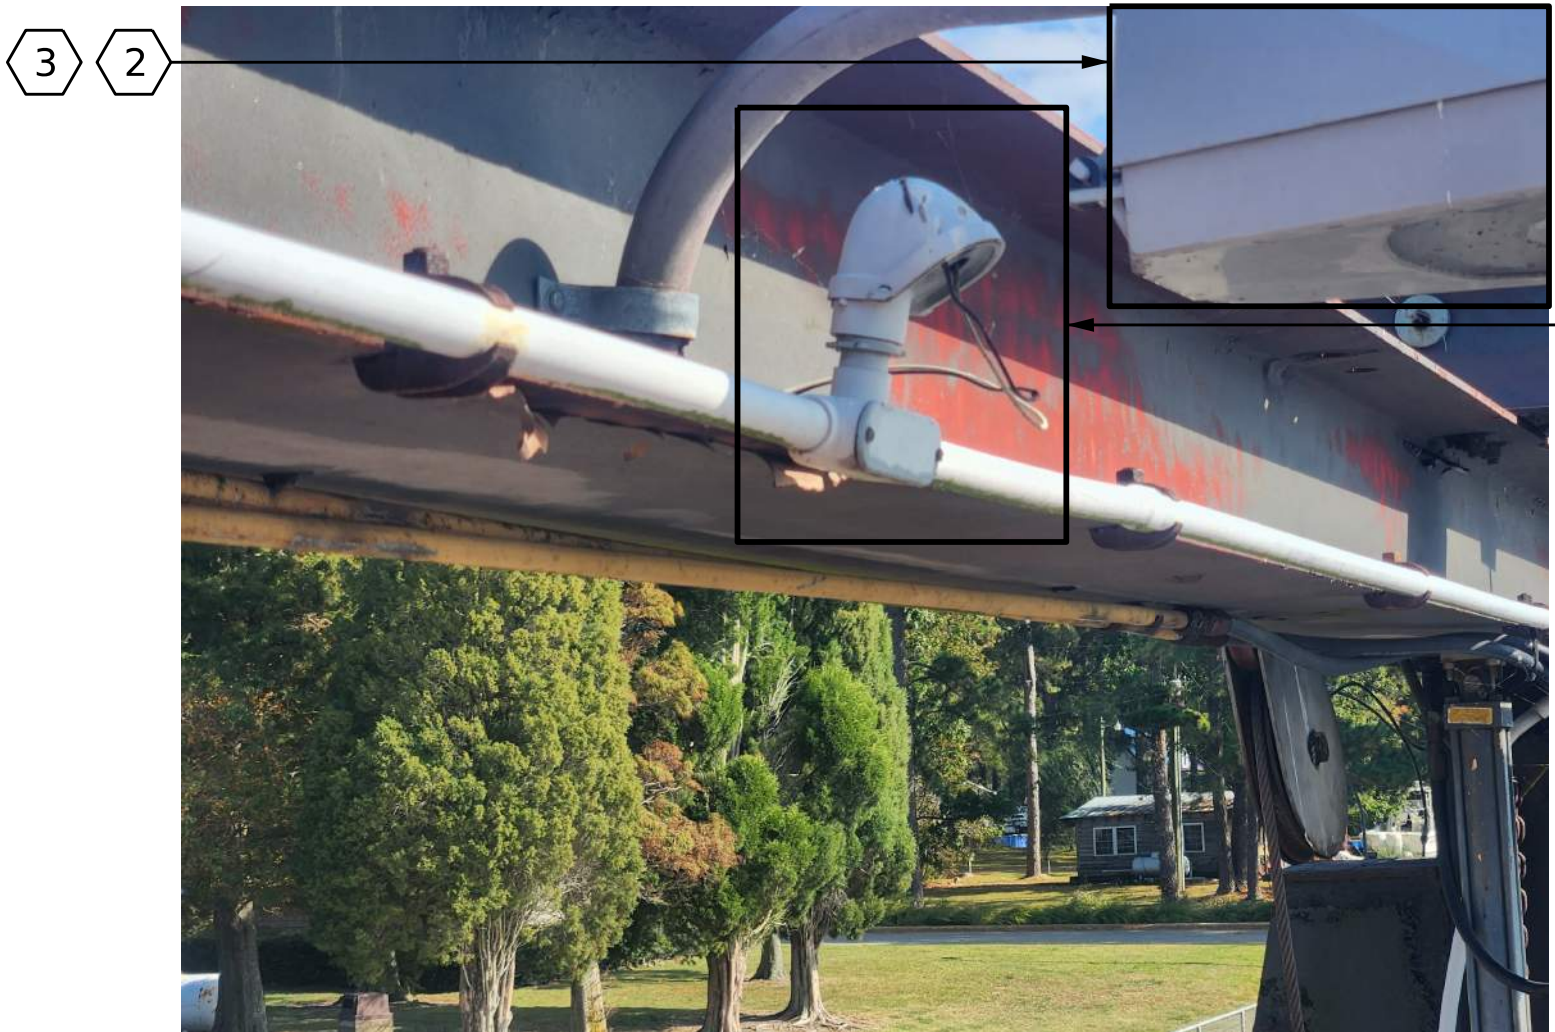

GANTRY LIGHT ELECTRICAL WIRES NOT IN CONDUIT

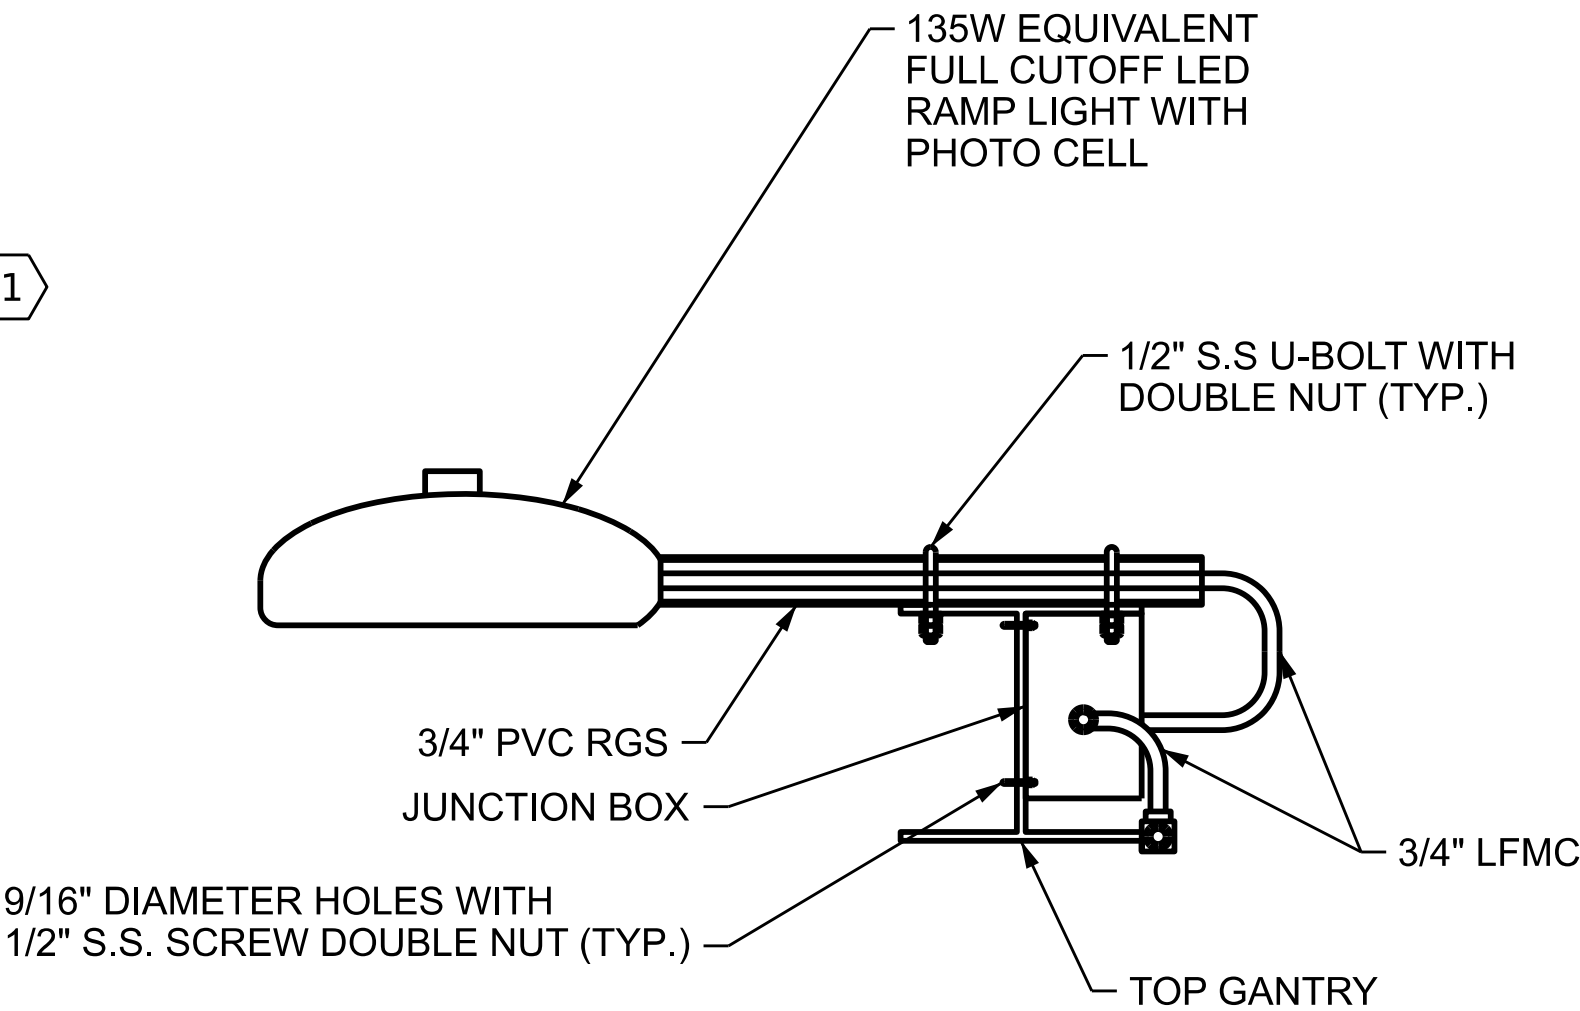

LED RAMP LIGHT DETAIL

KEY NOTES

- 1 THE CONTRACTOR SHALL REMOVE THE EXISTING WEATHER HEAD AND INSTALL A NEW NEMA 4X STAINLESS STEEL JUNCTION BOX TO CONNECT TO THE EXISTING CONDUIT. LFMC CONDUIT OR APPROVED EQUAL SHALL BE USED TO CONNECT JUNCTION BOX TO LUMINAIRE.
- 2 THE CONTRACTOR SHALL DISCONNECT, DEMOLISH, AND REMOVE THE EXISTING LIGHTING FIXTURE. THE CONTRACTOR SHALL INSTALL NEW LED FLOOD LIGHT MODEL 53XH22 FROM AMERICAN ELECTRIC OR APPROVED EQUAL.
- 3 REPLACEMENT LIGHTING TO PROVIDE OF A MINIMUM OF 15 FC ON THE FERRY RAMP. THE CONTRACTOR IS RESPONSIBLE TO ORIENT THE FIXTURE AS REQUIRED.

PROJECT NO. **15BPR.164**
BEAUFORT COUNTY
TERMINAL: **BAYVIEW**

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

AREA LIGHTING
REPAIR DETAILS



7/16/2026
Drake Cole

DES BY: <u>M. TORRES</u>	DATE : <u>11/2025</u>	DWG BY: <u>B. PETERSON</u>	DATE : <u>11/2025</u>
DES CHK: <u>D. COLE</u>	DATE : <u>11/2025</u>	CHK BY: <u>D. COLE</u>	DATE : <u>11/2025</u>

HDR

HDR Engineering, Inc. of the Carolinas

555 Fayetteville St., Suite 900 Raleigh, N.C. 27601

N.C.B.E.L.S. License Number: F-0116

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO. E2-02
NO.	BY:	DATE:	NO.	BY:	DATE:	
1	--	--	3	--	--	TOTAL SHEETS 34
2	--	--	4	--	--	