

REFERENCE: SF-690005

PROJECT: 17BP.1.R.88

CONTENTS

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
1	TITLE SHEET
2	LEGEND (SOIL & ROCK)
3	SITE PLAN
4	PROFILE
5-6	BORE LOGS
7	SOIL TEST RESULTS

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 GEOTECHNICAL ENGINEERING UNIT

STRUCTURE
SUBSURFACE INVESTIGATION

COUNTY PASQUOTANK
 PROJECT DESCRIPTION BRIDGE NO. 5 ON -L- (SR 1103)
OVER CHAPEL CREEK AT -L- STA. 18+70

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	SF-690005	1	7

CAUTION NOTICE

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N. C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT AT (919) 707-6850. THE SUBSURFACE PLANS AND REPORTS, FIELD BORING LOGS, ROCK CORES AND SOIL TEST DATA ARE NOT PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO MAKE SUCH INDEPENDENT SUBSURFACE INVESTIGATIONS AS HE DEEMS NECESSARY TO SATISFY HIMSELF AS TO CONDITIONS TO BE ENCOUNTERED ON THE PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE DIFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

- NOTES:
1. THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N. C. DEPARTMENT OF TRANSPORTATION AS ACCURATE NOR IS IT CONSIDERED PART OF THE PLANS, SPECIFICATIONS OR CONTRACT FOR THE PROJECT.
 2. BY HAVING REQUESTED THIS INFORMATION, THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

PERSONNEL



C.R. BALDWIN
MBO
KWD

INVESTIGATED BY T.C. BOTTOMS
 DRAWN BY T.C. BOTTOMS
 CHECKED BY D.N. ARGENBRIGHT
 SUBMITTED BY D.N. ARGENBRIGHT
 DATE JUNE 2019



DocuSigned by:
Tyler C. Bottoms 8/13/2019
 48A2D3BD08 SIGNATURE DATE


**DOCUMENT NOT CONSIDERED FINAL
 UNLESS ALL SIGNATURES COMPLETED**

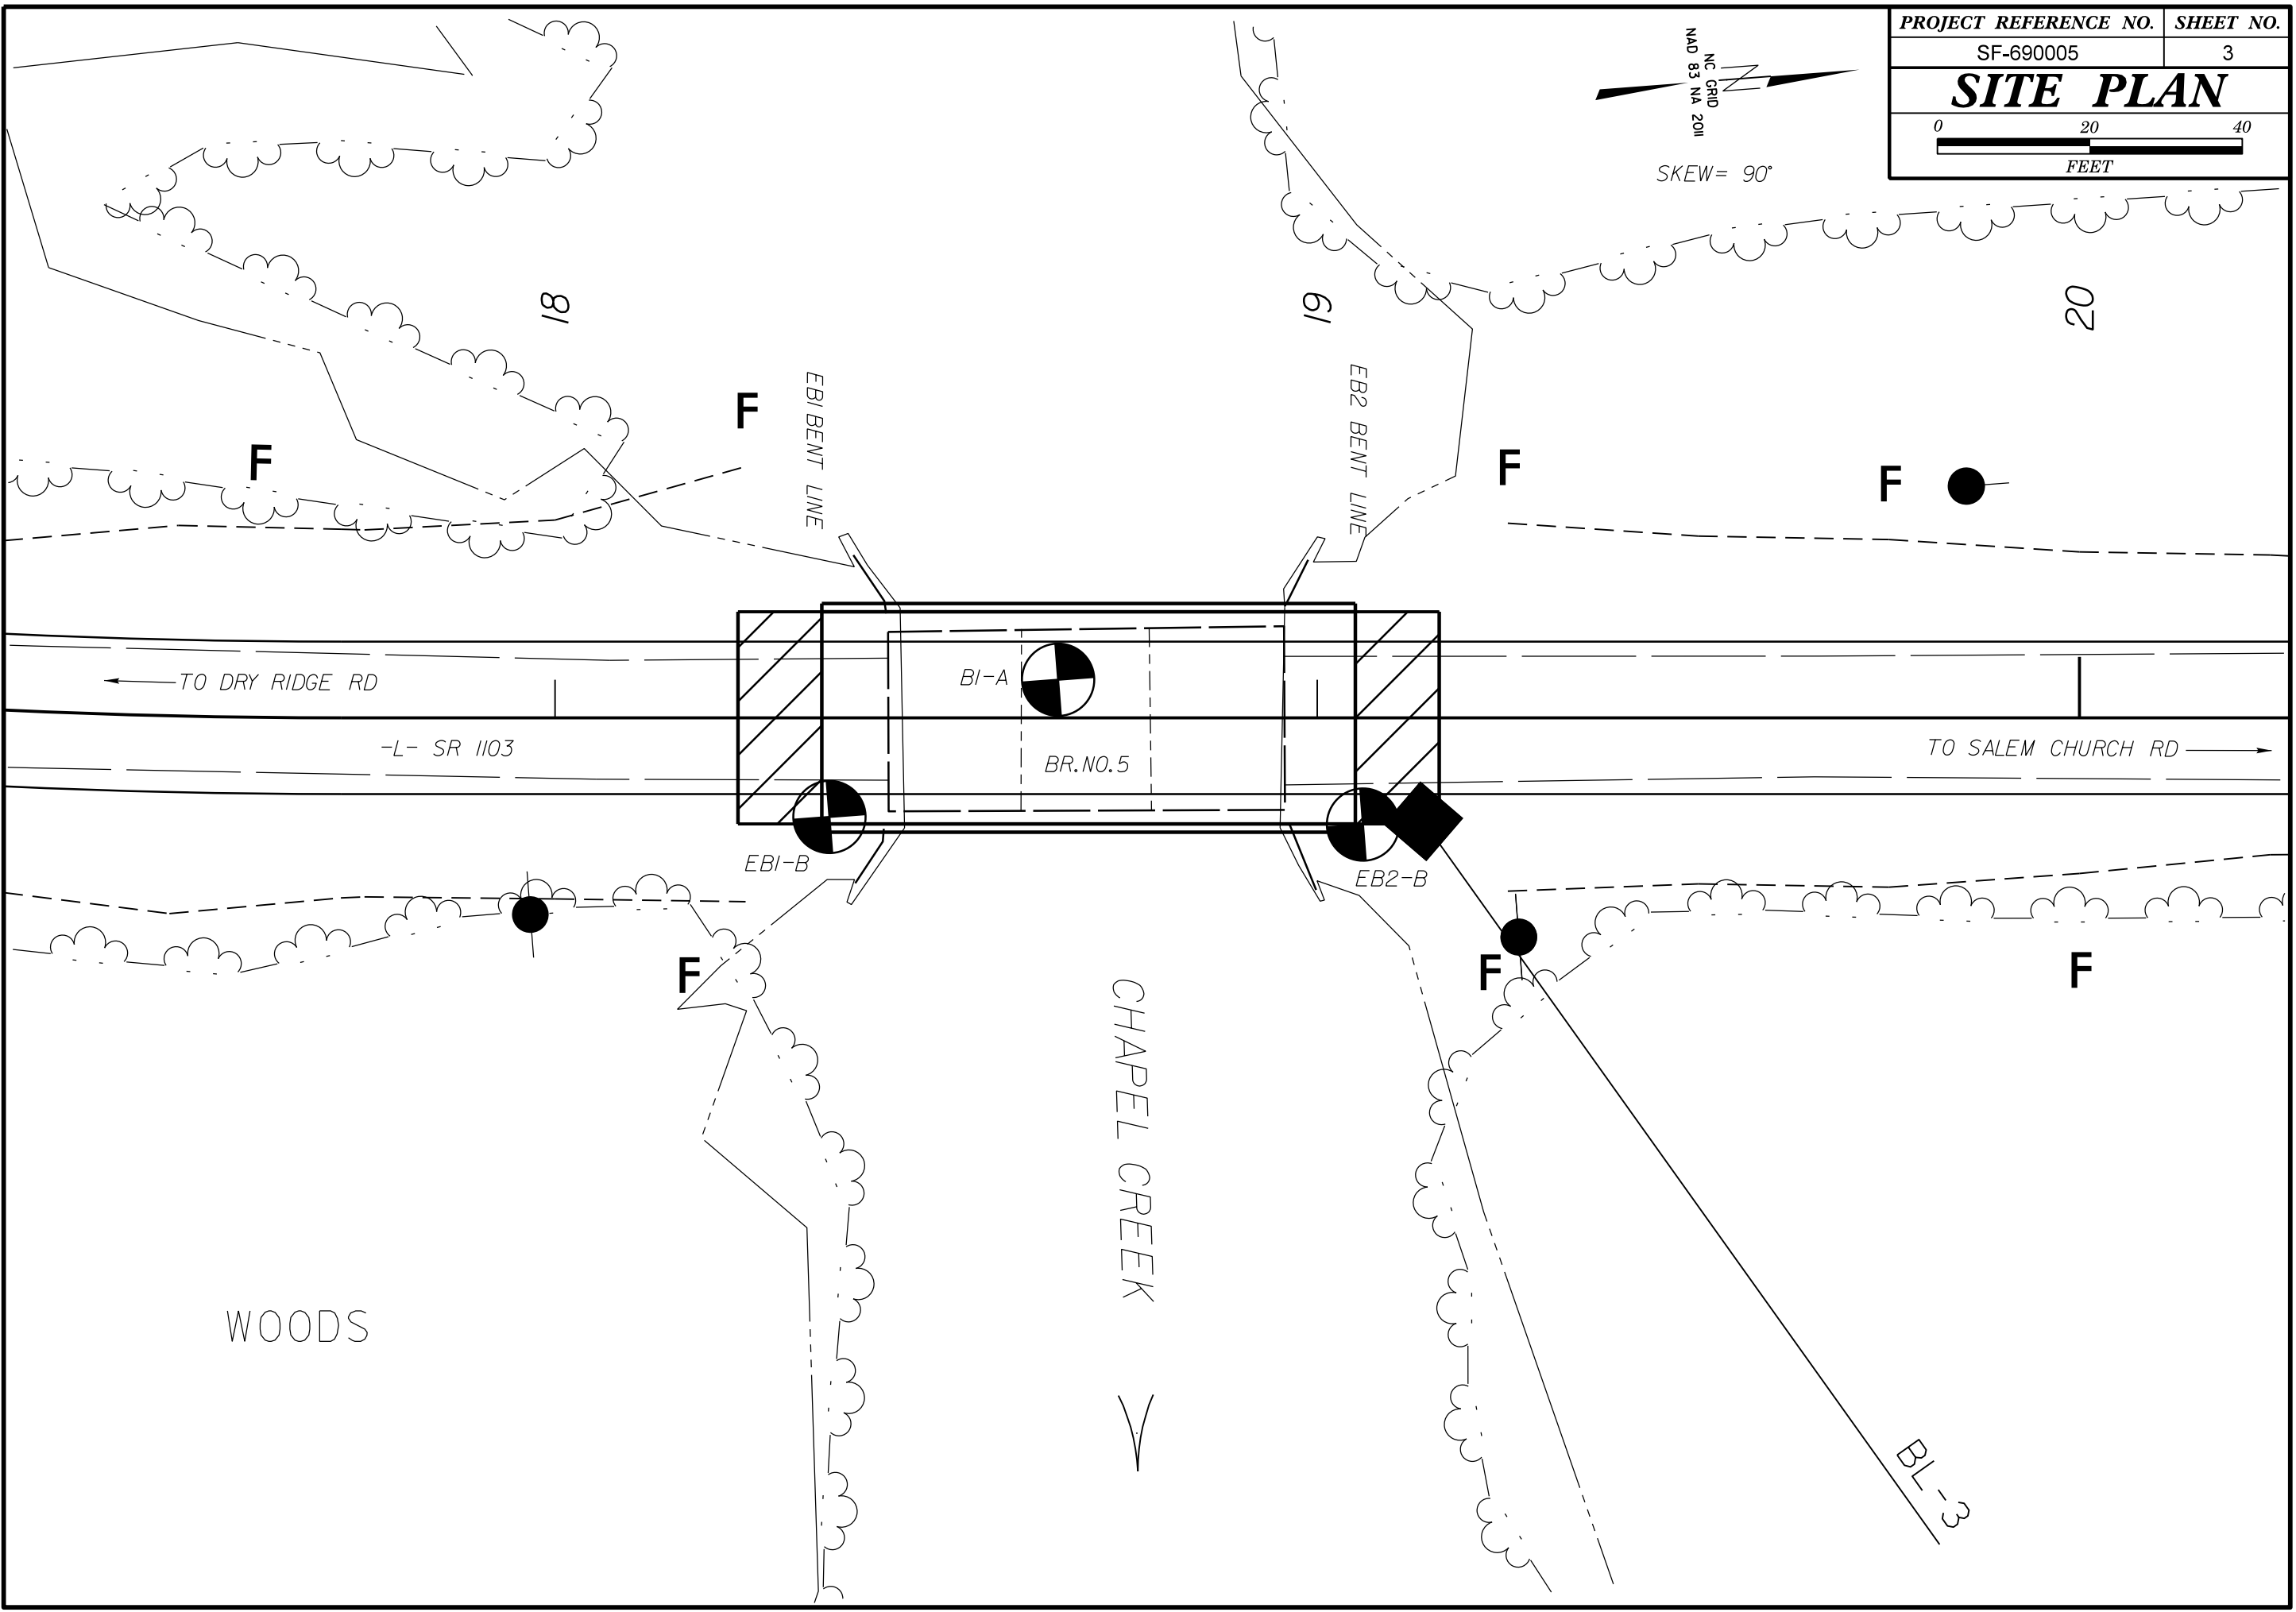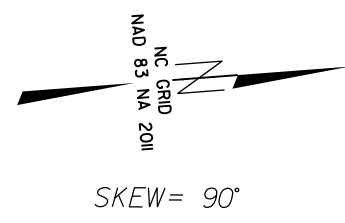

5/14/99

PROJECT REFERENCE NO. SF-690005	SHEET NO. 4
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
INCOMPLETE PLANS DO NOT USE FOR R/W ACQUISITION	
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	

PROFILE THROUGH BORINGS PROJECTED ALONG -L-

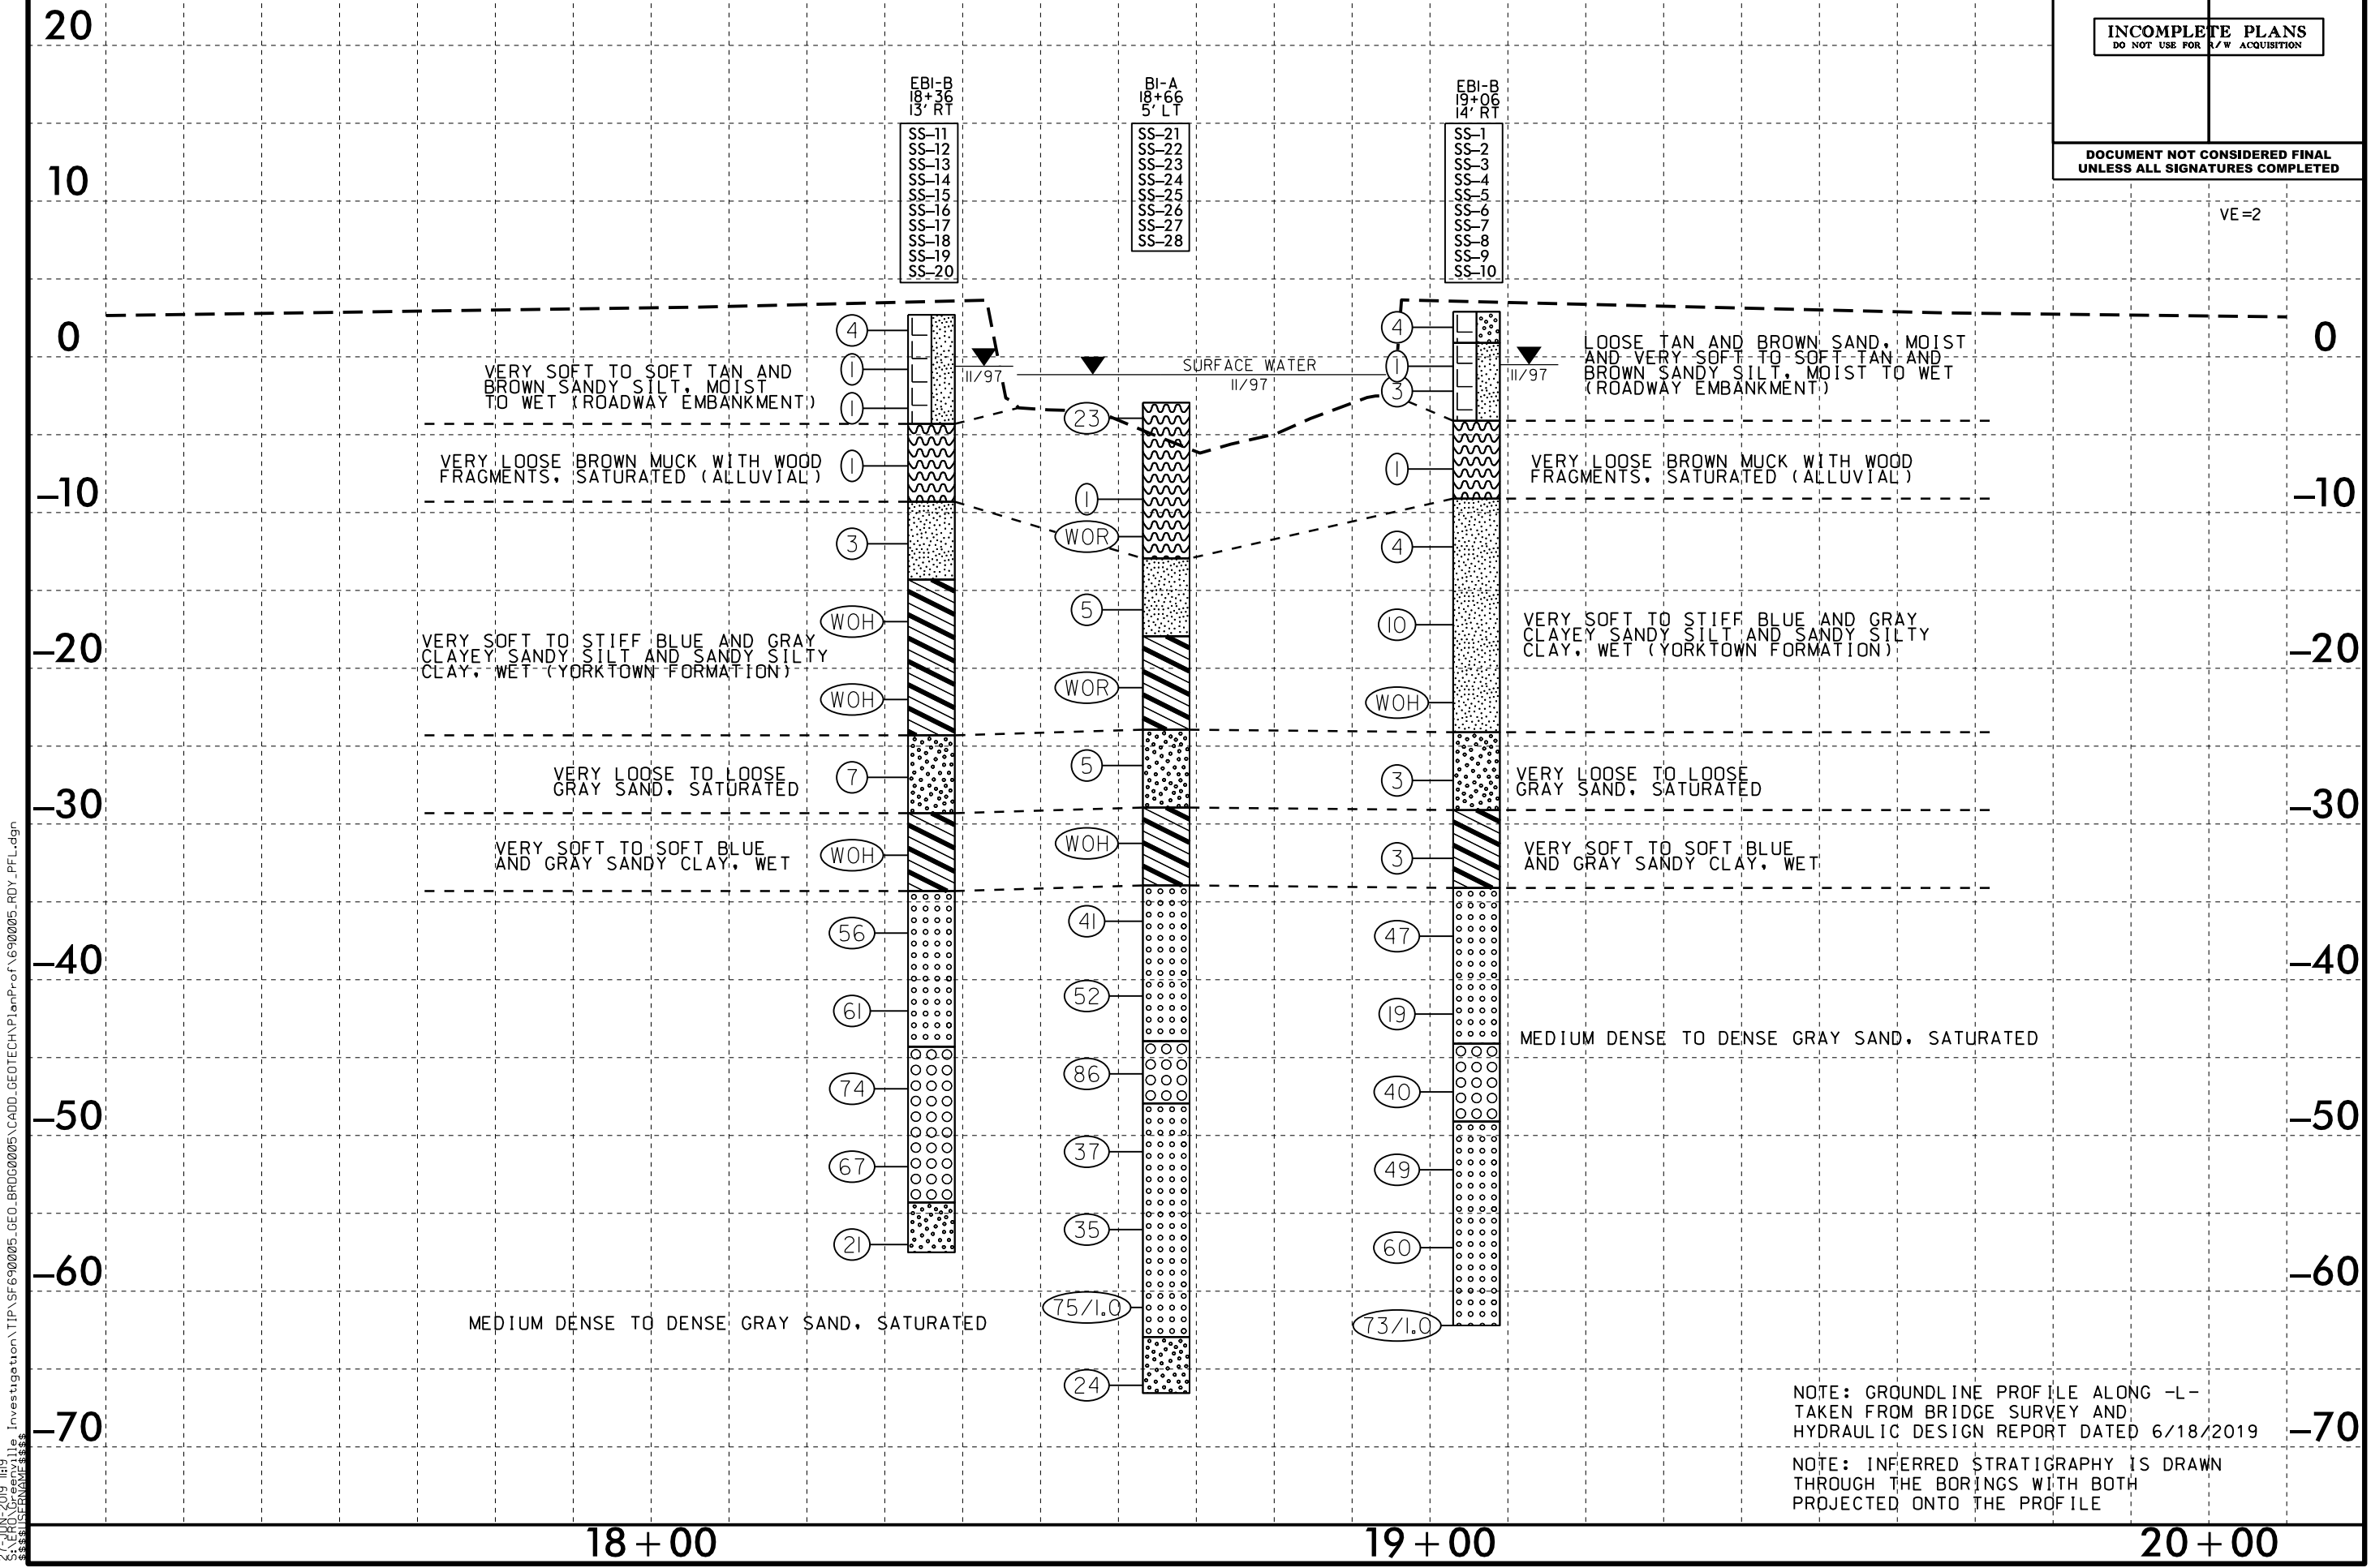

27-JUN-2019 11:19 S:\ERC\Greenville_Investigation\TIP_SF690005_GEO_BRDG0005\CADD_GEOTECH\PlanProf\690005_RDY_PFL.dgn

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C.SAND	F.SAND	SILT	CLAY	10	40	200		
SS- 1	14' RT	19+06	0.0- 1.5	A- 2- 4(0)	20	NP	11.5	56.2	20.2	12.1	89	85	34	-	-
SS- 2	14' RT	19+06	2.5- 4.0	A- 4(1)	23	4	3.0	50.7	28.1	18.2	100	100	74	-	-
SS- 3	14' RT	19+06	14.1- 15.6	A- 4(6)	29	7	1.0	37.4	43.4	18.2	100	100	91	-	-
SS- 4	14' RT	19+06	19.1- 20.6	A- 4(0)	23	NP	13.7	58.2	26.1	2.0	100	98	52	-	-
SS- 5	14' RT	19+06	24.1- 25.6	A- 4(4)	24	10	1.0	33.7	43.0	22.2	100	100	68	-	-
SS- 6	14' RT	19+06	29.1- 30.6	A- 2- 4(0)	17	3	63.0	9.5	19.4	8.1	100	68	30	-	-
SS- 7	14' RT	19+06	34.1- 35.6	A- 6(3)	30	11	8.3	47.5	30.1	14.1	100	97	55	40.6	-
SS- 8	14' RT	19+06	39.1- 41.6	A- 3(0)	19	NP	46.0	48.5	2.5	3.0	100	84	7	-	-
SS- 9	14' RT	19+06	49.1- 50.6	A- 1- b(0)	19	NP	74.9	19.9	4.1	1.0	84	44	5	-	-
SS- 10	14' RT	19+06	59.1- 60.6	A- 3(0)	23	NP	13.3	79.1	6.6	1.0	100	97	10	-	-
SS- 11	13' RT	18+36	0.0- 1.5	A- 4(0)	19	1	11.1	48.9	25.9	14.1	91	88	53	-	-
SS- 12	13' RT	18+36	2.5- 4.0	A- 4(0)	21	NP	5.3	54.3	28.3	12.1	100	99	71	-	-
SS- 13	13' RT	18+36	8.7- 10.2	-	-	-	58.6	8.5	24.8	8.1	100	48	35	249.4	61.4
SS- 14	13' RT	18+36	13.7- 15.2	A- 4(0)	20	NP	16.0	51.3	22.6	10.1	100	95	49	-	-
SS- 15	13' RT	18+36	18.7- 20.2	A- 6(4)	24	11	1.8	39.8	34.1	24.2	100	100	61	-	-
SS- 16	13' RT	18+36	28.7- 30.2	A- 2- 4(0)	15	NP	54.0	15.8	21.1	9.1	100	80	32	-	-
SS- 17	13' RT	18+36	33.7- 35.2	A- 6(4)	30	12	8.3	46.5	29.1	16.2	100	97	56	-	-
SS- 18	13' RT	18+36	38.7- 40.2	A- 3(0)	20	NP	38.9	53.7	5.4	2.0	100	88	9	-	-
SS- 19	13' RT	18+36	48.7- 50.2	A- 1- b(0)	17	NP	75.8	18.9	4.3	1.0	92	47	6	-	-
SS- 20	13' RT	18+36	58.7- 60.2	A- 2- 4(0)	23	NP	5.6	82.6	7.8	4.0	100	98	17	-	-
SS- 21	5' LT	18+66	12.3- 13.8	A- 4(0)	19	NP	10.9	53.6	24.3	11.1	100	96	45	-	-
SS- 22	5' LT	18+66	17.3- 18.8	A- 6(10)	30	15	0.6	19.8	43.2	36.4	100	100	82	-	-
SS- 23	5' LT	18+66	22.3- 23.8	A- 2- 4(0)	15	NP	77.5	7.2	9.3	6.1	100	56	16	-	-
SS- 24	5' LT	18+66	27.3- 28.8	A- 6(3)	30	11	7.3	48.1	30.5	14.1	100	98	54	-	-
SS- 25	5' LT	18+66	32.3- 33.8	A- 3(0)	20	NP	71.1	24.7	3.1	1.0	100	75	5	-	-
SS- 26	5' LT	18+66	42.1- 43.6	A- 1- b(0)	18	NP	77.7	18.7	2.6	1.0	92	49	4	-	-
SS- 27	5' LT	18+66	52.1- 53.6	A- 3(0)	23	NP	16.5	77.3	4.2	2.0	95	89	8	-	-
SS- 28	5' LT	18+66	62.1- 63.6	A- 2- 4(0)	18	NP	61.6	29.4	8.0	1.0	91	62	11	-	-