



29-JAN-2025 13:52  
S:\DCC\Projects\Mitchell\Slagle Rd (SR 1170).tsh.dgn  
etwells AT DIV13-330176

09/08/2025

CONTRACT: DM00473

PROJECT: DF18313.2061278

GRAPHIC SCALES

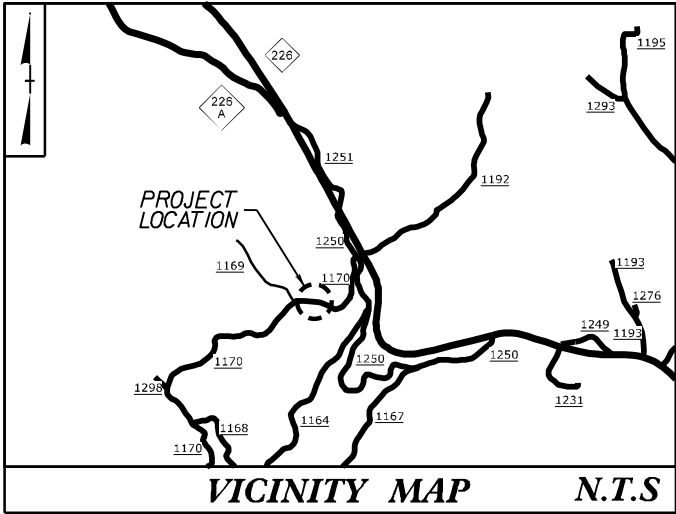


STATE OF NORTH CAROLINA  
DIVISION OF HIGHWAYS

**MITCHELL COUNTY**

LOCATION: SR1170 (SLAGLE RD) 0.4 MI WEST  
OF SR1250 (SNOW CREEK RD)  
TYPE OF WORK: PIPE REPLACEMENT

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	DF18313.2061278	1	
STATE PROJ. NO.	F.A. PROJ. NO.	DESCRIPTION	

INCOMPLETE PLANS  
DO NOT USE FOR R/W ACQUISITION  
DOCUMENT NOT CONSIDERED FINAL  
UNLESS ALL SIGNATURES COMPLETED



Prepared In the Office of:  
**DIVISION OF HIGHWAYS**  
55 Orange St., Asheville NC, 28801

2024 STANDARD SPECIFICATIONS

LETTING DATE:  
March 19, 2025

PROJECT ENGINEER

PROJECT DESIGN ENGINEER



REVISIONS

PROJECT REFERENCE NO. <b>DF18313.2061278</b>	SHEET NO. <b>2</b>
RW SHEET NO.	
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
<div>INCOMPLETE PLANS</div> <div>DO NOT USE FOR A/W ACQUISITION</div>	
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	





29-JAN-2025 14:07  
S:\DDC-Projects\1170\Slagle Rd (SR 1170)\Slagle Rd (SR 1170).psh.dgn  
C:\Users\jwells\AppData\Local\Temp\1170-330172






# ONSITE CONCRETE WASHOUT STRUCTURE WITH LINER

PROJECT REFERENCE NO.	SHEET NO.
DF18313.2061278	3
RW SHEET NO.	
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER

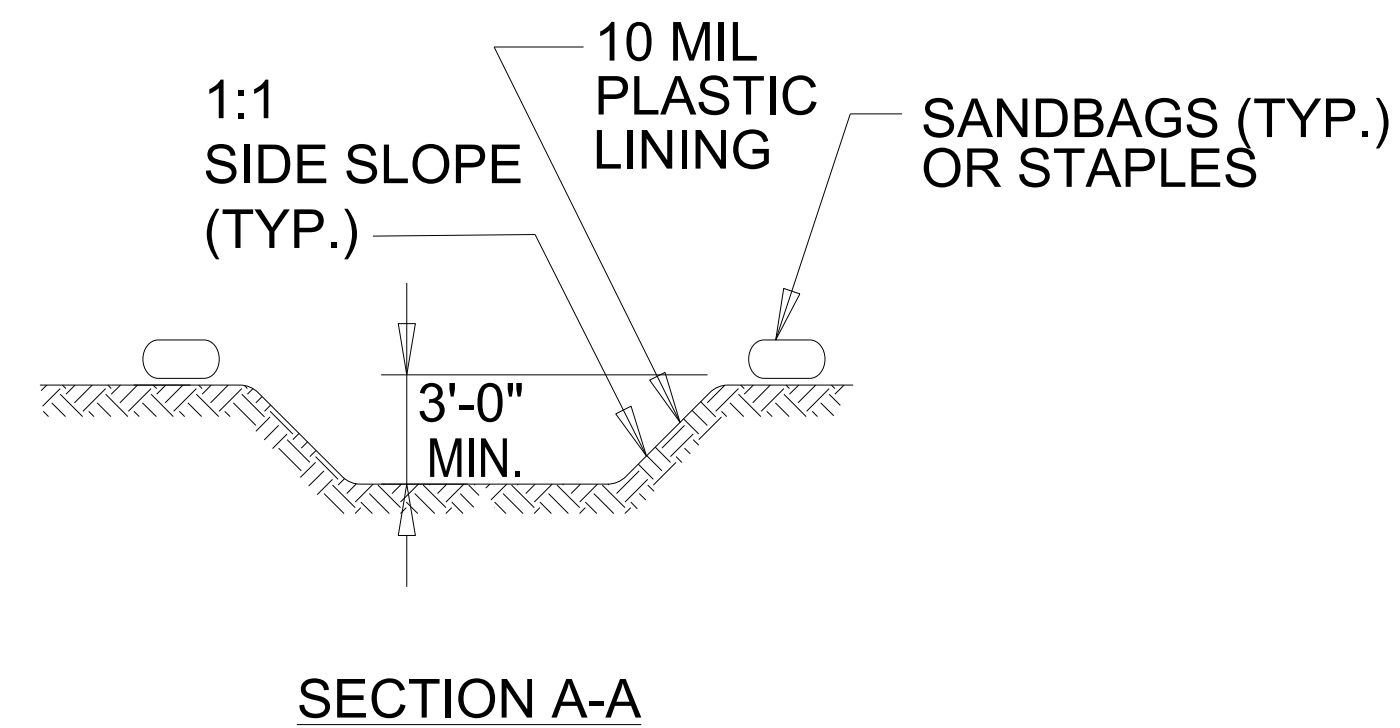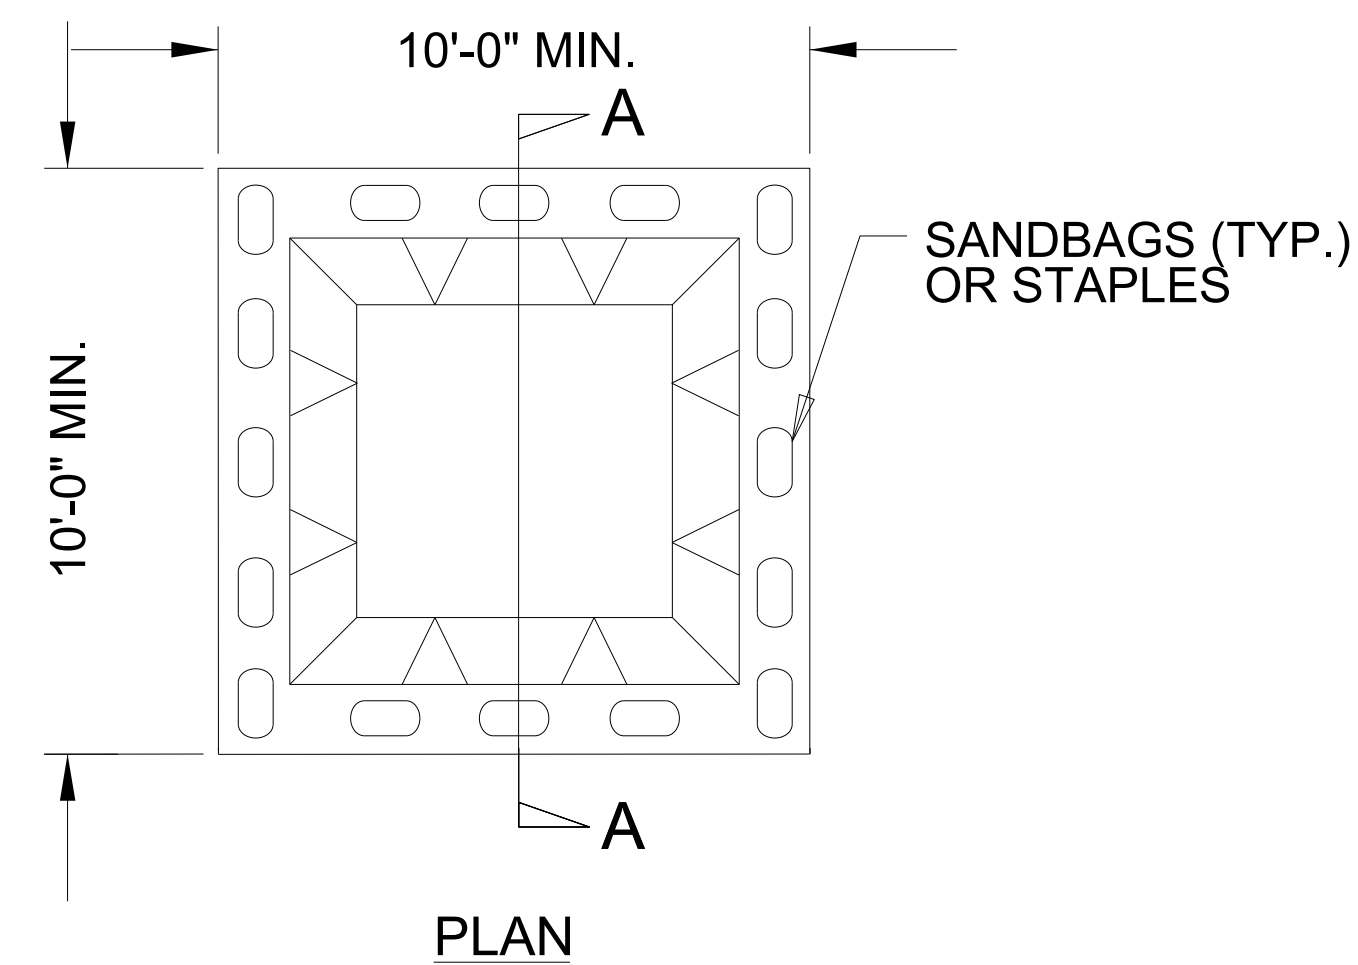

**BELOW GRADE WASHOUT STRUCTURE**  
NOT TO SCALE

- NOTES:
1. ACTUAL LOCATION DETERMINED IN FIELD
  2. THE CONCRETE WASHOUT STRUCTURES SHALL BE MAINTAINED WHEN THE LIQUID AND/OR SOLID REACHES 75% OF THE STRUCTURES CAPACITY TO PROVIDE ADEQUATE HOLDING CAPACITY WITH A MINIMUM 12 INCHES OF FREEBOARD.
  3. CONCRETE WASHOUT STRUCTURE NEEDS TO BE CLEARLY MARKED WITH SIGNAGE NOTING DEVICE.

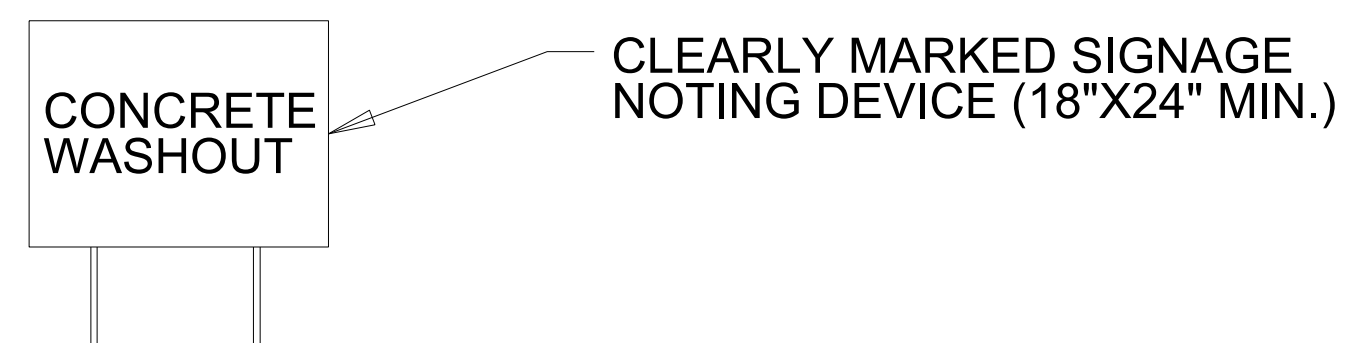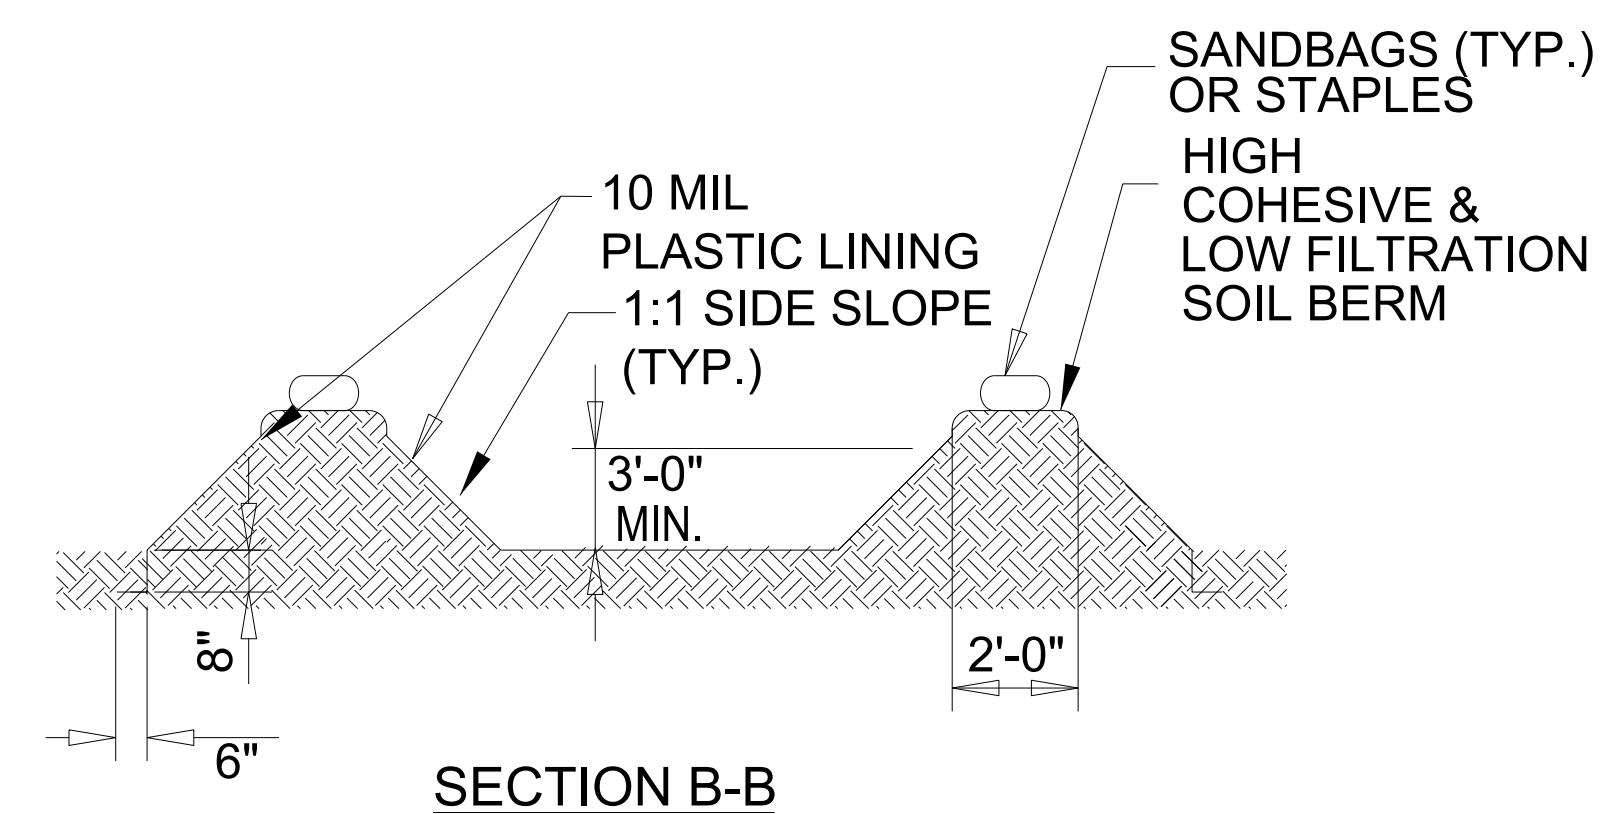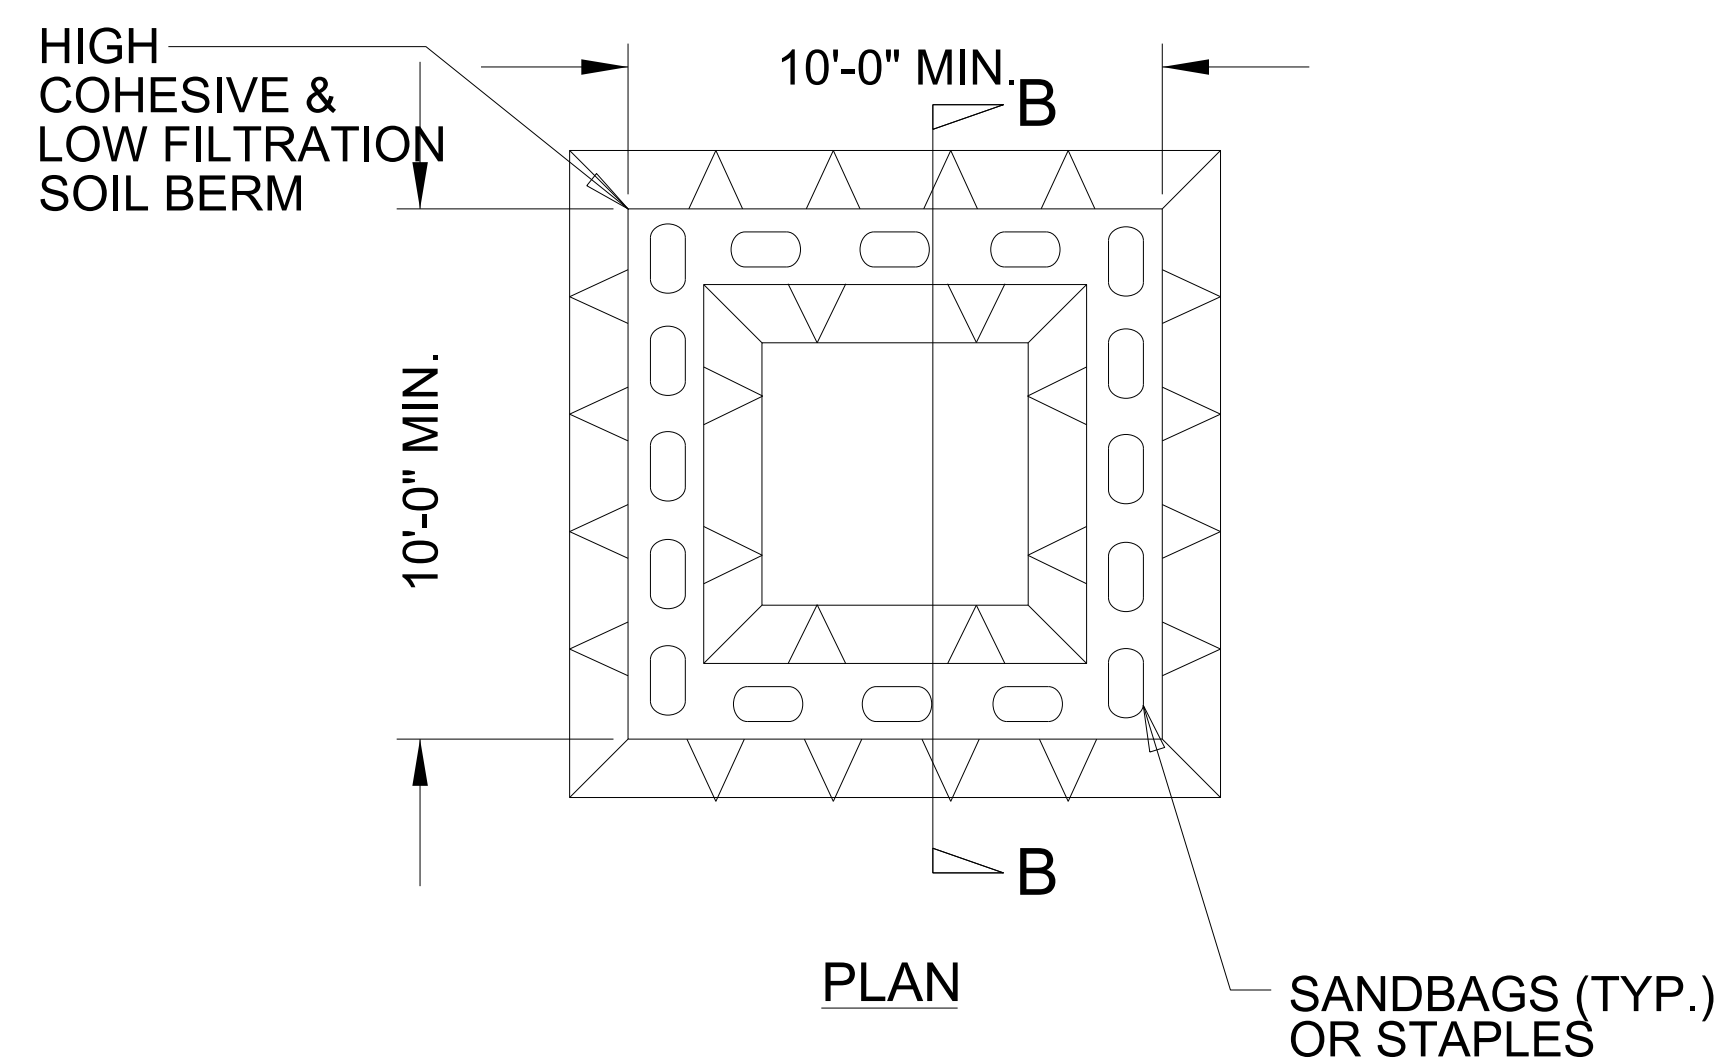

**ABOVE GRADE WASHOUT STRUCTURE**  
NOT TO SCALE

- NOTES:
1. ACTUAL LOCATION DETERMINED IN FIELD
  2. THE CONCRETE WASHOUT STRUCTURES SHALL BE MAINTAINED WHEN THE LIQUID AND/OR SOLID REACHES 75% OF THE STRUCTURES CAPACITY TO PROVIDE ADEQUATE HOLDING CAPACITY WITH A MINIMUM 12 INCHES OF FREEBOARD.
  3. CONCRETE WASHOUT STRUCTURE NEEDS TO BE CLEARLY MARKED WITH SIGNAGE NOTING DEVICE.