
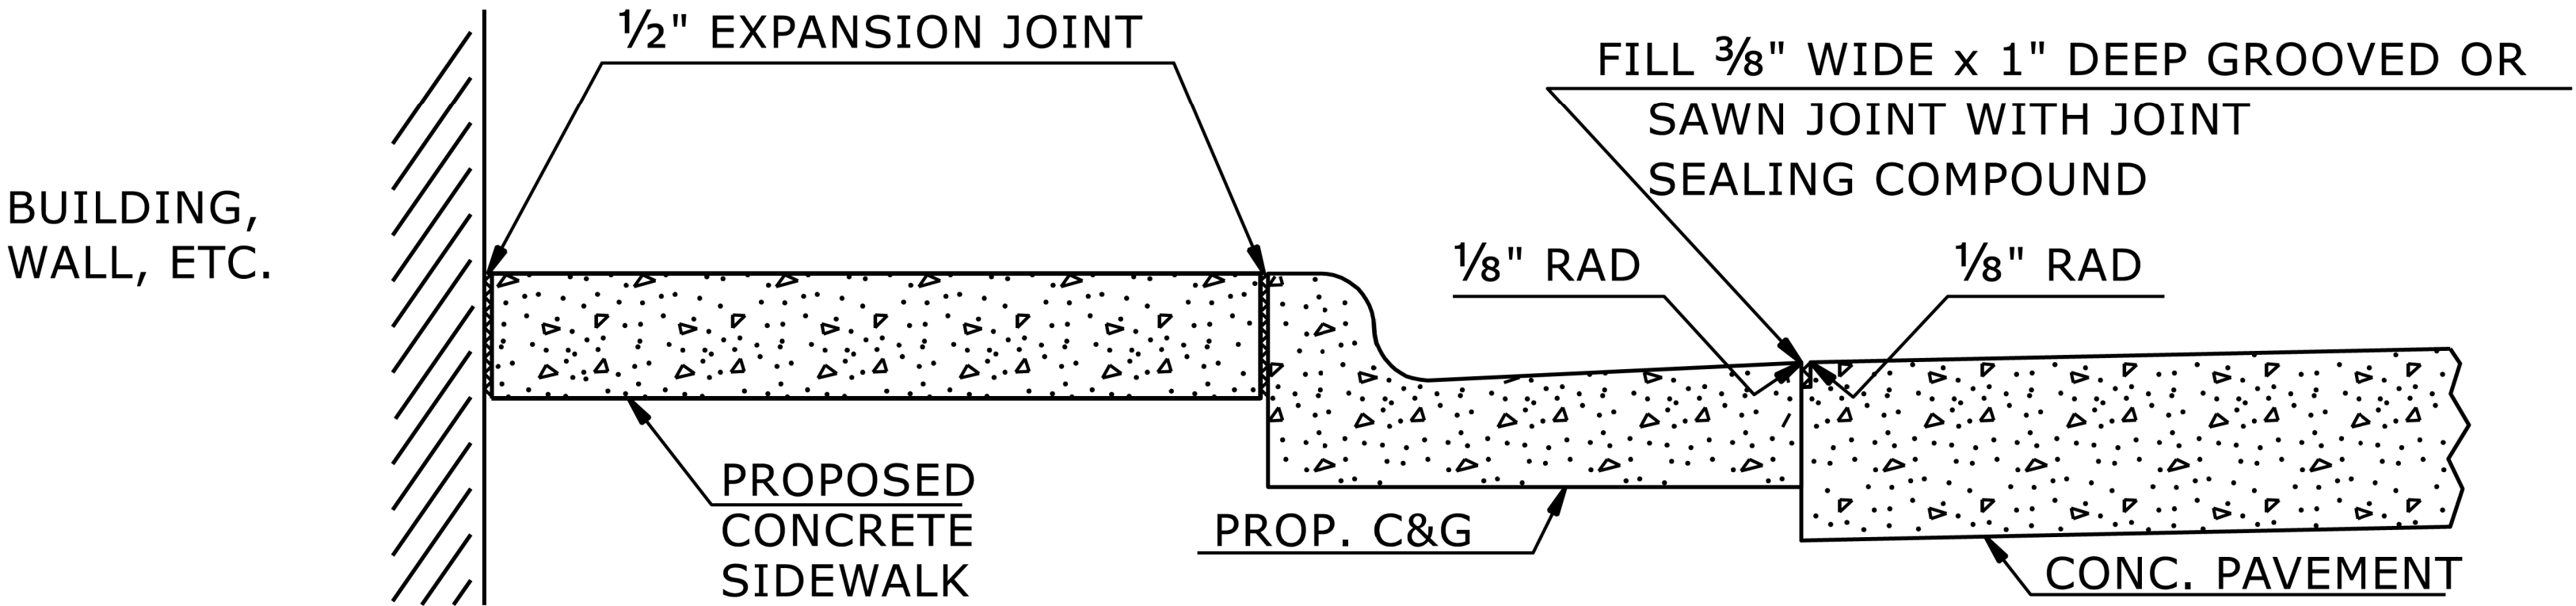


NOTES:

CONSTRUCT STANDARD SIDEWALK 5' WIDE AND 4" THICK UNLESS OTHERWISE DENOTED ON PLANS.

PLACE A GROOVE JOINT 1" DEEP WITH 1/8" RADII IN THE CONCRETE SIDEWALK AT 5' INTERVALS. ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 50' INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.

SEE STD. DWG. 848.06 FOR CURB RAMP LOCATION REQUIREMENTS AND CONSTRUCTION GUIDELINES.

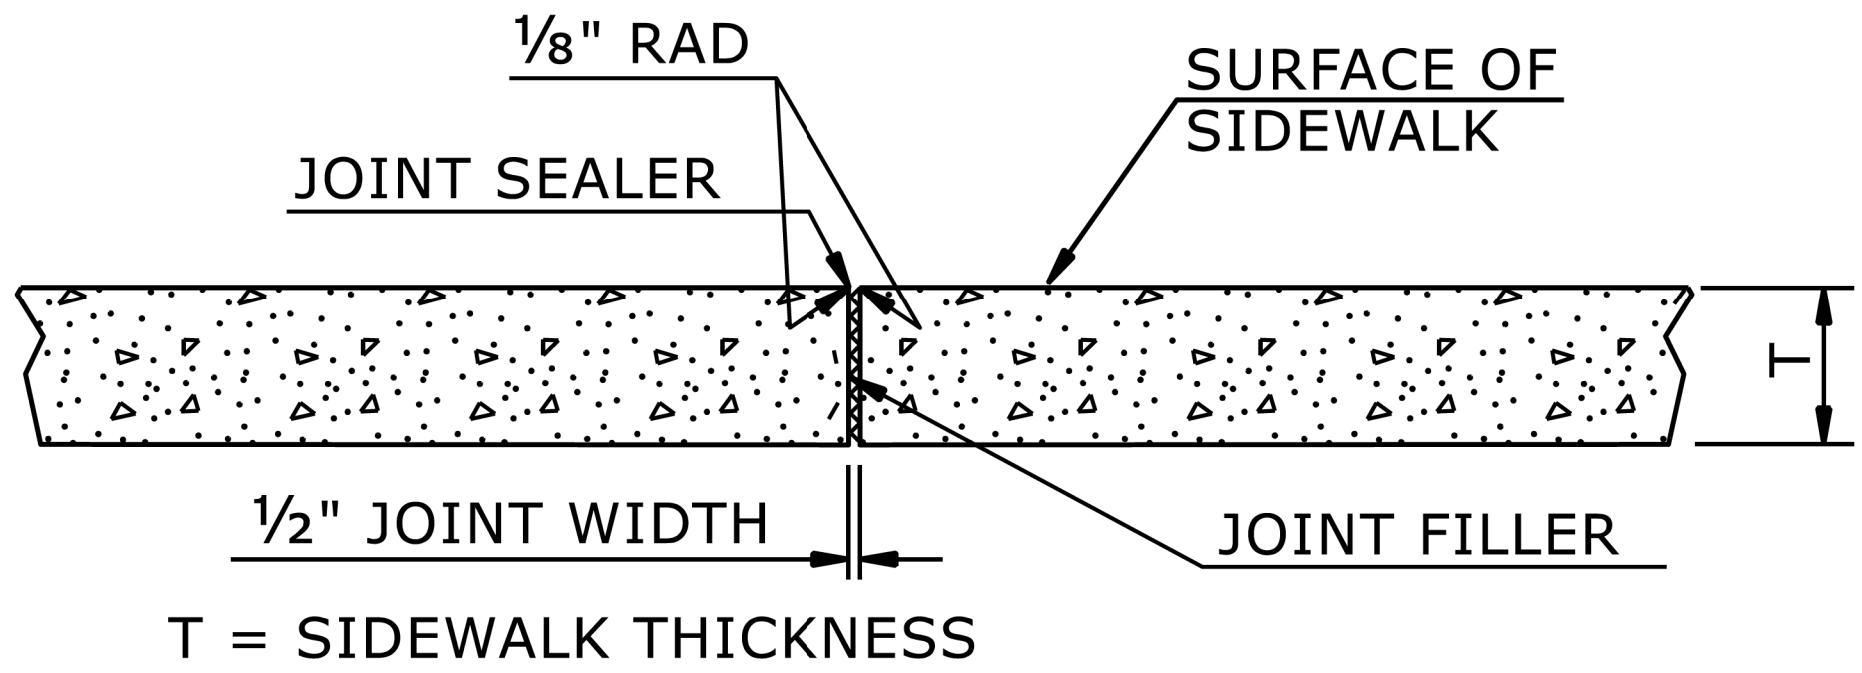

STATE OF
NORTH CAROLINA
DEPT. OF TRANSPORTATION
DIVISION OF HIGHWAYS
RALEIGH, N.C.

ROADWAY DETAIL DRAWING FOR
CONCRETE SIDEWALK

SHEET 1 OF 1
848D01

BN-0003

2C-2

NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
JACKSON COUNTY

ROADWAY DESIGN UNIT

ROADWAY DESIGN
ENGINEER

SEAL
042574
7/31/2028

ENGINEER
GUY/AMBER BRUNS

080953043E414AB

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

PREPARED BY

McADAMS

621480borough Street Suite 500 Raleigh, NC 27603
N.C.E.E.L.S. License Number: C-0255

REVISIONS