


1 / M2 EXISTING HVAC PLAN – RETURN/EXHAUST SYSTEM

SCALE: 1/4" = 1'-0"

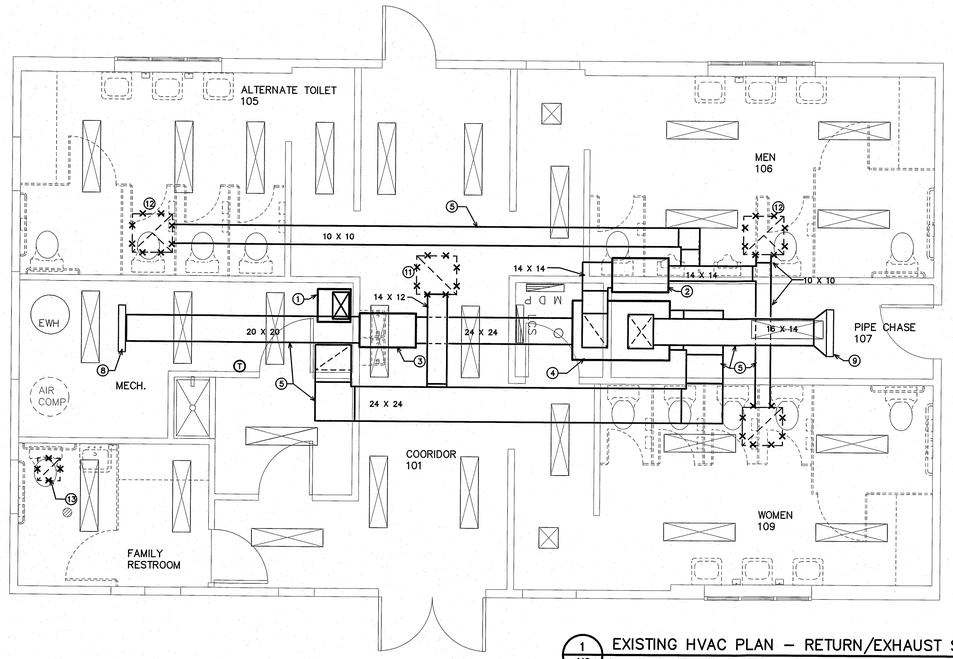


1 / M2 EXISTING HVAC PLAN – SUPPLY SYSTEM

SCALE: 1/4" = 1'-0"

KEY NOTES FOR SHEET M2

1. EXISTING 5 TON AIR HANDLING UNIT TO REMAIN.
2. EXISTING EXHAUST FAN IN ATTIC TO REMAIN.
3. EXISTING OUTSIDE AIR FAN IN ATTIC TO REMAIN.
4. EXISTING HEAT EXCHANGER IN ATTIC TO REMAIN.
5. EXISTING RETURN AND EXHAUST DUCTWORK IN ATTIC TO REMAIN. (TYPICAL).
6. EXISTING SUPPLY DUCTWORK IN ATTIC TO REMAIN. (TYPICAL).
7. EXISTING 5 TON OUTDOOR HEAT PUMP UNIT TO REMAIN.
8. EXISTING OUTDOOR INTAKE LOUVER TO REMAIN.
9. EXISTING EXHAUST LOUVER TO REMAIN.
10. REMOVE EXISTING CEILING SUPPLY AIR DIFFUSER.
11. REMOVE EXISTING CEILING RETURN AIR GRILLE.
12. REMOVE EXISTING CEILING EXHAUST GRILLE.
13. REMOVE EXISTING CEILING CABINET EXHAUST FAN. EXISTING EXHAUST DUCT TO REMAIN FOR CONNECTION TO NEW FAN.

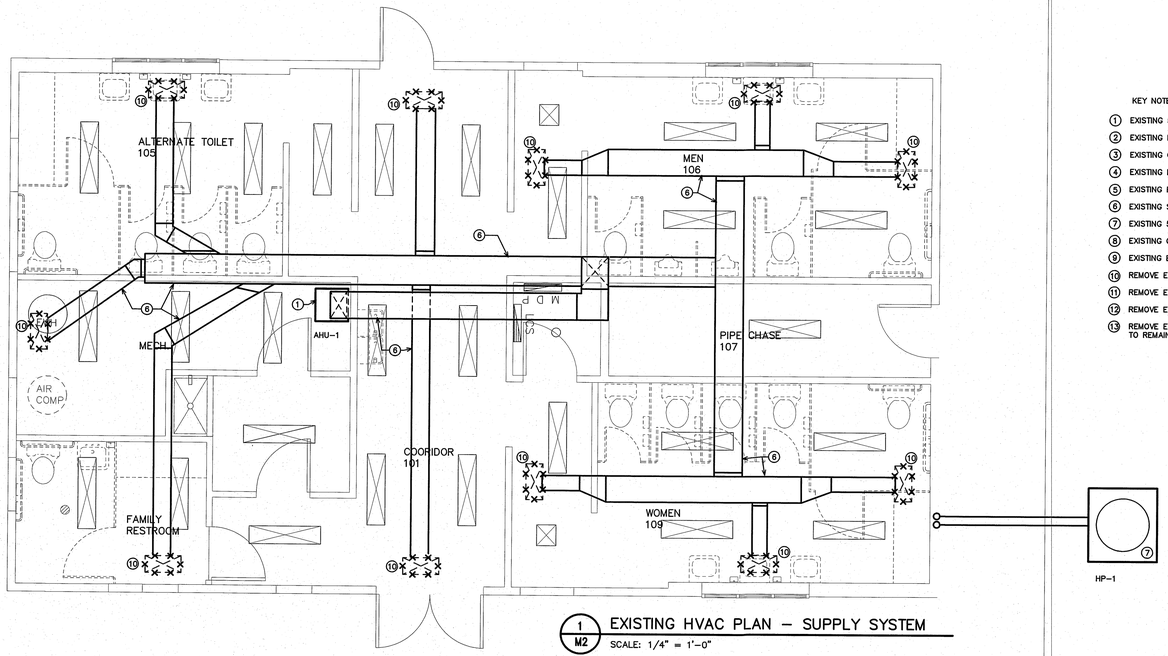CONSTRUCTION DOCUMENTS

SEAL:

NORTH CAROLINA PROFESSIONAL SEAL 22038 ENGINEER BENJAMIN E. BURKE 4/6/2015

DESIGNED BY:

FACILITIES DESIGN
ARCHITECTS & ENGINEERS
FACILITIES MANAGEMENT DIVISION, NCDOT

1 SOUTH WILMINGTON STREET
RALEIGH, NORTH CAROLINA 27601
Phone: 919-707-4540 Fax: 919-715-0399

CONSULTANT:

ENGINEER

BURKE DESIGN GROUP, PA
CONSULTING ENGINEERS
3305-109 Durham Drive
Raleigh, North Carolina 27603
919.771.1916 fax: 919.779.0826
email: bdg@burkedesigngroup.com
Corp. License # C-2652

DRAWING TITLE / DESCRIPTION:

FLOOR PLAN

PROJECT TITLE:

CAMDEN COUNTY REST AREA REFURBISHMENT

2356 HWY 117 NORTH, SOUTH MILLS NC 27976
CAMDEN COUNTY, NORTH CAROLINA

| | |
|---|---|
| SCO ID NO. | 14-11342-01A |
| TIP PROJ. NO. | - |
| WBS NO. | 36059.27 |
| FEDERAL ID NO. | - |

ASSET NUMBER:

| CO.# | SITE.# | BLDG.# |
|---|---|---|
| 15 | 04 | 02 |

REVISIONS

| NO. | DATE |
|---|---|
| | |
| | |
| | |

DATE ISSUED: 04-17-2015
DRAWN BY: WBE
CHECKED BY: BEB

SHEET NO.

M2