NOTE:
THE EXISTING INFORMATION SHOWN ON THIS DRAWING IS FROM FIELD INVESTIGATION & PREVIOUS PERMIT DRAWINGS. THE CONTRACTOR IS RESPONSIBLE FOR VISITING THE SITE AND FIELD VERIFYING ALL RELEVANT INFORMATION. THE SUBMISSION OF A BID INDICATES ACCEPTANCE OF EXISTING CONDITIONS. NOTIFY THE ENGINEER OF ANY DISCREPANCIES NOTED.

CONTRACTOR SHALL PROPERLY DISPOSE OF ALL FIXTURES, WIRING, AND DEVICES NOT RETAINED BY THE OWNER.

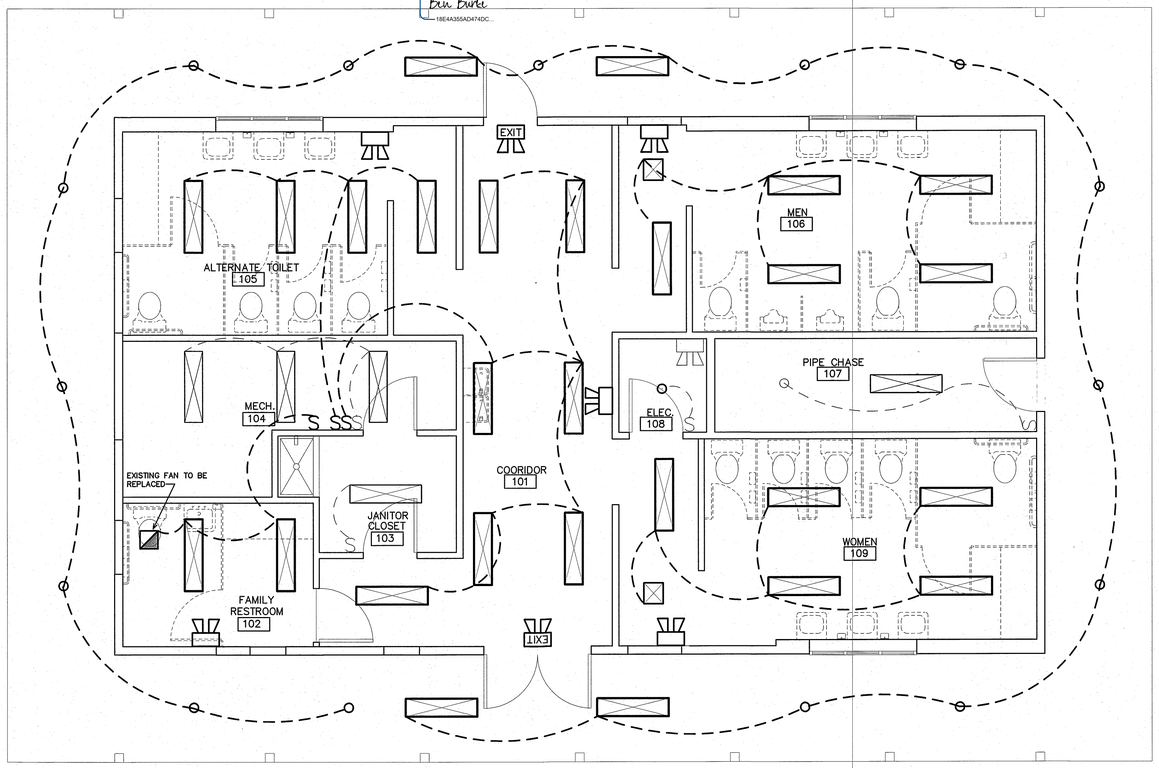


FIXTURES TO BE REMOVED/RE-LOCATED

EXISTING FIXTURES TO BE RE-USED

## 1 / E2 EXISTING LIGHTING PLAN

SCALE: 1/4" = 1'-0"

Camden Cty E-2

## LIGHTING SCHEDULE

| MARK | MANUFACTURER | CATALOG NO. | VOLT. | LAMPS NO. | LAMPS TYPE | LAMPS W | BALLAST TYPE | W/ FIXTURE | REMARKS |
|---|---|---|---|---|---|---|---|---|---|
| A | FINELITE | HP-4D-4-HO-35K-120-FA-SC-C4 | 120 | – | LED | 18 | – | 18 | 4' LINEAR LED – SURFACE MOUNT |
| B | PRESOLITE | LC6LED120-6LCLED-6-35K-8 | 120 | – | LED | 25 | – | 25 | 6" LED CAN LIGHT |
| C | DUAL LITE | PGN-P UFO-LED25 | 120 | – | LED | 17 | – | 17 | EMERGENCY EGRESS WALL SCONCE |
| | | | | | | | | | |
| LIGHT / EXIT | MULE | RLEDC-1 | 120 | 2 | LED | 5 | – | 10 | EMERGENCY EXIT SIGN/LIGHT COMBO FIXTURE |
| | MULE | MRDR-6-12-B-SD | 120 | 2 | LED | 5 | – | 10 | EMERGENCY LIGHT |

* OR APPROVED EQUAL BY DAYBRITE, LITHONIA, CREE. PROVIDE CUT SHEETS FOR OWNER APPROVAL PRIOR TO ORDERING FIXTURES. FOR FLUORESCENT FIXTURES CONTROLLED BY MOTION SENSOR, PROVIDE "PROGRAMMED RAPID START" BALLASTS. CATALOG NUMBERS ARE FOR REFERENCE ONLY, ACTUAL NUMBERS MAY VARY. "EB" DENOTES ELECTRONIC BALLAST.

** VERIFY FIXTURE HAS INTEGRAL LOCAL DISCONNECTING MEANS PER NEC 410.130 (G) (2011).

PROVIDE PHOTOCELL(S) AS REQUIRED TO SWITCH EXTERIOR LIGHTING. PROVIDE SHIELDING AS REQUIRED FOR PROPER OPERATION. COORDINATE LOCATION.

TIE ALL EXIT AND EMERGENCY LIGHTS, INTERIOR AND EXTERIOR, TO NEAREST AVAILABLE UNSWITCHED LIGHTING CIRCUIT IN THE AREA SERVED.

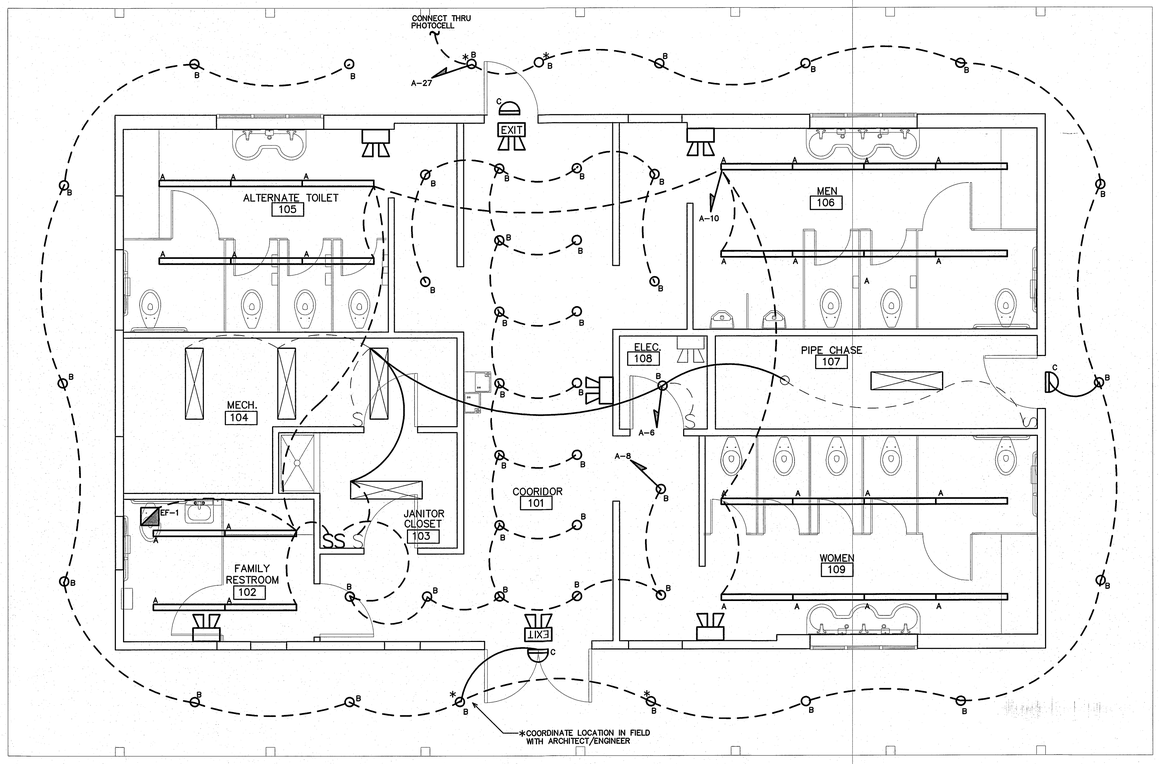


NEW FIXTURES

EXISTING FIXTURES TO BE RE-USED

## 2 / E2 REVISED LIGHTING PLAN

SCALE: 1/4" = 1'-0"

CONSTRUCTION DOCUMENTS

SEAL:

DESIGNED BY:
FACILITIES DESIGN
ARCHITECTS & ENGINEERS
FACILITIES MANAGEMENT DIVISION, NCDOT
1 SOUTH WILMINGTON STREET
RALEIGH, NORTH CAROLINA 27601
Phone: 919-707-4540 Fax: 919-715-0399

CONSULTANT:
ENGINEER
BURKE DESIGN GROUP, PA
CONSULTING ENGINEERS
Electrical, Telecommunications
Raleigh, North Carolina 27603
919.771.1916 fax: 919.779.0826
email: benburke@nc.rr.com
Corp. License # C-2652

DRAWING TITLE / DISCRIPTION:
LIGHTING PLAN

PROJECT TITLE:
CAMDEN COUNTY REST AREA REFURBISHMENT
2356 HWY 117 NORTH, SOUTH MILLS NC 27976
CAMDEN COUNTY, NORTH CAROLINA

| | |
|---|---|
| SCO ID NO. | 14-11342-01A |
| TIP PROJ. NO. | – |
| WBS NO. | 36059.27 |
| FEDERAL ID NO. | |

ASSET NUMBER:
CO.# SITE.# BLDG.#
15 - 04 - 02

REVISIONS
NO. DATE

DATE ISSUED: 04/17/15
DRAWN BY: VG
CHECKED BY: BEB

SHEET NO.
E2