



STATE OF NORTH CAROLINA  
DEPARTMENT OF TRANSPORTATION

PAT MCCRORY  
GOVERNOR

ANTHONY J. TATA  
SECRETARY

September 30, 2014

**Addendum No. 1**

Contract No.: 11421568  
TIP No.: N/A  
WBS No.: 1SP.10371.4, ETC.

*Construction of Secondary Containment Structures in Gates, Hertford and Hyde Counties*

To Whom It May Concern:

Reference is made to the proposal and plans previously furnished for this project.

The following revision has been made to the proposal and plans:

Plan Sheets have been revised to include a note that the Contractor shall be responsible for the excavation of all footings and to clarify the size of the drain valve with lock. Please void existing Plan Sheets and staple revised Plan Sheets thereto.

Please acknowledge receipt of Addendum #1 in the space provided on the Addendum Acknowledgement Form.

Sincerely,


A handwritten signature in black ink, appearing to read "W. B. Hobbs".

W. B. Hobbs, PE  
Division Project Manager

WBH  
Attachment


cc: S. D. Baker, PE  
C. S. Mebane, PE  
R. L. Shook

NOTE: VERIFY WATERSTOP CHOSEN IS COMPATIBLE W/ BRINE SOLUTION

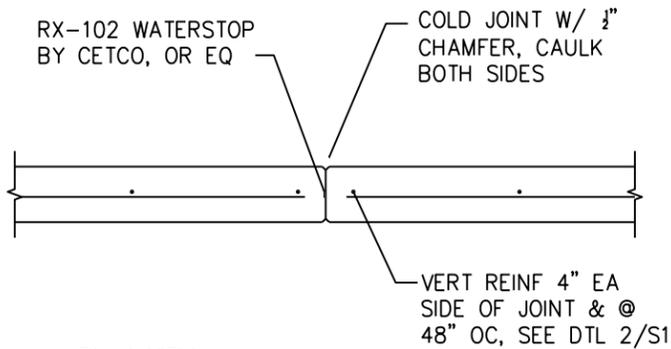

PLAN VIEW

3 WALL CONTROL JOINT  
S1 SCALE: 1" = 2'-0"

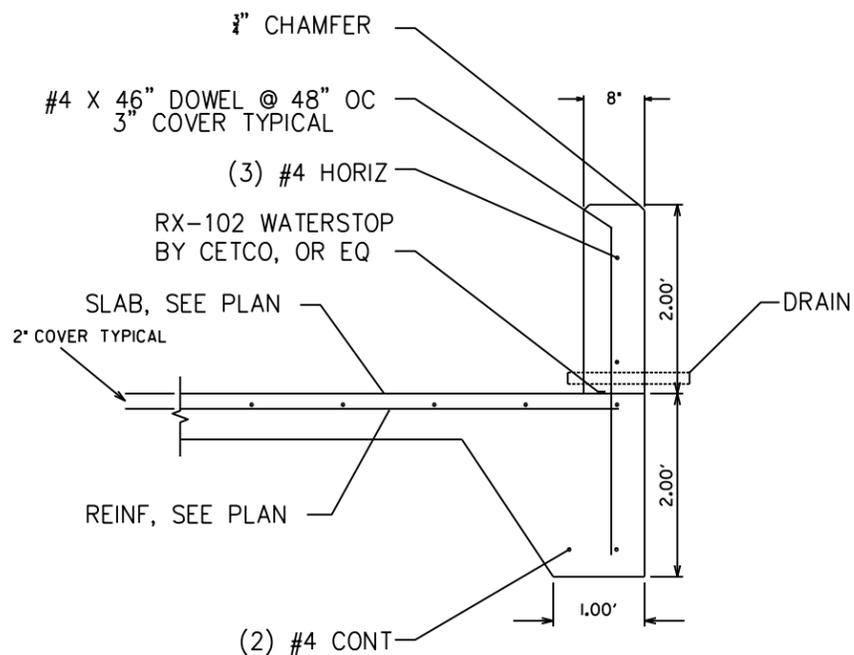


2 EXTERIOR SLAB EDGE  
S1 SCALE: 1/2" = 1'-0"

1. CONCRETE SHALL HAVE MAXIMUM W/C RATIO = 0.40 & MIN COMPRESSIVE STRENGTH = 5000 PSI. CONCRETE FOR SLABS & WALLS SHALL BE AIR ENTRAINED.
2. ALL REINF STEEL SHALL BE ASTM A 615, GR 60.
3. CJ DENOTES SAWN SLAB CONTROL JOINT. SEAL CONTROL JOINTS.
4. WCJ DENOTES WALL CONTROL JOINT. SEE DETAIL 3/S1.
5. SLOPE SLAB MIN 1/4"/FT TO DRAIN VALVE(S).

6" CONC SLAB REINF W/ EPOXY COATED #4 @ 12" EW ON 6" COMPACTED GRANULAR BASE  
(GRADING AND STONE WORK TO BE PERFORMED BY NCDOT)  
NOTE: CONTRACTOR WILL BE RESPONSIBLE FOR EXCAVATION OF FOOTER LOCATIONS

HIGH POINT OF SLAB, ELEVATION VARIES BY SITE, FIELD VERIFY

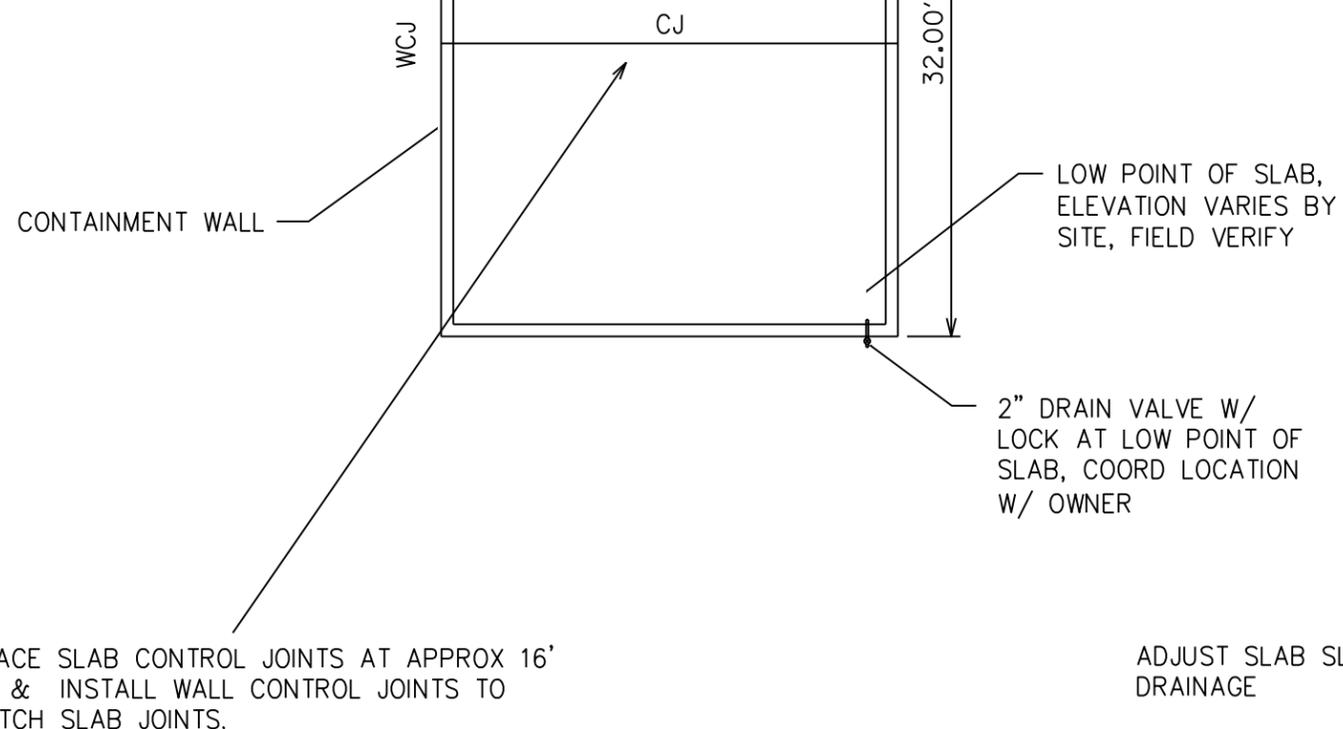


1 FOUNDATION PLAN  
S1 SCALE: 1" = 10'-0"

REVISED 9/30/14

GATES COUNTY MAINTENANCE YARD  
304 US 158 W  
Gatesville, NC 27938




NOTE: VERIFY WATERSTOP CHOSEN IS COMPATIBLE W/ BRINE SOLUTION

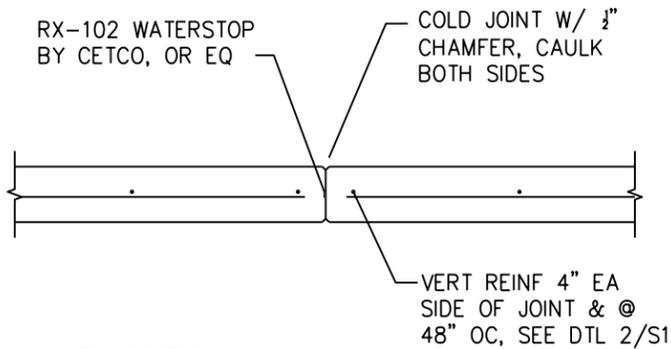

PLAN VIEW

3 WALL CONTROL JOINT  
S1 SCALE: 1" = 2'-0"

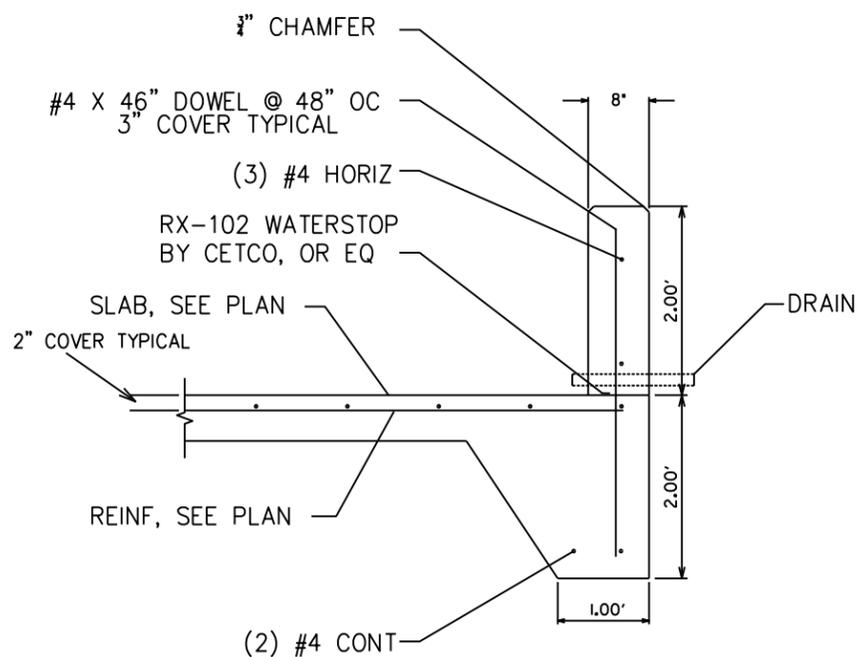


2 EXTERIOR SLAB EDGE  
S1 SCALE: 1" = 2'-0"

1. CONCRETE SHALL HAVE MAXIMUM W/C RATIO = 0.40 & MIN COMPRESSIVE STRENGTH = 5000 PSI. CONCRETE FOR SLABS & WALLS SHALL BE AIR ENTRAINED.
2. ALL REINF STEEL SHALL BE ASTM A 615, GR 60.
3. CJ DENOTES SAWN SLAB CONTROL JOINT. SEAL CONTROL JOINTS.
4. WCJ DENOTES WALL CONTROL JOINT. SEE DETAIL 3/S1.
5. SLOPE SLAB MIN 1/4"/FT TO DRAIN VALVE(S).

6" CONC SLAB REINF W/ EPOXY COATED #4 @ 12" EW ON 6" COMPACTED GRANULAR BASE  
(GRADING AND STONE WORK TO BE PERFORMED BY NCDOT)  
NOTE: CONTRACTOR WILL BE RESPONSIBLE FOR EXCAVATION OF FOOTER LOCATIONS

HYDE COUNTY MAINTENANCE YARD  
1245 MAIN STREET  
SWAN QUARTER, NC 27885

REVISED 9/30/14

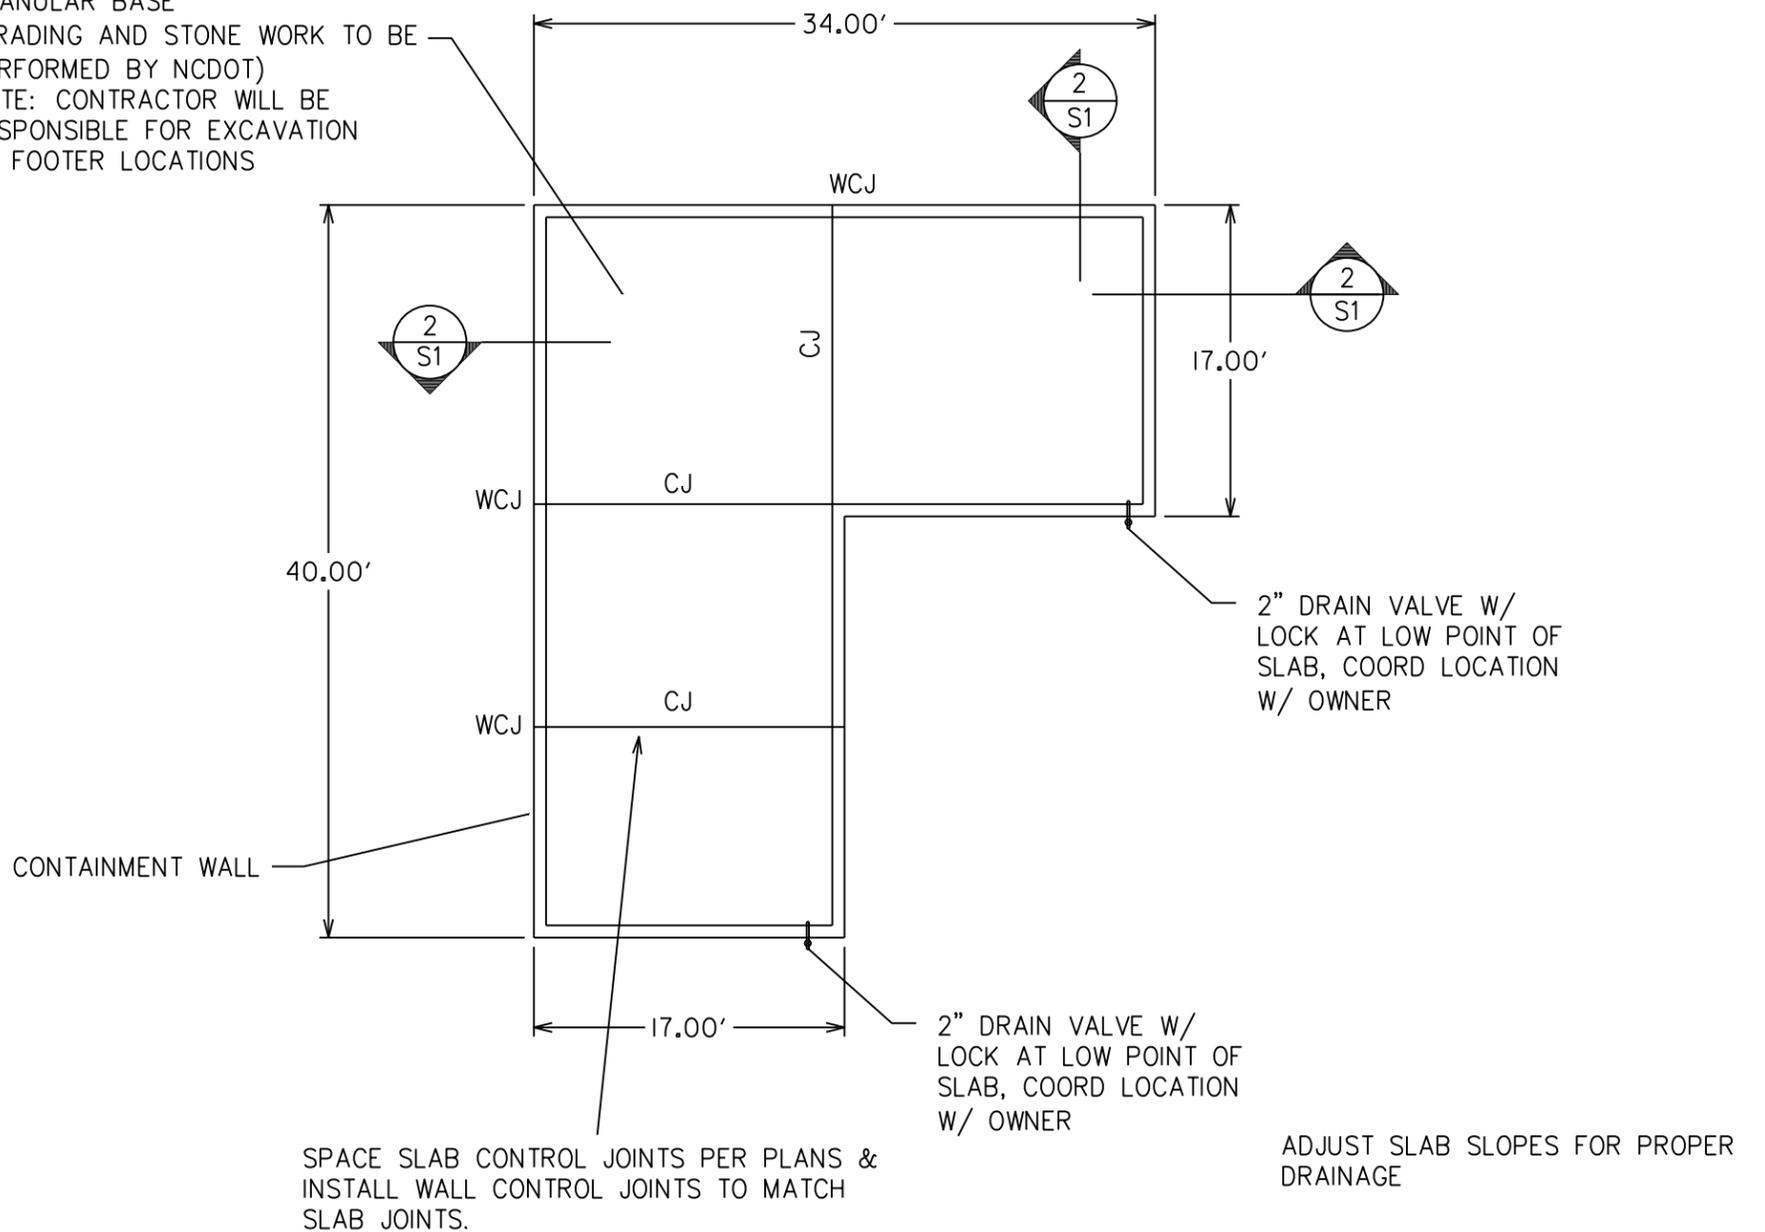

1 FOUNDATION PLAN  
S1 SCALE: 1" = 10'-0"

1. CONCRETE SHALL HAVE MAXIMUM W/C RATIO = 0.40 & MIN COMPRESSIVE STRENGTH = 5000 PSI. CONCRETE FOR SLABS & WALLS SHALL BE AIR ENTRAINED.
2. ALL REINF STEEL SHALL BE ASTM A 615, GR 60.
3. CJ DENOTES SAWN SLAB CONTROL JOINT. SEAL CONTROL JOINTS.
4. WCJ DENOTES WALL CONTROL JOINT. SEE DETAIL 3/S1.
5. SLOPE SLAB MIN 1/4" / FT TO DRAIN VALVE(S).

REVISED 9/30/14

HERTFORD COUNTY MAINTENANCE YARD  
318 W. MODLIN RD  
AHOSKIE, NC 27910




6" CONC SLAB REINF W/ EPOXY COATED  
#4 @ 12" EW ON 6" COMPACTED  
GRANULAR BASE  
(GRADING AND STONE WORK TO BE  
PERFORMED BY NCDOT)  
NOTE: CONTRACTOR WILL  
BE RESPONSIBLE FOR  
EXCAVATION OF FOOTER  
LOCATIONS

HIGH POINT OF SLAB,  
ELEVATION VARIES BY  
SITE, FIELD VERIFY



CONTAINMENT WALL

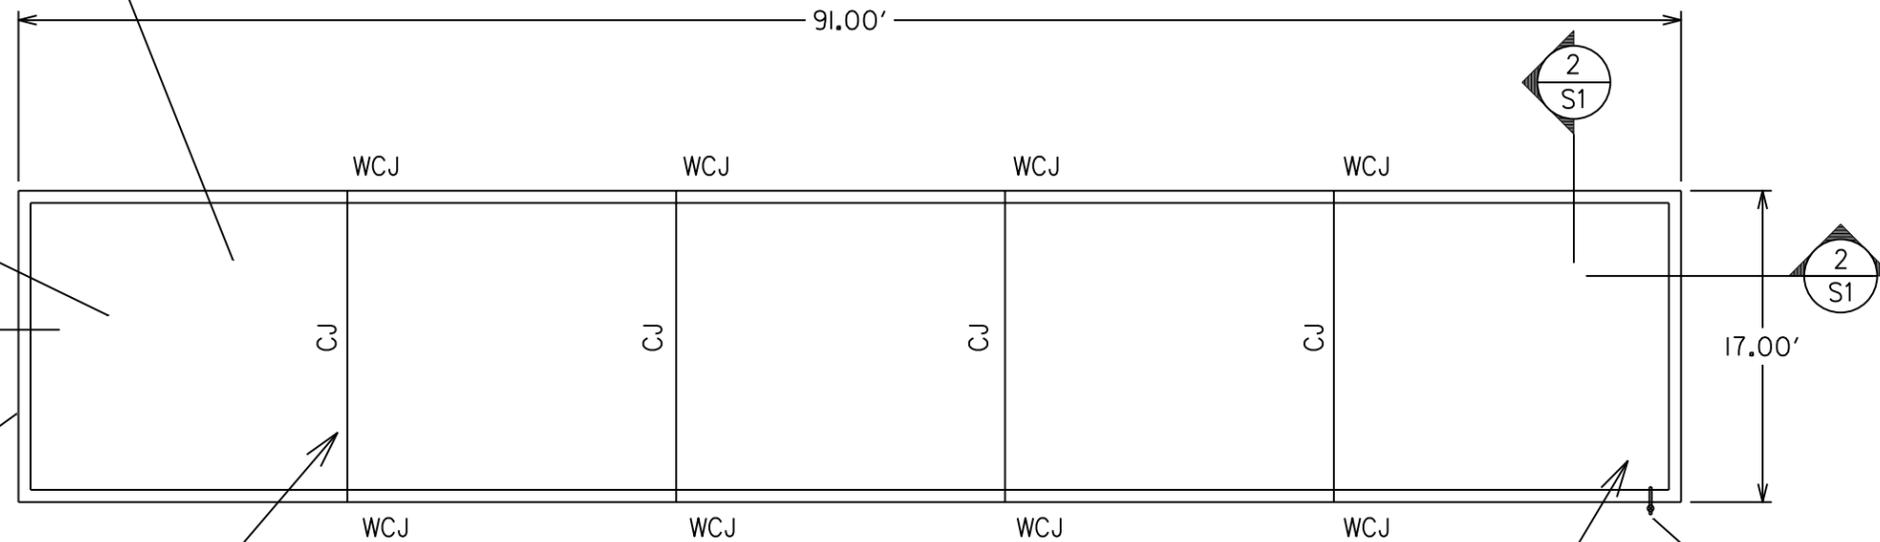

LOW POINT OF SLAB,  
ELEVATION VARIES BY  
SITE, FIELD VERIFY

2" DRAIN VALVE W/  
LOCK AT LOW POINT OF  
SLAB, COORD LOCATION  
W/ OWNER

SPACE SLAB CONTROL JOINTS AT APPROX 18'  
OC & INSTALL WALL CONTROL JOINTS TO  
MATCH SLAB JOINTS.

ADJUST SLAB SLOPES FOR PROPER  
DRAINAGE

1 FOUNDATION PLAN  
S1 SCALE: 1" = 10'-0"