DocuSign Envelope ID: D3C044AF-7E34-4D0A-A63F-163702E8D275

PROJECT REFERENCE NO.	SHEET NO.
C-5600H	ITS-27

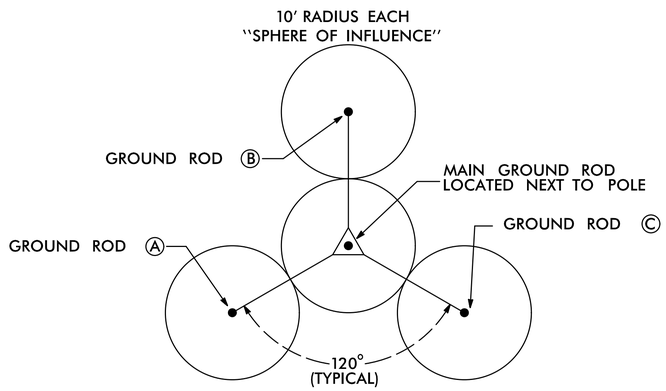

GROUND ROD PLACEMENT DETAIL
(TYPICAL EACH POLE)

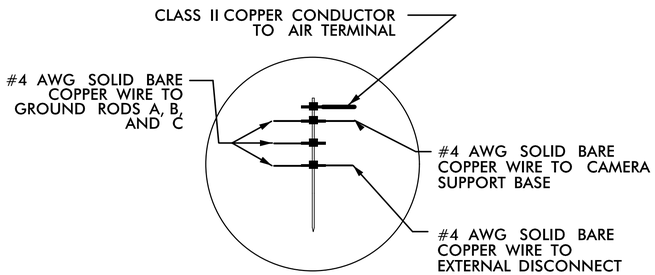

INSET `A′

ALTERNATE GROUNDING METHOD

IF SPACE IS NOT AVAILABLE TO DRIVE MULTIPLE RODS, DRIVE SECTIONAL GROUND RODS A MINIMUM OF 30′.



JOIN SECTIONAL GROUND RODS BY EXOTHERMIC WELDING CONNECTION

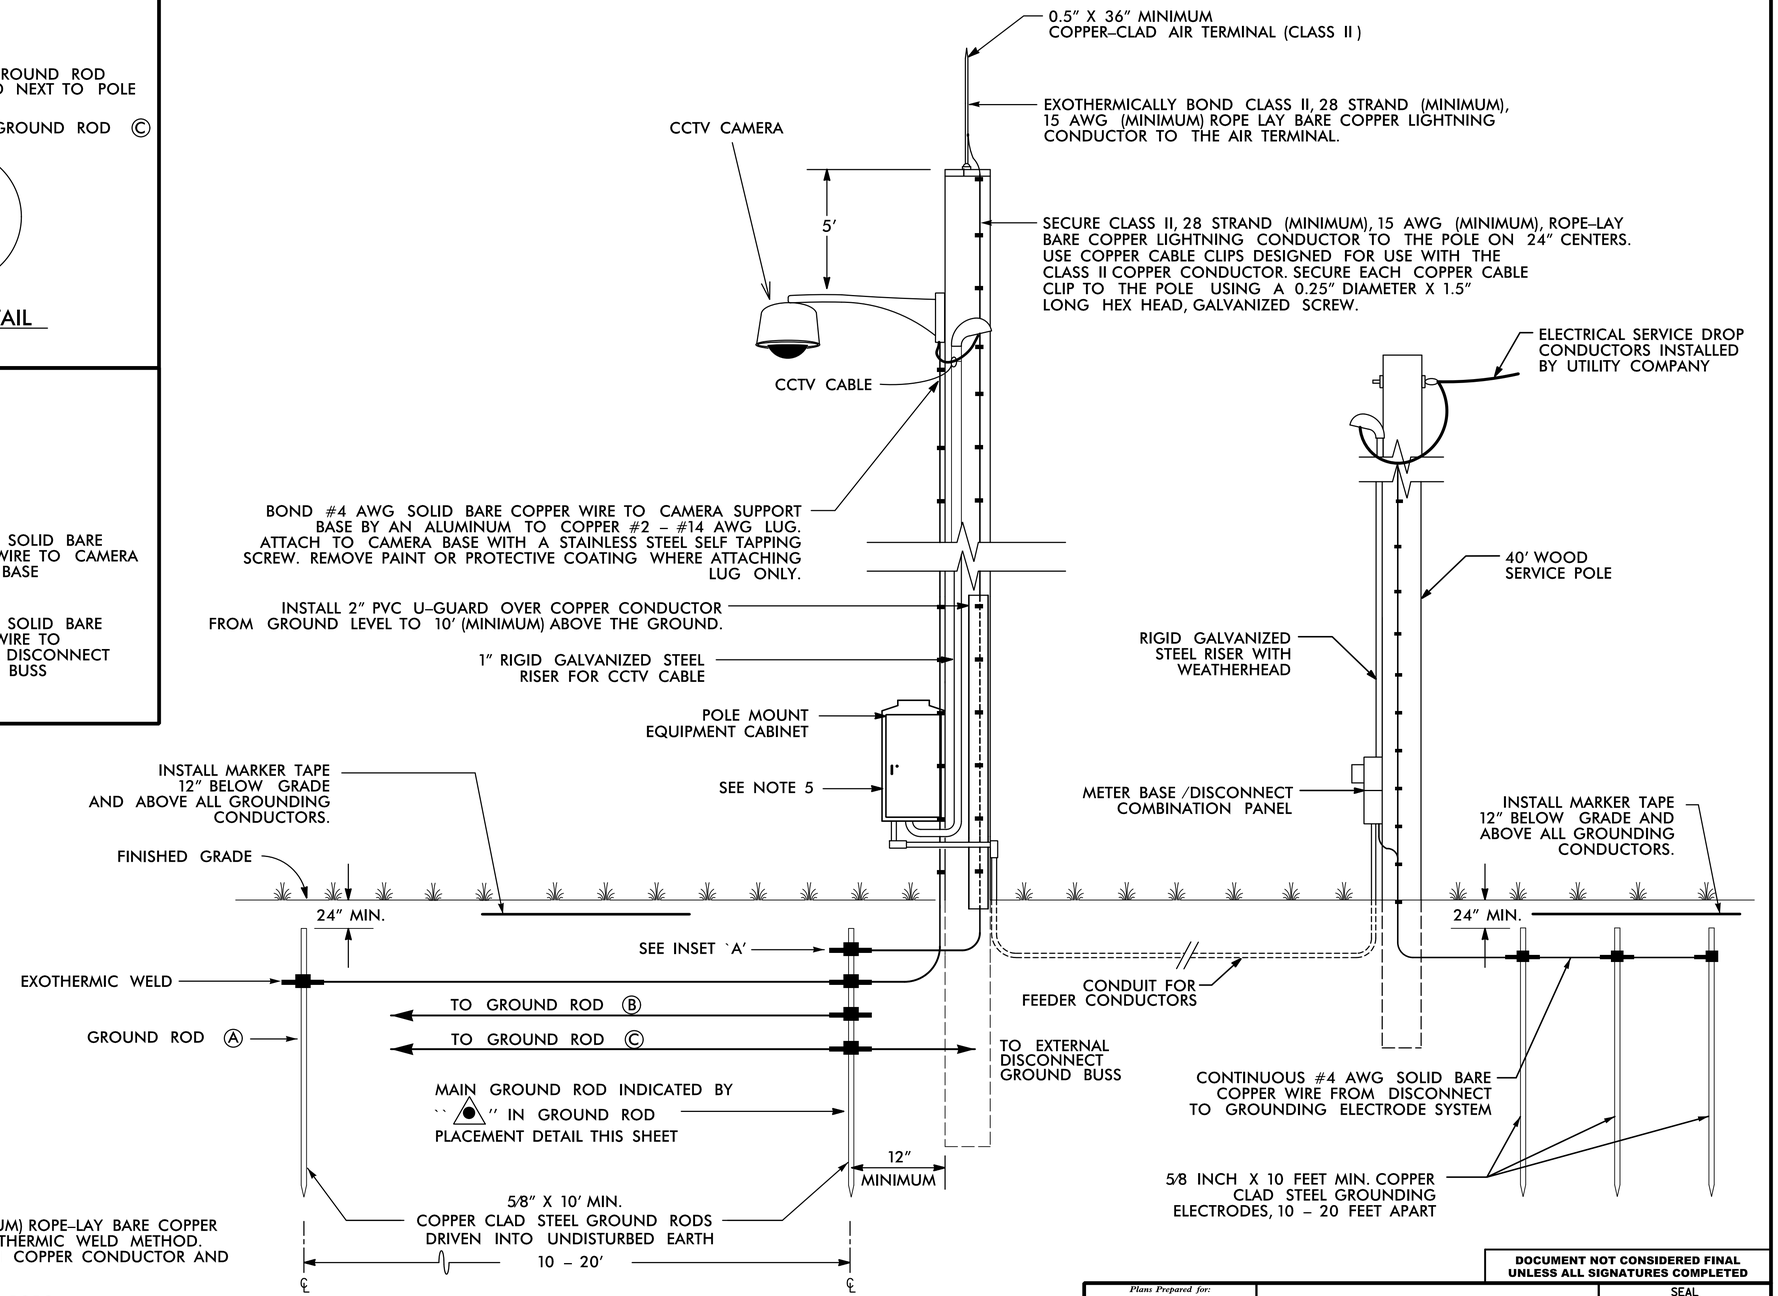

NOTES:

1. BOND CLASS II, 28 STRAND (MINIMUM), 15 AWG (MINIMUM) ROPE–LAY BARE COPPER CONDUCTOR TO THE MAIN GROUND ROD BY AN EXOTHERMIC WELD METHOD. MAINTAIN MAXIMUM HORIZONTAL SEPARATION BETWEEN COPPER CONDUCTOR AND RISER.
2. EXOTHERMICALLY WELD ALL CONNECTIONS TO GROUND RODS.
3. THE CONTRACTOR MAY, UPON APPROVAL OF THE ENGINEER, INSTALL A 30′ SECTIONAL GROUND ROD FOR INSTANCES WHEN CONDITIONS WILL NOT ALLOW FOR THE INSTALLATION OF THE 3 – RADIAL GROUND RODS.
4. INSTALL MARKER TAPE DIRECTLY ABOVE ALL GROUNDING ELECTRODES AND CONDUCTORS AT A DEPTH OF 12″.
5. REMOVE BONDING JUMPER BETWEEN EQUIPMENT CABINET GROUND BUSS AND NEUTRAL BUSS.

HNTB
HNTB NORTH CAROLINA, P.C.
343 E. Six Forks Road, Suite 200
Raleigh, North Carolina 27609
NC License No: C-1554

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

Plans Prepared for:
750 N. Greenfield Pkwy., Garner, NC 27529

CCTV CAMERA AND CABINET
ON WOOD POLE -
OVERHEAD SERVICE

PLAN DATE: AUGUST 2016	REVIEWED BY: J.A. WAGNER
PREPARED BY: T.R. TERRELL	REVIEWED BY: H.L. WINSTEAD

SCALE: NONE

REVISIONS | INIT. | DATE

SEAL
NORTH CAROLINA PROFESSIONAL SEAL 07983 ENGINEER HARVEY L. WINSTEAD, JR.

DocuSigned by:
H L Winstead, Jr. 8/31/2016
E5315D9814724F4
SIGNATURE DATE

CADD Filename: C-5600H_ITS-27.dgn