


GENERAL NOTES:


IN THE 4" CONC. PAVED DITCHES, PLACE 1/2" EXPANSION JOINTS AT 30' INTERVALS AND AT ALL OTHER POINTS WHERE PROPOSED DITCHES ABUT RIGID OBJECTS. PLACED GROOVED JOINTS 1" DEEP AT 10' INTERVALS BETWEEN EXPANSION JOINTS.

CONSTRUCT WIDTH AND SHAPE OF PROPOSED 4" CONCRETE PAVED DITCHES AS SHOWN OR AS DIRECTED BY THE ENGINEER.


FOR DITCH GRADES ABOVE 2% EROSION CONTROL, INSTALL MATTING ON BOTH SIDES OF THE PAVING FOR A MINIMUM WIDTH OF 36" OR AS DIRECTED BY THE ENGINEER.

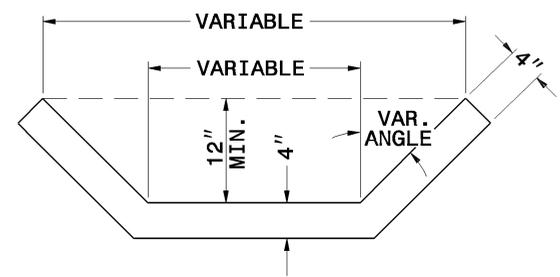


**BASE DITCH OR
BERM DRAINAGE OUTLET DITCH**

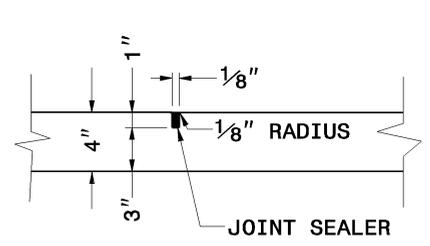


SHOWING GROOVED JOINT

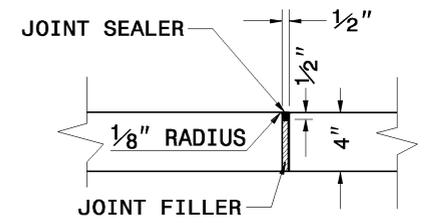

SHOWING EXPANSION JOINT

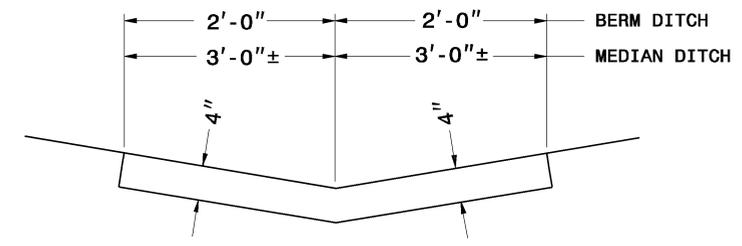


MEDIAN OR BERM DITCH

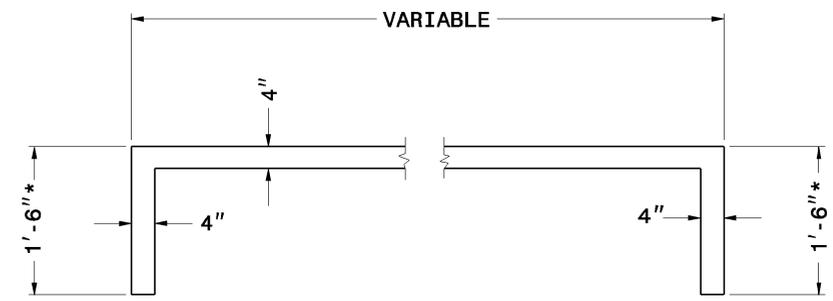


**PART LONGITUDINAL SECTION OF PAVED DITCH
SHOWING 1'-6" CURTAIN WALL REQUIRED AT EACH END**

* WHEN CURTAIN WALL FOR PAVED DITCH IS LOCATED ADJACENT TO A DRAINAGE STRUCTURE AND THE PIPE FROM THE STRUCTURE INTERFERES WITH THE 1'-6" DEPTH, THE DEPTH OF THE CURTAIN WALL MAY BE REDUCED BELOW 1'-6" TO CLEAR THE TOP OF THE PIPE.

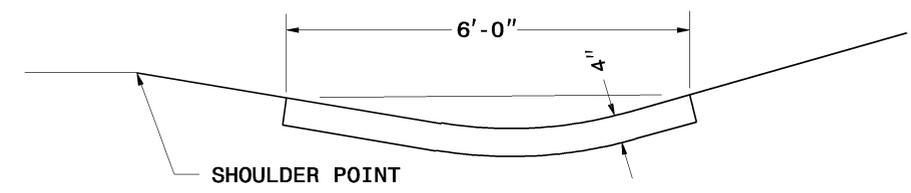

SIDE DITCH

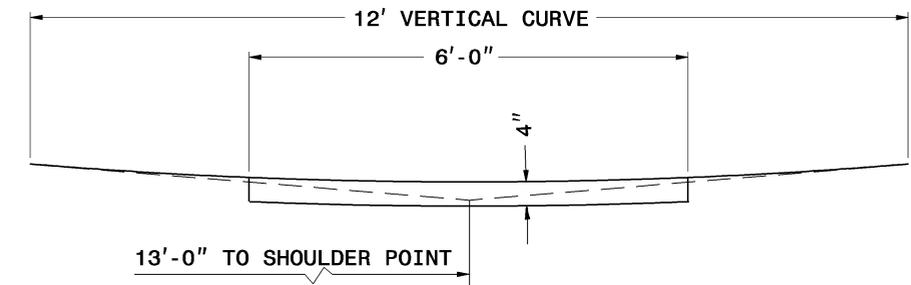

12' V.C. ROADWAY DITCH