


**SPACER
DETAIL**

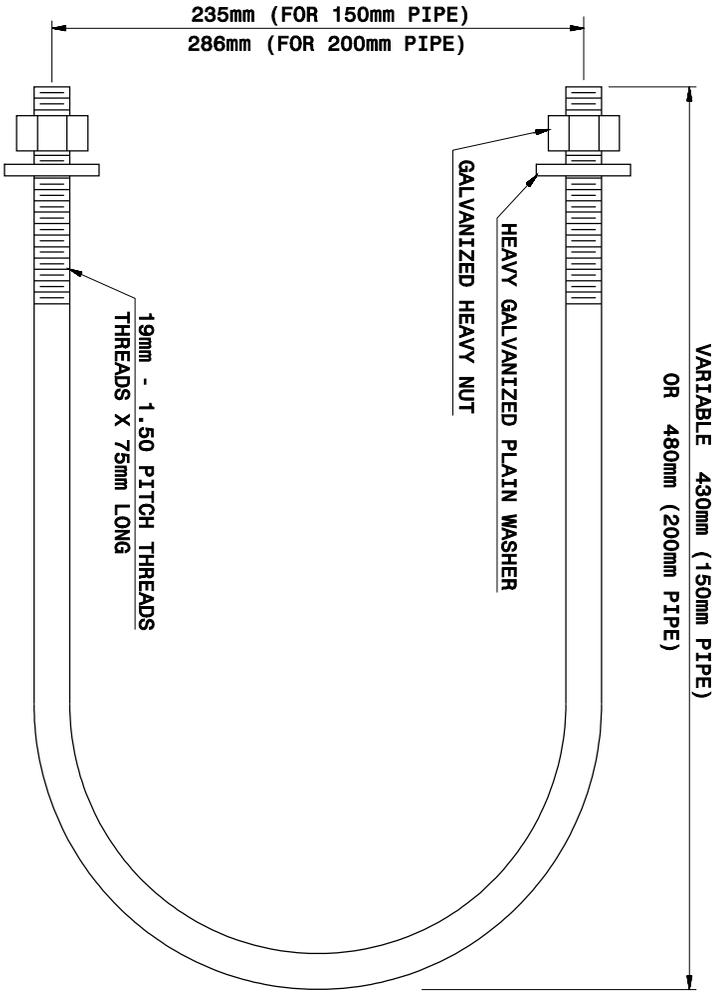

DETAIL OF "C" CLAMP

Note:
This drawing is dimensioned in millimeters unless otherwise depicted within the drawing.

REINFORCED CONCRETE FOOTING REQUIRED WHEN MANHOLE IS OVER 3.6m AND ON POOR SOIL BASE.
FOR DETAIL OF MANHOLE FOOTING SEE STANDARD PRECAST SANITARY SEWER MANHOLE STD. NO. 1525.01 SHEET 2.
FOR GENERAL NOTES REFER TO STD. NO. 1525.01 SHEET 1.

