



NOTE
THE CONTRACTOR, WITH APPROVAL FROM THE ENGINEER, MAY ADJUST FINAL BURIAL DEPTH OF CONDUIT(S) IN ORDER TO TRAVERSE NON-MOVABLE OBJECTS.

NOTE

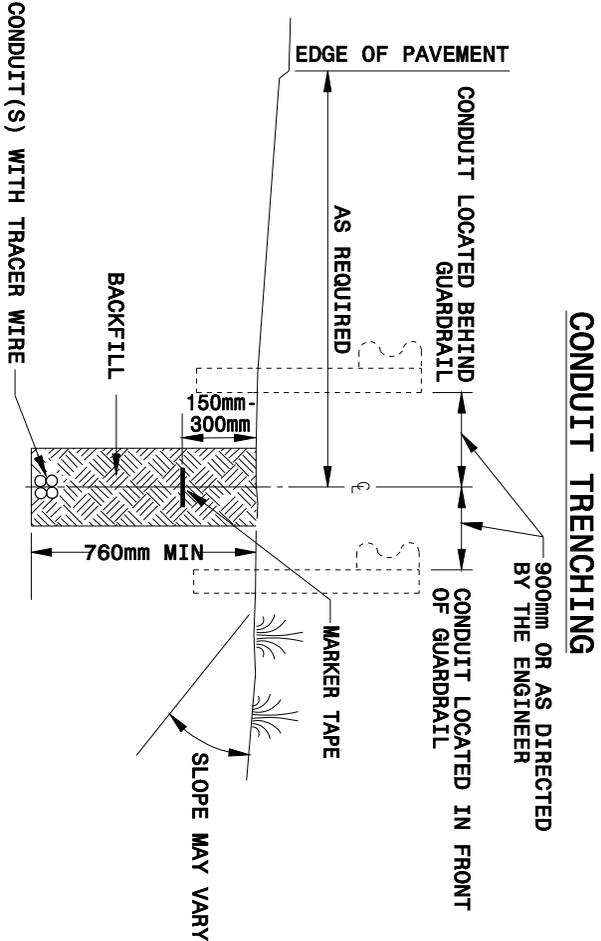

CONDUIT TRENCHING AROUND NON-MOVABLE OBJECT

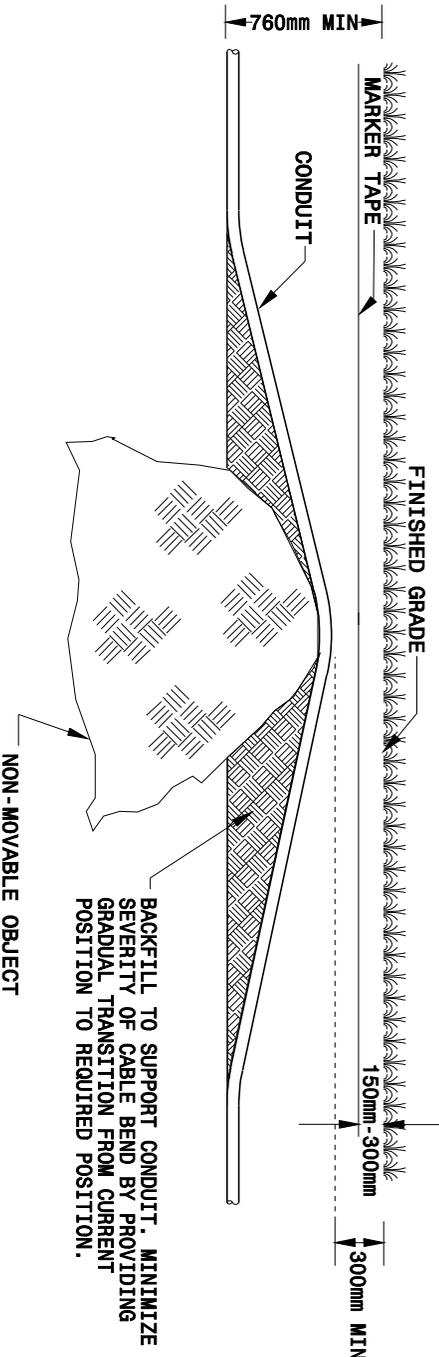

BACKFILL TO SUPPORT CONDUIT. MINIMIZE SEVERITY OF CABLE BEND BY PROVIDING GRADUAL TRANSITION FROM CURRENT POSITION TO REQUIRED POSITION.