
## FIRE EXTINGUISHER INSPECTION

May 23, 2014

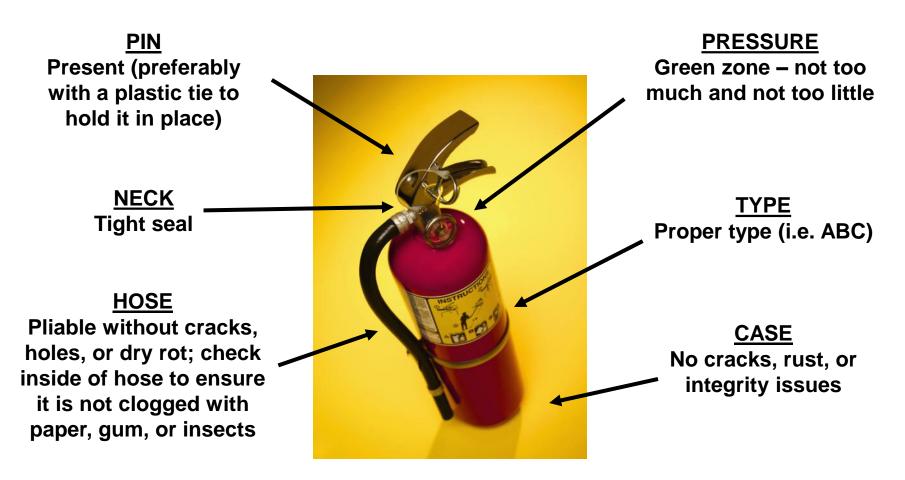

## **TAG**

Should be present, initialed and dated monthly, and have annual service data/provider indicated

## **LOCATION**

Wall markings visible from at least 25 feet, Extinguisher visible from at least 3 feet, and Accessible (not blocked or obstructed)